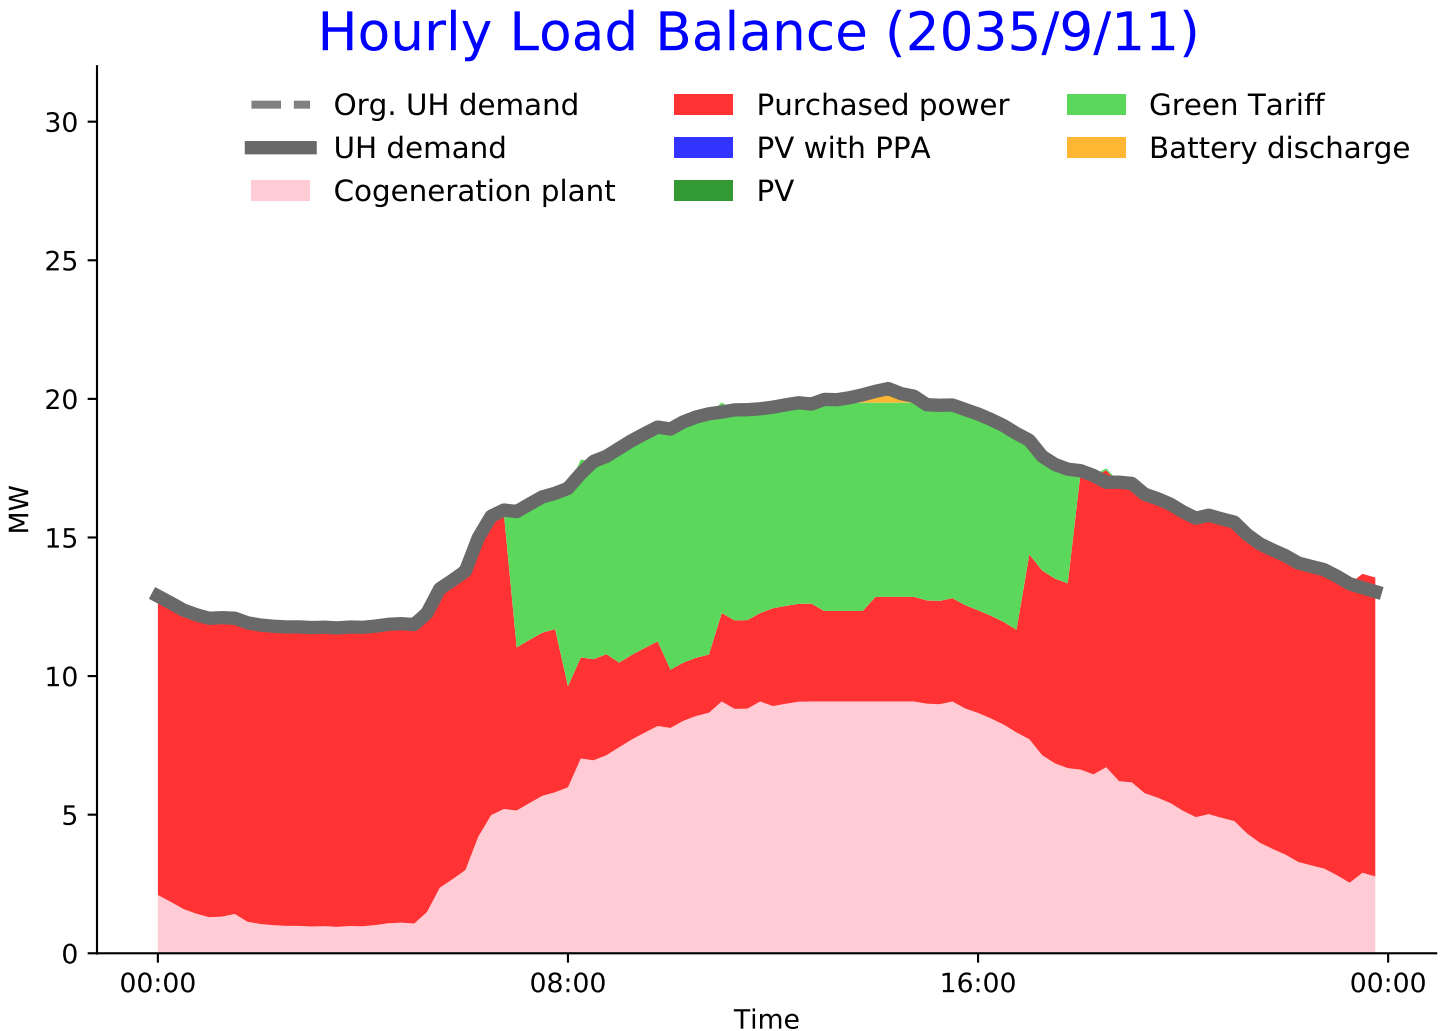
Hourly Load Balance (2035/9/11)
Org. UH demand
UH demand
Cogeneration plant
Purchased power
PV with PPA
PV
Green Tariff
Battery discharge
MW
0
5
10
15
20
25
30
00:00
08:00
16:00
00:00
Time