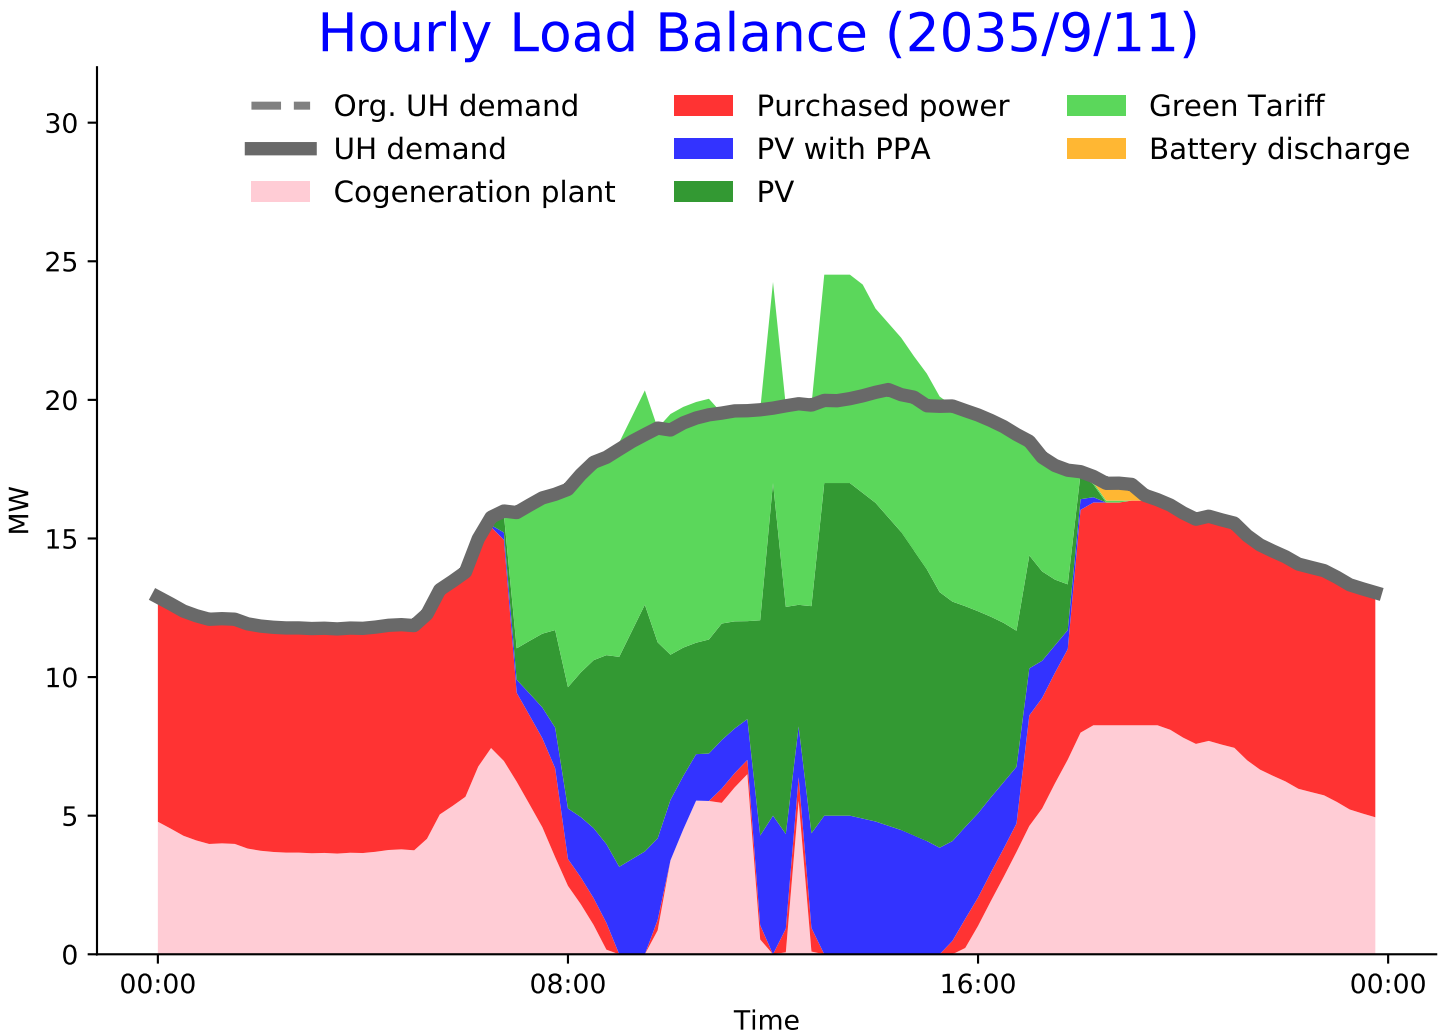
Hourly Load Balance (2035/9/11)
Org. UH demand
UH demand
Cogeneration plant
Purchased power
PV with PPA
PV
Green Tariff
Battery discharge
MW
30
25
20
15
10
5
0
00:00
08:00
16:00
00:00
Time