



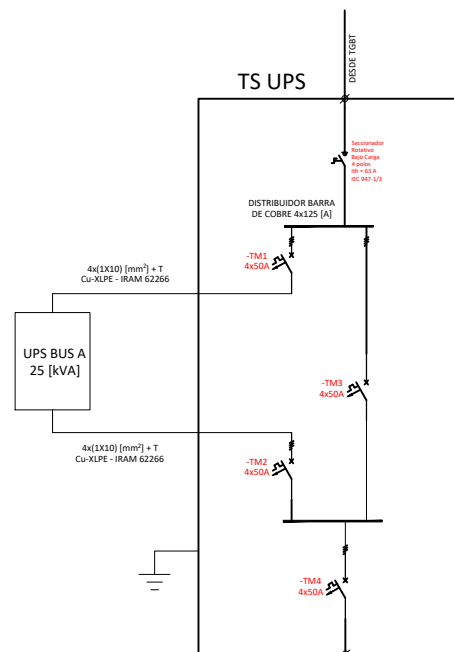

CIRCUITO		TIE
POTENCIA [kW]		17,4
CONSUMO [A]		33,08
CABLE [mm²]		4x(1x10)
DESCRIPCIÓN DE CIRCUITO		TS ILUMINACION EXTERIOR BARRA UPS
POT. TOTAL [W]	SALA TGBT	

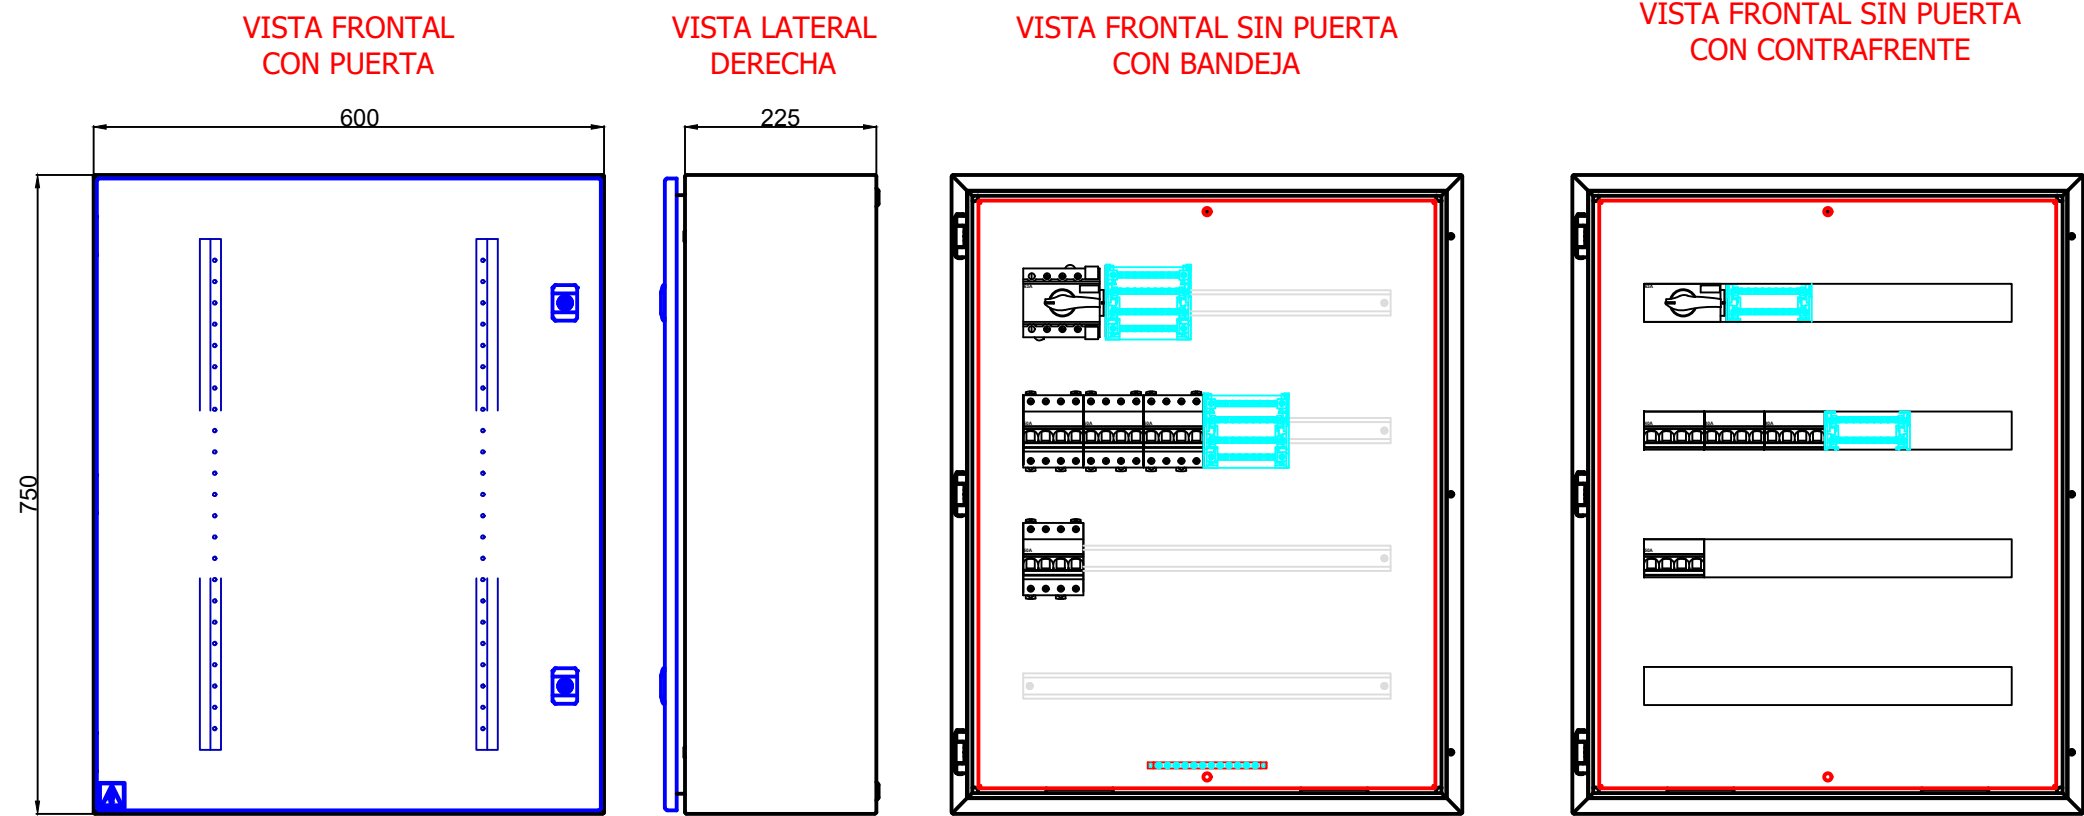

OBRA: UP N°8	REV A
COMITENTE: EDECA SA, PECAM SA, DYSCON SA, MINERVINO SA	
PLANO: UNIFILARES Y TOPOGRAFICOS	FECHA: 17/06/2025
ESCALA: Gráfica	HOJA: 1/1