





GENERAL NOTES 1. ALL WORK SHALL COMPLY WITH THE CALIFORNIA RESIDENTIAL CODE (CRC), CBC, CEC, CMC, CPC, CALIFORNIA ENERGY CODE (TITLE 24 PART 6), AND CALGREEN AS AMENDED BY THE LOCAL JURISDICTION. VERIFY THE ENFORCED CODE CYCLE BEFORE SUBMITTAL. 2. WRITTEN DIMENSIONS GOVERN OVER SCALED DIMENSIONS. 3. VERIFY ALL DIMENSIONS AND SITE CONDITIONS BEFORE CONSTRUCTION. 4. SMOKE ALARMS PER CRC R314; CARBON MONOXIDE ALARMS PER CRC R315. 5. EMERGENCY ESCAPE AND RESCUE OPENINGS PER CRC R310. 6. CONTRACTOR SHALL VERIFY ALL UTILITY LOCATIONS BEFORE EXCAVATION. 7. THIS SET IS A PRELIMINARY DRAWING SKELETON. A QUALIFIED PROFESSIONAL MUST REVIEW, COMPLETE, AND APPROVE EVERY SHEET BEFORE ANY PERMIT SUBMITTAL. PROJECT DATA PROJECT: DEMO BACKYARD STUDIO LOCATION: CALIFORNIA, USA LOT: 50 x 120 FT (6000 SF) BUILDING FOOTPRINT: 20 x 24 FT (480 SF) LOT COVERAGE: 8.0% WALL HEIGHT: 9'-0" ROOF: GABLE 4:12, 1 FT OVERHANG OCCUPANCY / CONSTRUCTION TYPE: BY DRAFTER PROJECT NOTES 1. DEMO INPUT ONLY; DIMENSIONS AND SETBACKS ARE PLACEHOLDERS. 2. NO CODE COMPLIANCE OR PERMIT READINESS IS IMPLIED.				
Demo Backyard Studio California, USA	PRELIMINARY — NOT FOR CONSTRUCTION	GENERAL NOTES	SCALE: 1/4" = 1'-0"	A0.1

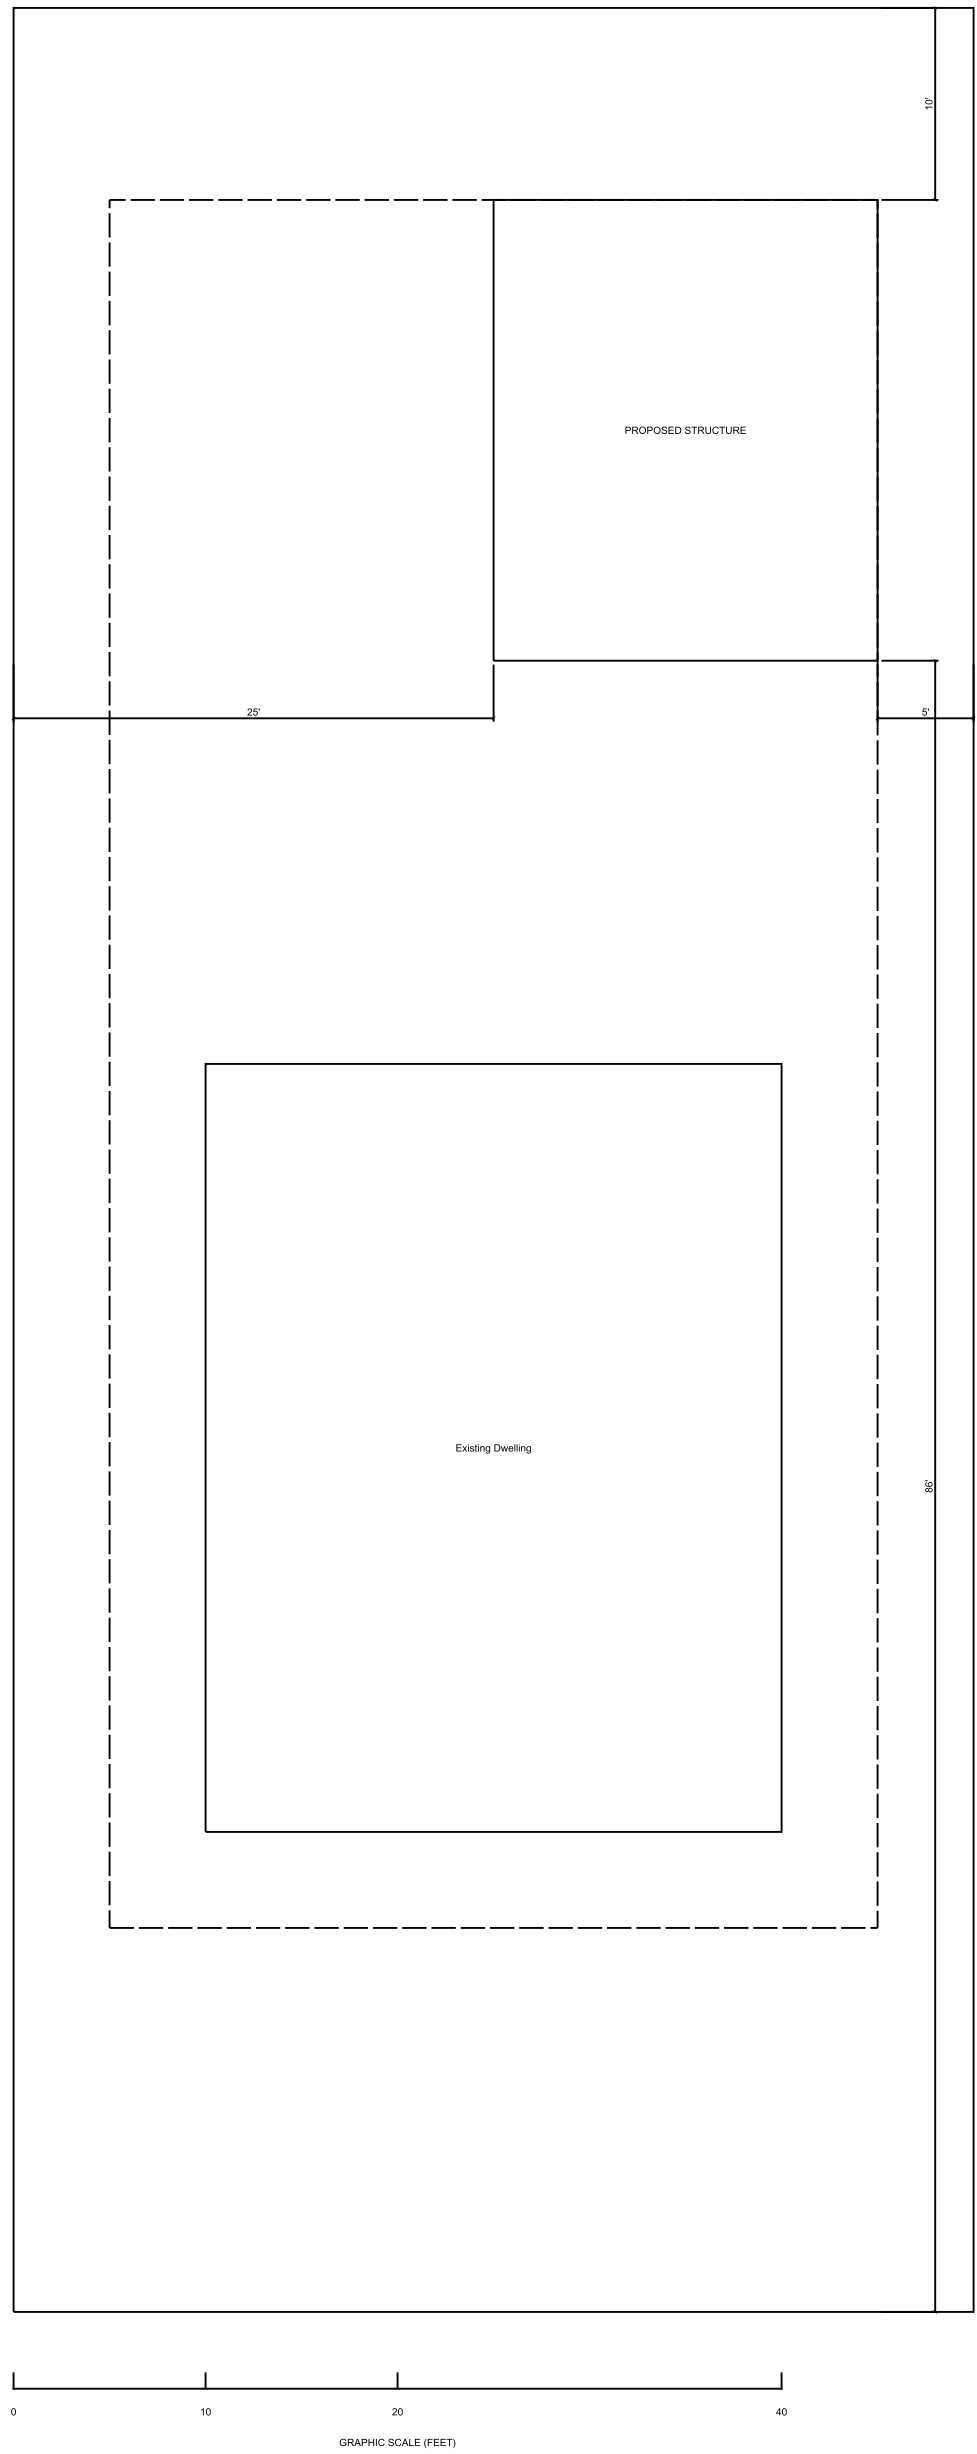

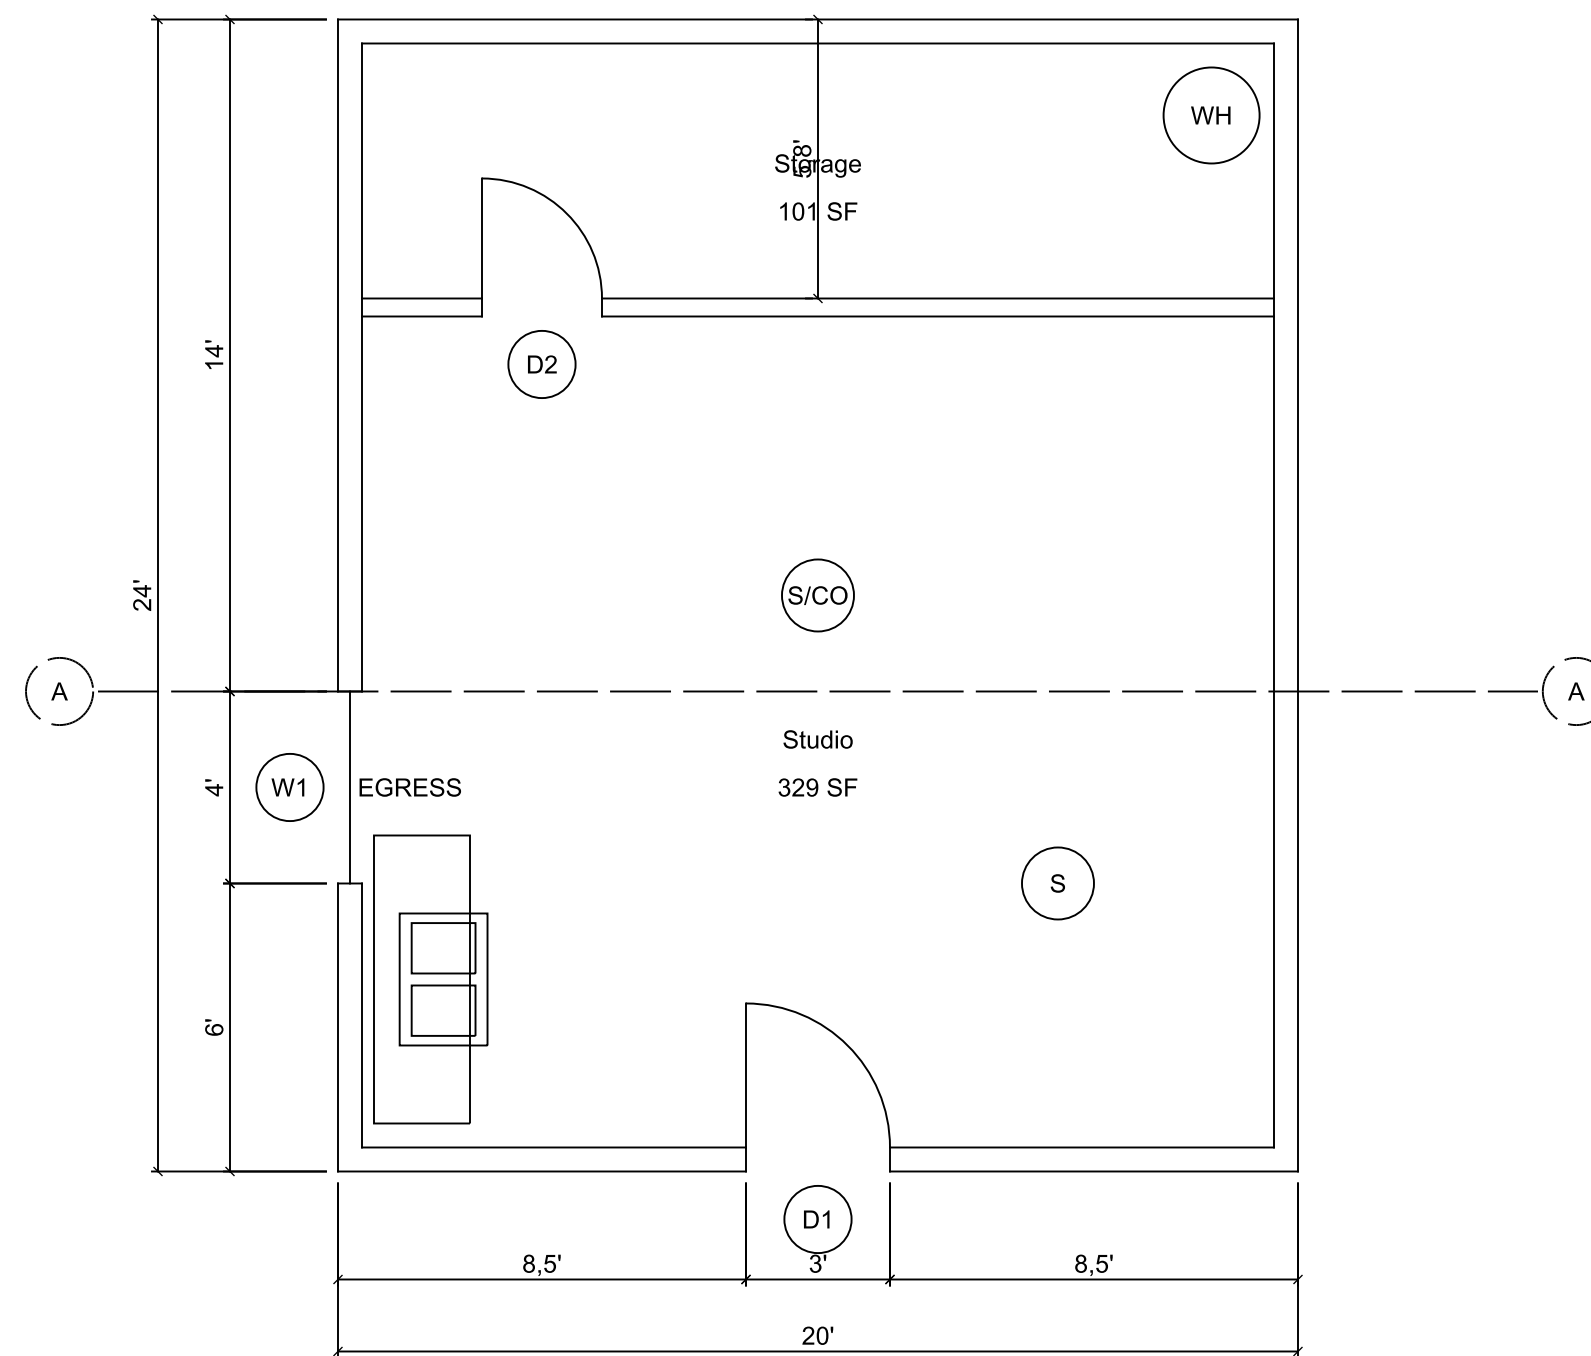


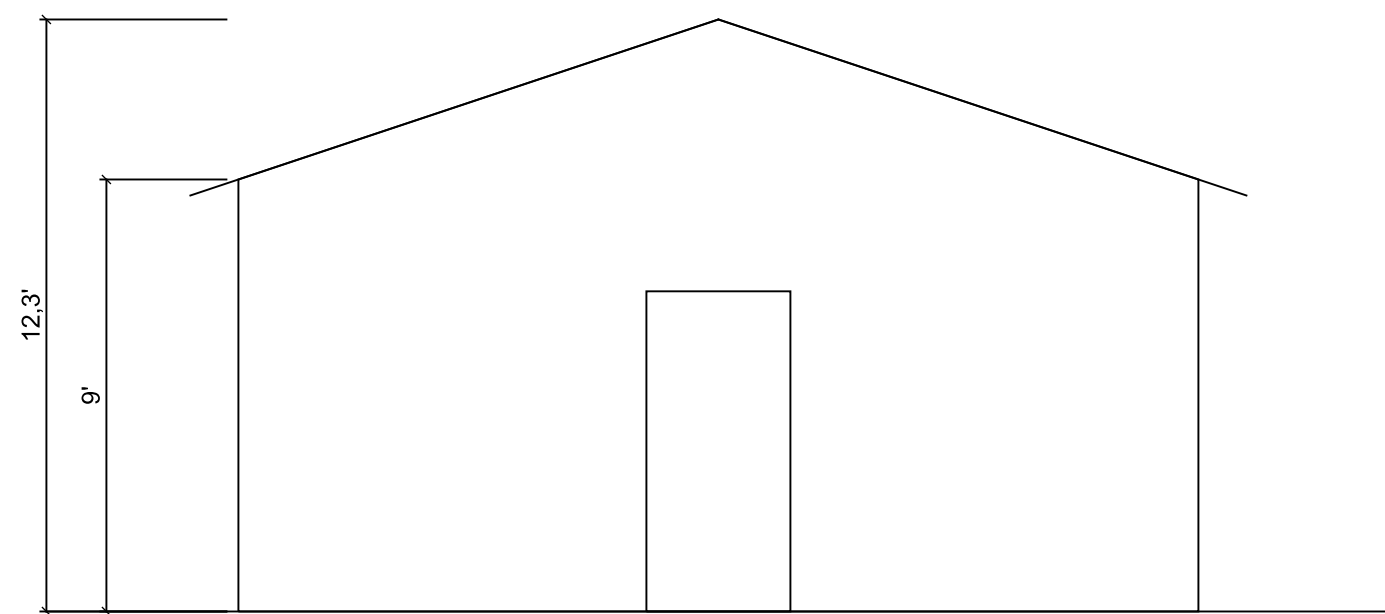


FRONT ELEVATION

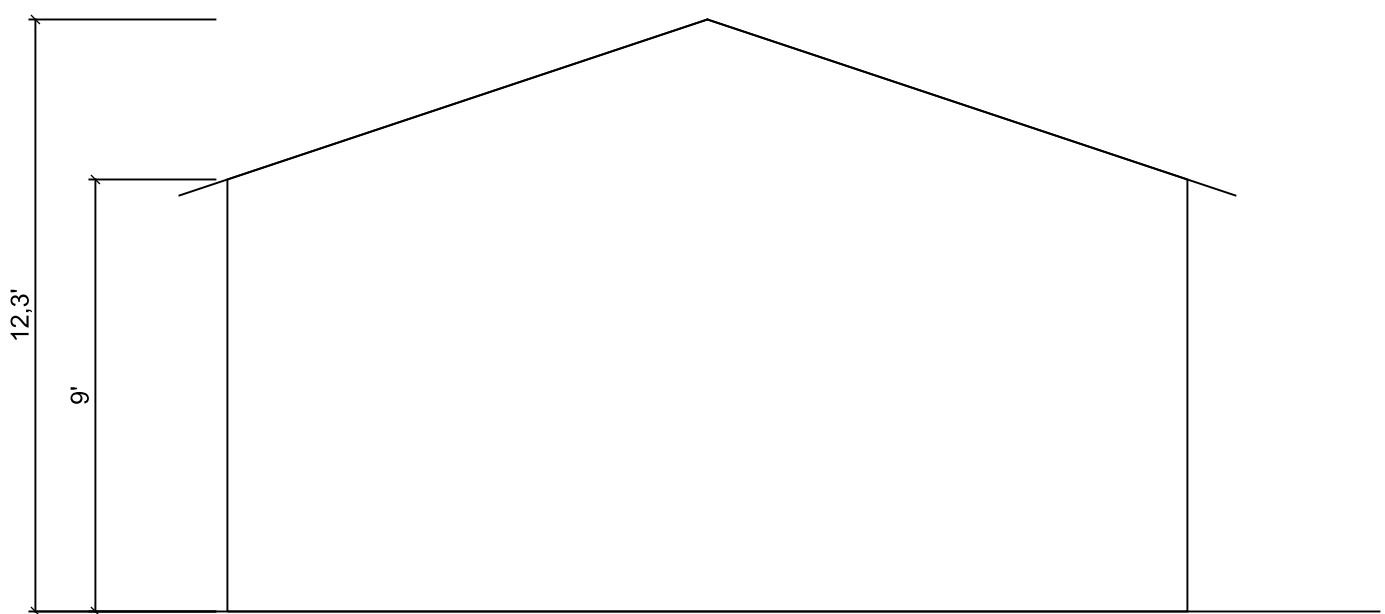


REAR ELEVATION

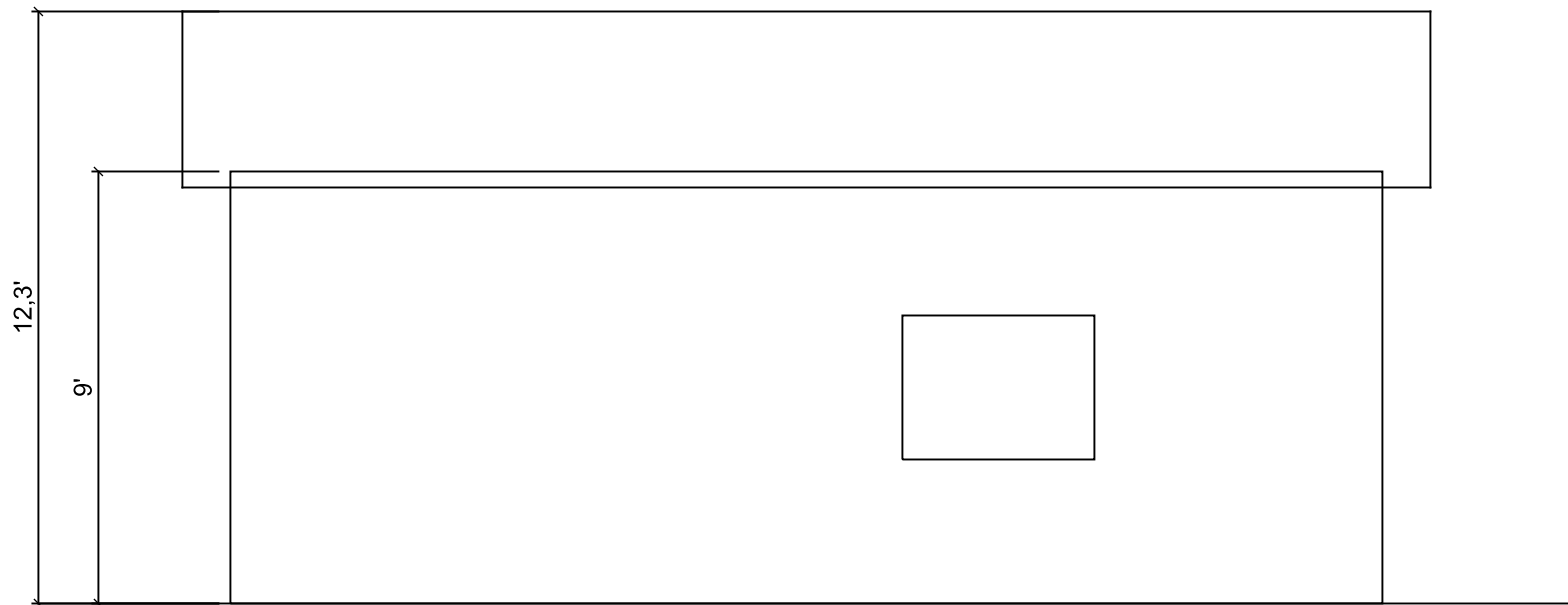

LEFT ELEVATION

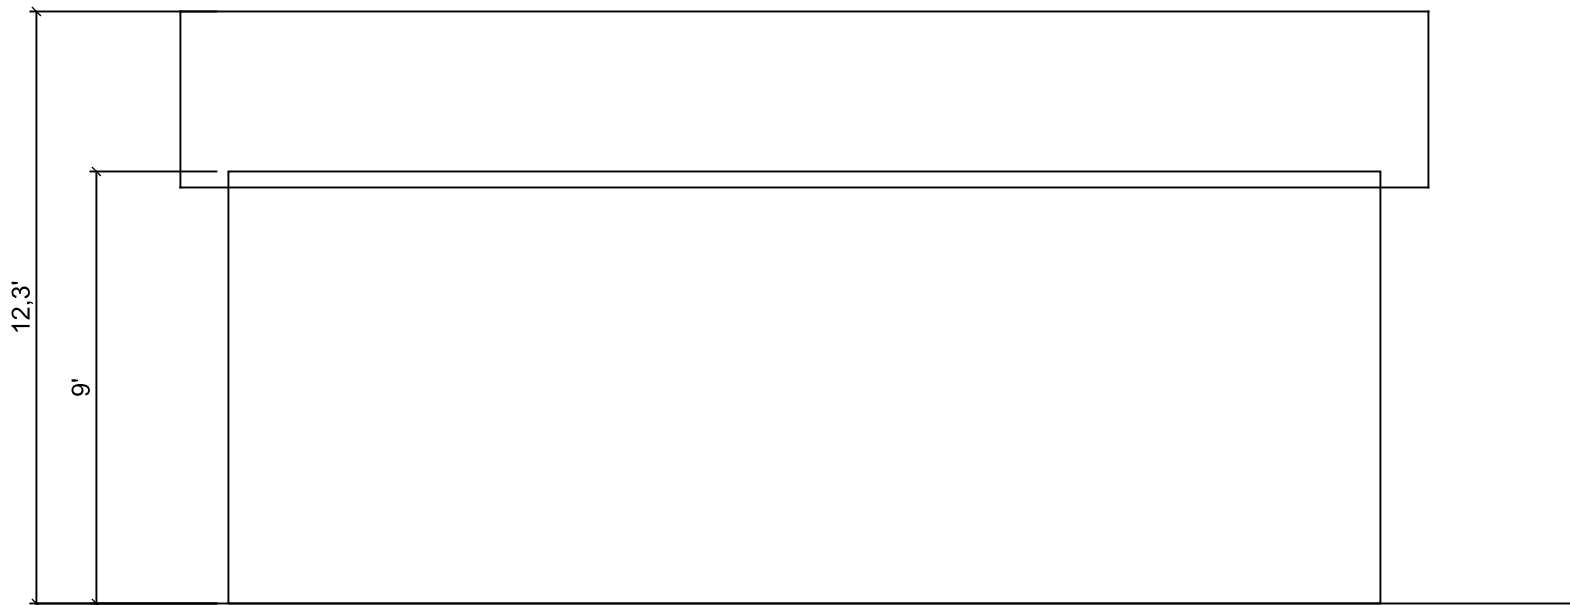

RIGHT ELEVATION

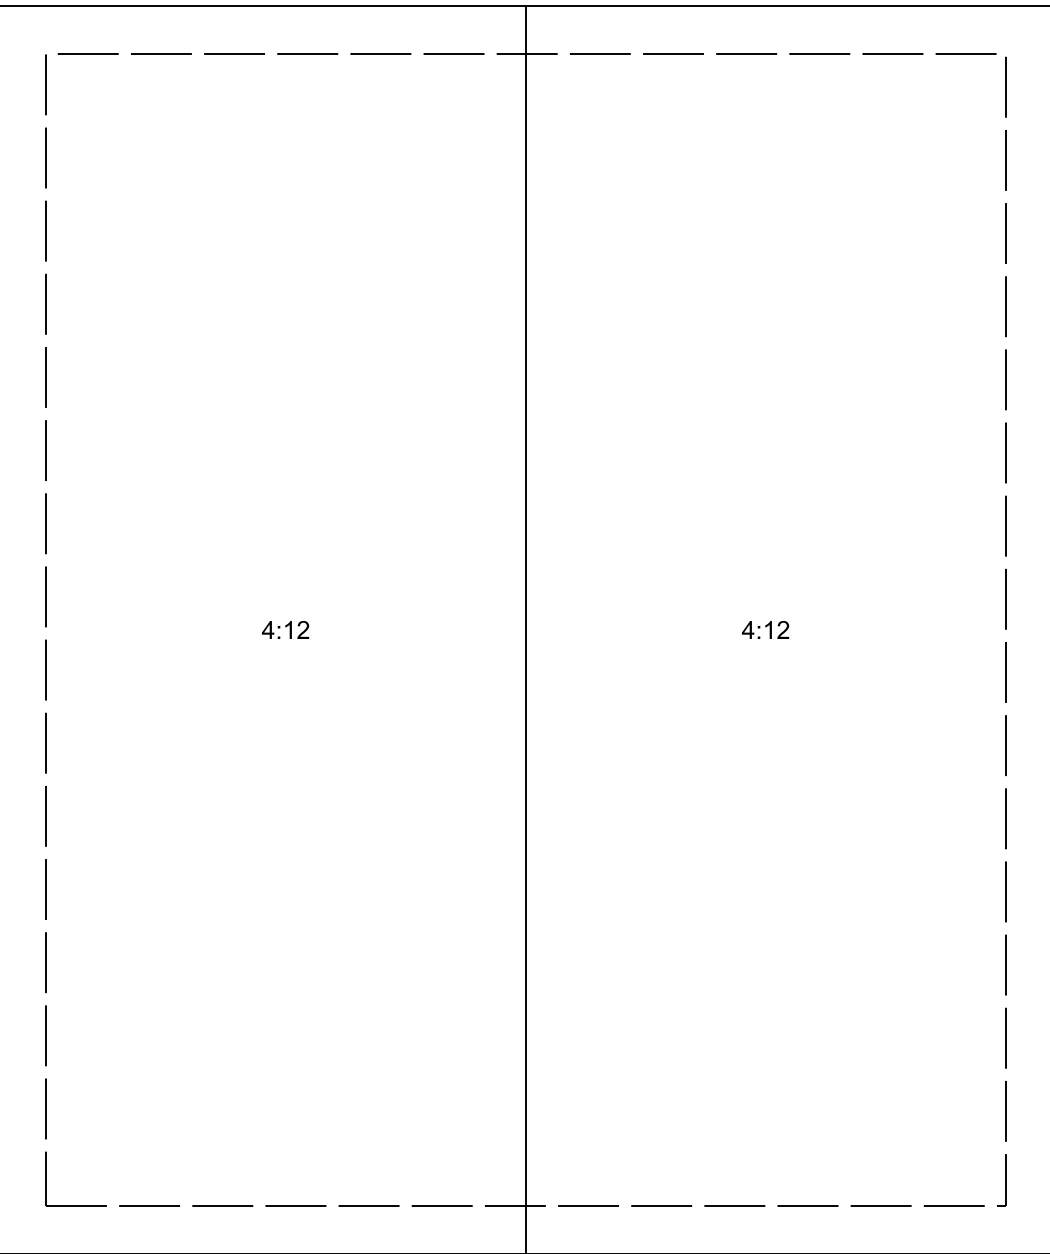


ROOF PLAN

DOOR SCHEDULE


MARK	WIDTH	HEIGHT	TYPE	QTY	REMARKS
D1	3'-0"	6'-8"	EXTERIOR	1	
D2	2'-6"	6'-8"	INTERIOR	1	

WINDOW SCHEDULE

MARK	WIDTH	HEIGHT	SILL	QTY	REMARKS
W1	4'-0"	3'-0"	SILL 3'-0"	1	EGRESS

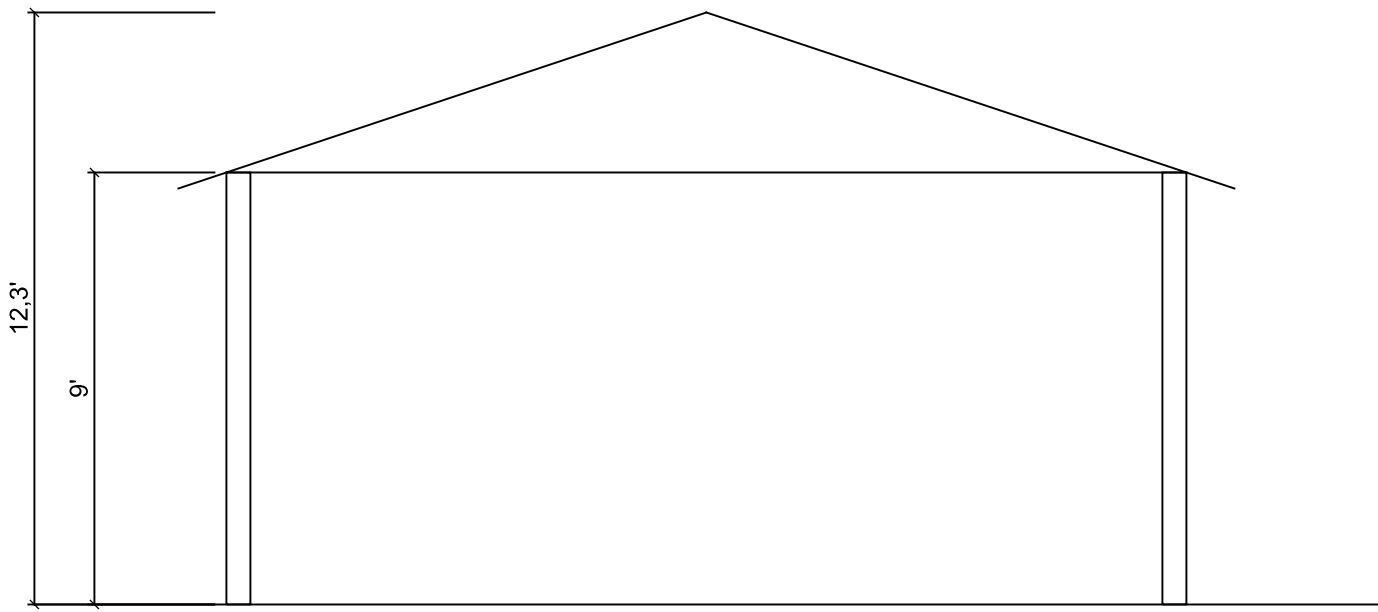

SECTION A-A

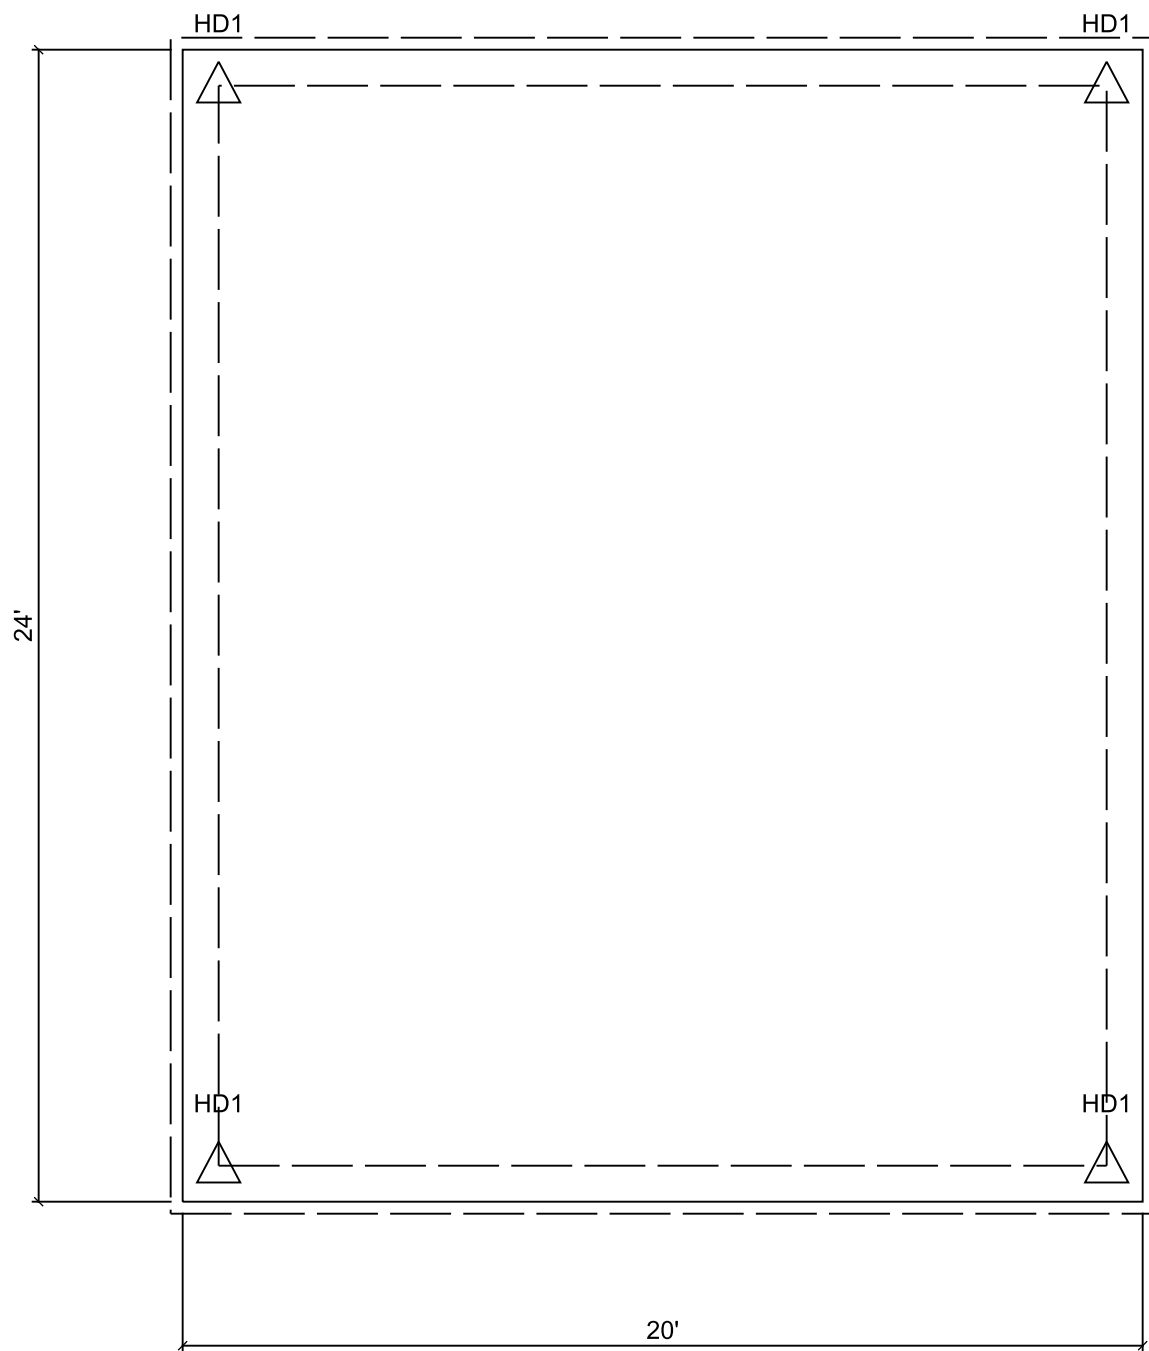

FOUNDATION PLAN

FOUNDATION NOTES

CONCRETE: MIN 2,500 PSI AT 28 DAYS (CRC R402.2).
CONTINUOUS FOOTING: 1'-0" WIDE x 1'-0" DEEP MIN, BOTTOM 12 IN
MIN BELOW UNDISTURBED GRADE (CRC R403.1.4), REINF: (1) #4 TOP,
(1) #4 BOTTOM (CRC R403.1.3, SDC D0-D2).
SLAB: 3.5 IN CONCRETE SLAB (CRC R506.1) OVER 10-MIL VAPOR RETARDER
(ASTM E1745 CLASS A, CRC R506.2.3 AS LOCALLY AMENDED) OVER 4 IN BASE.
ANCHOR BOLTS: 1/2 IN DIA AT 6'-0" O.C. MAX, 7 IN MIN EMBEDMENT, MIN 2
PER PLATE SECTION, ONE WITHIN 12 IN OF EACH PLATE END (CRC R403.1.6);
3x3x0.229 IN PLATE WASHERS AT BRACED WALL LINES (CRC R602.11.1).
HOLD-DOWNS PER PLAN; SIZE, MODEL, AND EMBEDMENT BY DRAFTER, KEYED
TO THE BRACED WALL SCHEDULE.
SOIL: 1,500 PSF ASSUMED BEARING; VERIFY. SOILS REPORT WHERE REQUIRED.
PRELIMINARY SKELETON: A QUALIFIED PROFESSIONAL MUST VERIFY ALL
FOUNDATION SIZES, REINFORCING, AND HARDWARE BEFORE SUBMITTAL.