





GENERAL NOTES 1. ALL WORK SHALL COMPLY WITH THE CALIFORNIA RESIDENTIAL CODE (CRC), CBC, CEC, CMC, CPC, CALIFORNIA ENERGY CODE (TITLE 24 PART 6), AND CALGREEN AS AMENDED BY THE LOCAL JURISDICTION. VERIFY THE ENFORCED CODE CYCLE BEFORE SUBMITTAL. 2. WRITTEN DIMENSIONS GOVERN OVER SCALED DIMENSIONS. 3. VERIFY ALL DIMENSIONS AND SITE CONDITIONS BEFORE CONSTRUCTION. 4. SMOKE ALARMS PER CRC R314; CARBON MONOXIDE ALARMS PER CRC R315. 5. EMERGENCY ESCAPE AND RESCUE OPENINGS PER CRC R310. 6. CONTRACTOR SHALL VERIFY ALL UTILITY LOCATIONS BEFORE EXCAVATION. 7. THIS SET IS A PRELIMINARY DRAWING SKELETON. A QUALIFIED PROFESSIONAL MUST REVIEW, COMPLETE, AND APPROVE EVERY SHEET BEFORE ANY PERMIT SUBMITTAL. PROJECT DATA PROJECT: DEMO BACKYARD STUDIO LOCATION: CALIFORNIA, USA LOT: 50 x 120 FT (6000 SF) BUILDING FOOTPRINT: 20 x 24 FT (480 SF) LOT COVERAGE: 8.0% WALL HEIGHT: 9'-0" ROOF: GABLE 4:12, 1 FT OVERHANG OCCUPANCY / CONSTRUCTION TYPE: BY DRAFTER PROJECT NOTES 1. DEMO INPUT ONLY; DIMENSIONS AND SETBACKS ARE PLACEHOLDERS. 2. NO CODE COMPLIANCE OR PERMIT READINESS IS IMPLIED. AREA SUMMARY <table><tr><th>ROOM</th><th>AREA (SF)</th></tr><tr><td>STUDIO</td><td>329</td></tr><tr><td>STORAGE</td><td>101</td></tr><tr><td>TOTAL</td><td>430</td></tr></table>					ROOM	AREA (SF)	STUDIO	329	STORAGE	101	TOTAL	430				
ROOM	AREA (SF)															
STUDIO	329															
STORAGE	101															
TOTAL	430															
Demo Backyard Studio California, USA	PRELIMINARY — NOT FOR CONSTRUCTION	GENERAL NOTES	SCALE: 1/4" = 1'-0"	A0.1												


CODE COMPLIANCE SUMMARY				
ITEM	CRC	REQUIRED	PROVIDED	STATUS
CEILING HEIGHT	R305.1	7'-0" MIN HABITABLE	9'-0"	OK
EGRESS (LEFT WALL)	R310	5.7 SF NET, 20"W x 24"H, SILL 44" MAX	12.0 SF GROSS, 4'-0" x 3'-0", SILL 3'-0"	OK*
LIGHT (GLAZING)	R303.1	8% OF FLOOR AREA PER HABITABLE ROOM	12 SF TOTAL GLAZING SHOWN	BY DRAFTER
VENTILATION	R303.1	4% OPENABLE PER HABITABLE ROOM	OPENABLE AREA PER WINDOW TYPE	BY DRAFTER
SMOKE ALARMS	R314	EACH SLEEPING ROOM, OUTSIDE, EACH STORY	2 SHOWN ON FLOOR PLAN	BY DRAFTER
CO ALARMS	R315	OUTSIDE SLEEPING AREAS, EACH STORY	1 SHOWN ON FLOOR PLAN	BY DRAFTER
ATTIC VENTILATION	R806.2	1/150 OF ATTIC AREA	3.2 SF NET FREE REQUIRED	BY DRAFTER

* NET CLEAR OPENING DEPENDS ON WINDOW TYPE - VERIFY. THIS TABLE IS ARITHMETIC ON STATED VALUES, NOT A CODE COMPLIANCE APPROVAL.

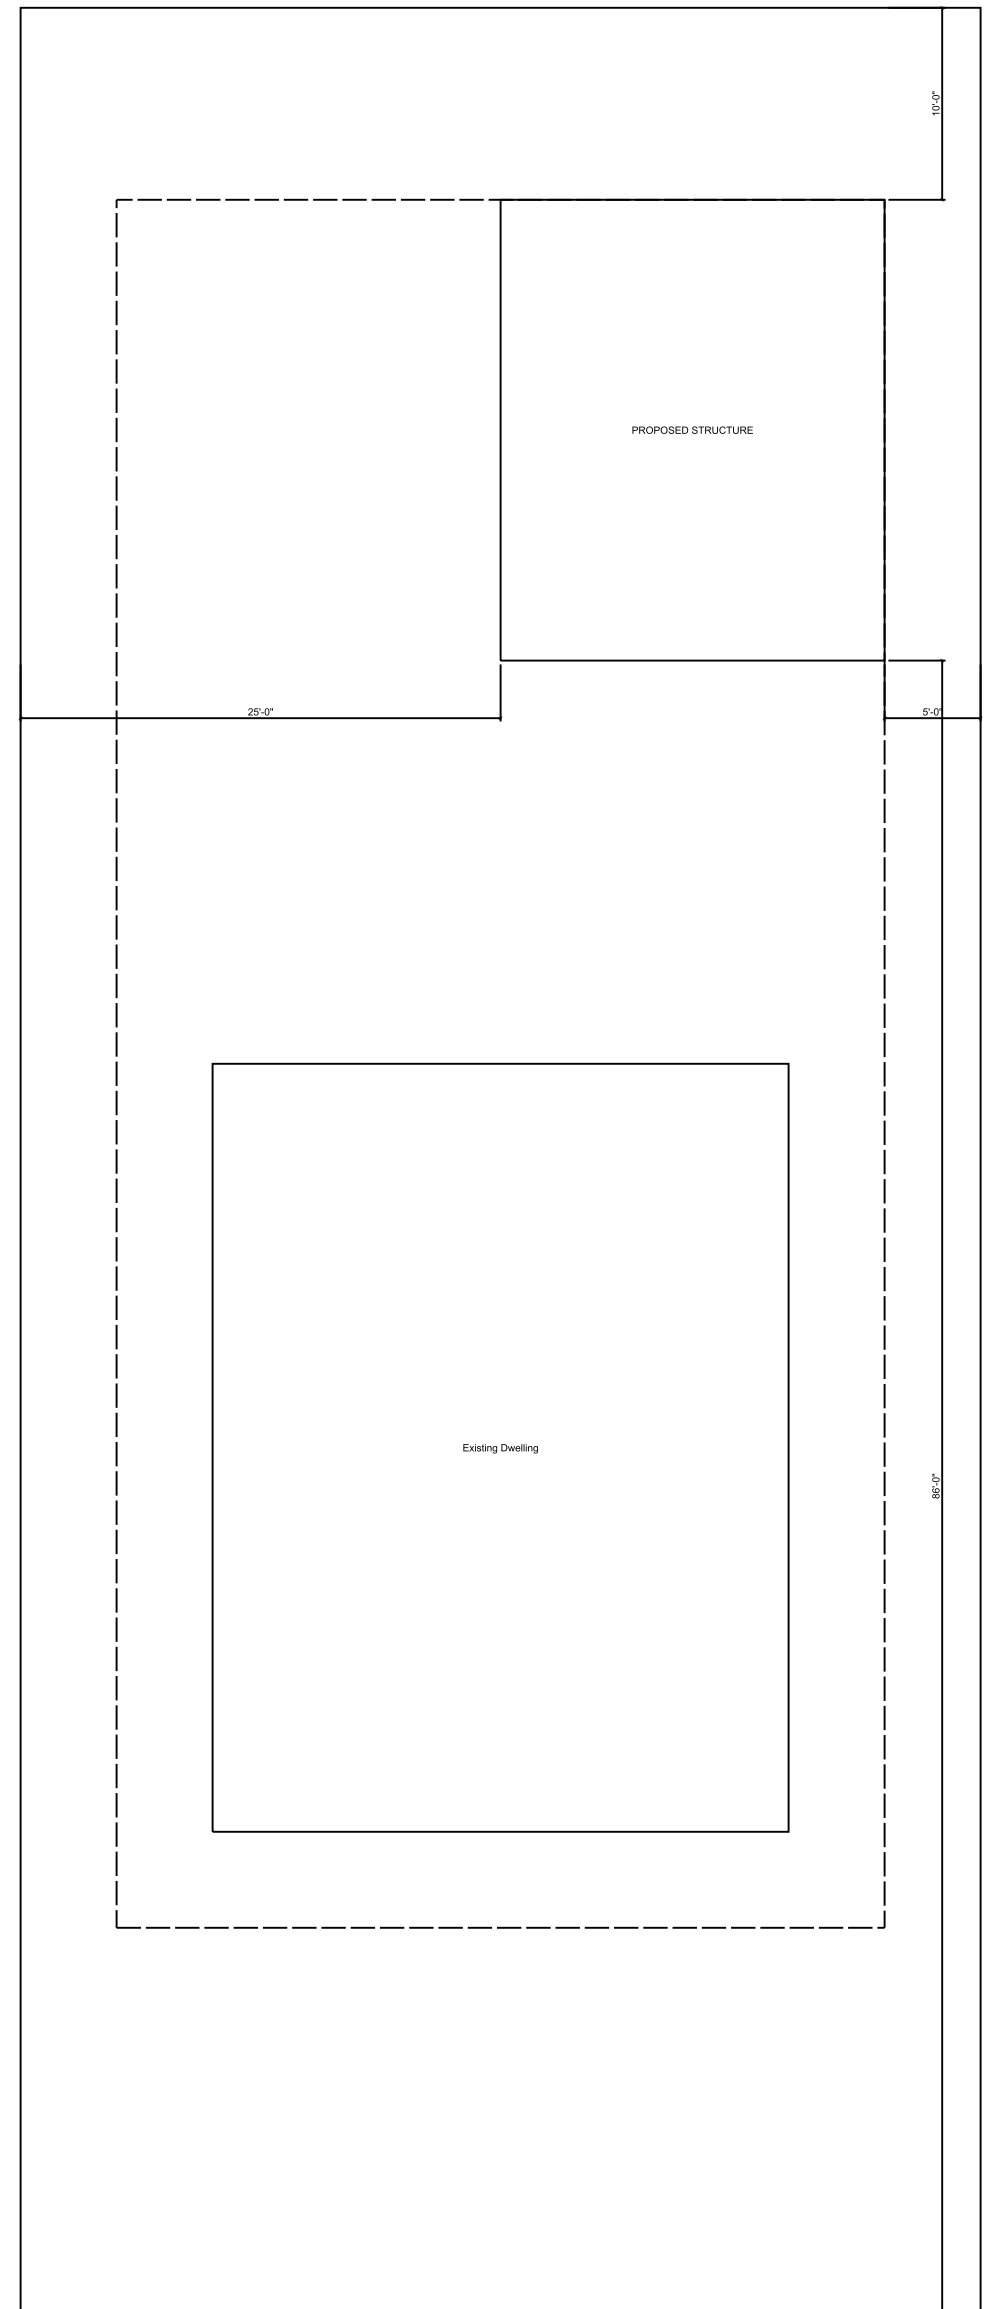


SITE PLAN
SCALE: 1" = 10'

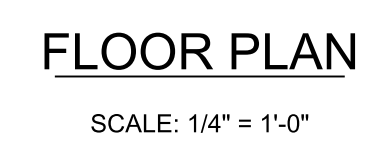

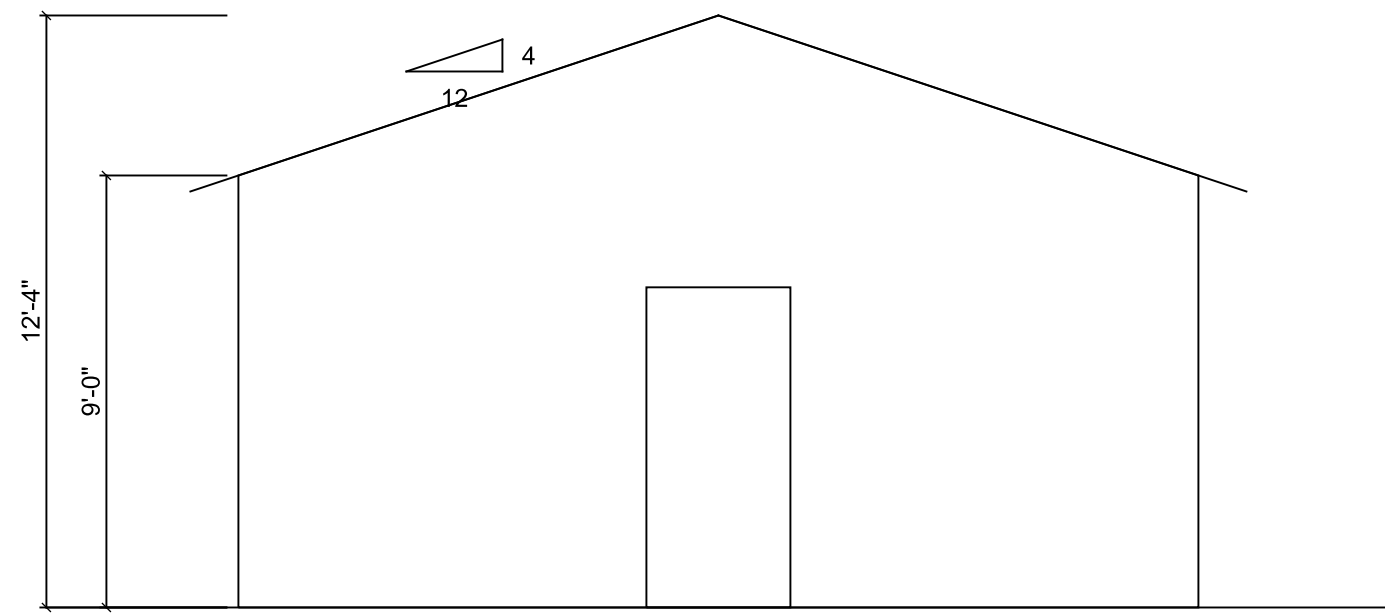


FRONT ELEVATION

SCALE: 1/4" = 1'-0"

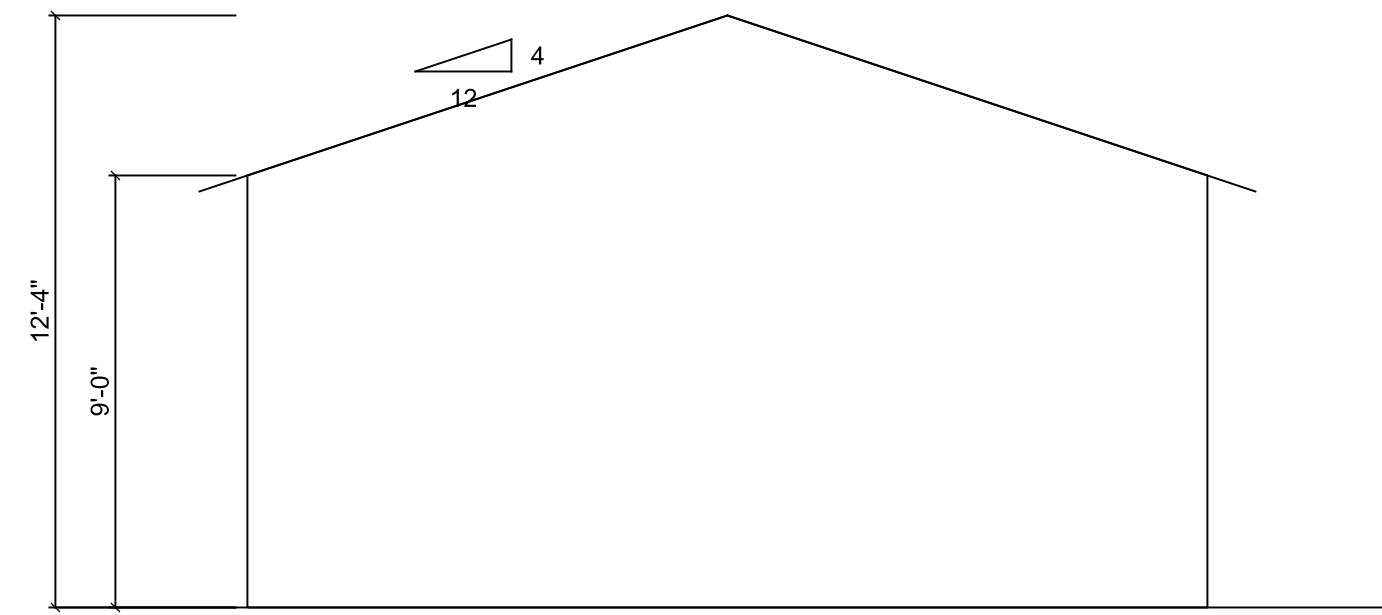


REAR ELEVATION

SCALE: 1/4" = 1'-0"

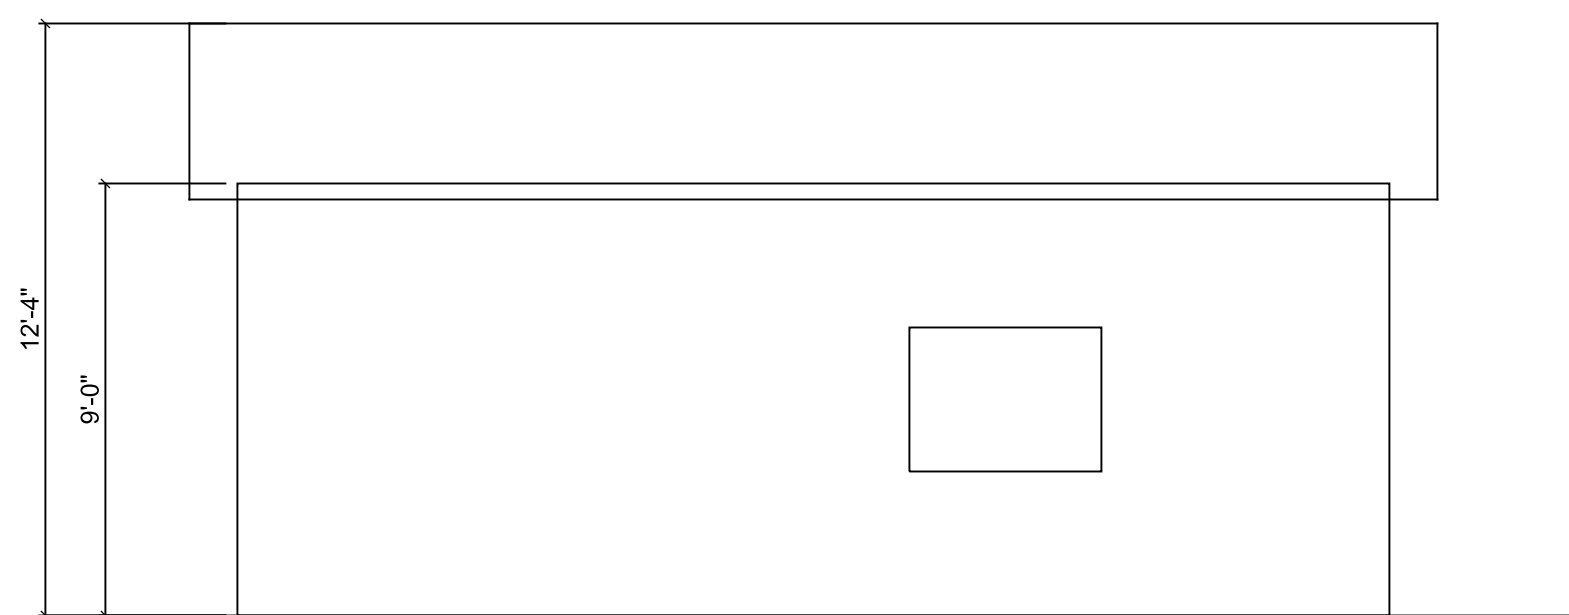


LEFT ELEVATION

SCALE: 1/4" = 1'-0"

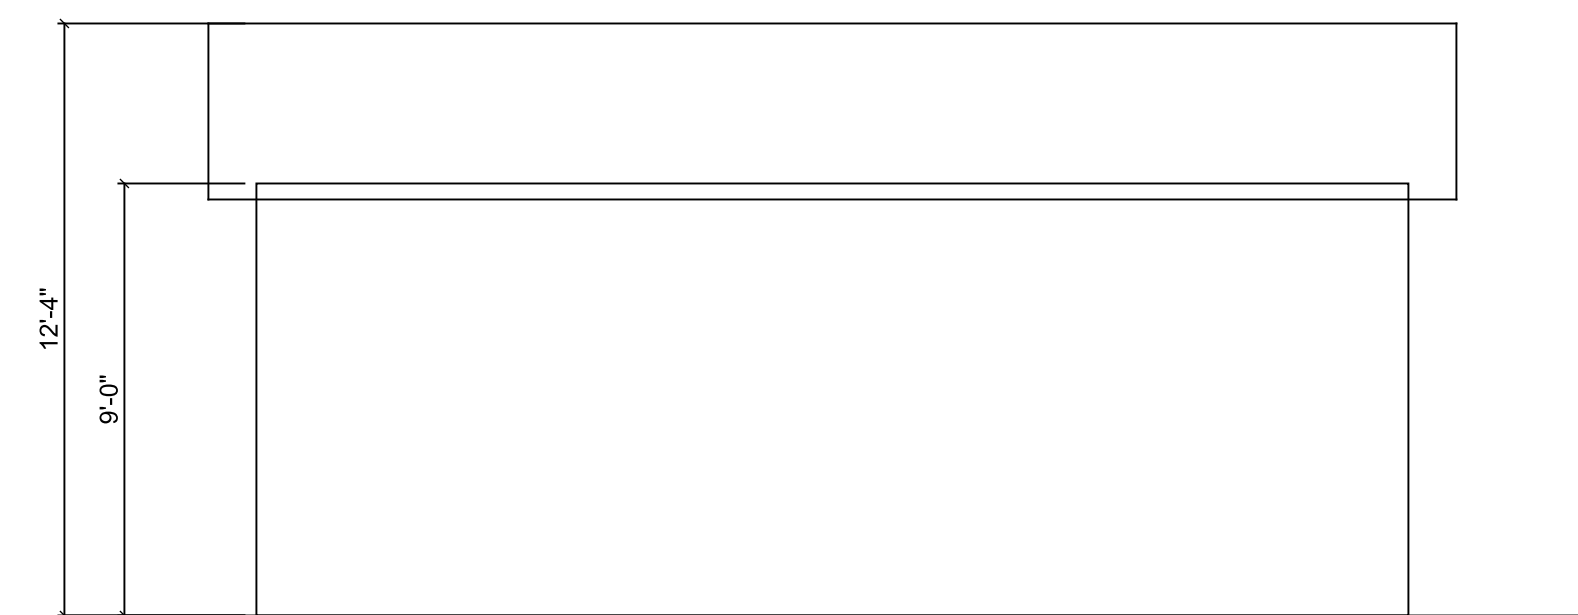

RIGHT ELEVATION

SCALE: 1/4" = 1'-0"

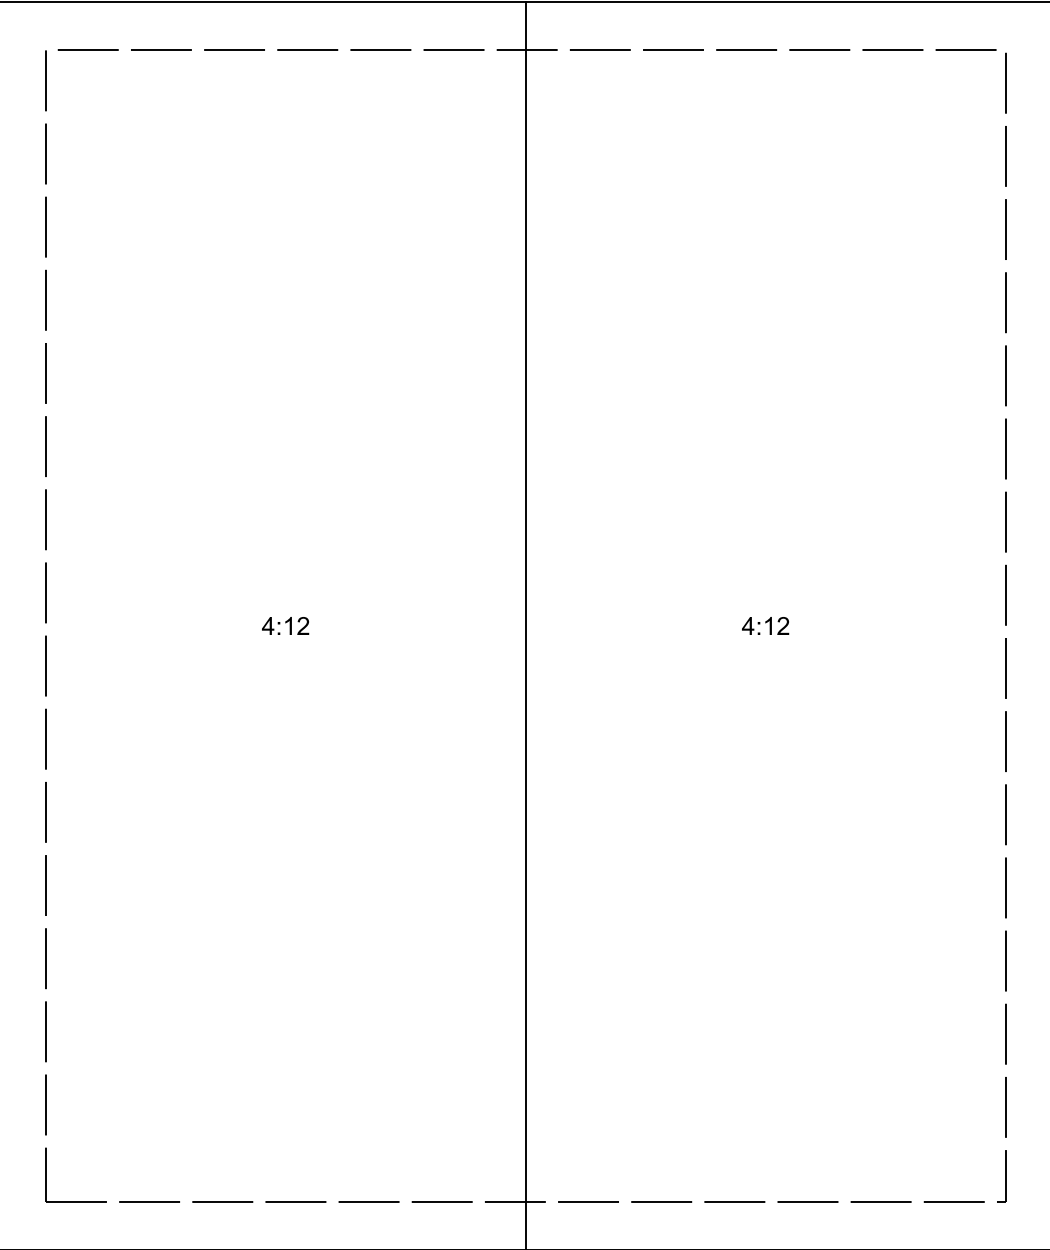


ROOF PLAN

SCALE: 1/4" = 1'-0"

DOOR SCHEDULE					
MARK	WIDTH	HEIGHT	TYPE	QTY	REMARKS
D1	3'-0"	6'-8"	EXTERIOR	1	
D2	2'-6"	6'-8"	INTERIOR	1	


WINDOW SCHEDULE						
MARK	WIDTH	HEIGHT	SILL	AREA	QTY	REMARKS
W1	4'-0"	3'-0"	SILL 3'-0"	12 SF	1	EGRESS

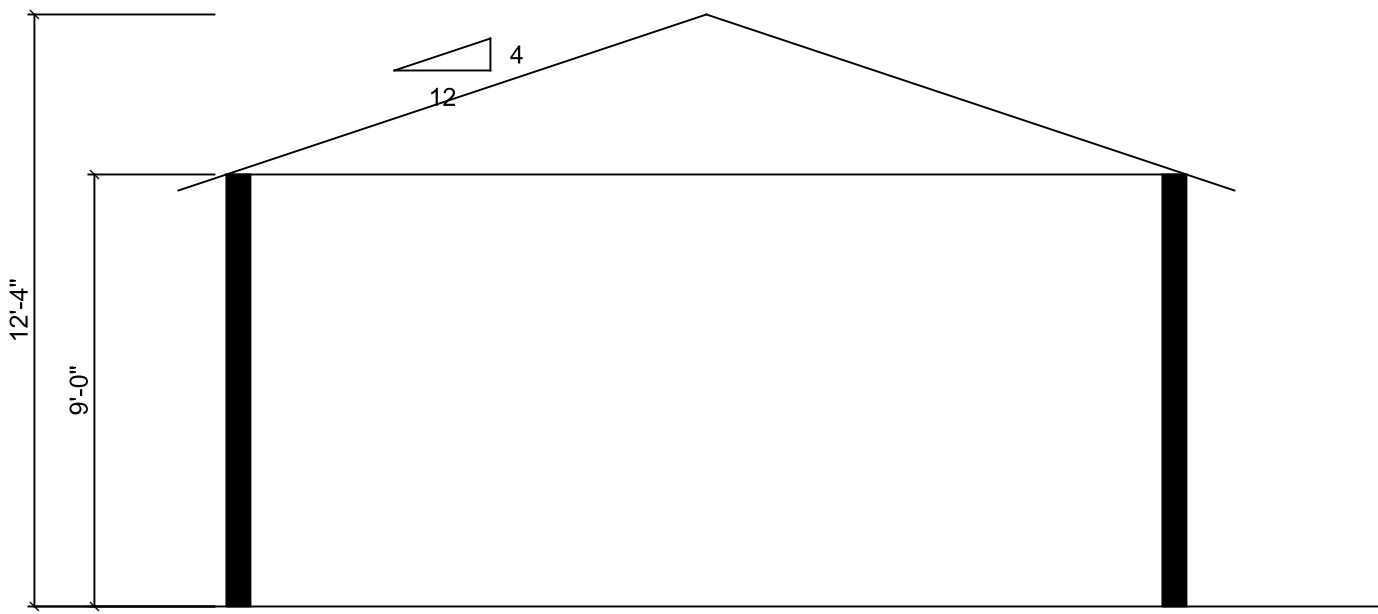

SECTION A-A

SCALE: 1/4" = 1'-0"

STRUCTURAL GENERAL NOTES 1. DESIGN BASIS (VERIFY ALL FOR THE PROJECT SITE): ROOF LL 20 PSF, ROOF DL 15 PSF, WIND 110 MPH EXPOSURE C, SEISMIC DESIGN CATEGORY D, SOIL BEARING 1,500 PSF ASSUMED. 2. THIS PROJECT IS DESIGNED UNDER THE CONVENTIONAL LIGHT-FRAME CONSTRUCTION PROVISIONS OF CRC R301.1.3 (OR THE LOCAL PRESCRIPTIVE PROGRAM, E.G. LA COUNTY WFPP). ENGINEERING IS REQUIRED WHERE THE DESIGN DEVIATES FROM THOSE PROVISIONS. 3. BRACED WALL LINES: SPACING 25 FT MAX; PANEL LOCATIONS, LENGTHS, AND SCHEDULE BY DRAFTER PER CRC R602.10, KEYED TO THE HOLD-DOWNS ON THE FOUNDATION PLAN. 4. WOOD: DF-L, MEMBER GRADES PER PLAN CALLOUTS (MIN NO. 2 UNLESS NOTED); SILL PLATES IN CONTACT WITH CONCRETE: PRESERVATIVE-TREATED (CRC R317). 5. FASTENING PER CRC TABLE R602.3(1) UNLESS NOTED. 6. CONCRETE: MIN 2,500 PSI AT 28 DAYS (CRC R402.2). 7. MANUFACTURED TRUSSES (WHERE USED): STAMPED TRUSS PACKAGE IS A DEFERRED SUBMITTAL (CRC R802.10.1). 8. PRELIMINARY SKELETON: A QUALIFIED PROFESSIONAL MUST VERIFY THE DESIGN BASIS AND ALL STRUCTURAL CONTENT BEFORE SUBMITTAL.				
Demo Backyard Studio California, USA	PRELIMINARY — NOT FOR CONSTRUCTION	STRUCTURAL NOTES	SCALE: 1/4" = 1'-0"	S0.0

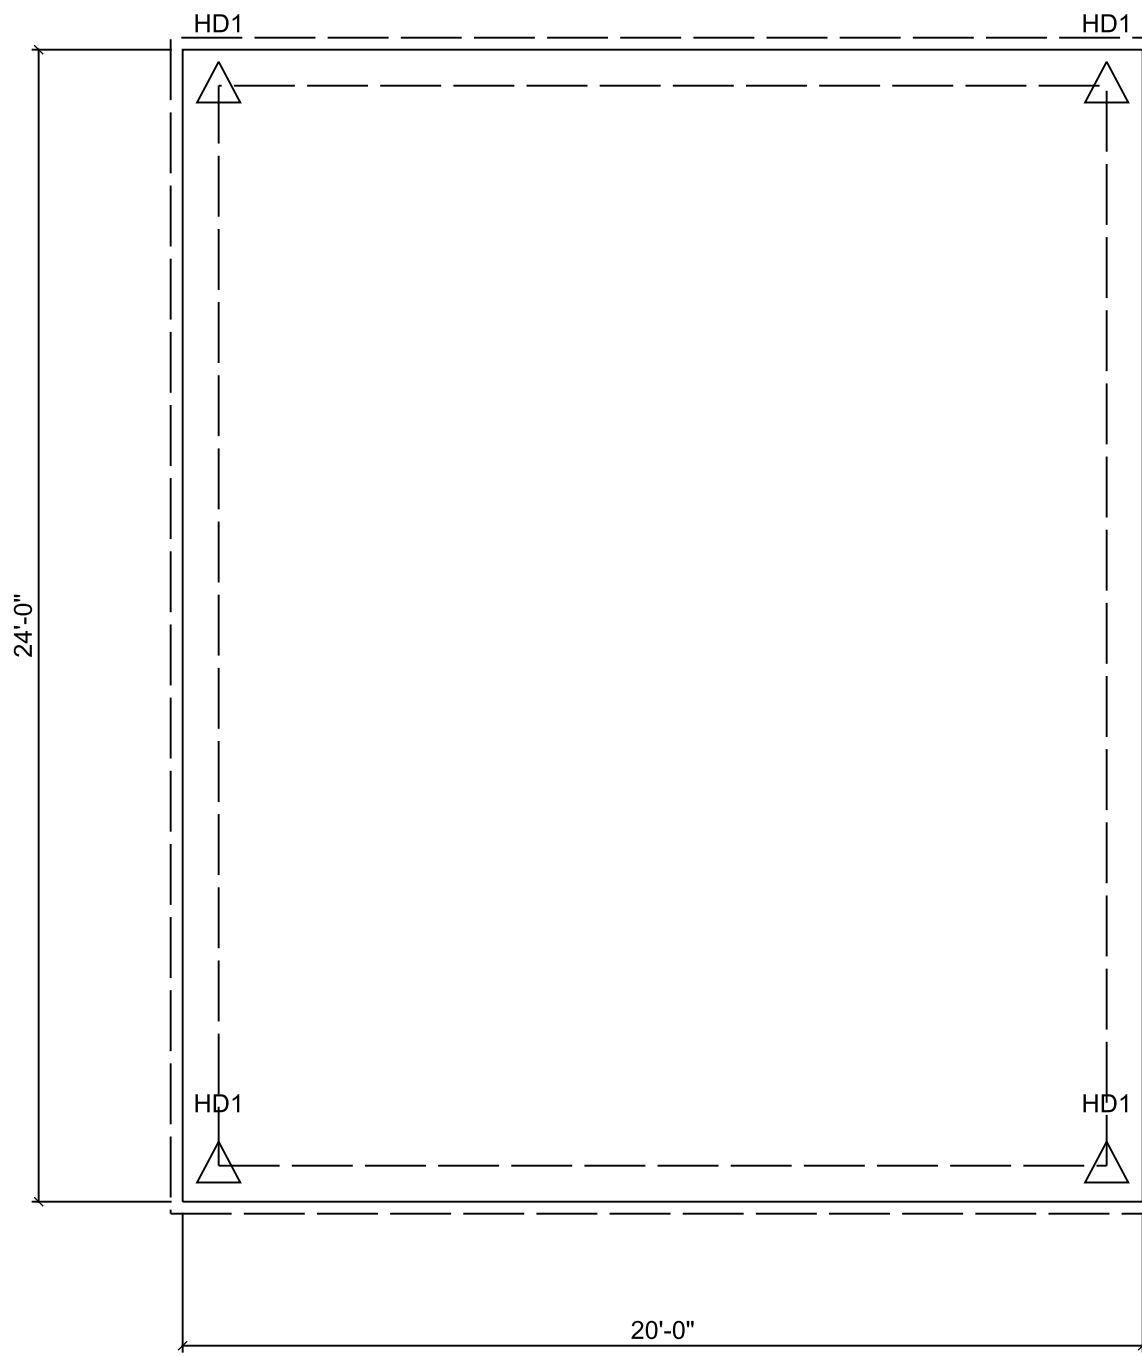


FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES

CONCRETE: MIN 2,500 PSI AT 28 DAYS (CRC R402.2).
CONTINUOUS FOOTING: 1'-0" WIDE x 1'-0" DEEP MIN, BOTTOM 12 IN
MIN BELOW UNDISTURBED GRADE (CRC R403.1.4), REINF: (1) #4 TOP,
(1) #4 BOTTOM (CRC R403.1.3, SDC D0-D2).
SLAB: 3.5 IN CONCRETE SLAB (CRC R506.1) OVER 10-MIL VAPOR RETARDER
(ASTM E1745 CLASS A, CRC R506.2.3 AS LOCALLY AMENDED) OVER 4 IN BASE.
ANCHOR BOLTS: 1/2 IN DIA AT 6'-0" O.C. MAX, 7 IN MIN EMBEDMENT, MIN 2
PER PLATE SECTION, ONE WITHIN 12 IN OF EACH PLATE END (CRC R403.1.6);
3x3x0.229 IN PLATE WASHERS AT BRACED WALL LINES (CRC R602.11.1).
HOLD-DOWNS PER PLAN; SIZE, MODEL, AND EMBEDMENT BY DRAFTER, KEYED
TO THE BRACED WALL SCHEDULE.
SOIL: 1,500 PSF ASSUMED BEARING; VERIFY. SOILS REPORT WHERE REQUIRED.
PRELIMINARY SKELETON: A QUALIFIED PROFESSIONAL MUST VERIFY ALL
FOUNDATION SIZES, REINFORCING, AND HARDWARE BEFORE SUBMITTAL.

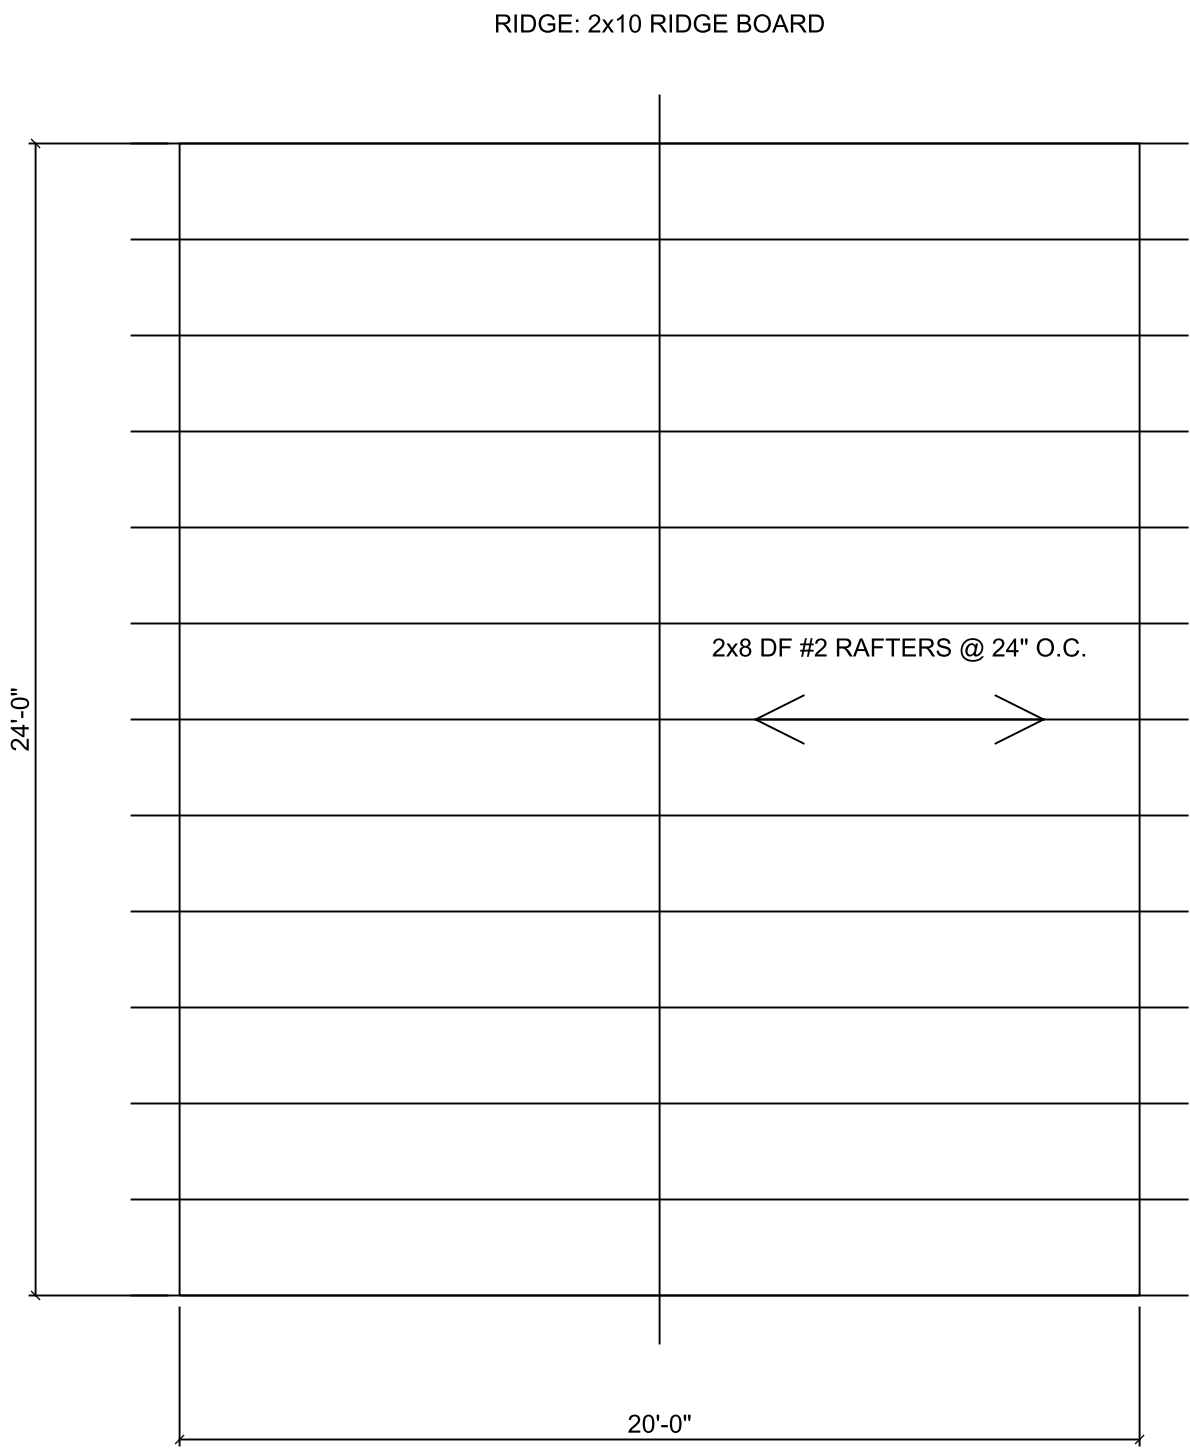


ROOF FRAMING PLAN


SCALE: 1/4" = 1'-0"

FRAMING NOTES


- MEMBER SPANS: VERIFY PER CRC TABLES R802.4.1(1)-(9).
- BLOCKING: SOLID BLOCK ALL MEMBERS AT EXTERIOR WALLS (CRC R802.8).
- SHEATHING: NAILING 8d @ 6 IN EDGES / 12 IN FIELD PER CRC TABLE R602.3(1); PANEL EDGES NAILED TO BLOCKING.
- UPLIFT CONNECTORS WHERE UPLIFT EXCEEDS 200 LB PER MEMBER (CRC TABLE R802.11).
- ATTIC VENTILATION: 1/150 (OR 1/300 PER R806.2 EXCEPTIONS).
- HEADERS PER CRC TABLE R602.7 UNLESS NOTED.
- RAFTER TIES MIN 2x4 @ 48 IN O.C. MAX (CRC R802.5.2.2) OR RIDGE BEAM WITH SUPPORTS; COLLAR TIES PER CRC R802.4.6.
- PRELIMINARY SKELETON: A QUALIFIED PROFESSIONAL MUST VERIFY ALL MEMBER SIZES, SPANS, AND CONNECTIONS BEFORE SUBMITTAL.

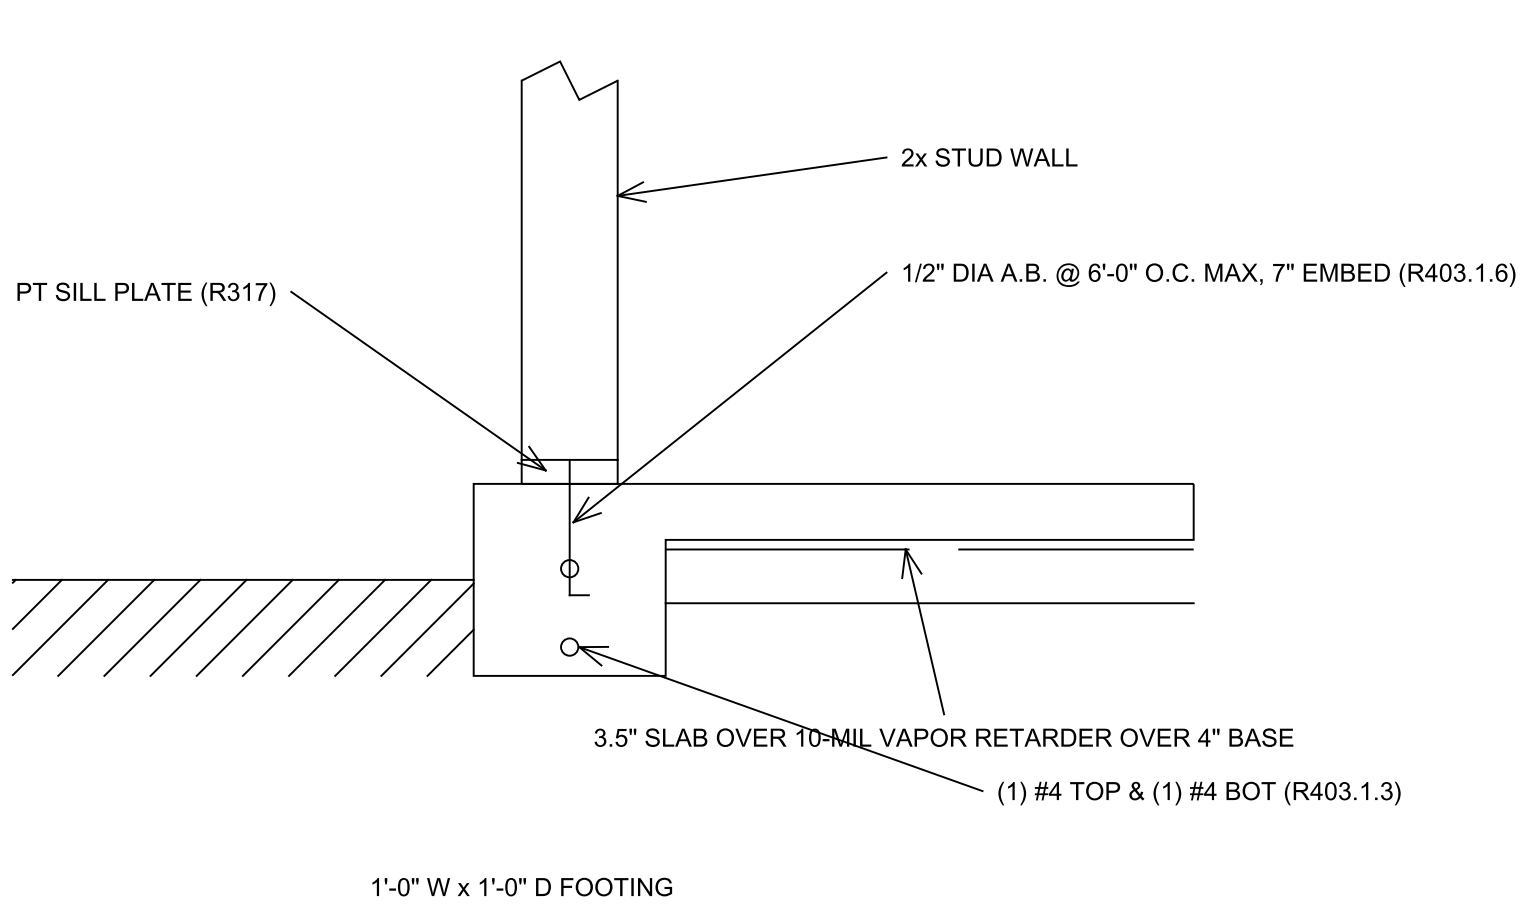


1 EXTERIOR FOOTING AT SLAB EDGE
SCALE: 1" = 1'-0"

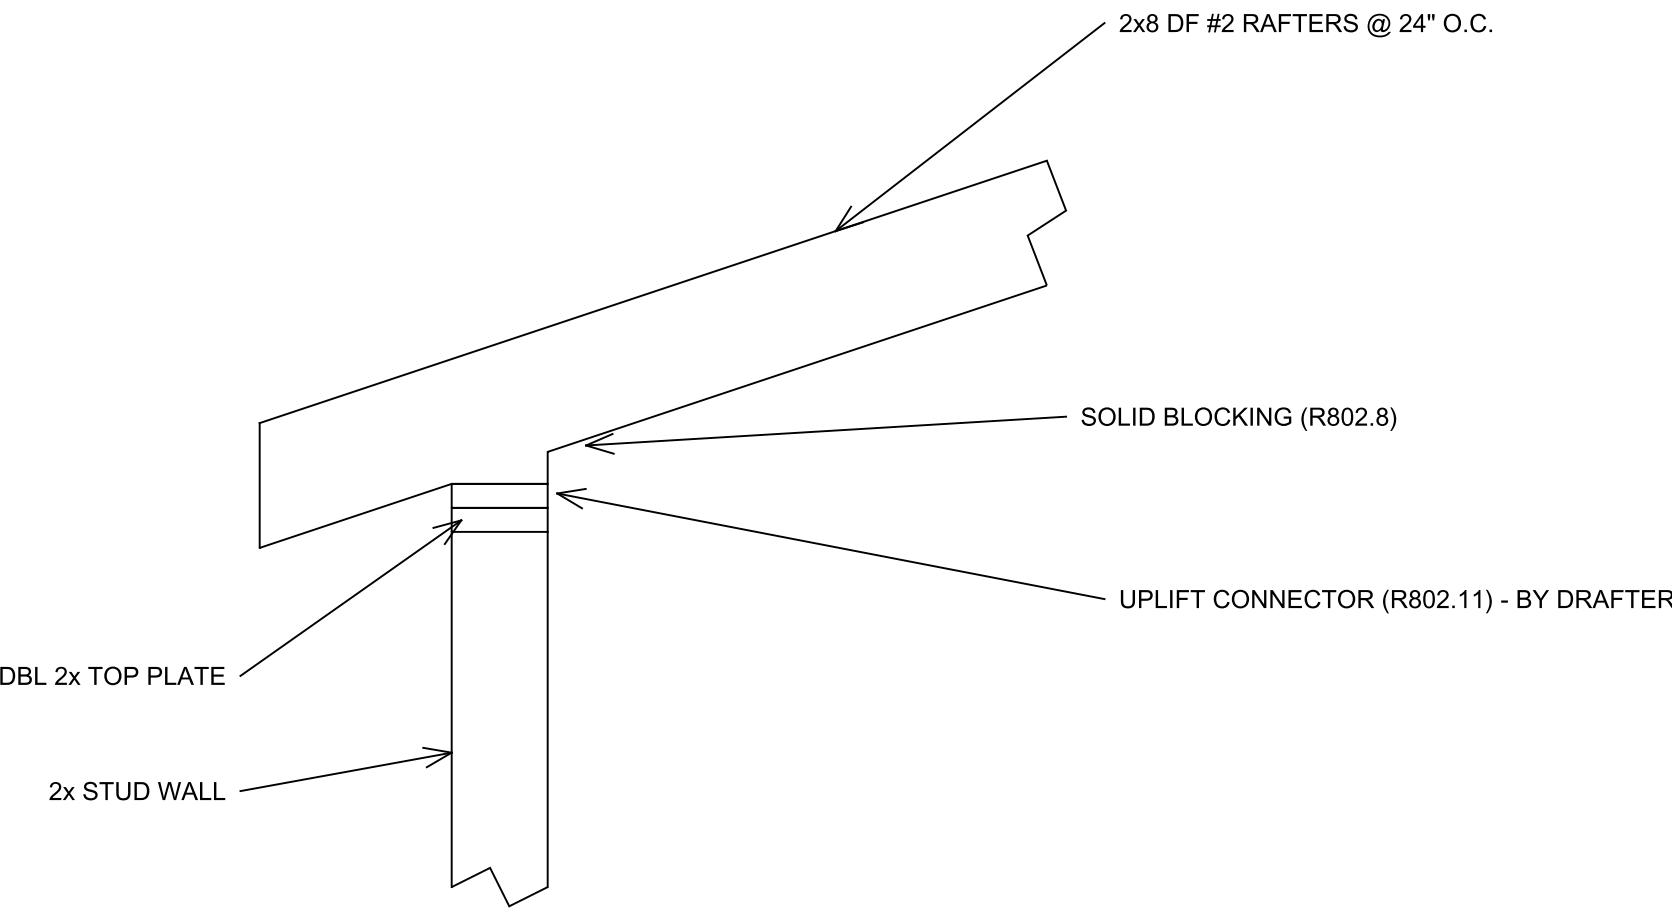

2 EAVE CONNECTION AT TOP PLATE
SCALE: 1" = 1'-0"

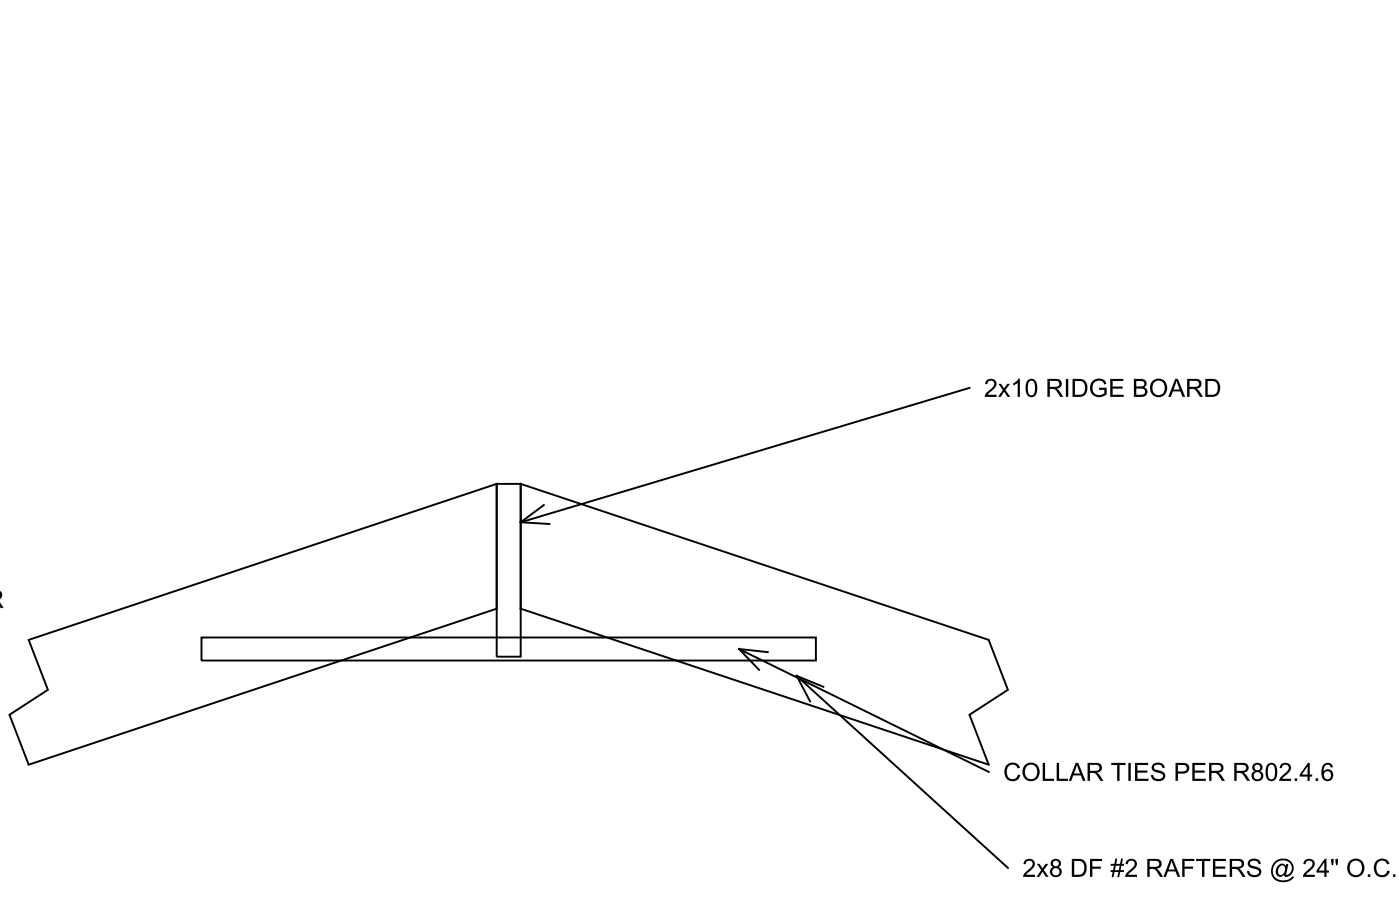

3 RIDGE CONNECTION
SCALE: 1" = 1'-0"

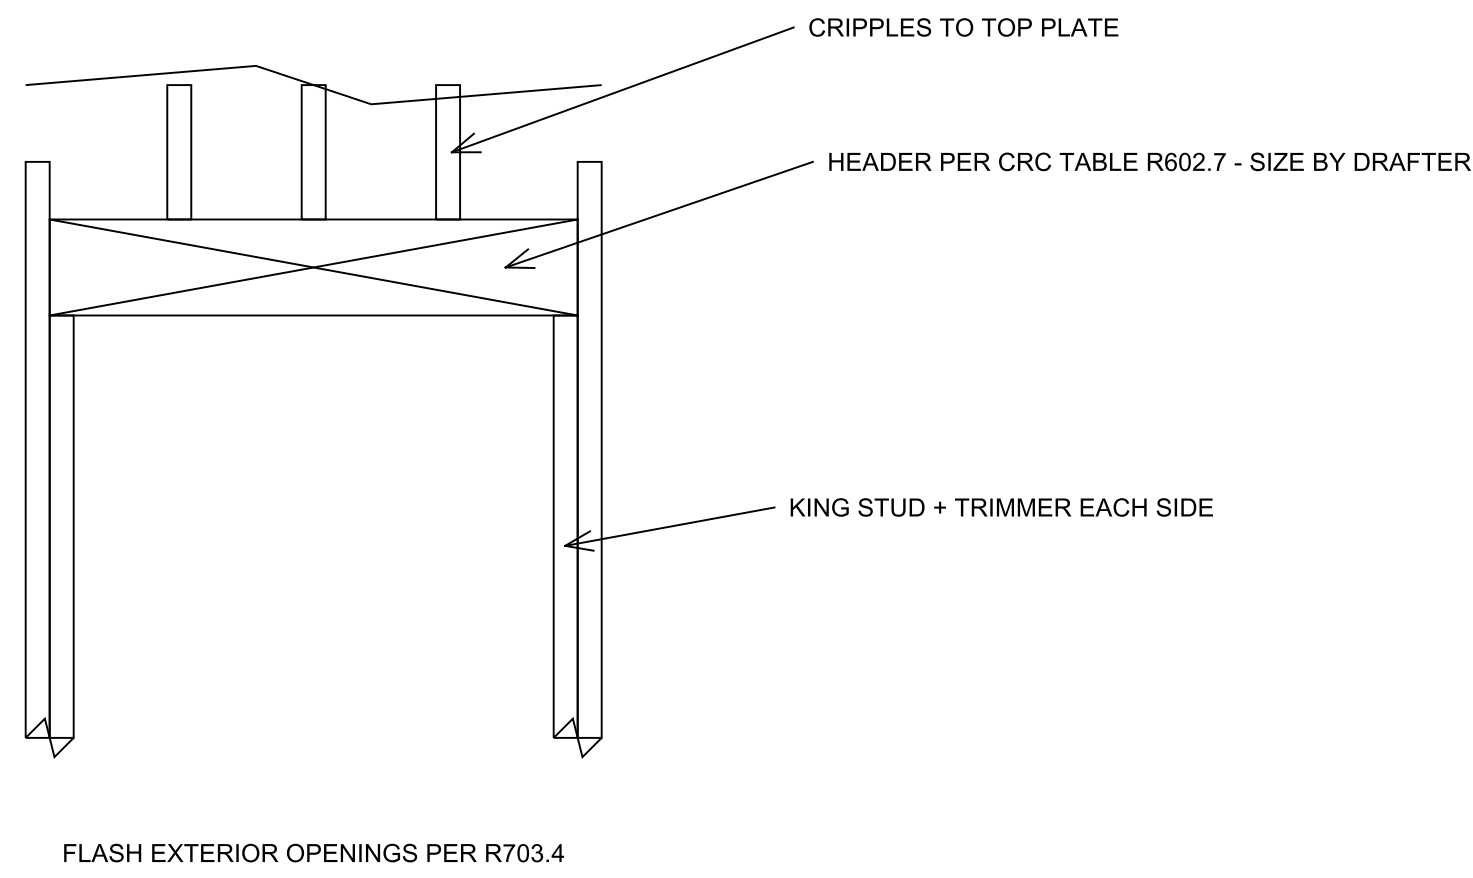

4 TYPICAL HEADER AT OPENING
SCALE: 1" = 1'-0"

ALL CONNECTOR MODELS, MEMBER SIZES, AND EMBEDMENTS ARE THE DRAFTER'S - PRELIMINARY SKELETON