

See discussions, stats, and author profiles for this publication at: <https://www.researchgate.net/publication/368914653>

Model-Free DER Hosting Capacity and Operating Envelopes: Project Update

Presentation · February 2023

DOI: 10.13140/RG.2.2.22483.66087

CITATIONS

0

READS

712

4 authors, including:



Luis(Nando) Ochoa

University of Melbourne

374 PUBLICATIONS 8,919 CITATIONS

[SEE PROFILE](#)



Vincenzo Bassi

University of Melbourne

16 PUBLICATIONS 52 CITATIONS

[SEE PROFILE](#)



Model-Free DER Hosting Capacity and Operating Envelopes: Project Update

Part of the Model-Free Operating Envelopes at NMI Level Project

Thank you for joining!
This webinar will start soon.

Important Information

- We will start at 13:02 PM. ~40-min presentation followed by ~10-min Q&A session.
- Please **use the Q&A box to ask any questions** you might have.
- The **webinar will be recorded** and will be available after the event.



Model-Free DER Hosting Capacity and Operating Envelopes:

Project Update

Luis(Nando) Ochoa, Vincenzo Bassi,
Tansu Alpcan and Chris Leckie

Webinar

15th Feb 2023

The Team

Faculty of Engineering and Information Technology



Prof Nando Ochoa



Vincenzo Bassi



Prof Tansu Alpcan




Prof Chris Leckie

Outline

1. Voltage Calculations and DER¹
2. Our Model-Free Approach
Improvements: Offline Data Pipeline and NN Recipe
3. Model-Free Applications
4. Too good to be true? Model-Driven vs Model-Free
5. Partial Smart Meter Data Availability
6. Key Remarks

¹ DER = Distributed Energy Resources




- +
= ×

1 Voltage Calculations and DER


1 Voltage Calculations and DER

DER & Low Voltage (LV) Networks

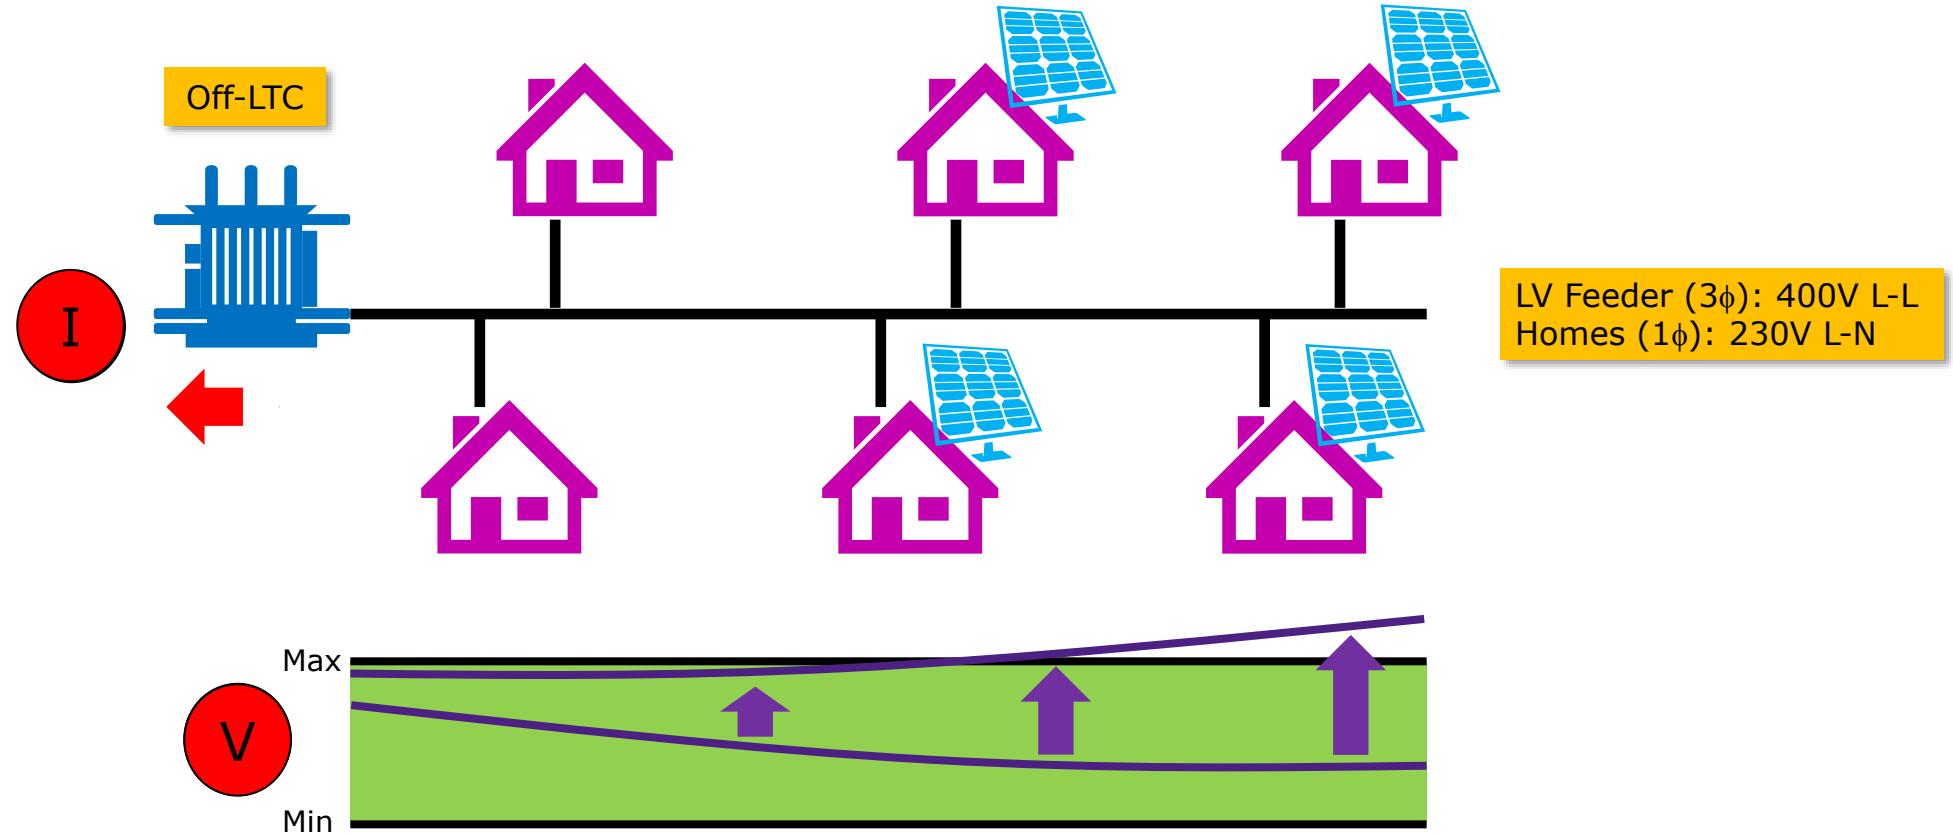


How can we determine the maximum exports (or imports) that our networks can withstand?


1 Voltage Calculations and DER Hosting Capacity

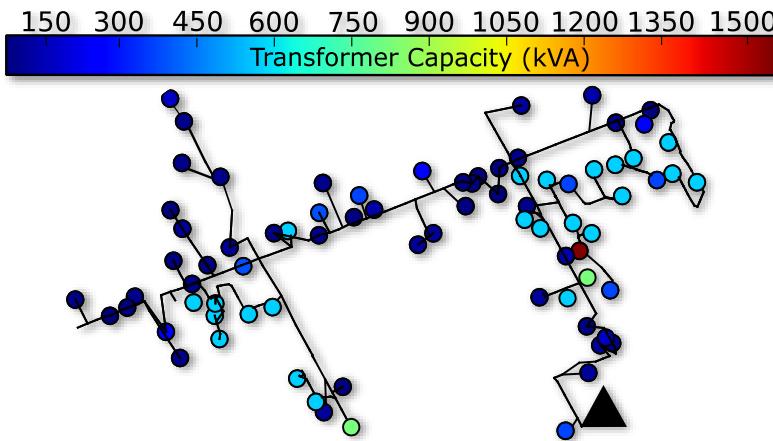

LV Voltage Issues

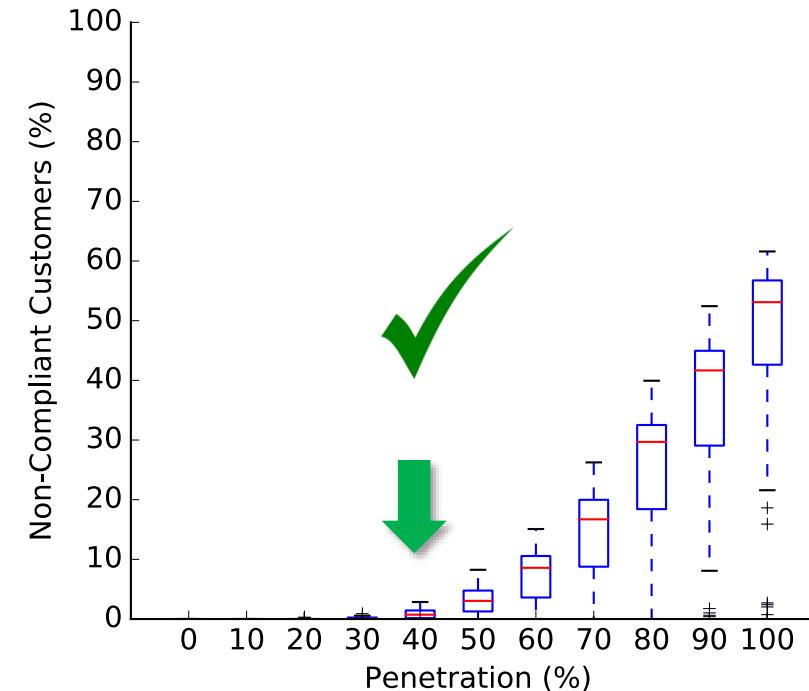


HV Conductors Congestion

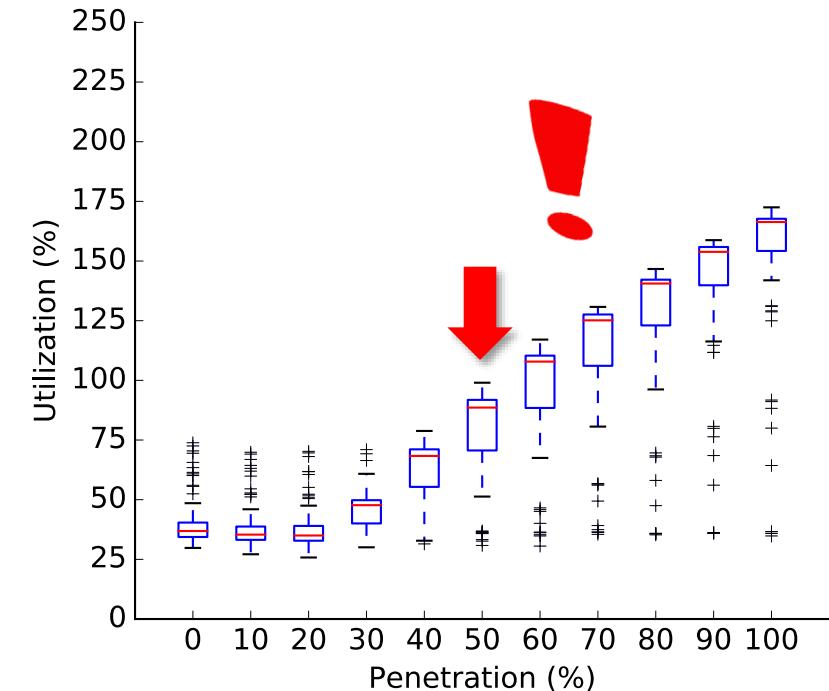




Exploration of DER scenarios → Power flows are essential

1 Voltage Calculations and DER

Operating Envelopes



- Time-varying maximum power imports/exports at the meter
- Calculated to ensure network integrity. Values may depend on location.

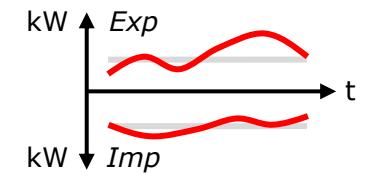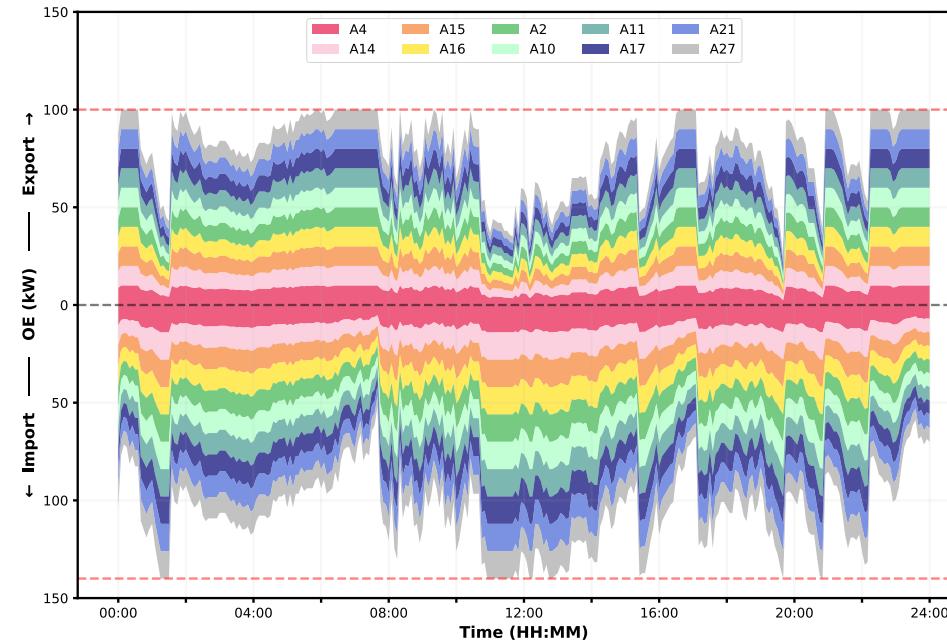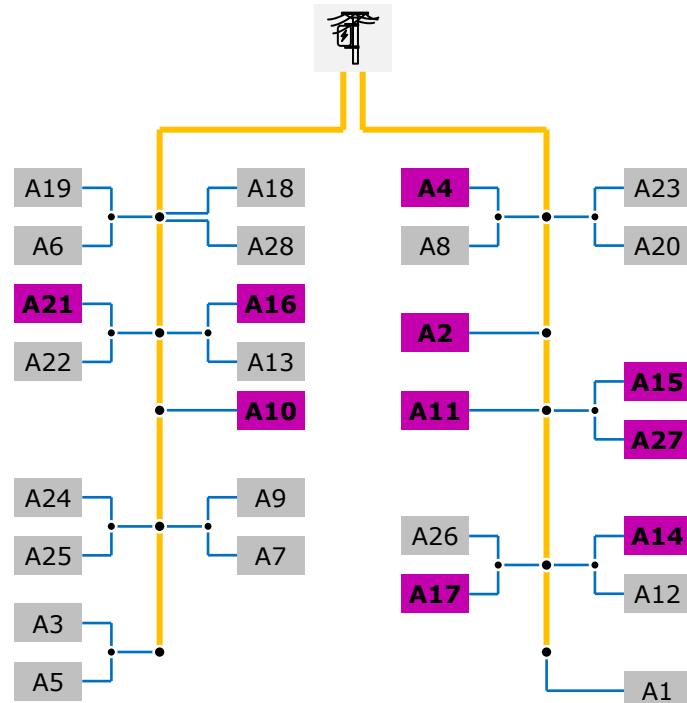

Again, exploration of DER scenarios → Power flows are essential

1 Voltage Calculations and DER


Today (Ideally)

Scenario to Check

- Min/Max Demand (P_{cust}, Q_{cust})
- DER exp/imp (P_{DER}, Q_{DER})
- Voltage at the ref bus

*Electrical
LV Network Model*

Topology
Impedances ($[Z]_{3 \times 3}$)
Phase Grouping (a, b, c)

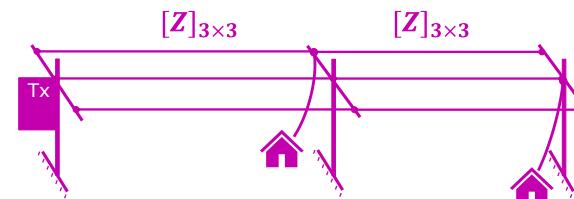

3 ϕ Power Flow

E.g., OpenDSS ☺



Voltages

V of customers



- ✓ Hosting Capacity (Planning)
- ✓ Operating Envelopes (Operation)
- ✓ Etc.

To achieve this, distribution companies are producing LV network models
→ Can be time-consuming, expensive and not 100% accurate²

² Errors in topology, phase grouping, impedances, neutral, grounding, etc.

1 Voltage Calculations and DER

Today (Ideally)

Scenario to Check

Min/Max Demand
(P_{cust}, Q_{cust})

DER exp/imp
(P_{DER}, Q_{DER})

Voltage at the ref bus

*Electrical
LV Network Model*

3 ϕ Power Flow

**What if we could
calculate voltages
without
electrical models?**

Voltages

V of customers


Voltages OK?

Yes
Harder Scenario

- No
- ✓ Hosting Capacity (Planning)
 - ✓ Operating Envelopes (Operation)
 - ✓ Etc.

To achieve this, distribution companies are producing LV network models
→ **Can be time-consuming, expensive and not 100% accurate²**

² Errors in topology, phase grouping, impedances, neutral, grounding, etc.



2 Our Model-Free Approach

Electrical Model-Free Voltage Calculations Using Neural Networks and Smart Meter Data, IEEE Trans. on Smart Grid ([ResearchGate](#))

Deliverables 3b-4: Improved Model-Free Operating Envelopes and Other Considerations, Report, 2023 ([ResearchGate](#))

Deliverable 1-2-3a: Model-Free Voltage Calculations and Operating Envelopes, Report, 2022 ([ResearchGate](#))

Deliverable 0: Concept, Smart Meter Data, and Initial Findings, Report, 2022 ([ResearchGate](#))

Model-Free Voltage Calculations for PV-Rich LV Networks: Smart Meter Data and Deep Neural Networks, IEEE PES PowerTech 2021 ([ResearchGate](#))

Calculating Voltages Without Electrical Models: Smart Meter Data and Neural Networks, CIRED 2021 ([ResearchGate](#))

Model-Free Operating Envelopes at NMI Level

Next Webinar (Feb): [Model-Free DER Hosting Capacity and Operating Envelopes: Project Update](#)

Our Latest Report: [Deliverables 3b-4 "Improved Model-Free Operating Envelopes and Other Considerations"](#)

Our Latest Paper: [Electrical Model-Free Voltage Calculations Using Neural Networks and Smart Meter Data](#)

[Timeline](#)[Resources](#)

C₊N_≡T

Centre for New
Energy Technologies

<https://electrical.eng.unimelb.edu.au/power-energy/projects/model-free-operating-envelopes>

2 Our Model-Free Approach

Concept


Scenario to Check

Min/Max Demand
 (P_{cust}, Q_{cust})

DER exp/imp
 (P_{DER}, Q_{DER})

Voltage at the ref bus

Model-Free Voltage Calculations

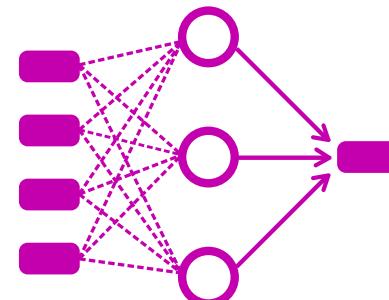

Clever stuff to capture the physics ☺

Neural Network trained with
 historical Smart Meter data

Voltages

V of customers





- ✓ Hosting Capacity (Planning)
- ✓ Operating Envelopes (Operation)
- ✓ Etc.

- ✓ **Removes time and cost** associated with the production of **LV electrical models**
- ✓ **Extremely quick alternative** to power flow-based techniques

2 Our Model-Free Approach

Development and Application




1. Development: Production of the Neural Network (NN) using a recipe



Processing of Smart Meter Data
 (P, Q, V)

NN Training (*Recipe*) and Selection
 $V = f(P, Q)$

2. Application



**DER Scenario or
Forecasts (P, Q)**

**NN Calculates
Voltages (V)**

- ✓ **Hosting Capacity**
- ✓ **Connection Request**
- ✓ **Operating Envelopes**

2 Our (Improved) Model-Free Approach

Development 1/2



Smart Meter Data: Improved Offline Data Pipeline

Step 1: Collect raw historical per-phase smart meter data



Step 2: Pre-process the historical smart meter data to obtain P and Q values

Step 3: Remove invalid and unfeasible instances

Step 4: Remove customers that do not show normal demand behaviours³



- ✓ Some customers have no consumption for most data points (e.g., construction)
- ✓ The NN will not be able to calculate voltages for P and Q very far from training

➤ **Output:** Training data set (P , Q , V)

The NN must be trained considering normal demand behaviours

³ Deliverables 3b-4: Improved Model-Free Operating Envelopes and Other Considerations, Report, 2023 ([ResearchGate](#))

2 Our Model-Free Approach

Development 2/2




NN Training (Recipe) and Selection

Step 5: Define NN hyperparameters and settings according to NN recipe⁴

- Enhanced extrapolation capabilities and reduced production time

Hyperparameters and Settings	
Inputs	$2 C $
Outputs	$ C $
Output Act. Function	Linear
Error Function	MSE
Scaler	[0,1]
Optimiser	ADAM
Regularisation	L2
Number of Neurons	$5 C $
Activation Function	Tanh
Learning Rate	1e-4
Regularisation Factor	1e-5
Batch Size	Eq. to 6 hours
Epochs	2,000

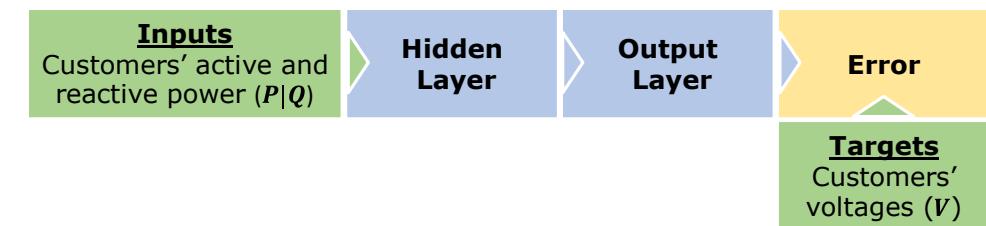

The NN can be produced in minutes

Step 6: 10 NNs based on Step 5 are trained from scratch. Select the lowest RMSE in training.

- **Output:** Final NN ready for voltage calculations $V = f(P, Q)$ ☺

⁴ Electrical Model-Free Voltage Calculations Using Neural Networks and Smart Meter Data, IEEE Trans. on Smart Grid ([ResearchGate](#))

2 Our Model-Free Approach

What has been achieved so far?



- ✓ Accurate and quick multi-LV circuit voltage calculations
 - One NN per transformer (all LV circuits simultaneously captured)
- ✓ Only 3 weeks of historical data (P , Q , and V) are required
 - Data from all customers connected to the transformer
 - No topological changes in the historical data
- ✓ NN can be used for multiple months without updates
 - If no changes in the LV network have occurred
- ✓ Several applications tested
 - Operating Envelopes, Connection Request, Hosting Capacity

Title: Deliverables 1-2-3a: Model-Free Voltage Calculations and Operating Envelopes

Synopsis: This report presents the different technical aspects and results of the development of the model-free approach to calculate voltages proposed by the University of Melbourne within the context of the Project "Model-Free Operating Envelopes at NMI Level". Specifically, this report presents the methodology and its scalability to distribute transformers with multiple LV circuits. Furthermore, this report presents the proposed model-free operating envelopes approach, the foundations for its potential implementation and its initial tests.

Data Document ID: UoM-CANET-Model-Free-OES-02a-4_v01

Date: 26th July 2022

Prepared For: Centre for New Energy Technologies (CANET)
C/- SBC, Level 2, 520 Bourke St, Melbourne
VIC 3000, Australia

Prepared By: Vincenzo Bassi, Dr Luis-Nando Ochoa, Prof Luis Alpcan, Prof Tamer Alpcan, Prof Cihan Ozturk, Prof Tim Leekie

Revised By: Prof Luis-Nando Ochoa, Prof Tamer Alpcan, Prof Cihan Ozturk, Prof Tim Leekie

Contact: Prof Luis-Nando Ochoa
+61 3 9345 4670
luis.ochoa@unimelb.edu.au

Copyright © 2022 V. Bassi, L. Ochoa, T. Alpcan, C. Leekie – The University of Melbourne

Title: Deliverables 3b-4: Improved Model-Free Operating Envelopes and Other Considerations

Synopsis: This report builds on the previous two reports (foundations, methodology, and extensive performance tests) and presents improvements to the model-free approach to calculate operating Envelopes at NMI Level. Specifically, this report presents improvements to the offline data pipeline previously defined, presents improvements to the online data processing and prediction process, and discusses how to cater for changes in voltage regulation devices as well as partial smart meter data availability.

Data Document ID: UoM-CANET-Model-Free-OES-03b-4_v01

Date: 31st January 2023

Prepared For: Centre for New Energy Technologies (CANET)
C/- SBC, Level 2, 520 Bourke St, Melbourne
VIC 3000, Australia


Prepared By: Vincenzo Bassi, Prof Luis-Nando Ochoa, Department of Electrical and Electronic Engineering, The University of Melbourne

Revised By: Prof Luis-Nando Ochoa, Prof Tamer Alpcan, Department of Electrical and Electronic Engineering, Prof Cihan Ozturk, School of Computing and Information Systems (CIS) The University of Melbourne

Contact: Prof Luis-Nando Ochoa
+61 3 9345 4670
luis.ochoa@unimelb.edu.au

Copyright © 2023 V. Bassi, L. Ochoa, T. Alpcan, C. Leekie – The University of Melbourne

✓ Removes time and cost associated with the production of **LV electrical models**
 ✓ Extremely quick alternative to power flow-based techniques

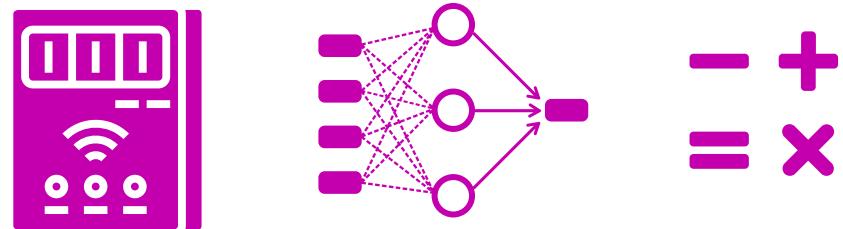



3 Model-Free Applications

3 Model-Free Applications

Jemena Case Study



- **Site:** 1 Distribution transformer with **4 LV circuits**
- **148 Customers:**
 - 110 single-phase
 - 38* three-phase
 - Total of **222** customers for the NN ($|C| = 110 + 2 \times 2 + 36 \times 3$)
- **Resolution:** 5 minutes (P, Q, V)
- **NN Production:** ~3 weeks (Training data)
- **Performance Assessment:** ~Next 3 weeks (Test data)




→ **Objective 1:** Produce a single Neural Network for all 4 LV circuits

→ **Objective 2:** DER Connection Request, DER Hosting Capacity and Operating Envelopes

* 1 phase from 2 three-phase customers were removed due to unfeasible measurements

3 Model-Free Applications

NN Production using Training Data



Hyperparameters and Settings (<u>Recipe</u>)	
Inputs	$2 C = 444$
Outputs	$ C = 222$
Output Act. Function	Linear
Error Function	MSE
Scaler	[0,1]
Optimiser	ADAM
Regularisation	L2
Number of Neurons	$5 C = 1,110$
Activation Function	Tanh
Learning Rate	1e-4
Regularisation Factor	1e-5
Batch Size	Eq. to 6 hours
Epochs	2,000

a 10 NNs are trained from scratch

b Final NN based on RMSE Training



**NN recipe massively reduces the computational time to produce the NN
 → From weeks (hyperparameter exploration) to minutes!**

3 Model-Free Applications

NN Accuracy using Test Data (all 148 Customers)

Model-Free Voltage Calculations Results


RMSE Test [V]	0.64
Av Dev Test [V]	0.48
Max Dev Test [V]	9.86

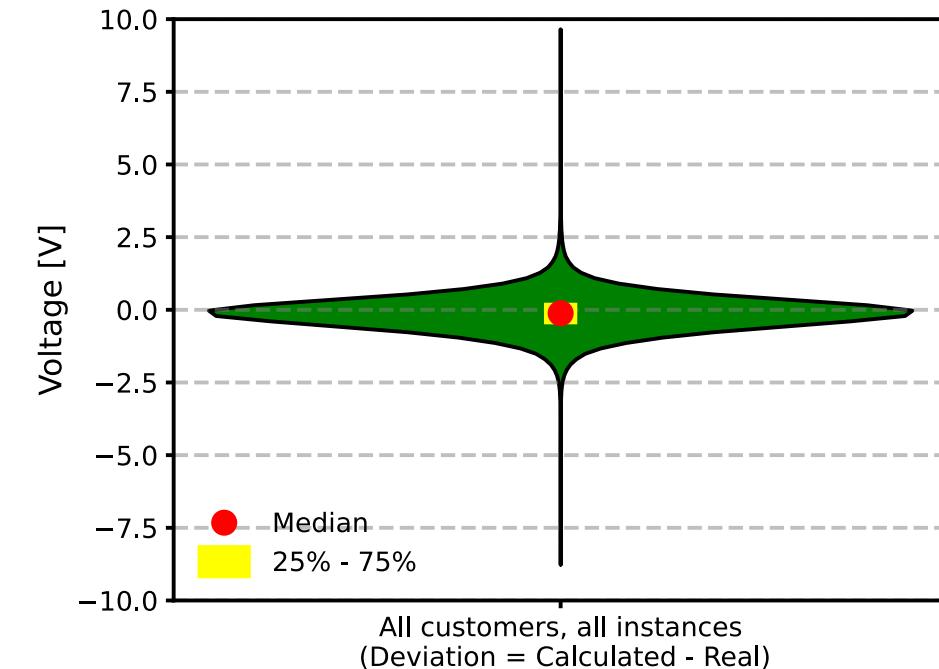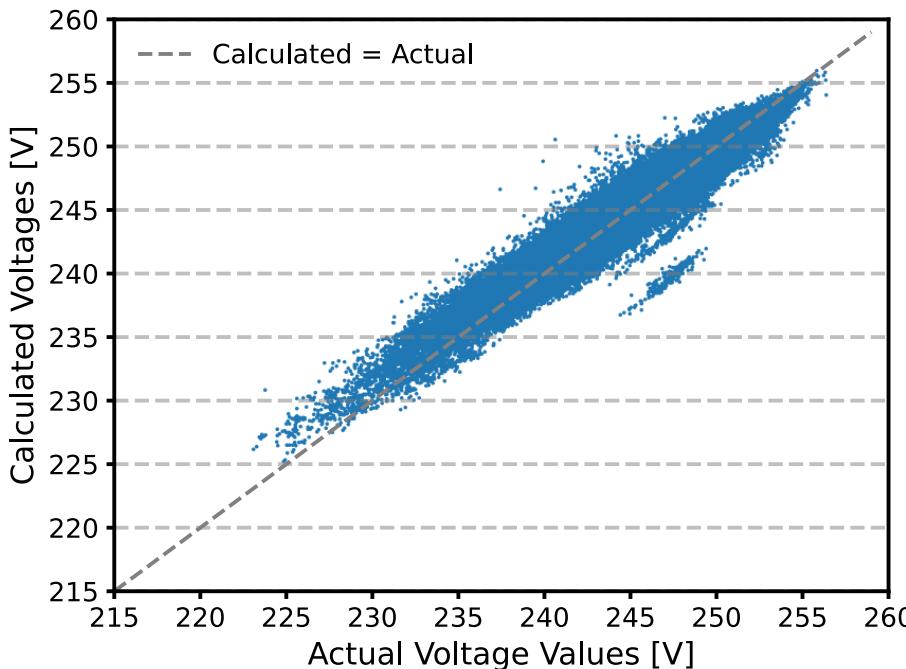

Improved results: Voltage calculations with an avg deviation of less than 0.5 V (out of around 230 V)

3 Model-Free Applications

NN Accuracy using Test Data (all 148 Customers)

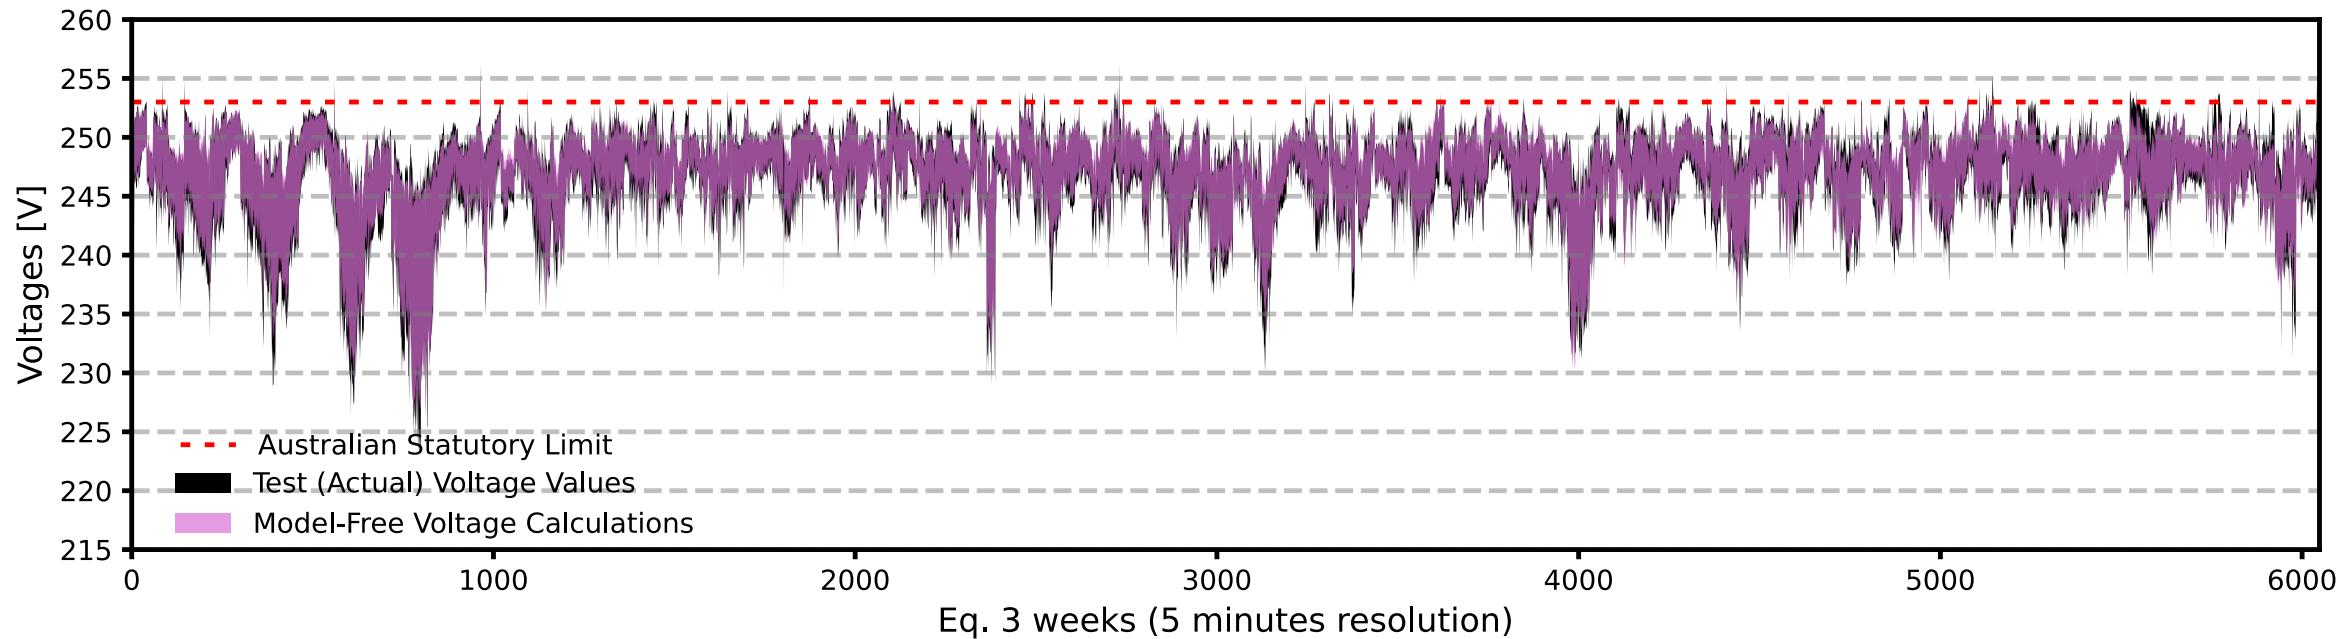

Accurate voltage calculations 😊

3 Model-Free Applications

DER Connection Request

Can a single customer install a 5 kW PV system?

Intensive Assessment using *Monte Carlo*


- Customers with PV $P_{PV} = -5 \text{ kW}$ (*high exports*)
- Single customer being assessed: $P_{PV} = -5 \text{ kW}$ (*high exports*)
- **100 demand scenarios**
 - $P_{Load} = \text{random}(0,1) \text{ kW}$ (*low demand*)
 - $pf = \text{inductive random}(0.90,0.99)$
- **Two cases**
 - **Case 1:** Customer with low voltages (closer to the trafo)
 - **Case 2:** Customer with high voltages (far from the trafo)
- **Check:** Compliance with voltage statutory limits ($\leq 253 \text{ V}$)



Improvement: Active and reactive power can be specified ☺

3 Model-Free Applications

DER Connection Request - Results

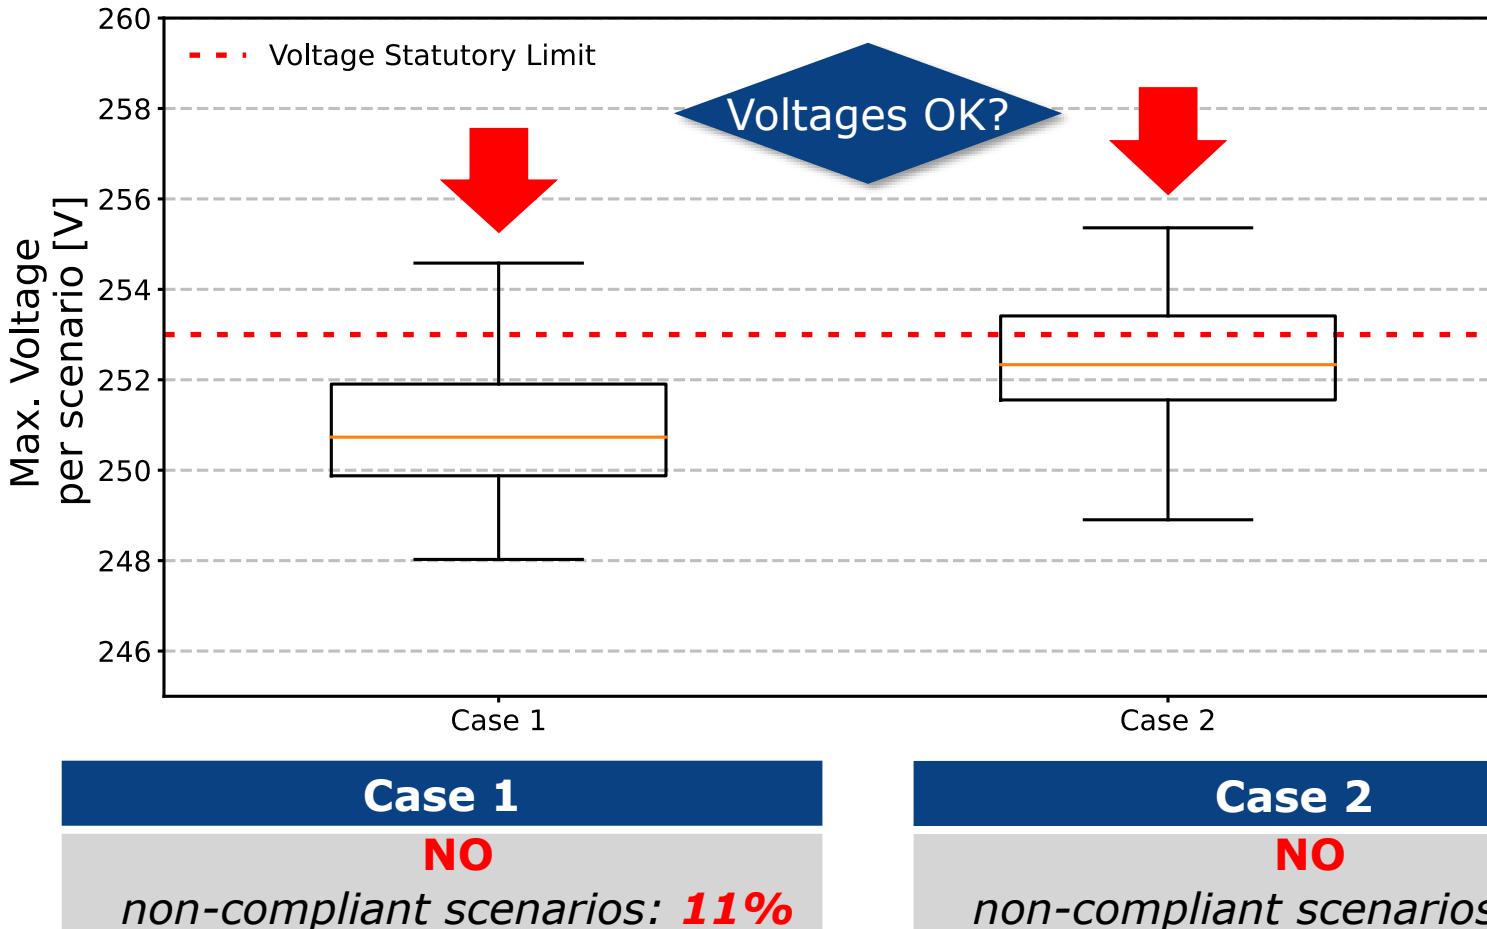

DER connection requests can be assessed extremely fast ☺
(even Monte Carlo is just few seconds)


3 Model-Free Applications

DER Hosting Capacity

How much PV systems the LV network can withstand?

Intensive Assessment using *Monte Carlo*


- Customers already with PV $P_{PV} = -5 \text{ kW}$ (*high exports*)
- 100 PV allocation scenarios
 - Customers installing PV are randomly allocated $P_{PV} = -5 \text{ kW}$ (*high exports*)
 - 100 Demand scenarios (*low demands, same as before*)
- Four progressive PV penetration scenarios
 - ~7% (*current PV*), ~10%, ~15% and ~20% of customers with PV
- **Check:** Compliance with voltage statutory limits ($\leq 253 \text{ V}$)

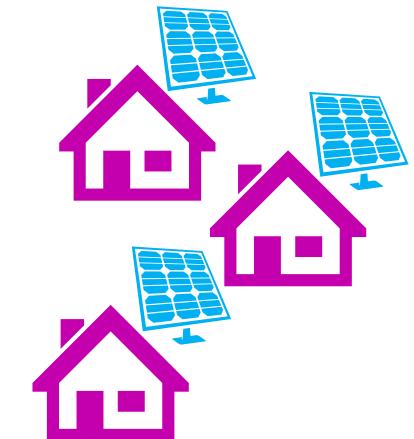

Improvement: Active and reactive power can be specified ☺

3 Model-Free Applications

DER Hosting Capacity - Results

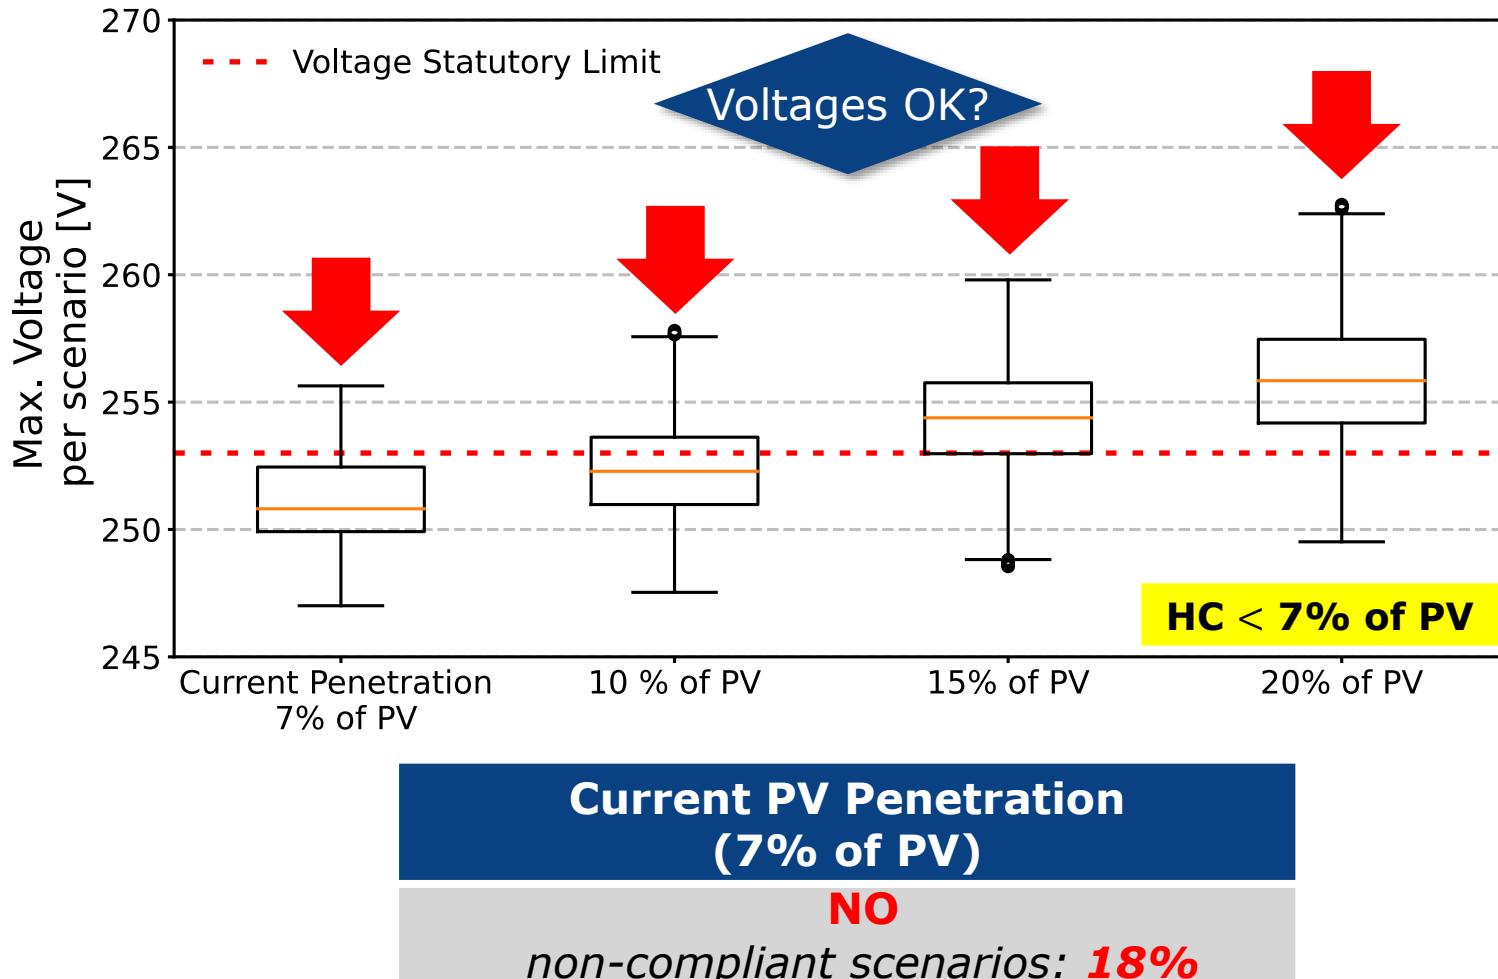

Super quick DER hosting capacity assessments 😊 (a few mins depending on penetrations)


3 Model-Free Applications

Operating Envelopes

How much exports from active customers the LV network can withstand?

Assessment

- OEs are calculated for a single instance (noon)
- Passive customers:
 - Demands (P and Q) from the previous instance (5 mins ago)
- Active customers:
 - ~50% of customers with PV (12) are selected as active customers (6)
 - $P \rightarrow$ Equal opportunity OEs; Progressive assessment of exports
 - $pf = 1$
- **Check:** Compliance with voltage statutory limits (≤ 253 V)

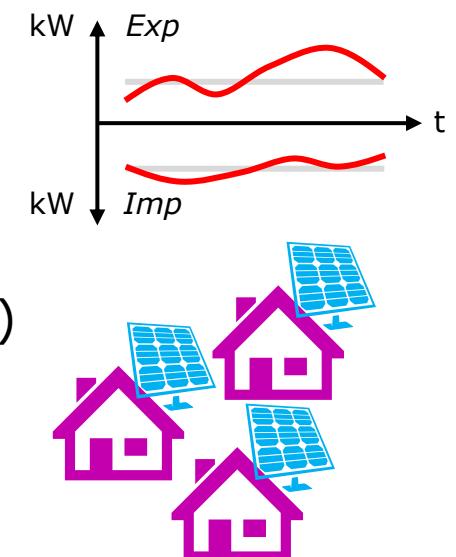

Improvement: Active and reactive power can be specified ☺

3 Model-Free Applications

Operating Envelopes - Results


Voltages OK?

Exports	Max Voltage
0 kW	248.37 V
1 kW	248.89 V
2 kW	249.72 V
3 kW	250.11 V
4 kW	250.75 V
5 kW	251.39 V
6 kW	252.03 V
7 kW	252.66 V
8 kW	253.30 V



OE

Again, super quick OE calculations ☺

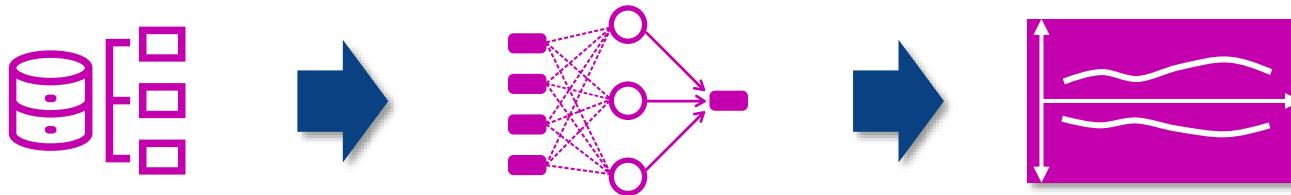

4 Model-Driven vs Model-Free



Our Latest Webinar: [Reactive power and voltage regulation devices to enhance operating envelopes \(Slides\)](#)

Our Latest Paper: [Using OPF-Based Operating Envelopes to Facilitate Residential DER Services](#)


Reports now available: [Operating Envelopes Calculation Architecture](#) and [High-level Assessment of Objective Functions](#)

[Timeline](#)[Resources](#)

<https://electrical.eng.unimelb.edu.au/power-energy/projects/project-edge>


4 Model-Driven vs Model-Free

Unvalidated vs Validated Electrical Model (EDGE AusNet SiteA)

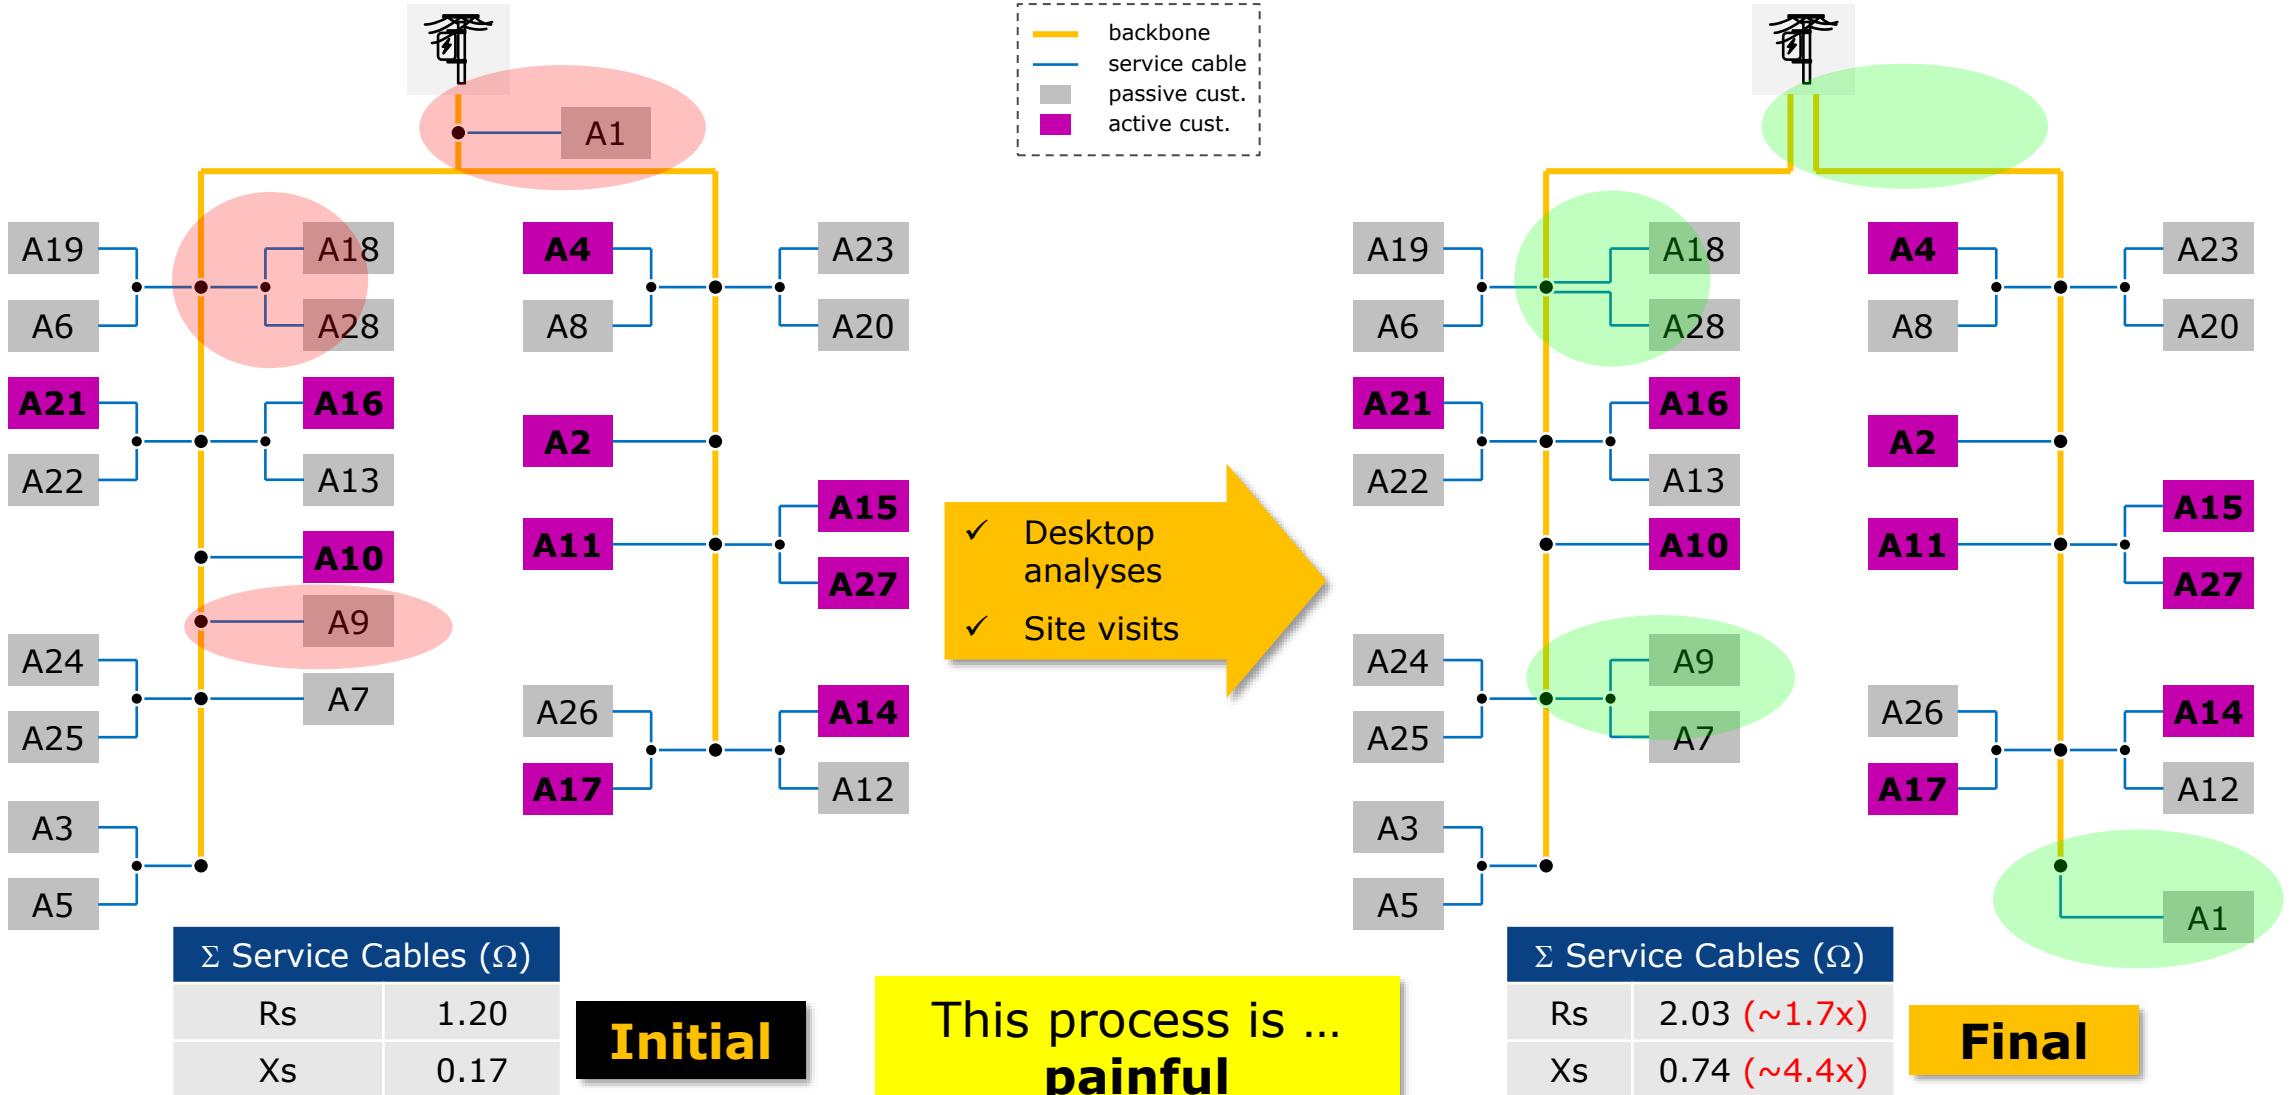

4 Model-Driven vs Model-Free


Unvalidated vs Validated Electrical Model (Voltage Calculations)

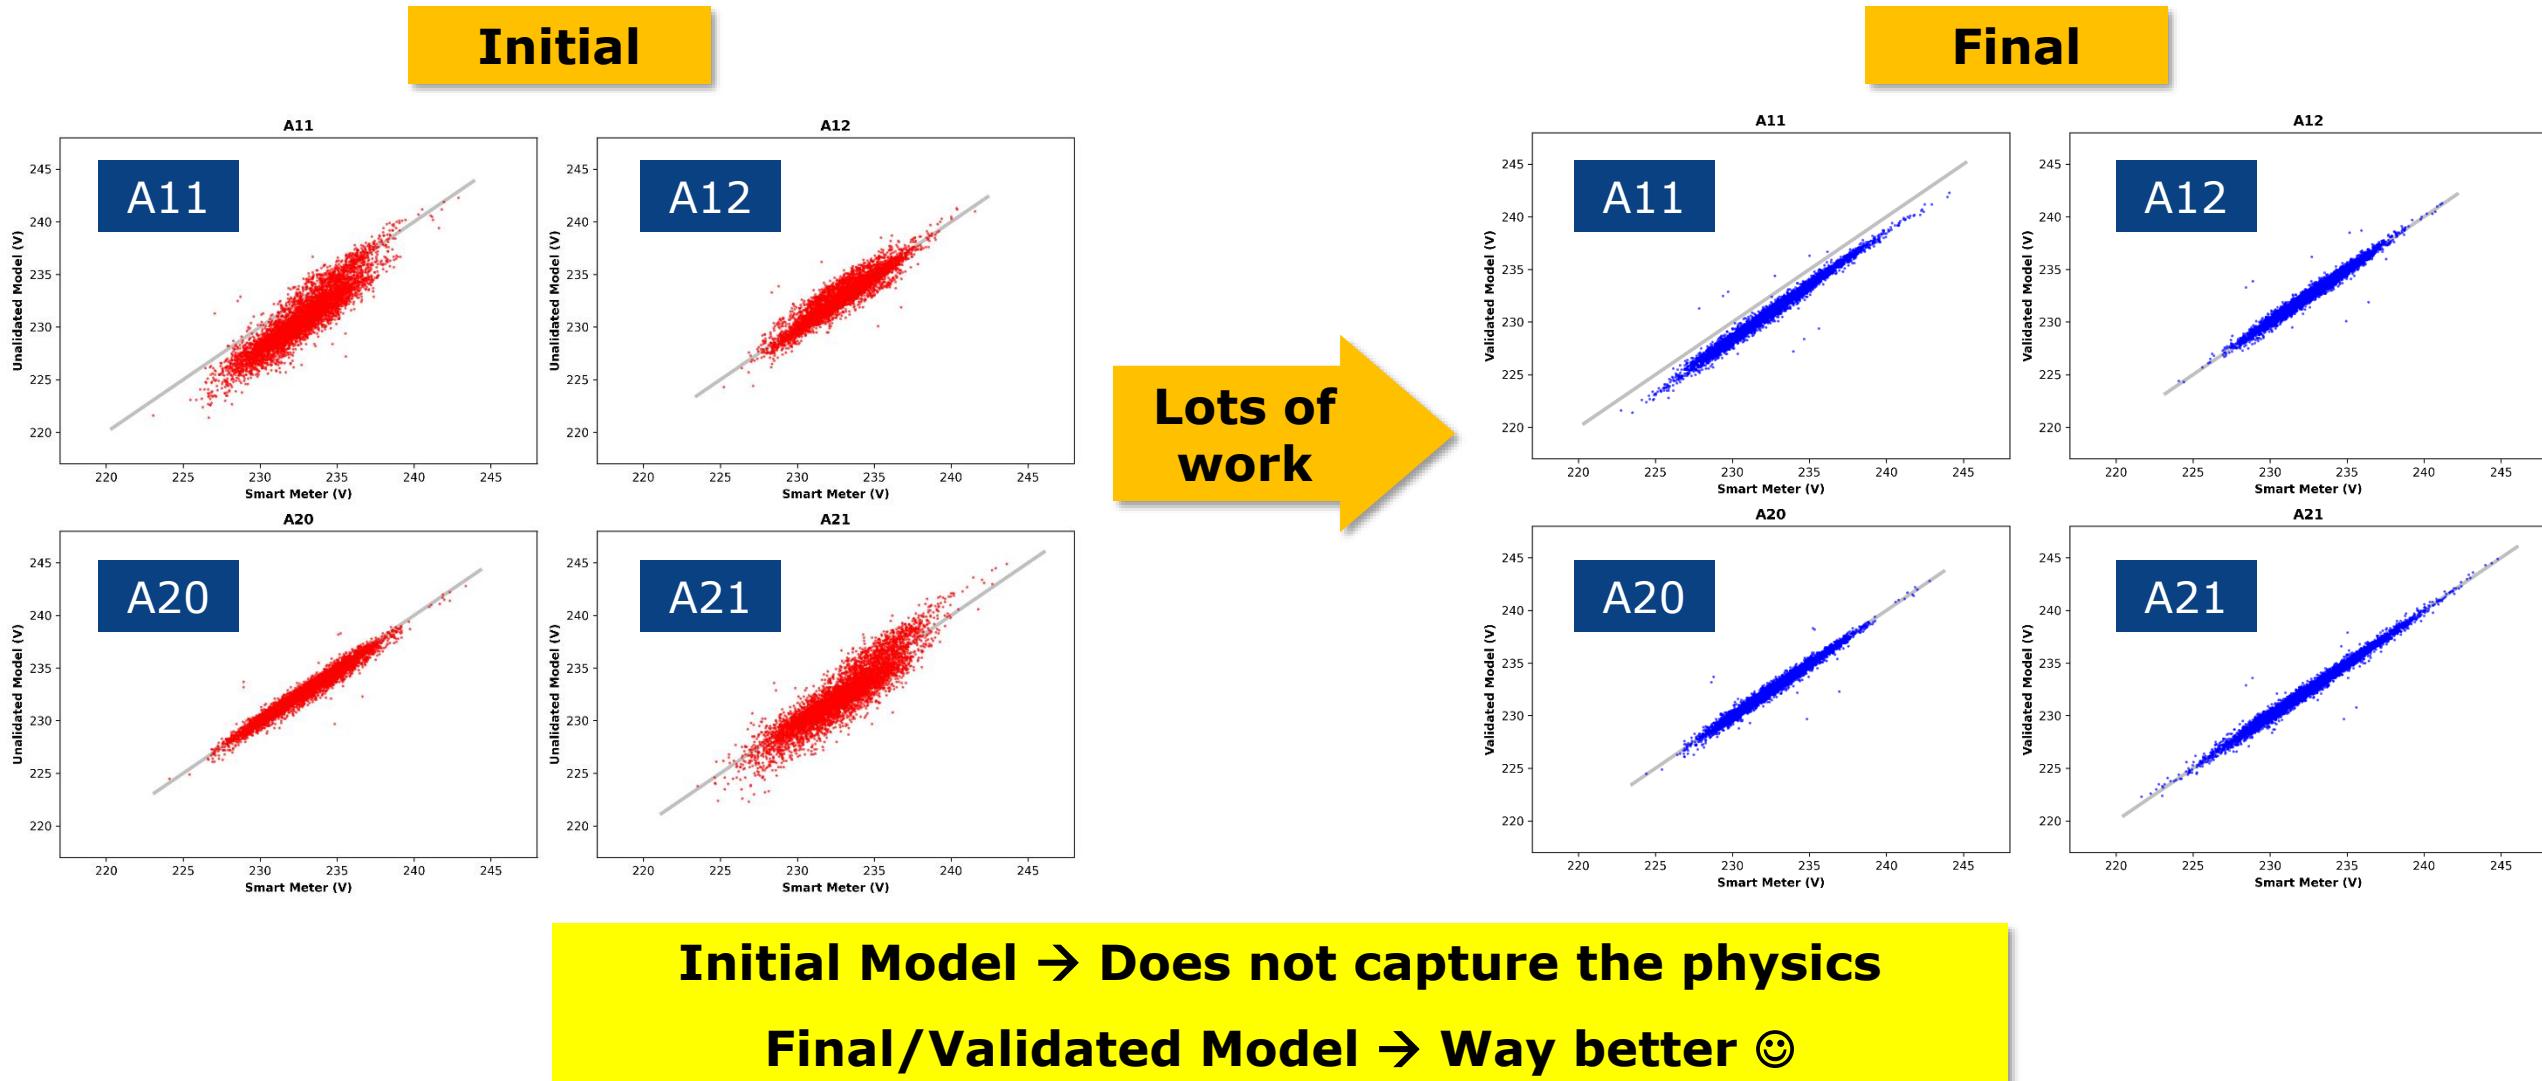

**... but, can we do this in just
minutes instead of weeks?**

4 Model-Driven vs Model-Free

Implementing our Model-Free Approach in EDGE

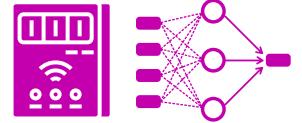

NN Adaptation

- Using smart meter data + head-of-feeder voltage measurements⁵:

$$V = f_{NN}(P, Q, W) \rightarrow V = f_{NN}(P, Q, \textcolor{red}{V_h}, W)$$

Development → Same as before

- **Data Processing**
 - Historical smart meter data + **head-of-feeder voltages** (~6 weeks, 5min)
- **NN Production**
 - Use NN recipe

A very straightforward process ☺


⁵ Deliverable 0: Concept, Smart Meter Data, and Initial Findings, Report, 2022 ([ResearchGate](#))

4 Model-Driven vs Model-Free

Validated Electrical Model vs NN (Voltage Calculations)


Electrical Model

Slow, expensive process

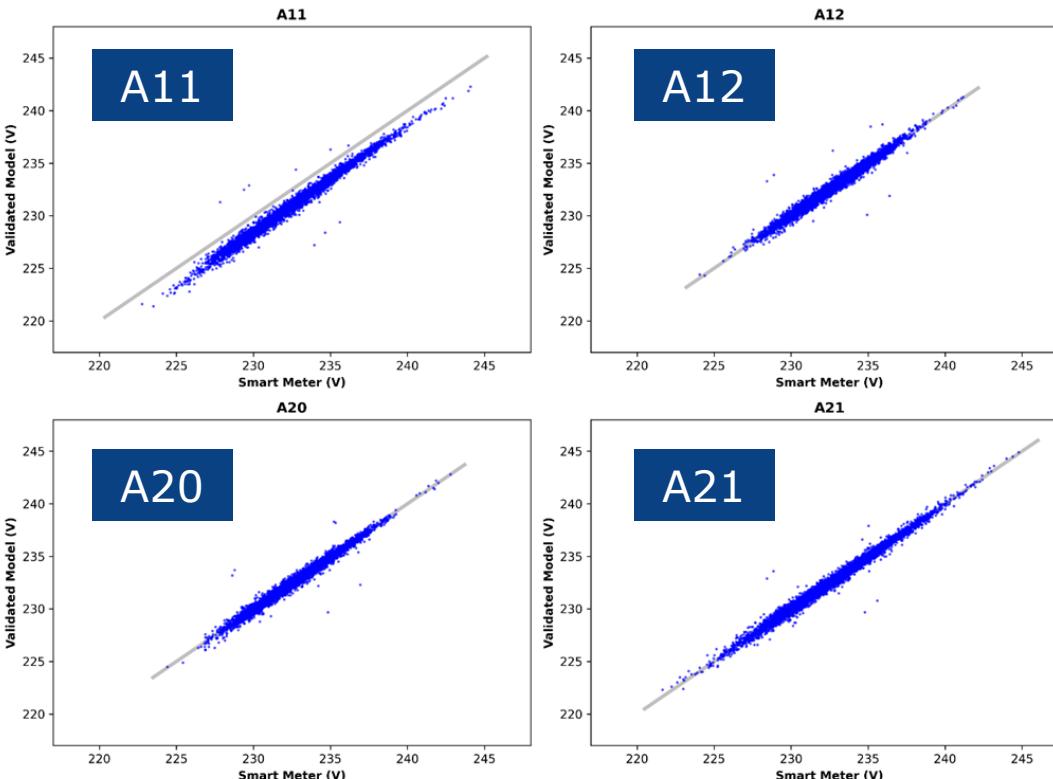

Neural Network



Fast and cheap ☺

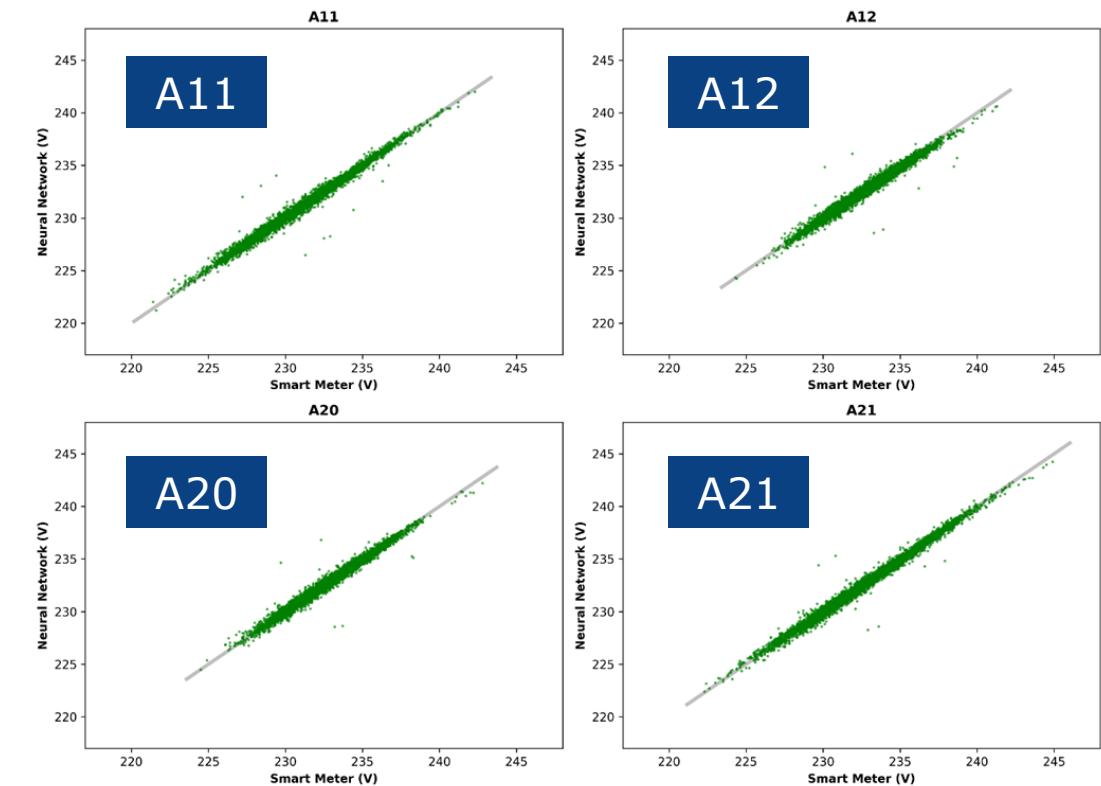

NN outperforms the electrical model!


4 Model-Driven vs Model-Free

OE³s for Site A³ - Model-Driven (Left) vs Model-Free (Right)

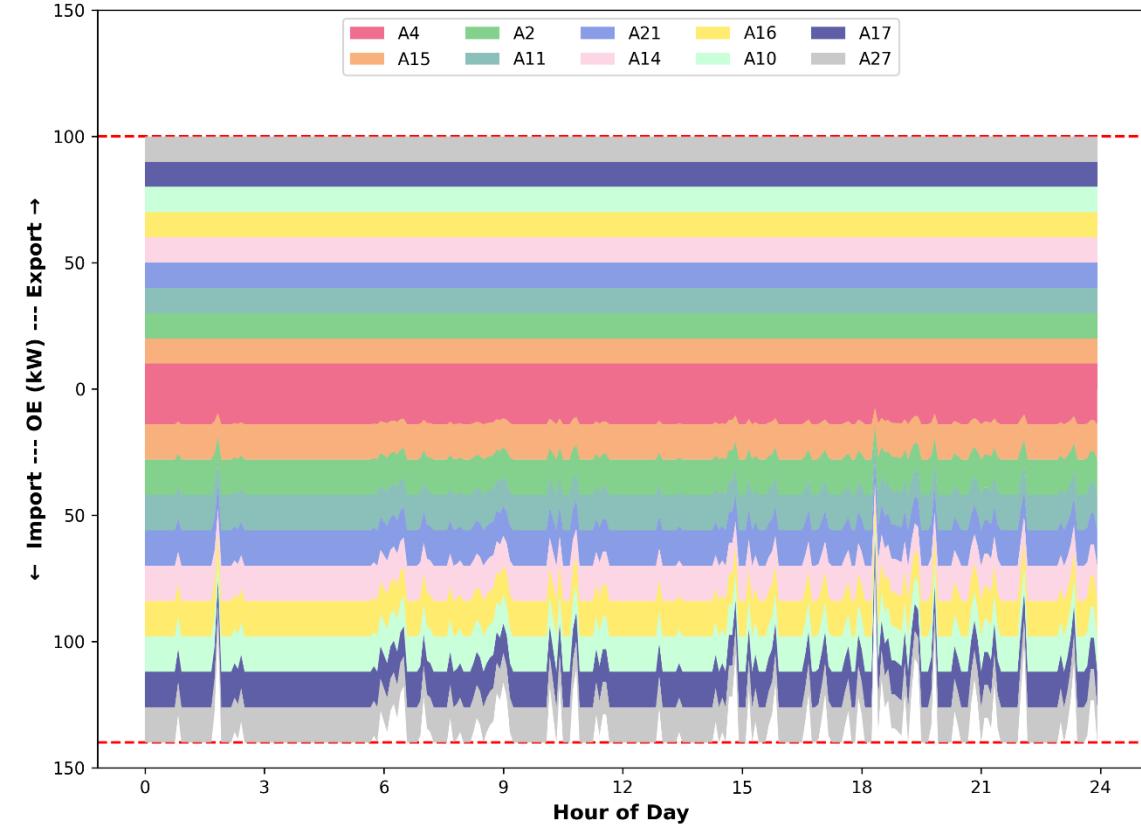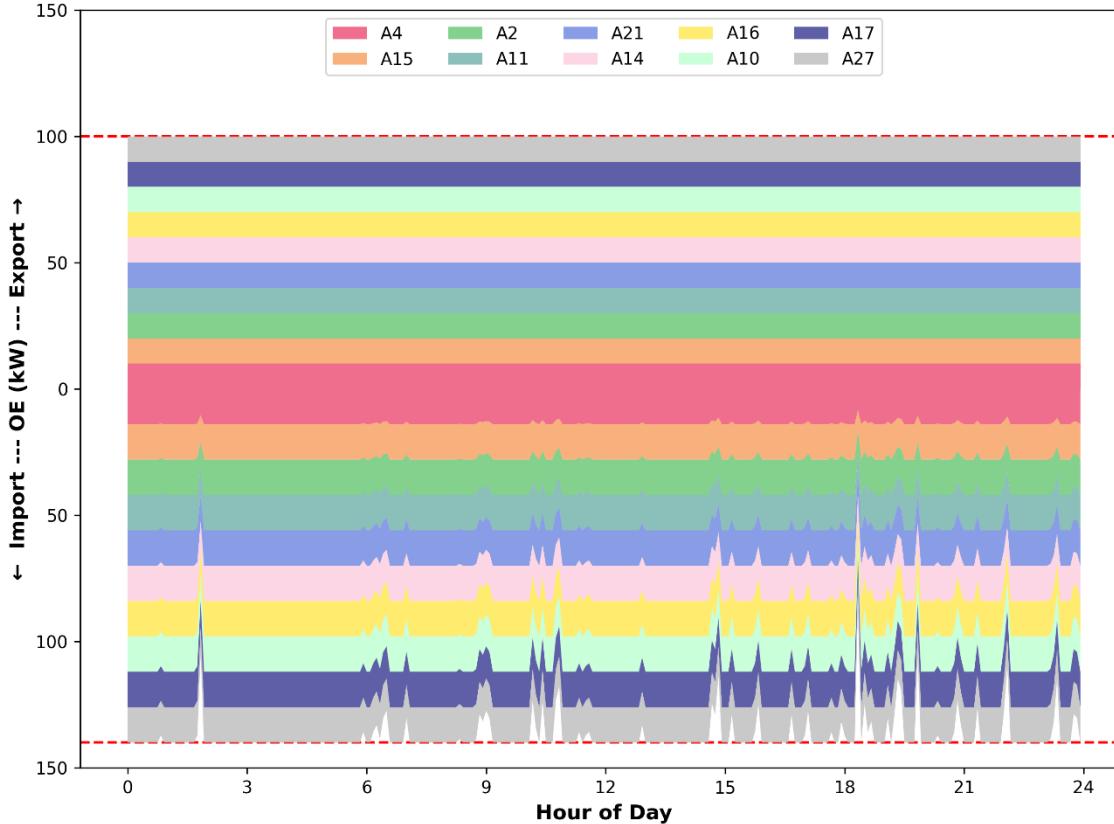


Overall, very consistent performance for both approaches 😊

³Equal opportunity objective function is used; historical data is used as forecasts

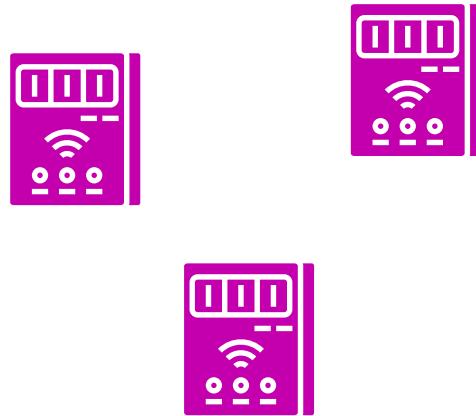

5 Partial Smart Meter Data Availability

5 Partial Smart Meter Data Availability Context

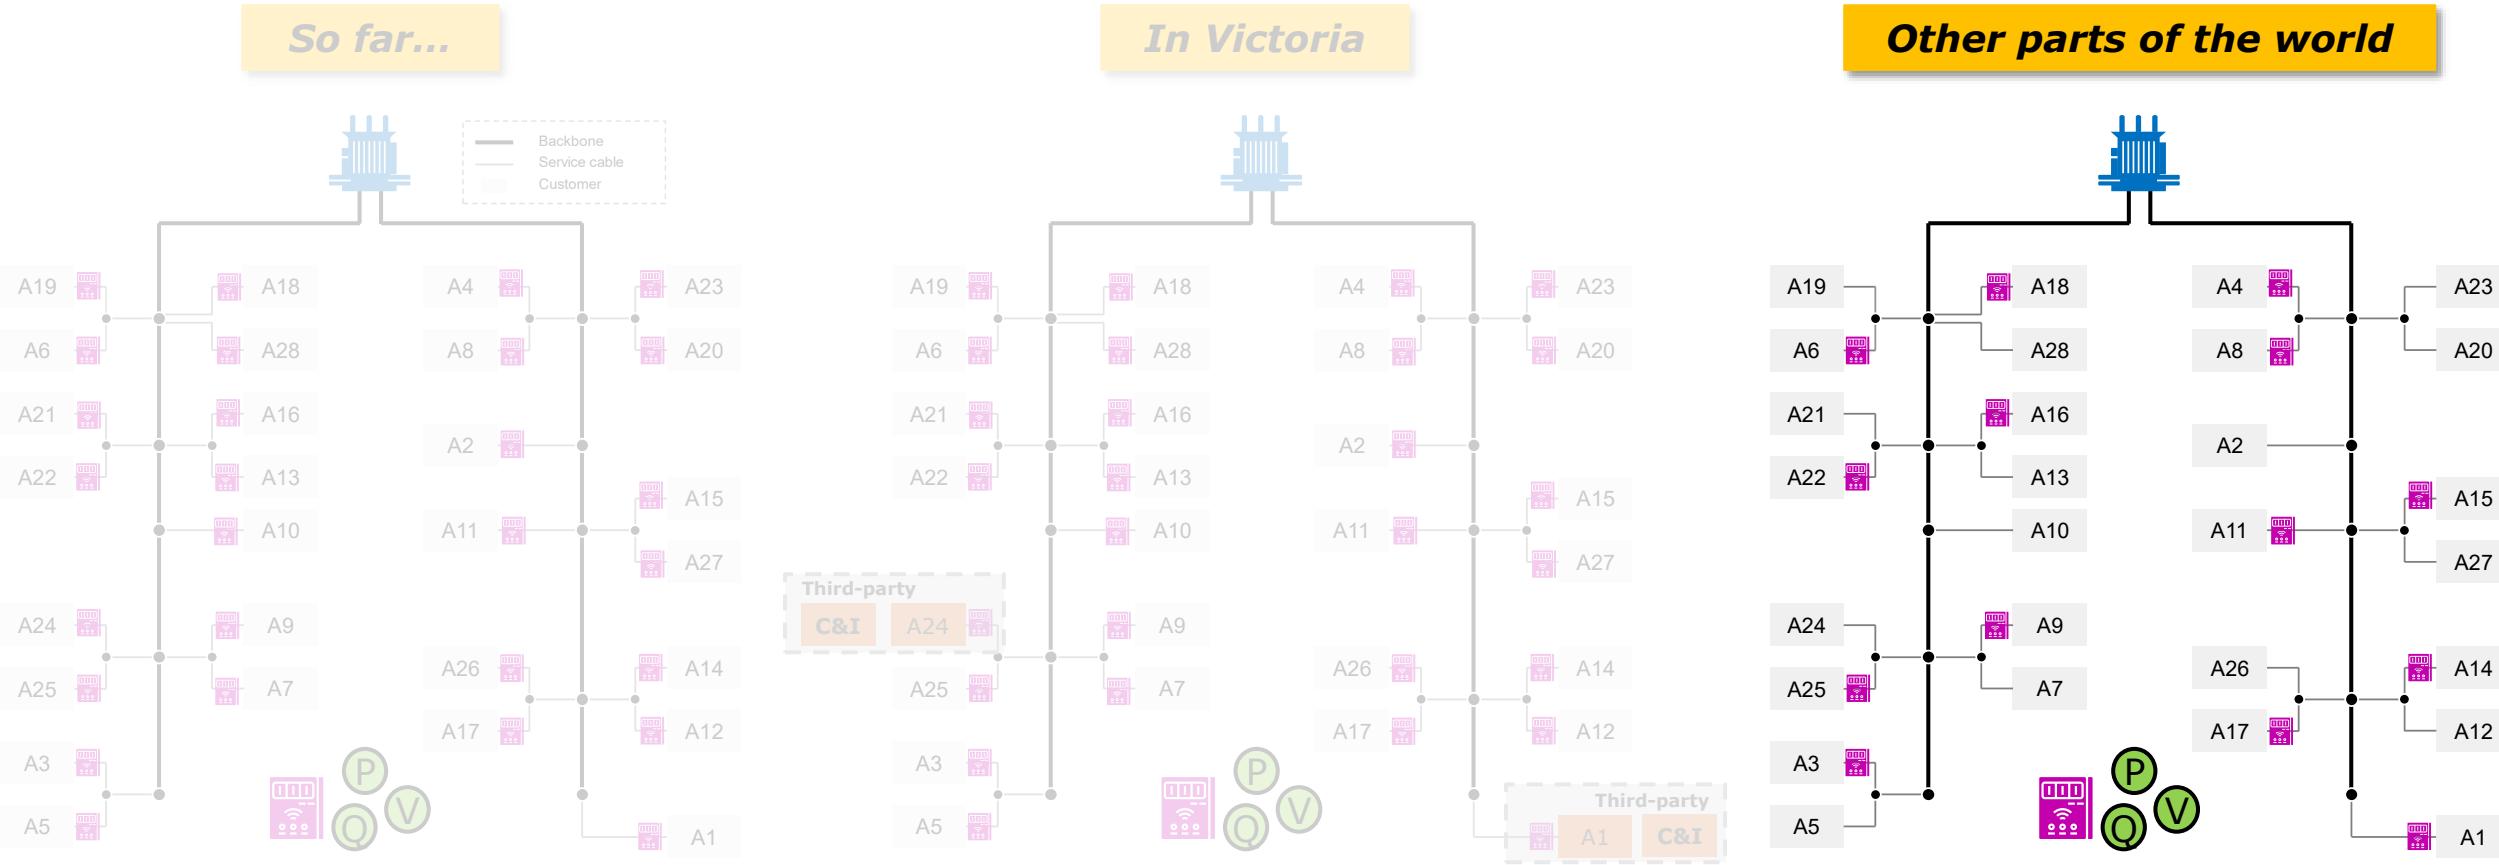

Key Question: Can we use our method when data from all customers is not available?


5 Partial Smart Meter Data Availability

Preliminary Analyses – Overview and Assumptions



Partial vs Full Observability

- Partial: Data from all 3Φ customers is *assumed* unavailable
 - Data is **not used to produce the NN or to assess its performance**
- Full: Data from all customers is available
 - All data is used




Jemena Case Study

- **Site**: 1 Distribution transformer with **4 LV circuits**
- **148 customers**: 110 1Φ and 38* 3Φ
- **NN Production: Resolution**: 5 minutes (P, Q, V)
- **NN Production**: ~3 weeks (Training data)
- **Performance Assessment**: ~Next 3 weeks (Test data)

* 1 phase from 2 three-phase customers were removed due to unfeasible measurements

5 Partial Smart Meter Data Availability

Preliminary Analyses – Results



Scenario	Inputs (Ps and Qs)	Outputs (Vs)	Training data points
Full Observability	$2*(110 + 2*2 + 36*3) = \underline{\underline{444}}$	$110 + 2*2 + 36*3 = \underline{\underline{222}}$	<u>4,027,968</u>
Partial Observability	$110*2 = \underline{\underline{220}}$	<u>110</u>	<u>1,995,840</u>

Almost 50% of the data is not available!


Scenario	RMSE Test [V]	Av Dev Test [V]	Max Dev Test [V]
Full Observability	0.55	0.43	9.70
Partial Observability	0.97	0.76	9.88

Despite the accuracy decrease in the case of partial observability, accurate voltage calculations are obtained in both scenarios ☺


5 Partial Smart Meter Data Availability

Preliminary Analyses – Results

Full Observability

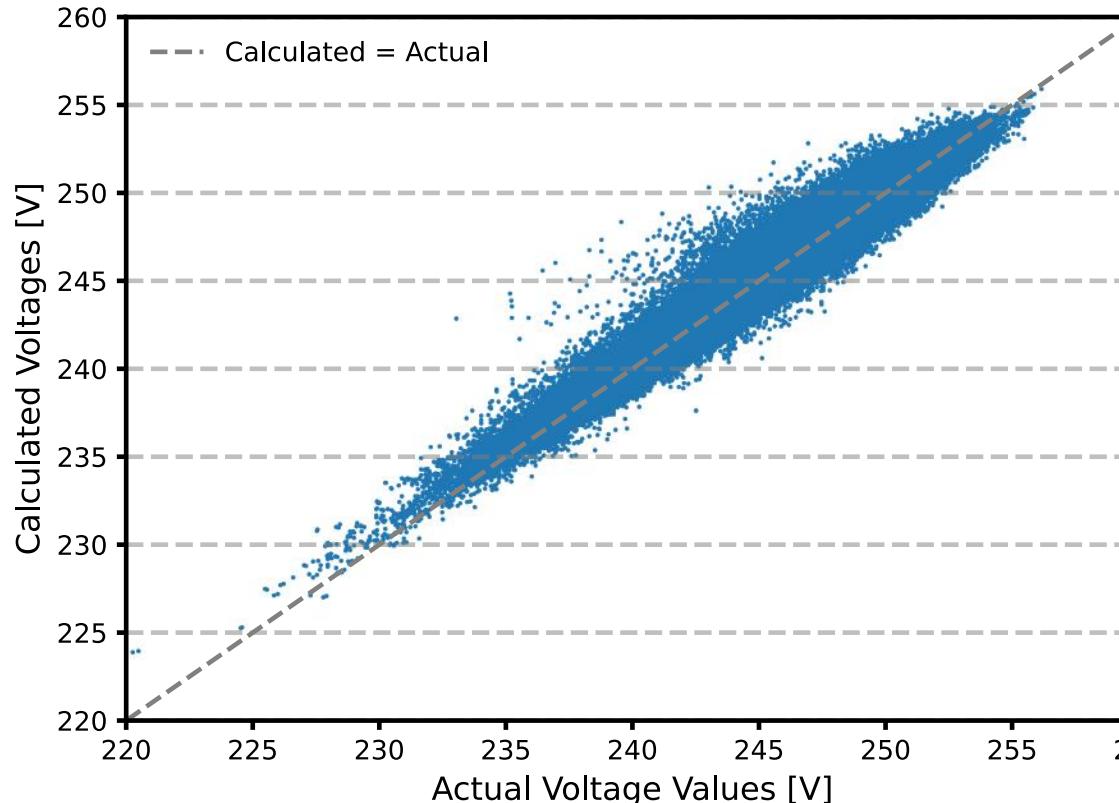

Partial Observability (~50%)

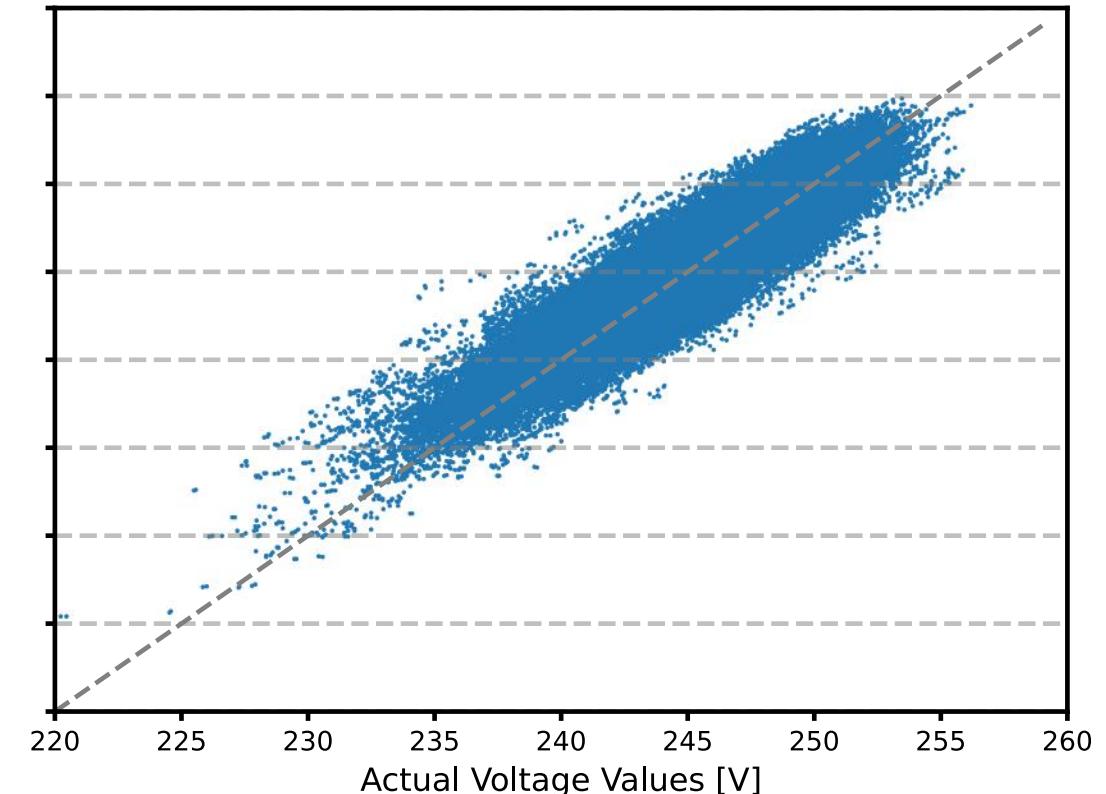

**Accuracy decrease with partial availability (as expected).
But we can still produce accurate voltage calculations 😊**

5 Partial Smart Meter Data Availability

Further Details

- **What about the calculation of OEs?**

- You can find this in our latest report available at [ResearchGate](#)
- Spoiler Alert: **Consistent OEs are obtained ☺**

- **Deliverables 3b-4:** Improved Model-Free Operating Envelopes and Other Considerations

- ✓ Offline Data Pipeline Improvements
- ✓ Operating Envelopes Allocation Technique: Maximise Exports
- ✓ Voltage Regulation Devices
- ✓ Partial Smart Meter Data Availability



Model-Free Operating Envelopes at NMI Level Project
 Deliverables 3b-4: Improved Model-Free Operating Envelopes and Other Considerations
 UniM-C4NET-Model-Free_OEs-D3b-4_v01
 31st January 2023

Title: Deliverables 3b-4: Improved Model-Free Operating Envelopes and Other Considerations

Synopsis: This report builds on the previous two reports (foundations, methodology, and extensive performance tests) and presents improvements and updates on the Project "Model-Free Operating Envelopes at NMI Level". The report presents improvements to the offline data pipeline previously defined, presents an alternative allocation technique to the one previously defined, and discusses how to cater for changes in voltage regulation devices as well as partial smart meter data availability.

Data Document ID: UniM-C4NET-Model-Free_OEs-D3b-4_v01

Date: 31st January 2023

Prepared For: Centre for New Energy Technologies (C4NET)
 Cf-SBC, Level 2, 520 Bourke St, Melbourne
 VIC 3000, Australia

Prepared By: Vincenzo Bassi
 Prof Luis(Nando) Ochoa
 Department of Electrical and Electronic Engineering
 The University of Melbourne

Revised By: Prof Luis(Nando) Ochoa
 Prof Tamer Alpcan
 Department of Electrical and Electronic Engineering
 Prof Christopher Leckie
 School of Computing and Information Systems (CIS)
 The University of Melbourne


Contact: Prof Luis(Nando) Ochoa
 +61 3 9035 4570
 luis.ochoa@unimelb.edu.au

Copyright © 2023 V. Bassi, L. Ochoa, T. Alpcan, C. Leckie – The University of Melbourne



6 Key Remarks

6 Key Remarks




- **A Model-Free future is possible 😊**

- **NNs can capture the physics** of LV networks
- Once the NN is ready, it becomes an **alternative to calculate voltages**
 - **Extremely quick** (many times faster than power flows) to assess **DER connection request DER Hosting Capacity, Operating Envelopes, etc.**
- NN can even **outperform** good electrical models
- **Minimum data needed?** 3 weeks (5-min res) and (potentially) ~50% of data/customers


- *Some Challenges Remain*

- **Reactive power** still bring some headaches
- **Topological changes?** → NN needs updating (same for any electrical model)
 - But a NN could flag this change
- **SWER networks?** → Tricky but not impossible



Further Reading

▪ Our Project

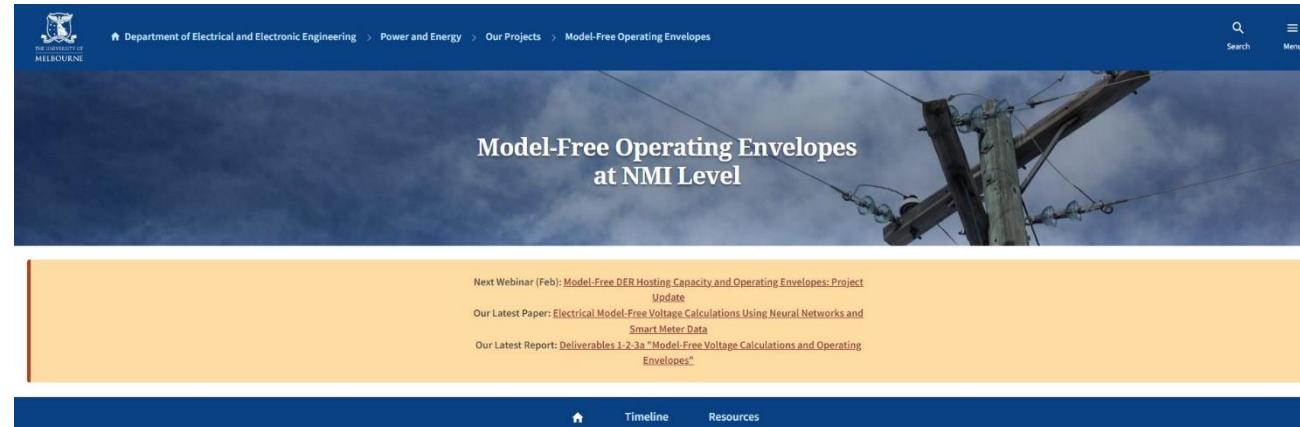

<https://electrical.eng.unimelb.edu.au/power-energy/projects/model-free-operating-envelopes>

▪ Latest Publications

Electrical Model-Free Voltage Calculations Using Neural Networks and Smart Meter Data, IEEE Trans. on Smart Grid ([ResearchGate](#))

Deliverable 3b-4: Improved Model-Free Operating Envelopes and Other Considerations, Report, 2023 ([ResearchGate](#))

Deliverable 1-2-3a: Model-Free Voltage Calculations and Operating Envelopes, Report, 2022 ([ResearchGate](#))

Deliverable 0: Concept, Smart Meter Data, and Initial Findings, Report, 2022 ([ResearchGate](#))

Model-Free Voltage Calculations for PV-Rich LV Networks: Smart Meter Data and Deep Neural Networks, IEEE PES PowerTech 2021 ([ResearchGate](#))

Calculating Voltages Without Electrical Models: Smart Meter Data and Neural Networks, CIRED 2021 ([ResearchGate](#))

Thanks! Questions?

luis.choa@, v.bassizillmann@, tansu.alpcan@ and caleckie@unimelb.edu.au

Acknowledgement



- John Theunissen
- Tobie DeVilliers
- Thanh Bui



- Melbourne Energy Institute