

## Trainings ▾


### Inspect for Reuse

Supplemental coolant additives, or equivalent, are used to prevent the buildup of corrosion and scale deposits in the cooling system.



#### ⚠ CAUTION ⚠


**Inadequate concentration of coolant additives can result in major corrosive damage to cooling system components. Over-concentration can cause the formation of gelatin (gel) that can cause restrictions and plugging.**

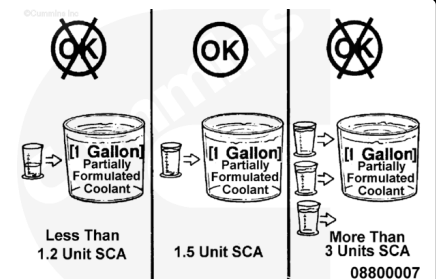


The SCA concentration **must not** fall below 1.2 units per 3.8 liters [1 gal], or exceed 3 units per 3.8 liters [1 gal].

When changing the coolant, the initial SCA, or equivalent concentration, **must** be between 1.2 and 3 units per 3.8 liters [1 gal] of coolant (initial charge).

**Note :** The cooling system **must** be clean before adding SCA or equivalent. Refer to Procedure 008-018 (</qs3/pubsys2/xml/en/procedures/20/20-008-018-tr.html>).

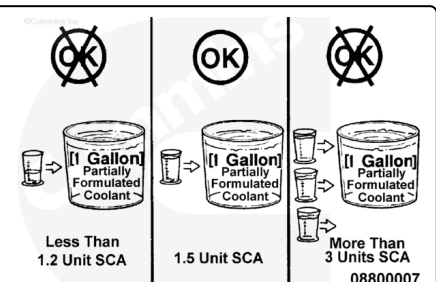

**Note :** DCA4 is compatible with all permanent-type antifreeze except Methoxy Propanol. If Methoxy Propanol antifreeze is used, reduce the amount of DCA4 by one-third. This will prevent inhibitor loss due to precipitation, caused by chemical incompatibility.

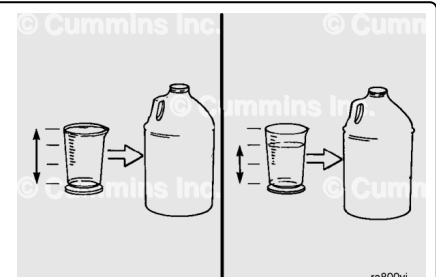


If coolant is added between drain intervals, additional SCA, or equivalent, will be required.

Check the coolant just before changing the coolant filter.

Use only coolant test kit, Fleetguard®, Part Number CC2602, to check the coolant additive concentration when SCA is used.

Refer to Procedure 018-004

(</qs3/pubsys2/xml/en/procedures/102/102-018-004.html>) in the QSK19 Series Operation and Maintenance Manual, Bulletin 3666120.

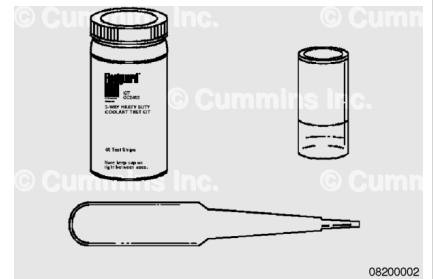

Use the correct Fleetguard® coolant filter to maintain the correct SCA concentration in the system. Procedure 018-004 (</qs3/pubsys2/xml/en/procedures/102/102-018-004.html>) in the QSK19 Series Operation and Maintenance Manual, Bulletin 3666120.

Maintain the correct concentration by changing the maintenance coolant filter at each oil drain interval.

