


Fault Code: 346

Engine Control Module Calibration Memory Software - Bad Intelligent Device or Component

 Printable Version

Overview

Codes	Reason	Effect
Fault Code: 346 PID(P): S253 SPN: 630 FMI: 12/12 Lamp: Amber SRT:	Bad intelligent device or component has been detected.	Data stored during power down is lost.

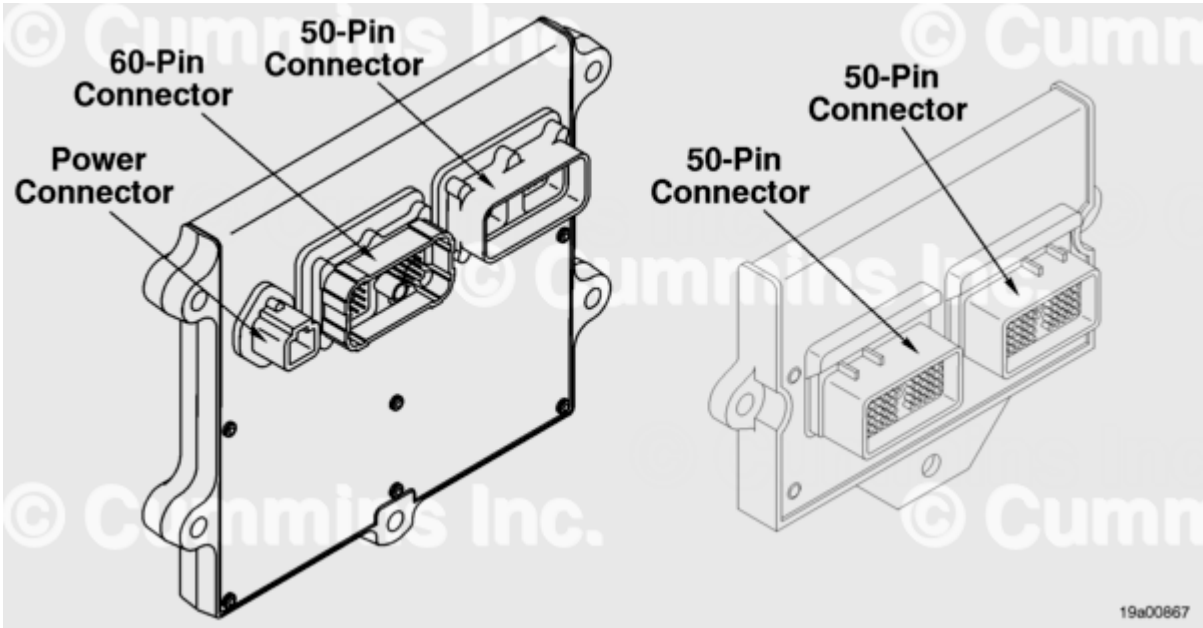

Engine Control Module (ECM)

Circuit Description

The Engine Control Module (ECM) is a computer that is responsible for engine control, diagnostics, and user features.

Component Location

The Engine Control Modules (ECM) are located on a plate that is above the flywheel housing.

Conditions For Running The Diagnostics

This diagnostic runs continuously when the generator set controller is active.

Conditions For Setting The Fault Codes

The Engine Control Module (ECM) detected a power interruption to the ECM.

Action Taken When The Fault Code Is Active

- The generator set controller displays a warning fault immediately when the diagnostics runs and fails.

Conditions For Clearing The Fault Code

- To validate the repair, start the engine and let it run for 1 minute at no load.
- The generator set controller will turn off the warning indicator immediately after the user presses reset.
- The "Reset All Faults" command in the recommended Cummins® electronic service tool or equivalent can be used to clear active faults.

Shoptalk

If a battery disconnect switch is turned OFF after the keyswitch is turned OFF, but before the ECM completely powers down (up to 30 seconds), this fault can register.

Possible causes of this fault code include:

- Loss of voltage to the ECM
- Malfunctioning or damaged engine wiring harness.
- Malfunctioning or damaged OEM wiring harness.
- Internal ECM failure.

Refer to Troubleshooting Fault Code 346 . (</qs3/pubsys2/xml/en/procedures/60/60-t05-346.html>)