

Trainings ▾

Reset


with Mechanically Actuated Injector

CENSE™ data **must** be reset every 250 hours in order to maintain maximum memory capacity.

For CENSE™ CM530 modules **only**, the data **must** be reset every 250 hours in order to maintain maximum memory capacity.

1. First retrieve the CENSE™ data that has been saved.
2. Select the fault codes and trend data options for resetting.

Contact a Cummins ® Authorized Repair Location for detailed instructions.

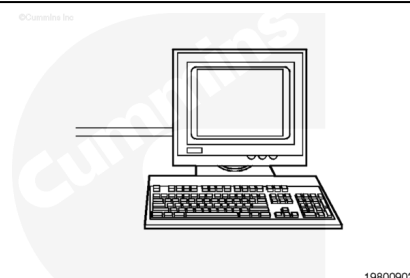

with Electronically Actuated Injector

These engines do **not** use CENSE™. Instead, they have advanced engine monitoring built into the ECMs. This data does **not** need to be reset because it will automatically write over the oldest data if the memory capacity becomes full. However, this memory can be cleared manually using INSITE™ electronic service tool. Fault logs **must** be viewed every 250 hours even if they are **not** going to be reset.

Note : CENSE™ CM2330 modules do **not** need to be reset.

