


Fault Code: 1444

Kilowatt Overload - Alternator Protection

 Printable Version

Overview

Codes	Reason	Effect
Fault Code: 1444 PID(P): SPN: FMI: Lamp: Warning SRT:	The kilowatt has reached overload.	No action is taken by the ECM.

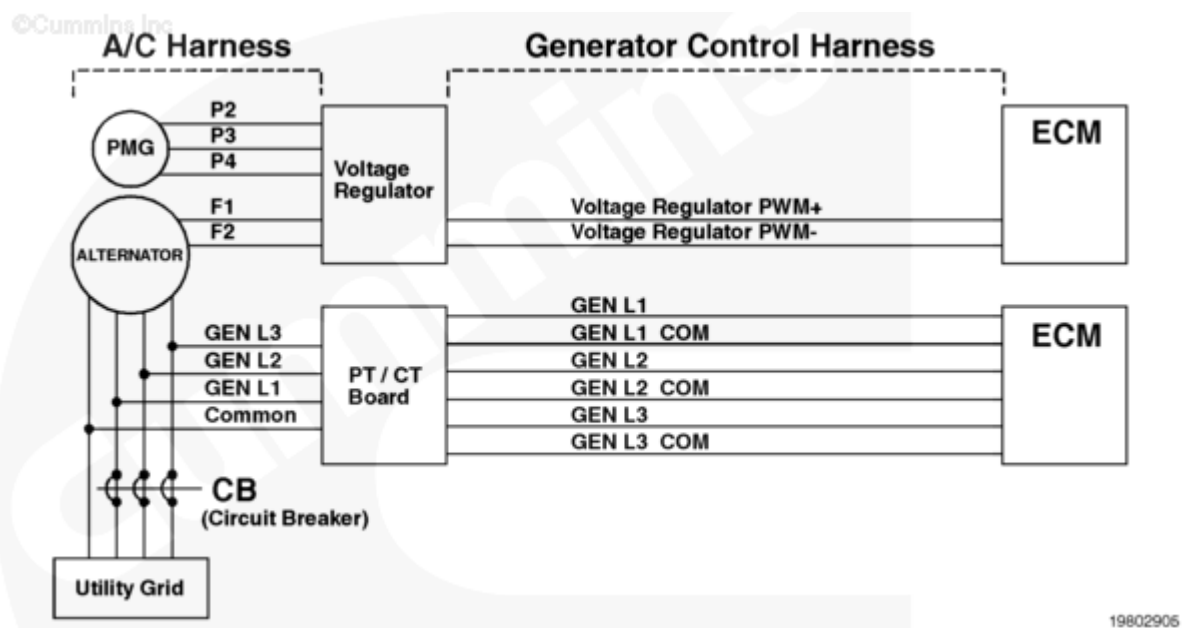

Generator Circuit

Circuit Description

The generator set produces electric power. When the generator is connected to the bus, it can be governed by adjusting the kilowatt load or the kVAR load. The engine control module (ECM) monitors the three-phase generator output. The threshold for kilowatt overload is 115 percent of rated power output. The ECM uses this fault code to inform the operator that the kilowatt load is too high for the engine and needs to be reduced.

Component Location

Refer to Section E for location of the alternator.

Refer to customer/facility/installation documentation for diagrams on the generator set/electric bus setup.

Shoptalk

Check the load and load lead connections.

Refer to Troubleshooting Fault Code t05-1444. (</qs3/pubsys2/xml/en/procedures/01/01-t05-1444.html>)

Last Modified: 08-May-2012
