

## Fault Code: 1465


### Generator Set Ready to Accept Load

 Printable Version

#### Overview

| Codes                                                                   | Reason                                                                             | Effect                         |
|-------------------------------------------------------------------------|------------------------------------------------------------------------------------|--------------------------------|
| Fault Code: 1465<br><br>PCODE(P):<br>SPN:<br>FMI:<br>Lamp: None<br>SRT: | The generator announces to the LonWorks network that it is "ready to accept load". | No action is taken by the ECM. |

©Cummins Inc

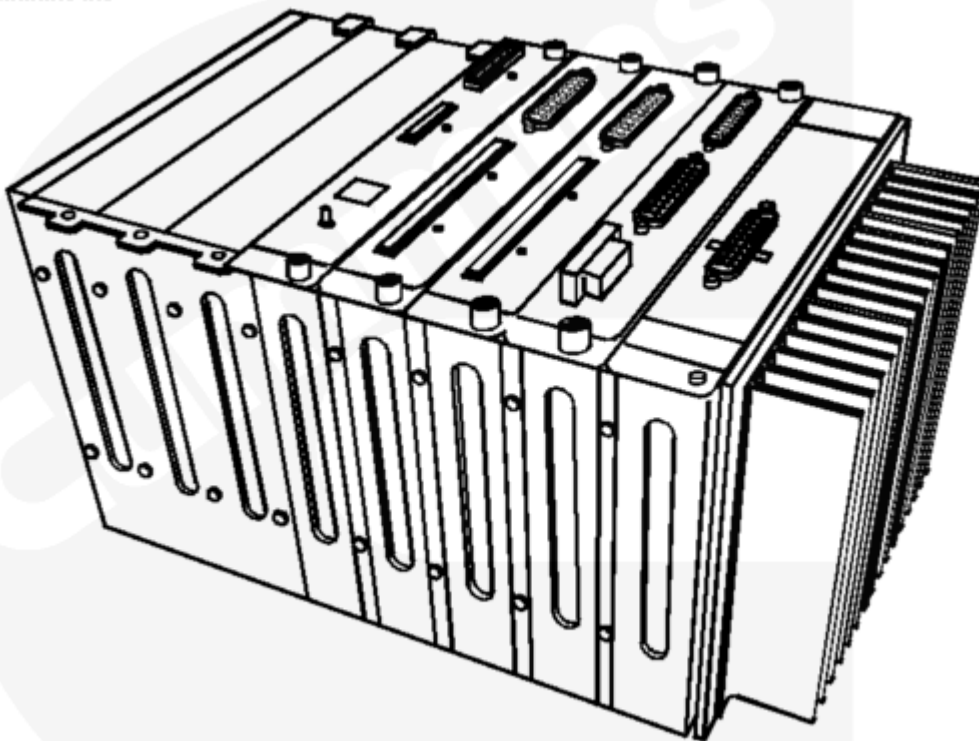

19802649

Generator Set ECM Card Cage

#### Circuit Description

## Component Location

Refer to Troubleshooting Fault Code t05-1465 (/qs3/pubsys2/xml/en/procedures/01/01-t05-1465.html)

---

**Last Modified: 29-Jul-2010**

---