


Fault Code: 1493

Operator Interface Panel Power Relay Driver Diagnostic

 Printable Version

Overview

Codes	Reason	Effect
Fault Code: 1493 PID(P): SPN: FMI: Lamp: Warning SRT:	Operator interface panel power relay driver diagnostic has detected an error.	Operator interface panel will not function correctly. No action taken by ECM. No loss of performance.

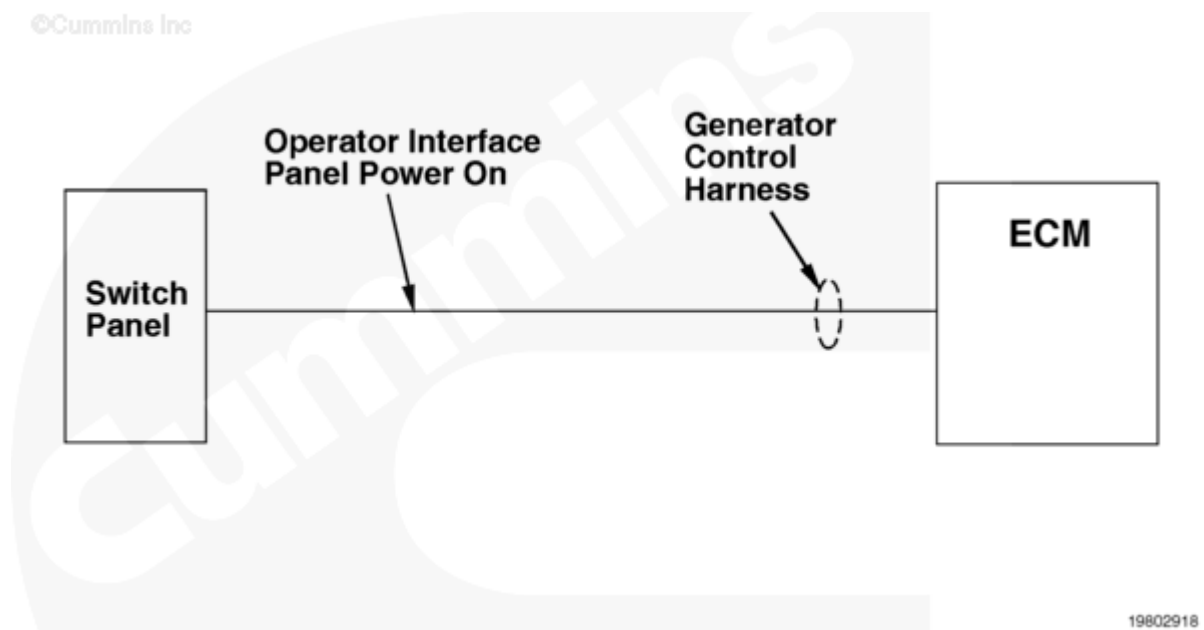

Operator Interface Panel Power Relay Driver Circuit

Circuit Description

The ECM checks the operator interface panel power relay driver to ensure correct operation. The ECM uses the operator interface panel to inform the operator about generator set operation, performance, setup, and diagnostics. The ECM monitors the voltage (no voltage increase will trip Fault Code 1493) caused by short circuits, open circuits, or failed operator interface panel power relay driver in the ECM.

Component Location

Refer to section E for location of the operator interface panel.

Shoptalk

Possible failure modes are open circuits, short circuits, short to ground, and loss of supply voltage inside the ECM.

Refer to Troubleshooting Fault Code t05-1493 (</qs3/pubsys2/xml/en/procedures/01/01-t05-1493.html>)

Last Modified: 29-Jul-2010
