


Trainings ▾

Maintenance Check

Industrial Applications

Check the cooling fan belt tensioner arm, spring, and pulley for cracks and other damage.

Rotate the pulley to check for rough bearings.

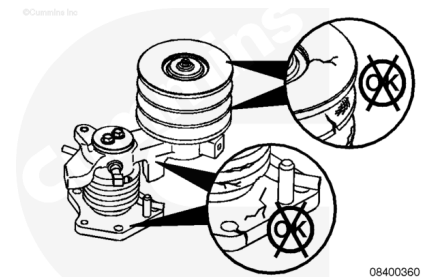


Power Generation

Check the cooling fan belt tensioner damage or deterioration.

Check the adjustable tensioner for cracks and broken bolts.

Rotate the pulley to check for rough bearings.

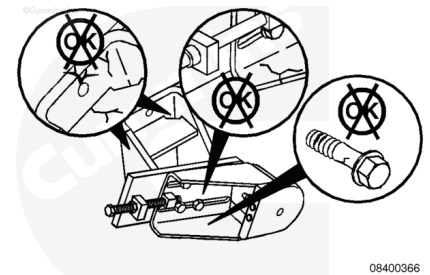


Maintenance Check

Industrial Applications

Use high performance, general purpose industrial-type grease (NLGI Grade No. 2) Chevron™ SRI Grease 2 or Mobilux™ EP 2 grease, or its equivalent.

If above greases are **not** available locally, contact a Cummins® Distributor for advice on other Cummins® approved equivalents.

Apply grease to the fitting on the tensioner until grease appears at the overflow valve.

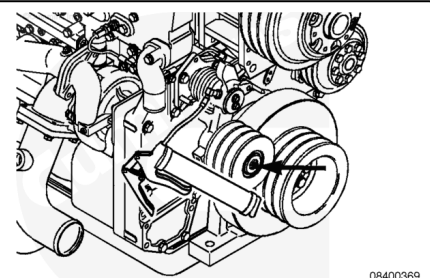

Power Generation

Use high performance, general purpose industrial-type grease (NLGI Grade No. 2) Chevron™ SRI Grease 2 or Mobilux™ EP 2 grease, or its equivalent.

If above greases are **not** available locally, contact a Cummins® Distributor for advice on other Cummins® approved equivalents.

Apply grease to the fitting on the tensioner until grease appears at the overflow valve.

