


	1	2	3	4	5	6	7	8	
A									A
B	page	Description	Version	Remark	page	Description	Version	Remark	
	1	DOCUMENT LIST	AA		24	H2/P2 INVERTER CUBICLE 660~690V 1000KW	AA		
	2	INCOMING CUBICLE 660~690V 1200KW AFE(MASTER)	AA		25	H2/P2 INVERTER CUBICLE 660~690V 1000KW	AA		
	3	INCOMING CUBICLE 660~690V 1200KW AFE(MASTER)	AA		26	H2/P2 INVERTER CUBICLE 660~690V 1000KW	AA		
	4	INCOMING CUBICLE 660~690V 1200KW AFE(MASTER)	AA		27	H2/P2 INVERTER CUBICLE 660~690V 1000KW	AA		
	5	INCOMING CUBICLE 660~690V 1200KW AFE(MASTER)	AA		28	S INVERTER CUBICLE 660~690V 1000KW	AA		
C	6	FILTER CUBICLE 660~690V 1200KW AFE(MASTER)	AA		29	S INVERTER CUBICLE 660~690V 1000KW	AA		
	7	RECTIFIER/REGENERATIVE CUBICLE 660~690V 1200KW AFE(MASTER)	AA		30	S INVERTER CUBICLE 660~690V 1000KW	AA		
	8	RECTIFIER/REGENERATIVE CUBICLE 660~690V 1200KW AFE(MASTER)	AA		31	C INVERTER CUBICLE 660~690V 630KW	AA		
	9	RECTIFIER/REGENERATIVE CUBICLE 660~690V 1200KW AFE(MASTER)	AA		32	C INVERTER CUBICLE 660~690V 630KW	AA		
	10	RECTIFIER/REGENERATIVE CUBICLE 660~690V 1200KW AFE(MASTER)	AA		33	C INVERTER CUBICLE 660~690V 630KW	AA		
	11	INCOMING CUBICLE 660~690V 1200KW AFE(SLAVE)	AA		34	TEXT DESCRIPTION	AA		
D	12	INCOMING CUBICLE 660~690V 1200KW AFE(SLAVE)	AA						
	13	INCOMING CUBICLE 660~690V 1200KW AFE(SLAVE)	AA						
	14	INCOMING CUBICLE 660~690V 1200KW AFE(SLAVE)	AA						
	15	FILTER CUBICLE 660~690V 1200KW AFE(SLAVE)	AA						
	16	RECTIFIER/REGENERATIVE CUBICLE 660~690V 1200KW AFE(SLAVE)	AA						
	17	RECTIFIER/REGENERATIVE CUBICLE 660~690V 1200KW AFE(SLAVE)	AA						
E	18	RECTIFIER/REGENERATIVE CUBICLE 660~690V 1200KW AFE(SLAVE)	AA						
	19	RECTIFIER/REGENERATIVE CUBICLE 660~690V 1200KW AFE(SLAVE)	AA						
	20	H1/P1 INVERTER CUBICLE 660~690V 1000KW	AA						
	21	H1/P1 INVERTER CUBICLE 660~690V 1000KW	AA						
F	22	H1/P1 INVERTER CUBICLE 660~690V 1000KW	AA						
	23	H1/P1 INVERTER CUBICLE 660~690V 1000KW	AA						
			DATE	Jan-10-2010			< > SHEET 34		
			DRAWN	Fu Xueming			=		
			CHECKED	Han Yong			+		
REVISION	NAME	DATE	APPROVAL	SEE SAP	APPLICATION FOR TYZX		SEDL	SIMOVERT MD CUVC DOCUMENT LIST	CIRCUIT DRAWING
1					3	4	5	6	7
								SO 30009140351000	
								SHEET 1 OF 34	
		2							8

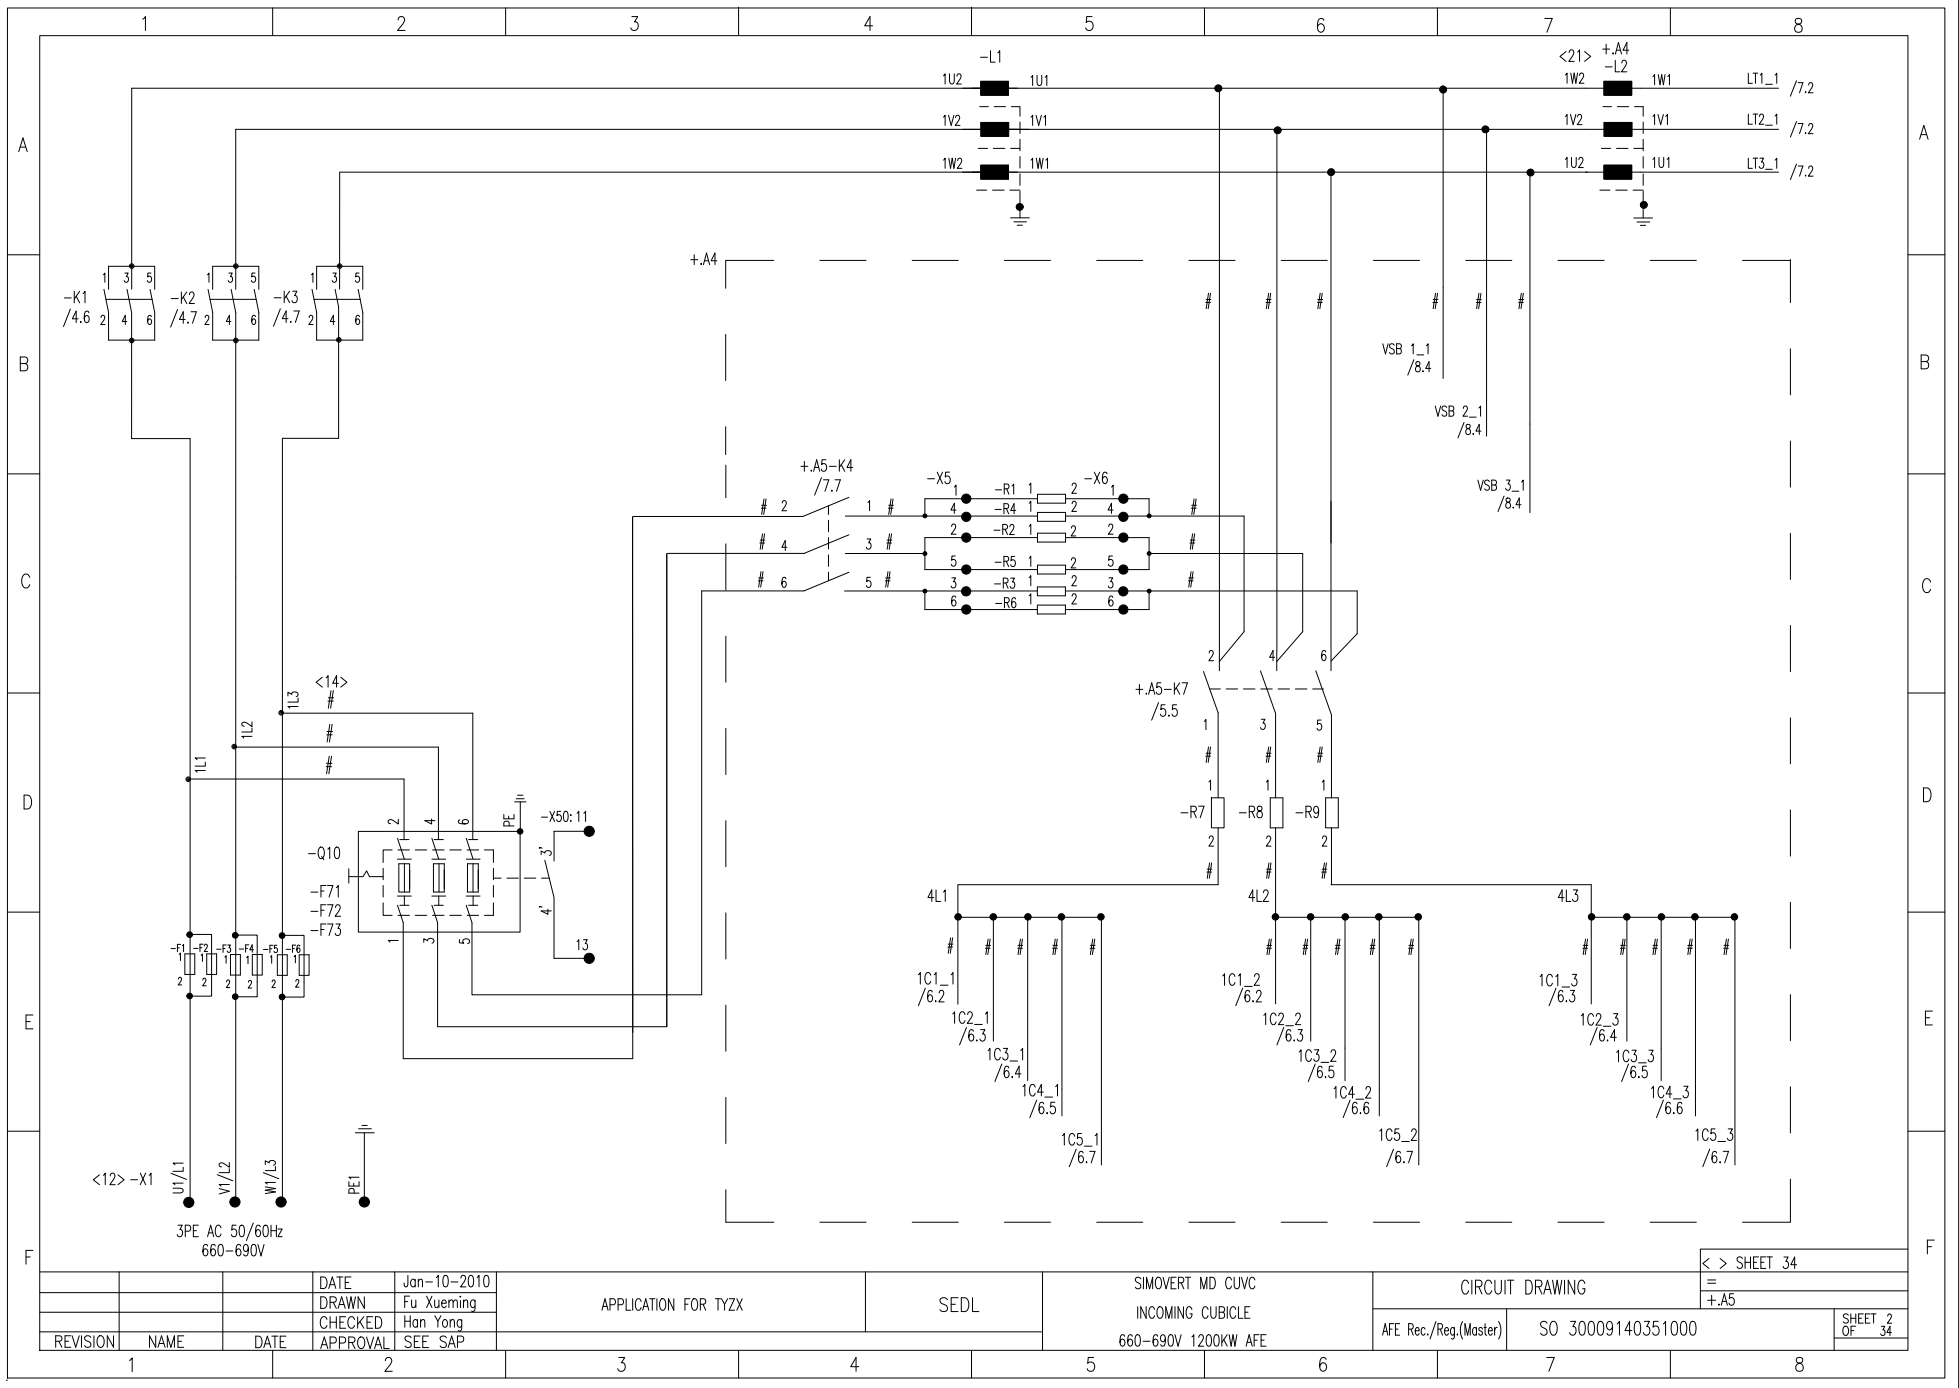

REVISION	NAME	DATE	DATE
			Jan-10-2010
			Drawn Fu Xueming
			Checked Han Yong
			Approval SEE SAP

APPLICATION FOR TYZX

SEDL

SIMOVERT MD CUVC
INCOMING CUBICLE
660-690V 1200KW AFE

CIRCUIT DRAWING

AFE Rec./Reg.(Master)


SO 30009140351000

< > SHEET 34

=


+A5

SHEET 2
OF 34

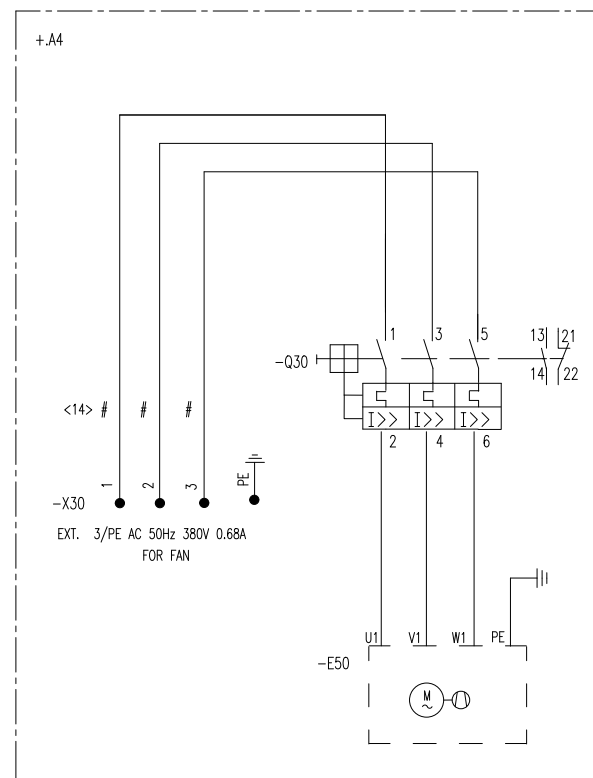


SHEET 3
OF 34

/3.5 AC Busbar 230V L1
/3.5 AC Busbar 230V N1







/5.2 SV_AN_L1_1
/5.5 SV_AN_L2_1

-X40 11 12 13 15 16 17



+A3-G10
+A3-X20 1 2
VSB_P24_1 /8.4
P24_EIN_1 /8.5
VSB_M_1 /8.4
M24_EIN_1 /8.6
AFE_P24_1 /7.5
AFE_M_1 /7.6

-K10 /8.6
33 43
34 44

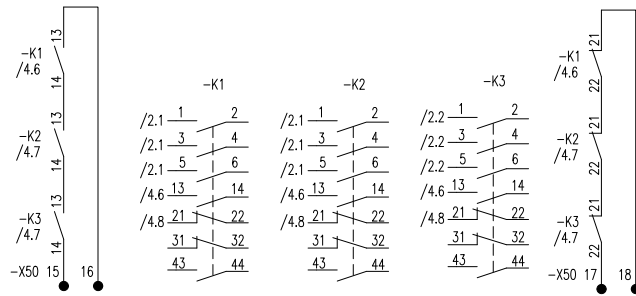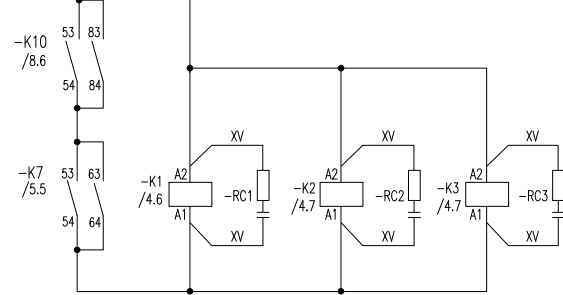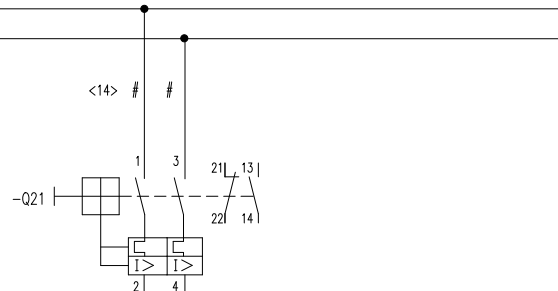

main contactors
are enabled

main contactors
are disabled

REVISION	NAME	DATE	DATE	Jan-10-2010
		DRAWN	Fu Xueming	
		CHECKED	Han Yong	
		APPROVAL	SEE SAP	

APPLICATION FOR TYZX

SED L

SIMOVERT MD CUV
INCOMING CUBICLE
660-690V 1200KW AFE

CIRCUIT DRAWING

AFE Rec./Reg.(Master)


SO 30009140351000

< > SHEET 34

=

+A5

SHEET 4
OF 34

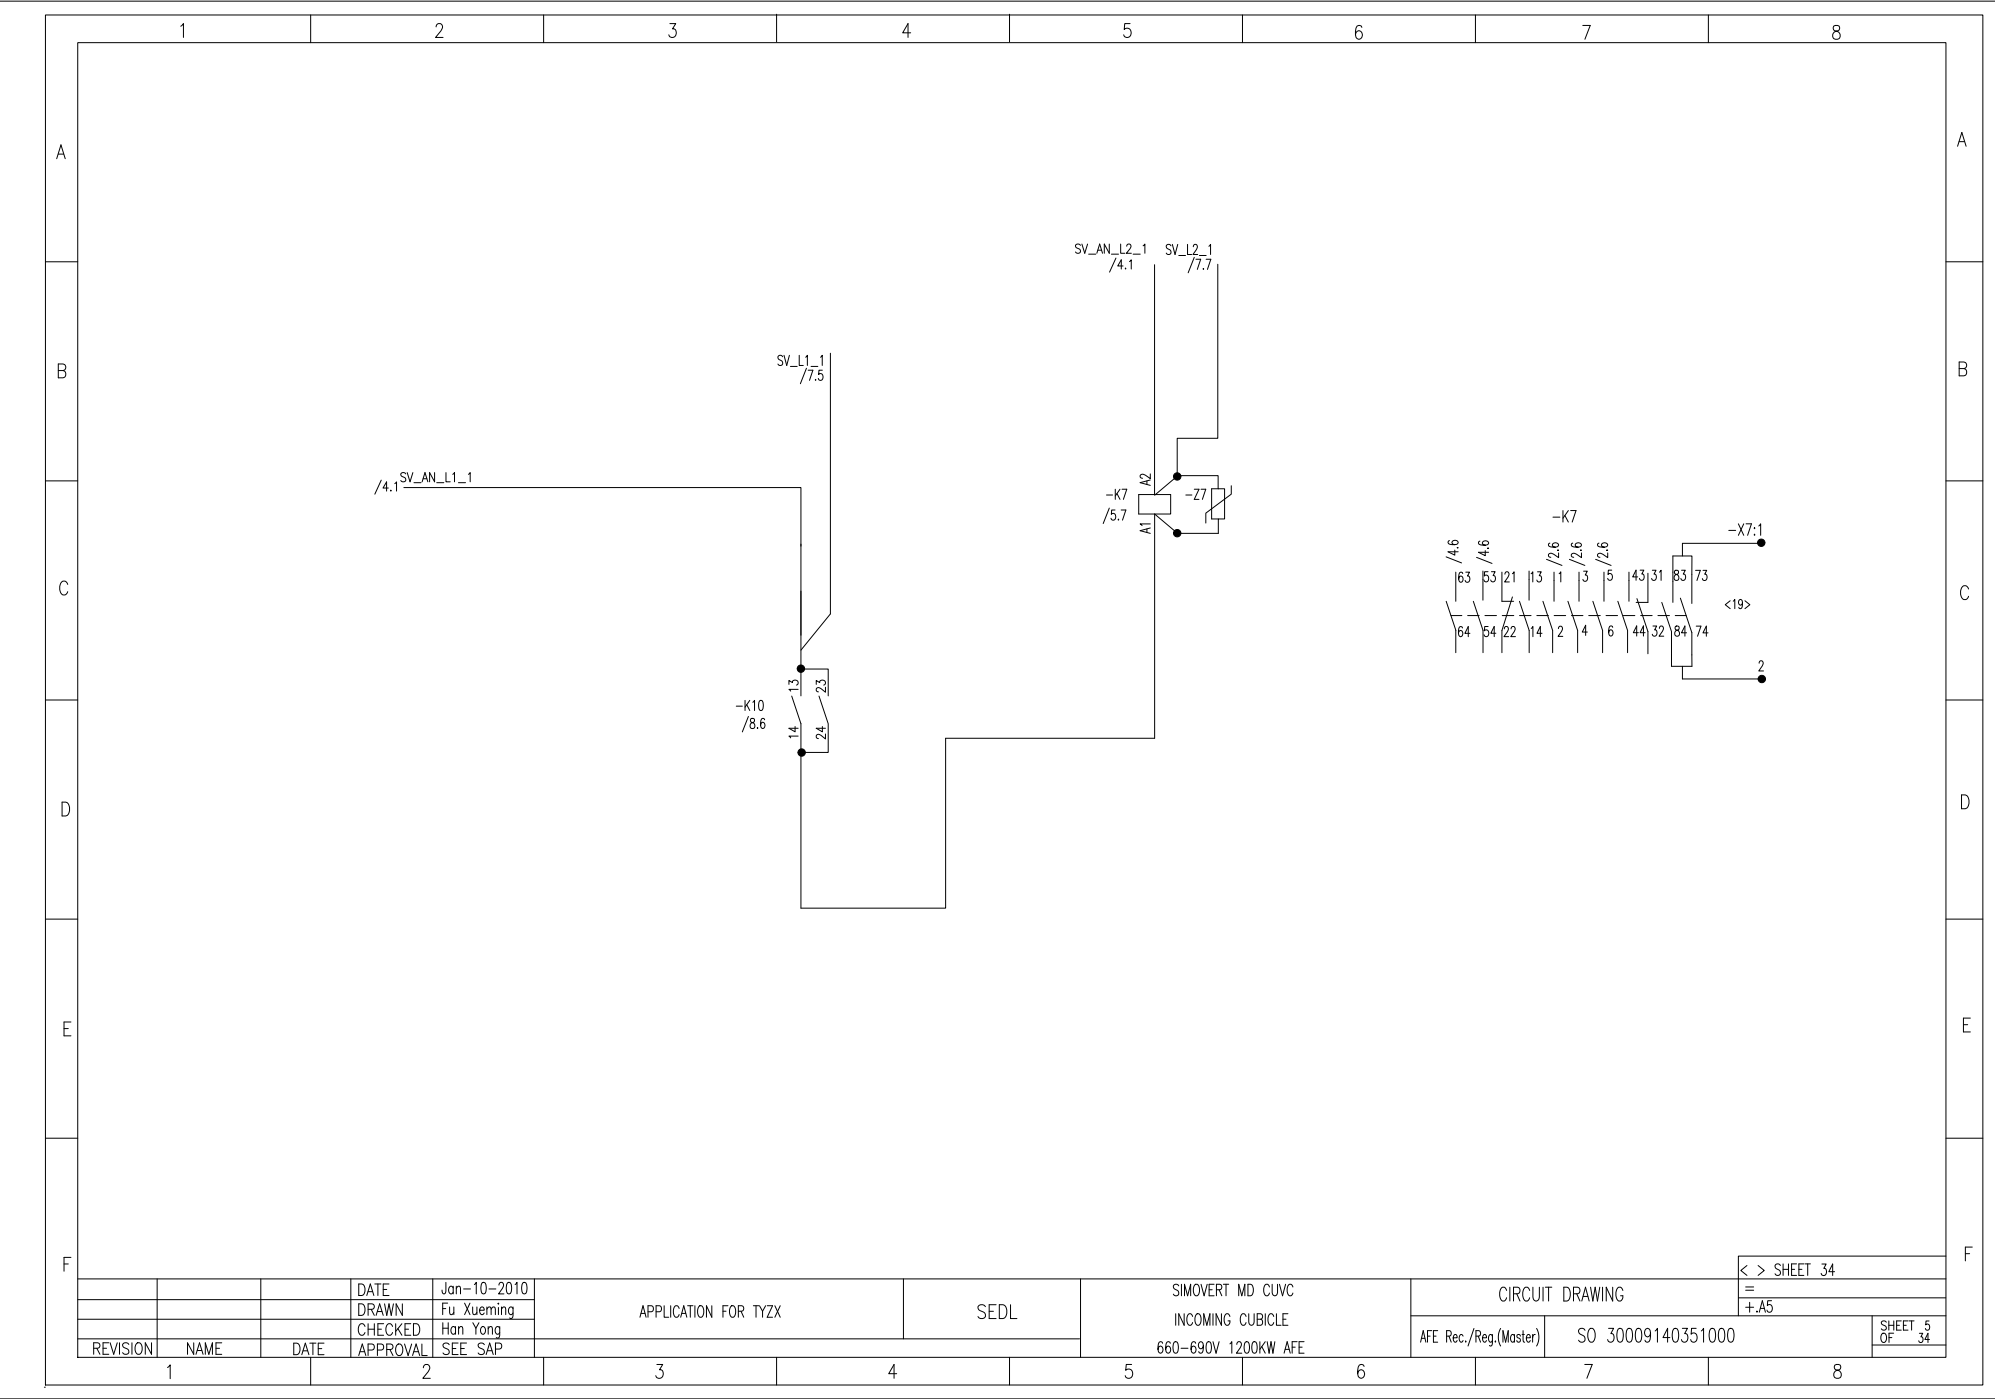


REVISION	NAME	DATE	DATE	Jan-10-2010
			DRAWN	Fu Xueming
			CHECKED	Han Yong
			APPROVAL	SEE SAP


APPLICATION FOR TYZX		SEDL	
----------------------	--	------	--

SIMOVERT MD CUVC
INCOMING CUBICLE
660-690V 1200KW AFE

CIRCUIT DRAWING	
AFE Rec./Reg.(Master)	SO 30009140351000

< > SHEET 34
=
+A5
SHEET 5 OF 34

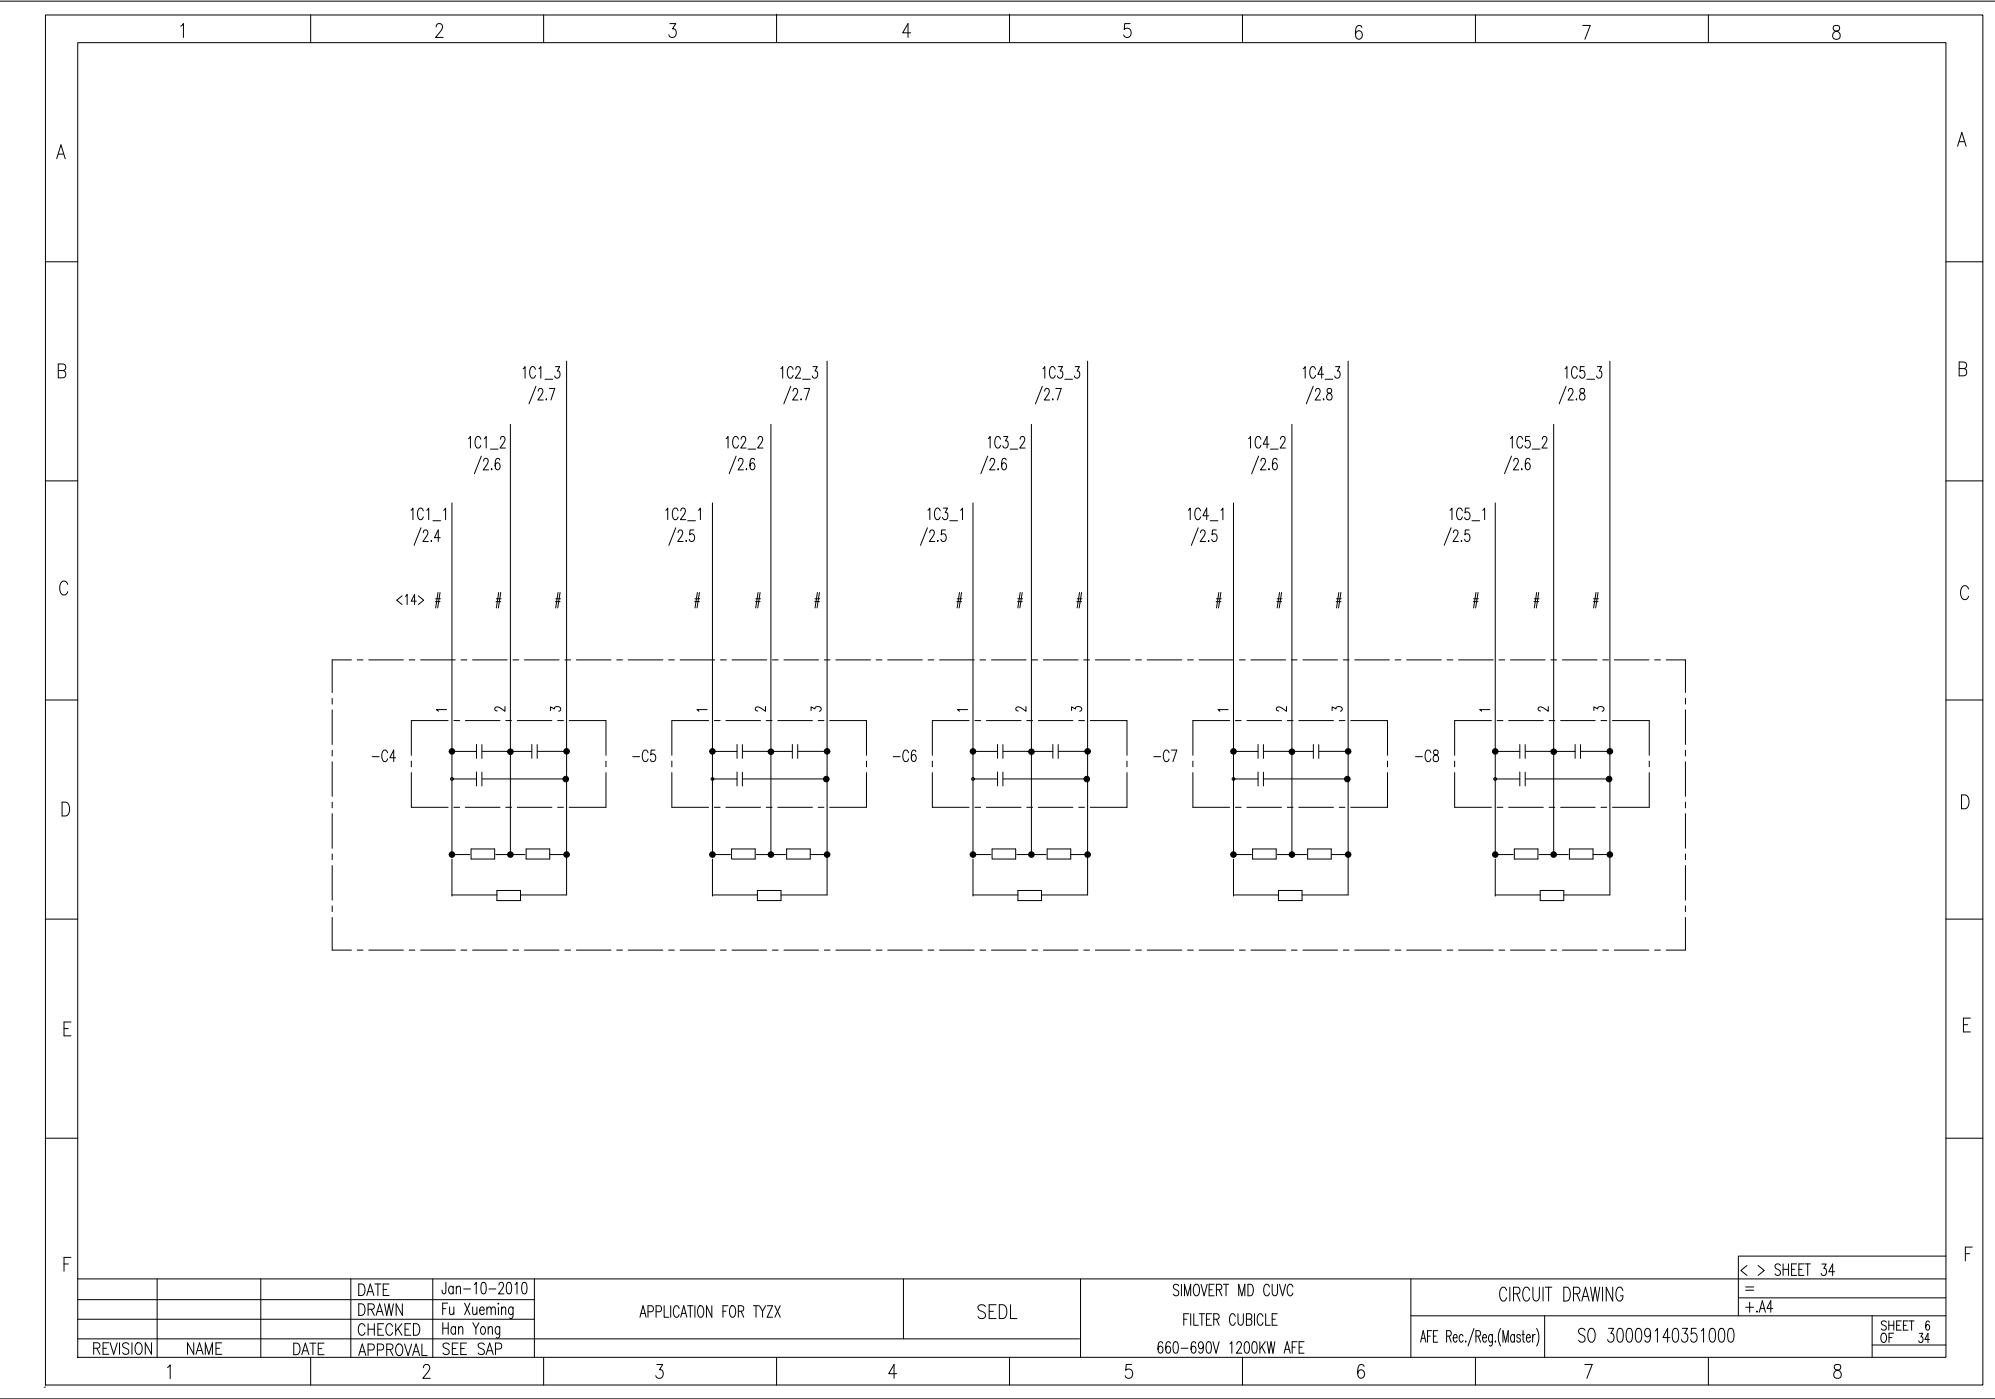

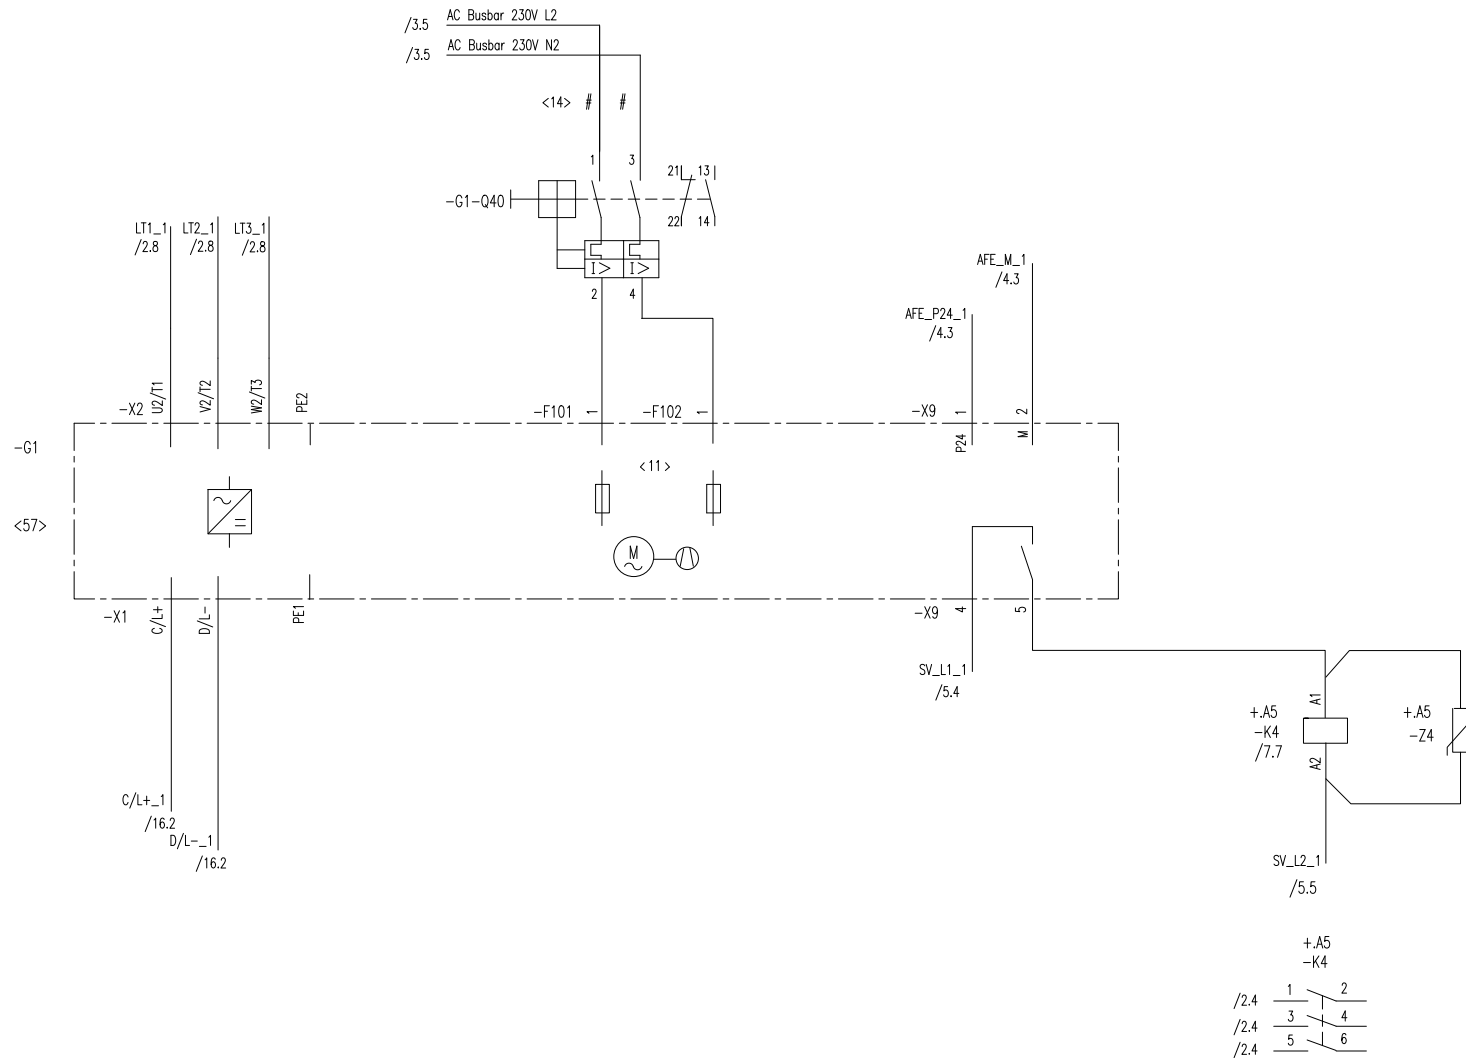

REVISION	NAME	DATE	DATE	Jan-10-2010
			DRAWN	Fu Xueming
			CHECKED	Han Yong
			APPROVAL	SEE SAP

APPLICATION FOR TYZX

SEDL

SIMOVERT MD CUVC
RECTIFIER/REGENERATIVE CUBICLE
660-690V 1200KW AFE

CIRCUIT DRAWING

AFE Rec./Reg.(Master)


SO 30009140351000

< > SHEET 34

=

+A3

SHEET 7
OF 34

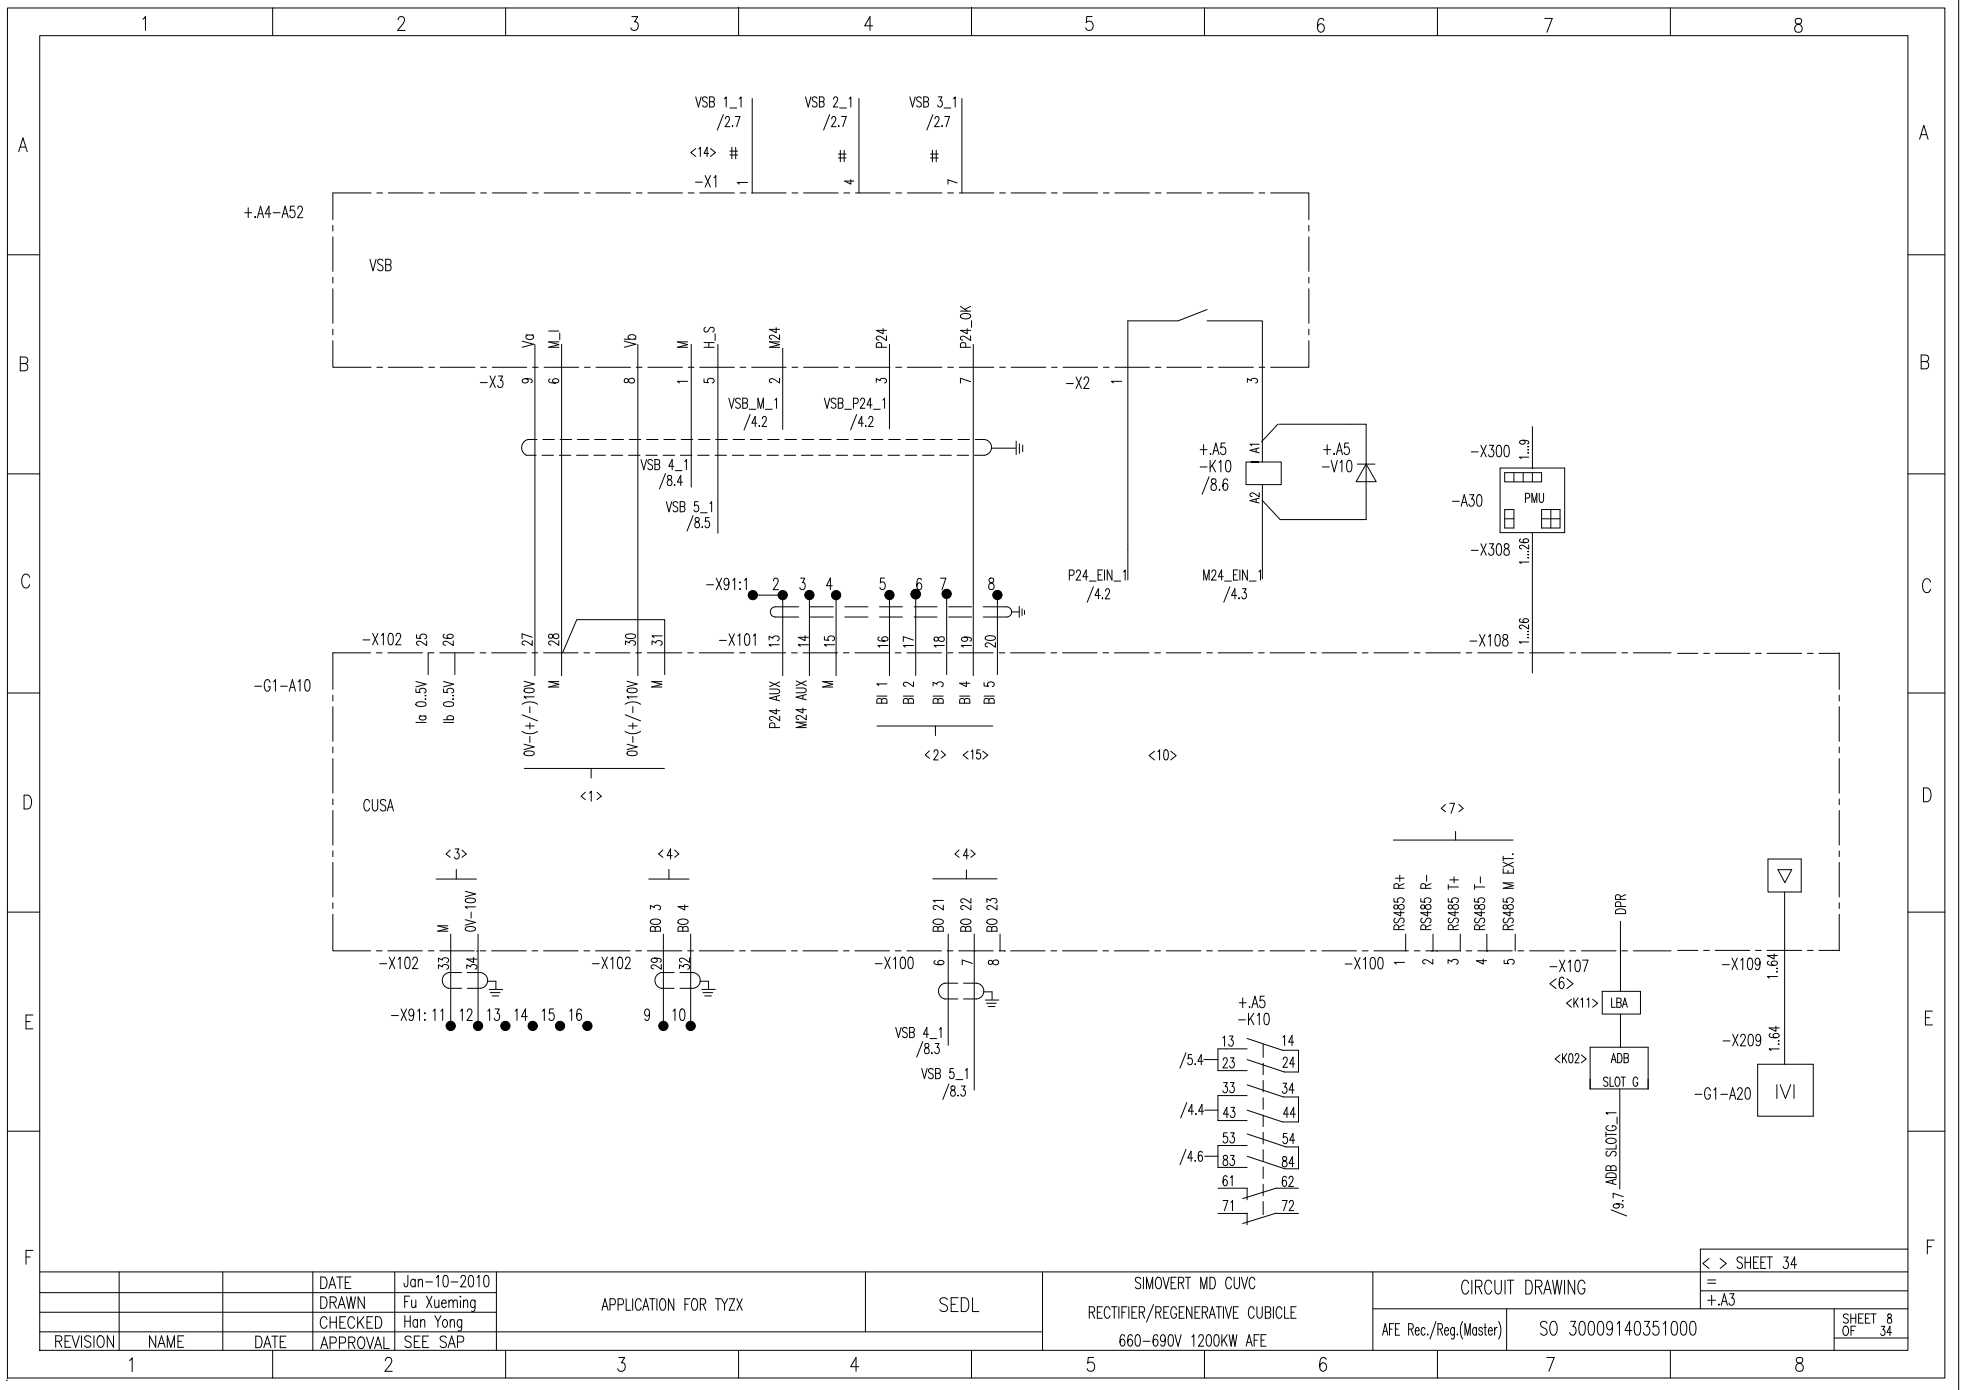

REVISION	NAME	DATE	DATE	Jan-10-2010
			DRAWN	Fu Xueming
			CHECKED	Han Yong
			APPROVAL	SEE SAP

APPLICATION FOR TYZX

SEDL

SIMOVERT MD CUVC
 RECTIFIER/REGENERATIVE CUBICLE
 660-690V 1200KW AFE

CIRCUIT DRAWING

AFE Rec./Reg.(Master)


SO 30009140351000


< > SHEET 34

=

+A3

SHEET 8
 OF 34

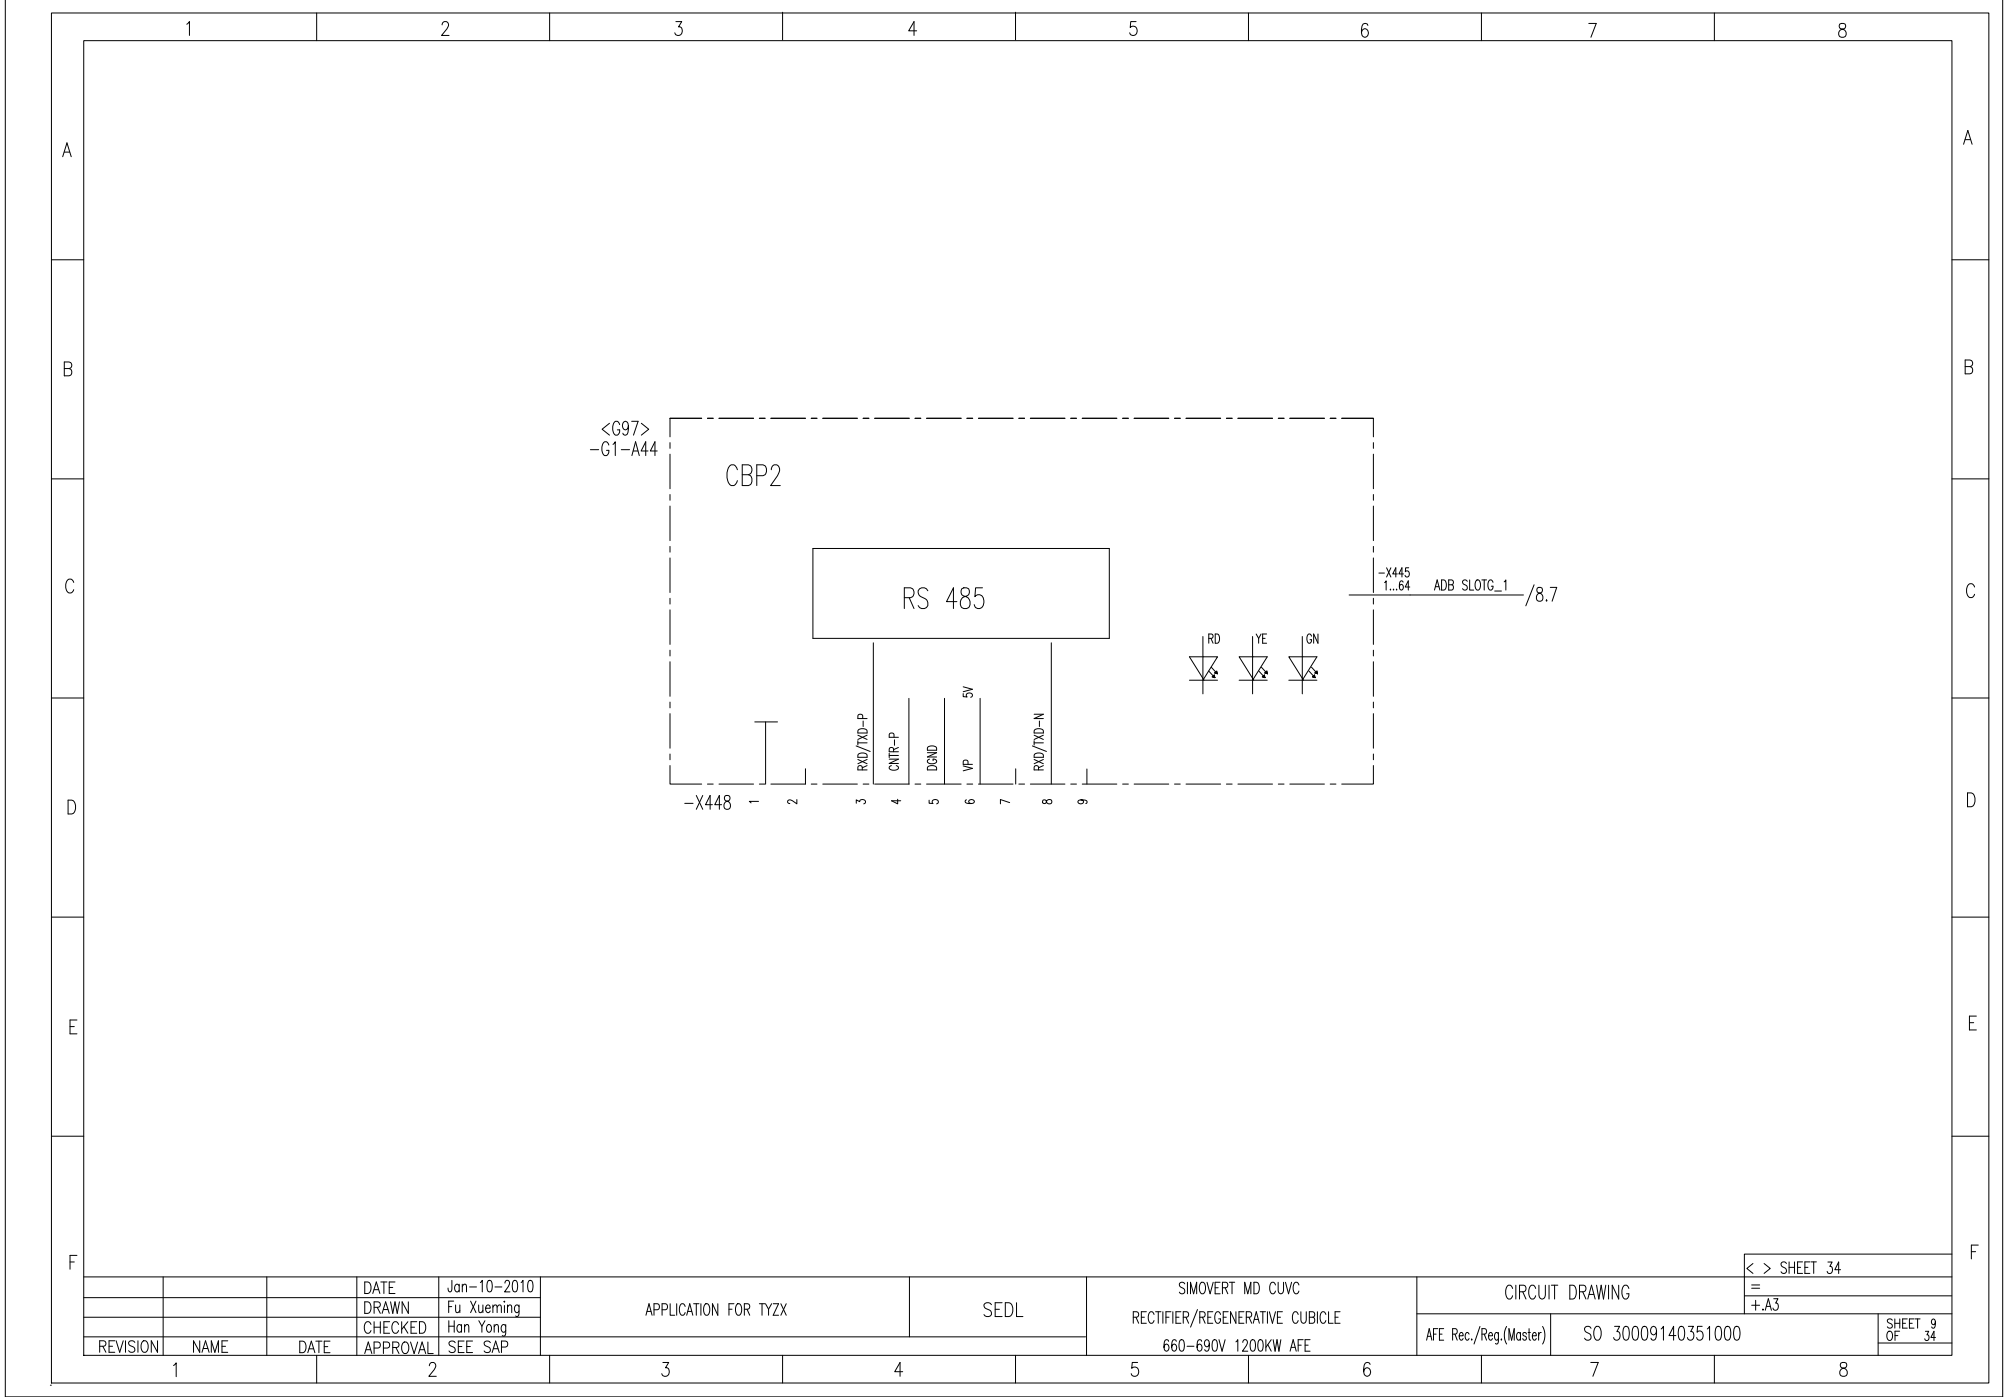

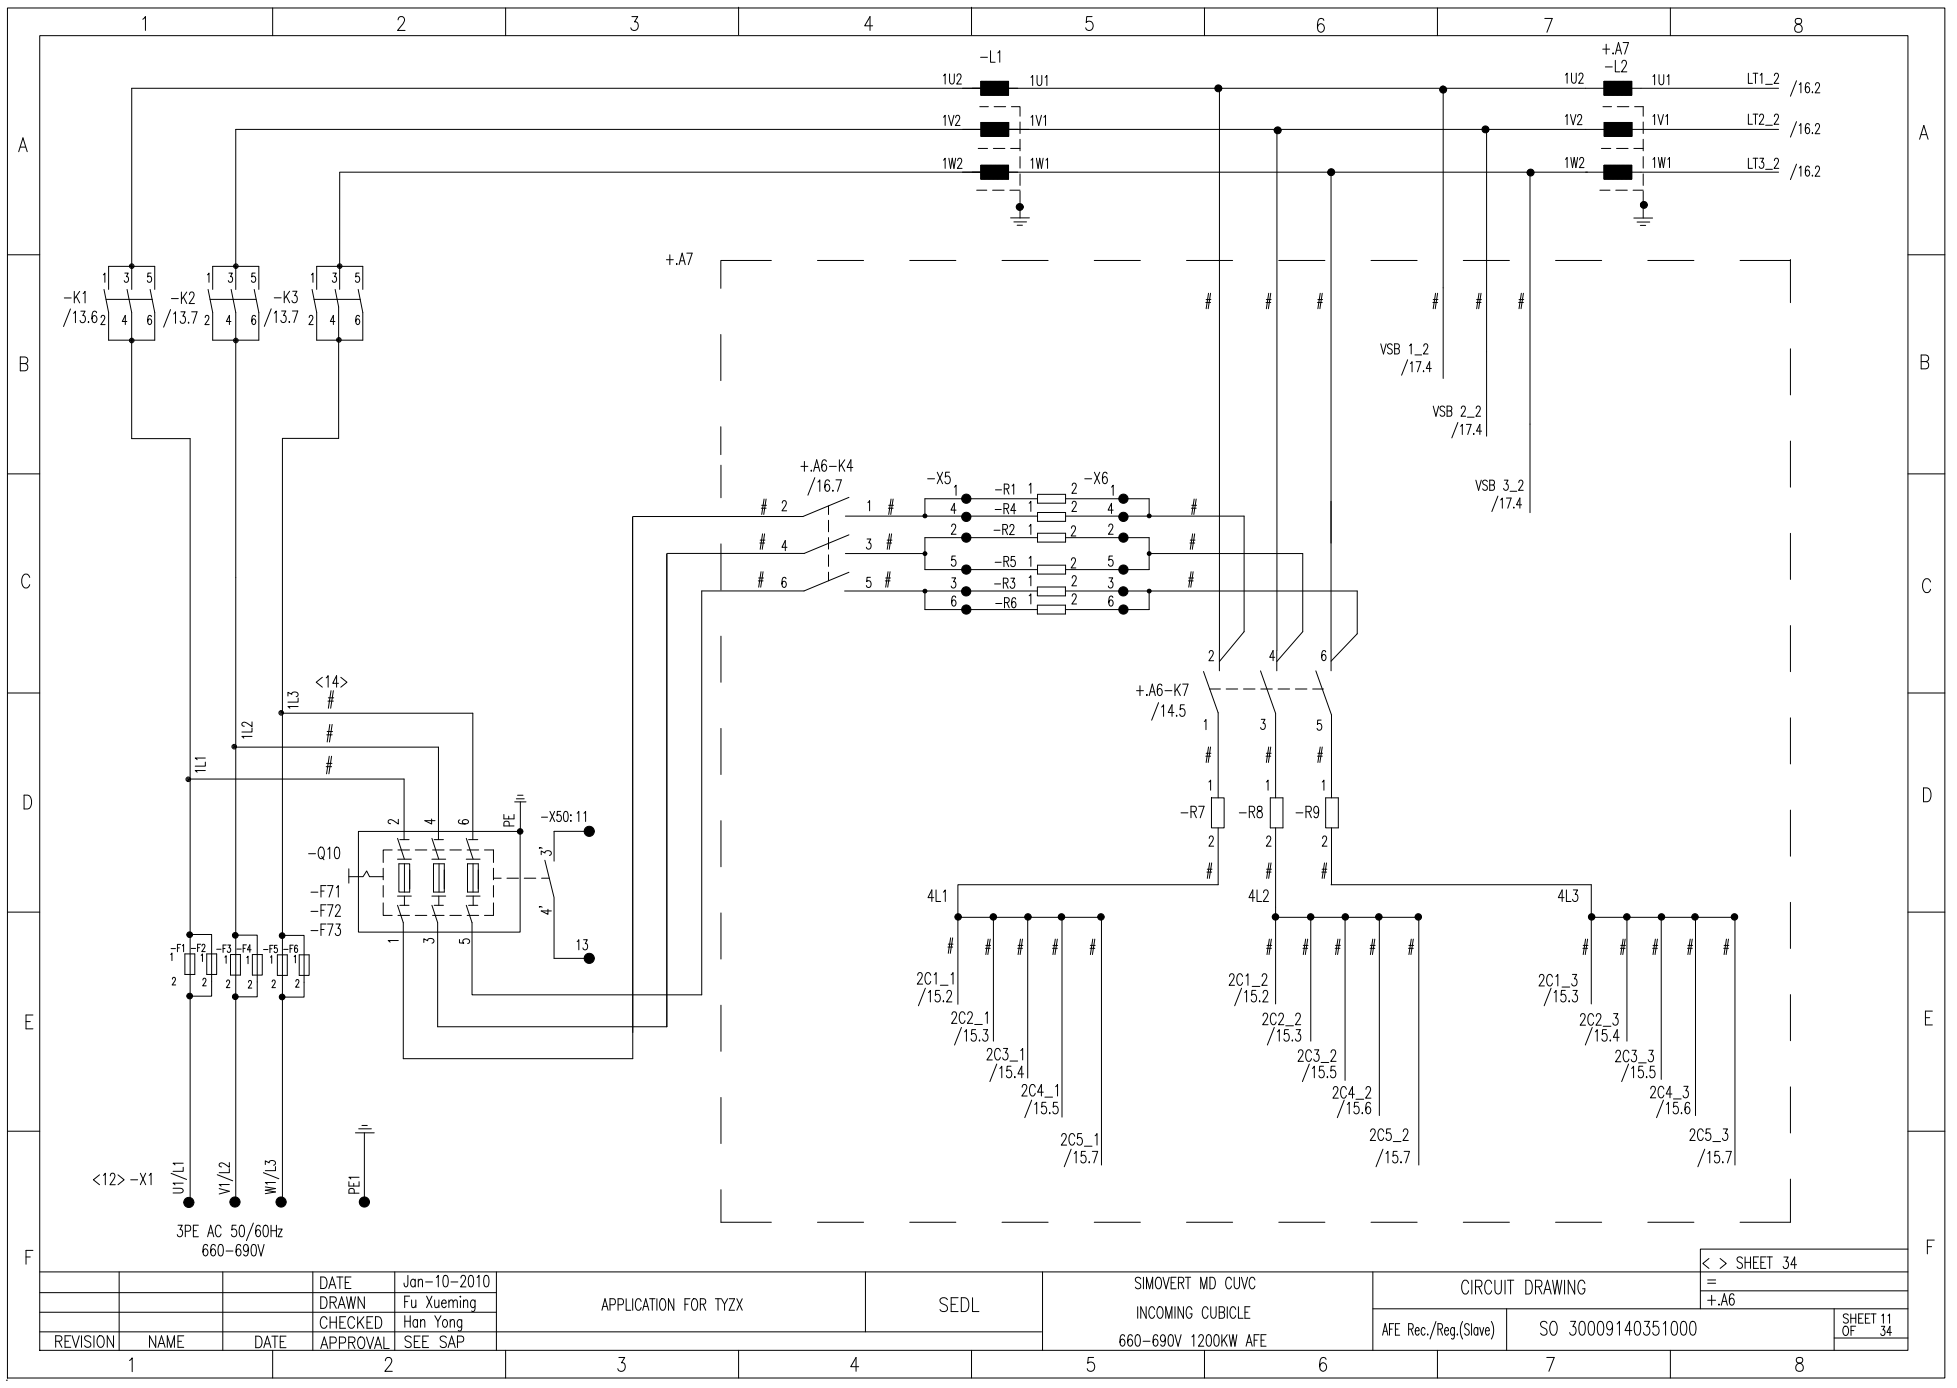

REVISION	NAME	DATE	DATE
1			Jan-10-2010
			Fu Xueming
			Han Yong
			SEE SAP




APPLICATION FOR TYZX	SEDL
----------------------	------

SIMOVERT MD CUVC
INCOMING CUBICLE
660-690V 1200KW AFE

CIRCUIT DRAWING
AFE Rec./Reg.(Slave)
SO 30009140351000

< > SHEET 34
=
+A6
SHEET 11
OF 34

EXT. AC230V 50Hz 30A FOR CHASSIS FAN

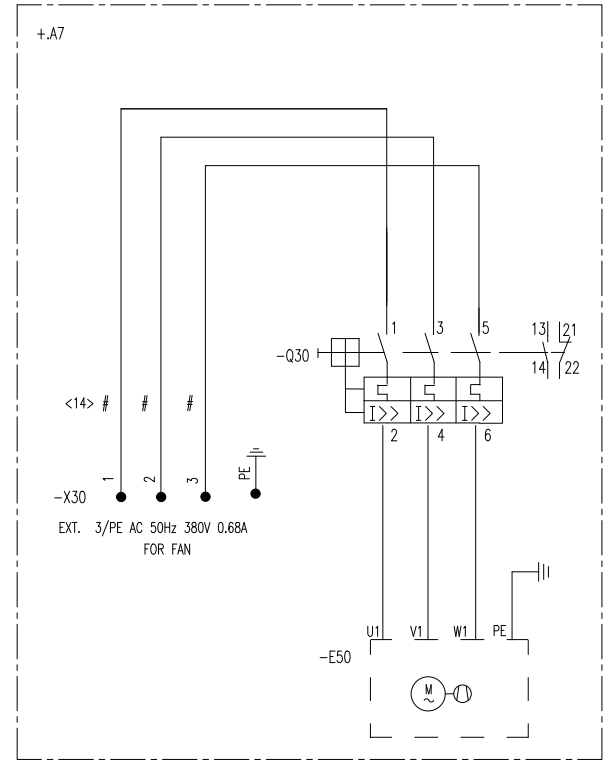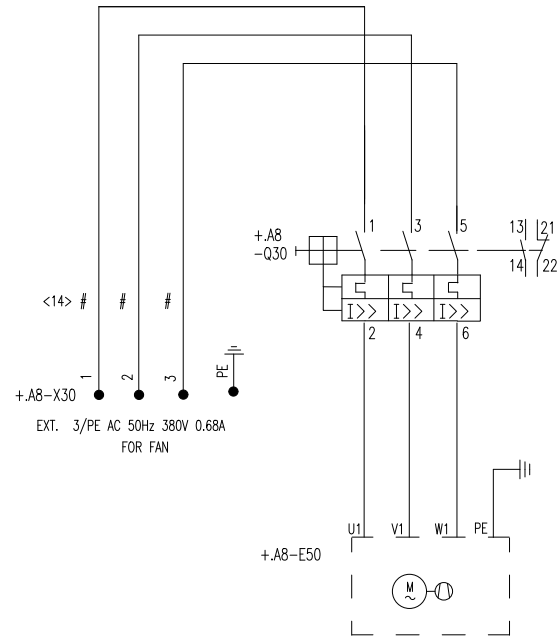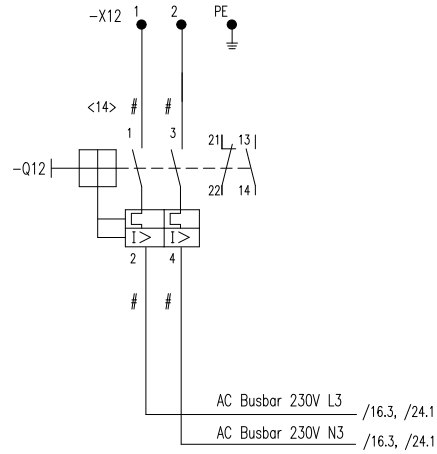

REVISION	NAME	DATE	DATE	Jan-10-2010
			DRAWN	Fu Xueming
			CHECKED	Han Yong
			APPROVAL	SEE SAP

APPLICATION FOR TYZX

SEDL

SIMOVERT MD CUV
INCOMING CUBICLE
660-690V 1200KW AFE

CIRCUIT DRAWING

AFE Rec./Reg.(Slave)

SO 30009140351000


< > SHEET 34

=





+A6

SHEET 12
OF 34

/31.7 AC Busbar 230V L1
/31.7 AC Busbar 230V N1



-X40 11 12 13 15 16 17
/14.2 SV_AN_L1_2
/14.5 SV_AN_L2_2

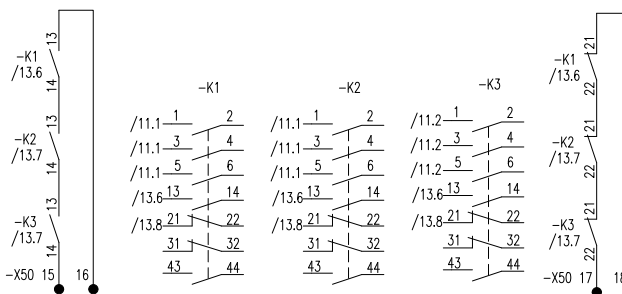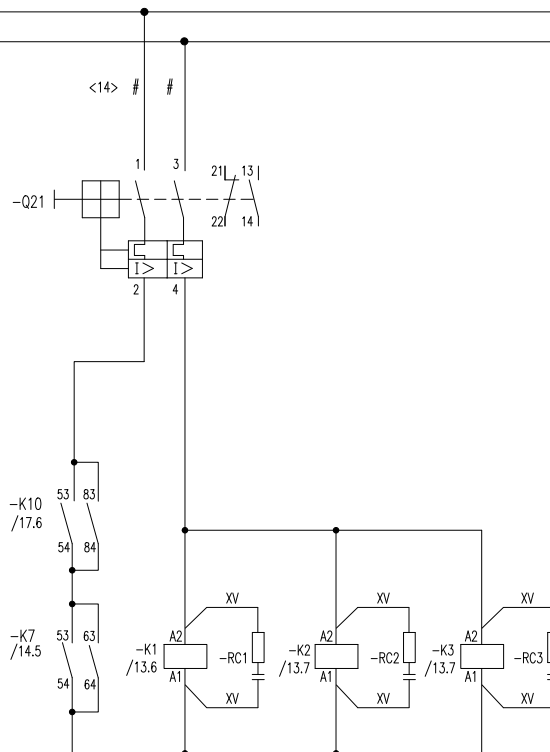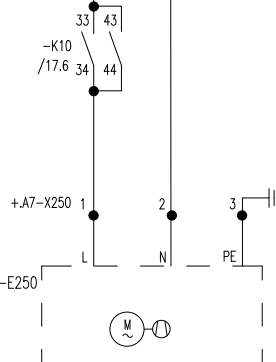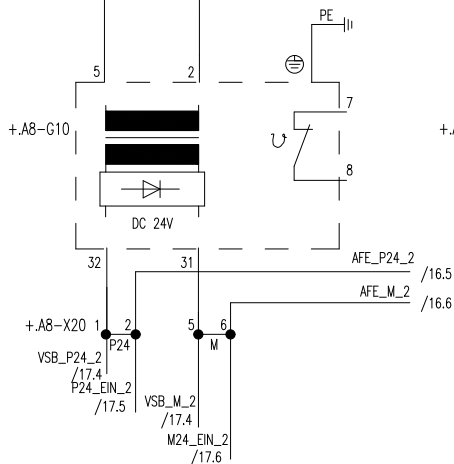

main contactors
are enabled

main contactors
are disabled

REVISION	NAME	DATE	DATE	Jan-10-2010
		DRAWN	Fu Xueming	
		CHECKED	Han Yong	
		APPROVAL	SEE SAP	

APPLICATION FOR TYZX

SEDL

SIMOVERT MD CUV
INCOMING CUBICLE
660-690V 1200KW AFE

CIRCUIT DRAWING

AFE Rec./Reg.(Slave)


SO 30009140351000

< > SHEET 34

=

+A6

SHEET 13
OF 34

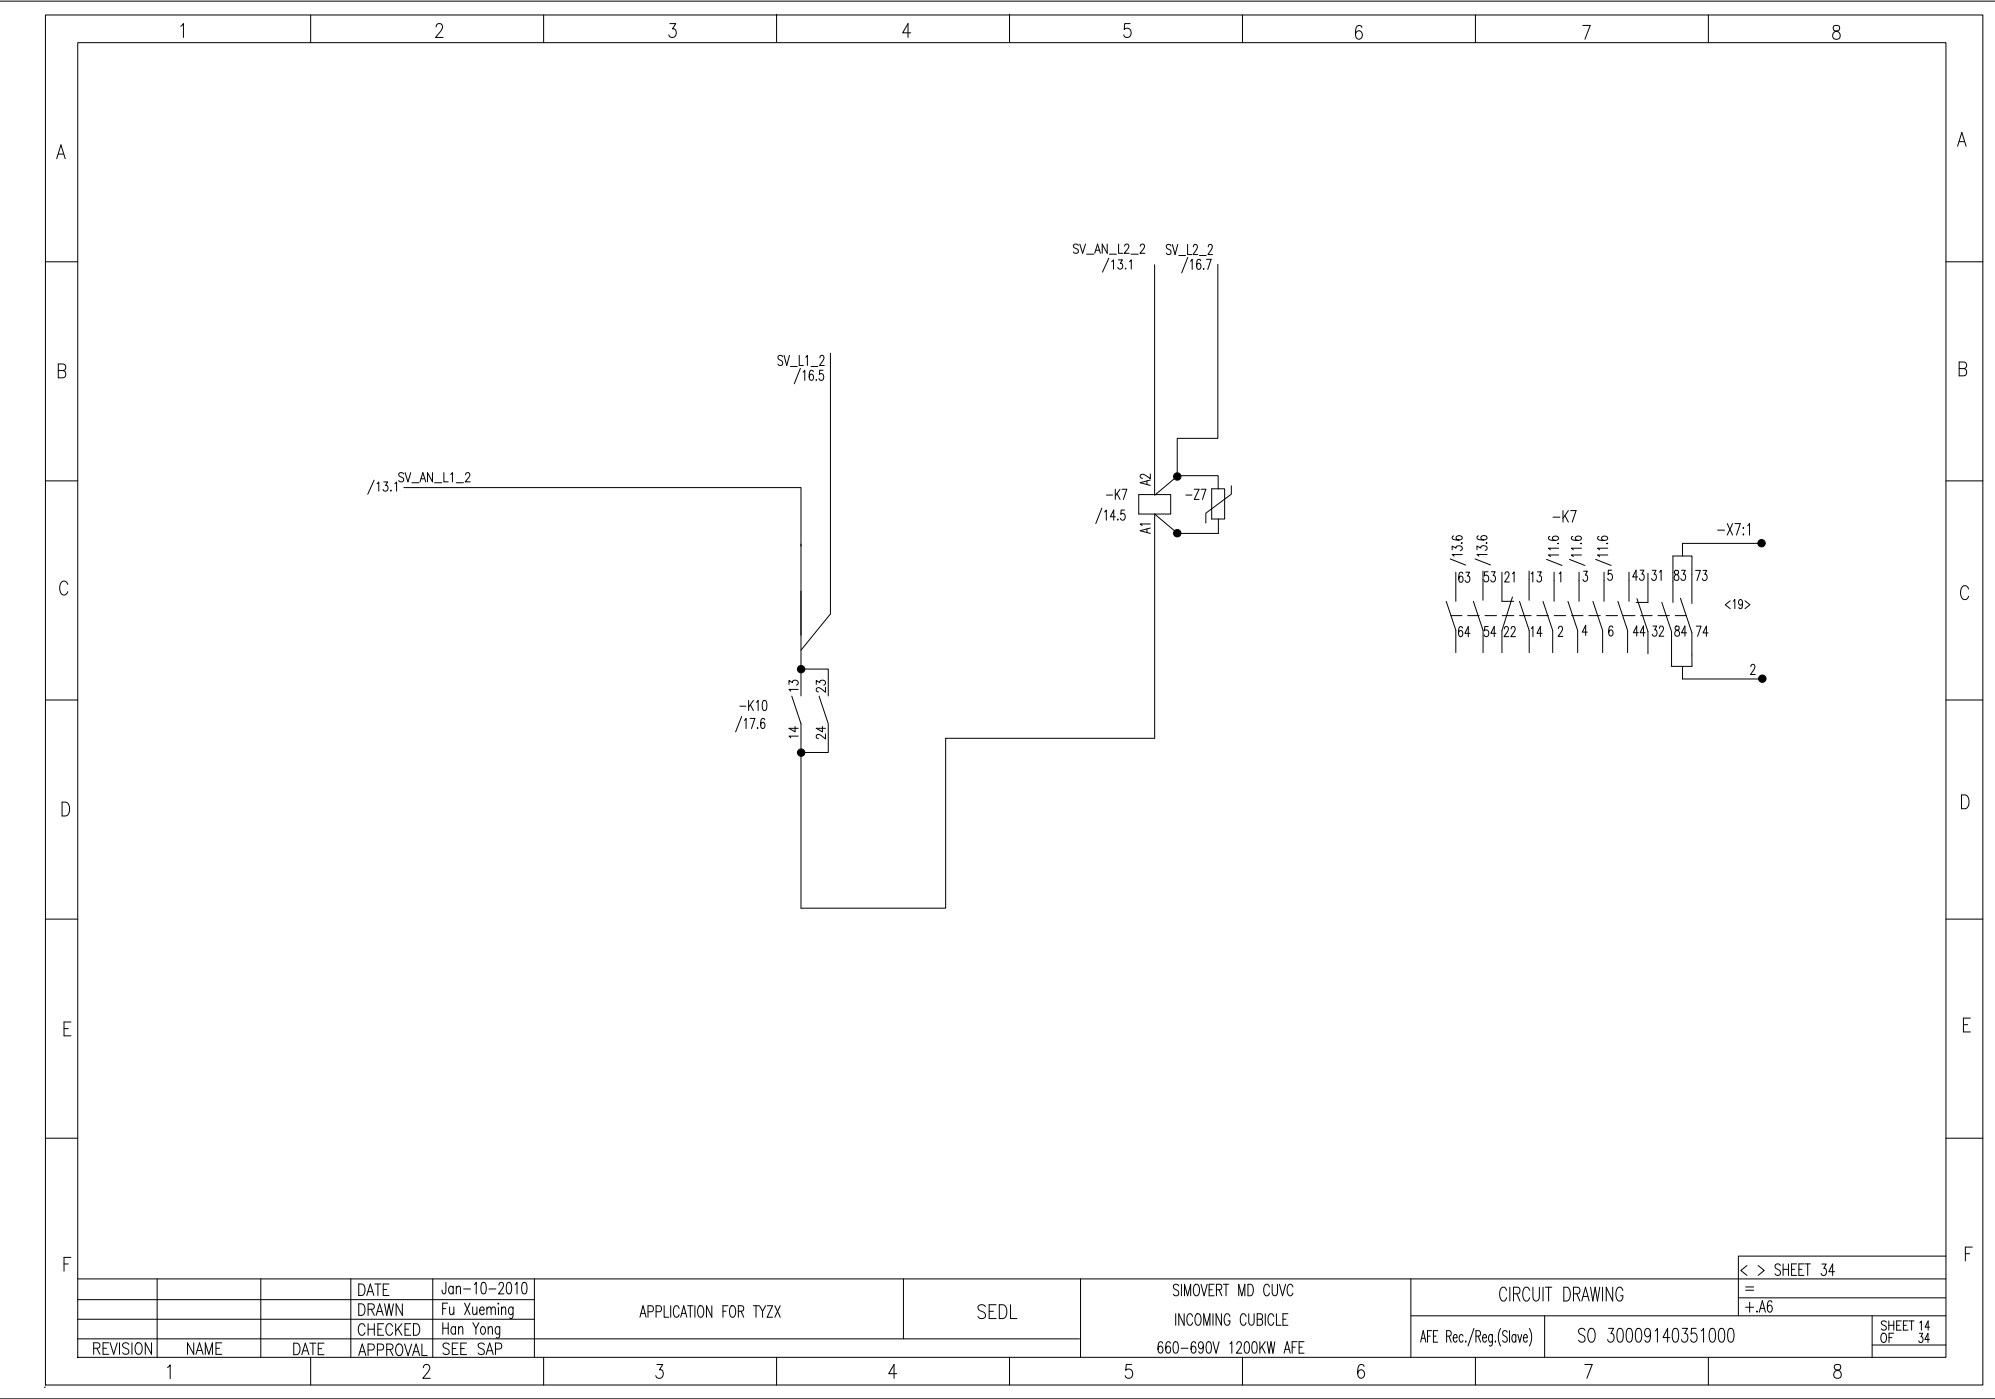


			DATE	Jan-10-2010
			DRAWN	Fu Xueming
			CHECKED	Han Yong
REVISION	NAME	DATE	APPROVAL	SEE SAP


APPLICATION FOR TYZX		SEDL
----------------------	--	------

SIMOVERT MD CUVC
INCOMING CUBICLE
660-690V 1200KW AFE

CIRCUIT DRAWING		< > SHEET 34
		=
		+A6
AFE Rec./Reg.(Slave)	SO 30009140351000	SHEET 14 OF 34

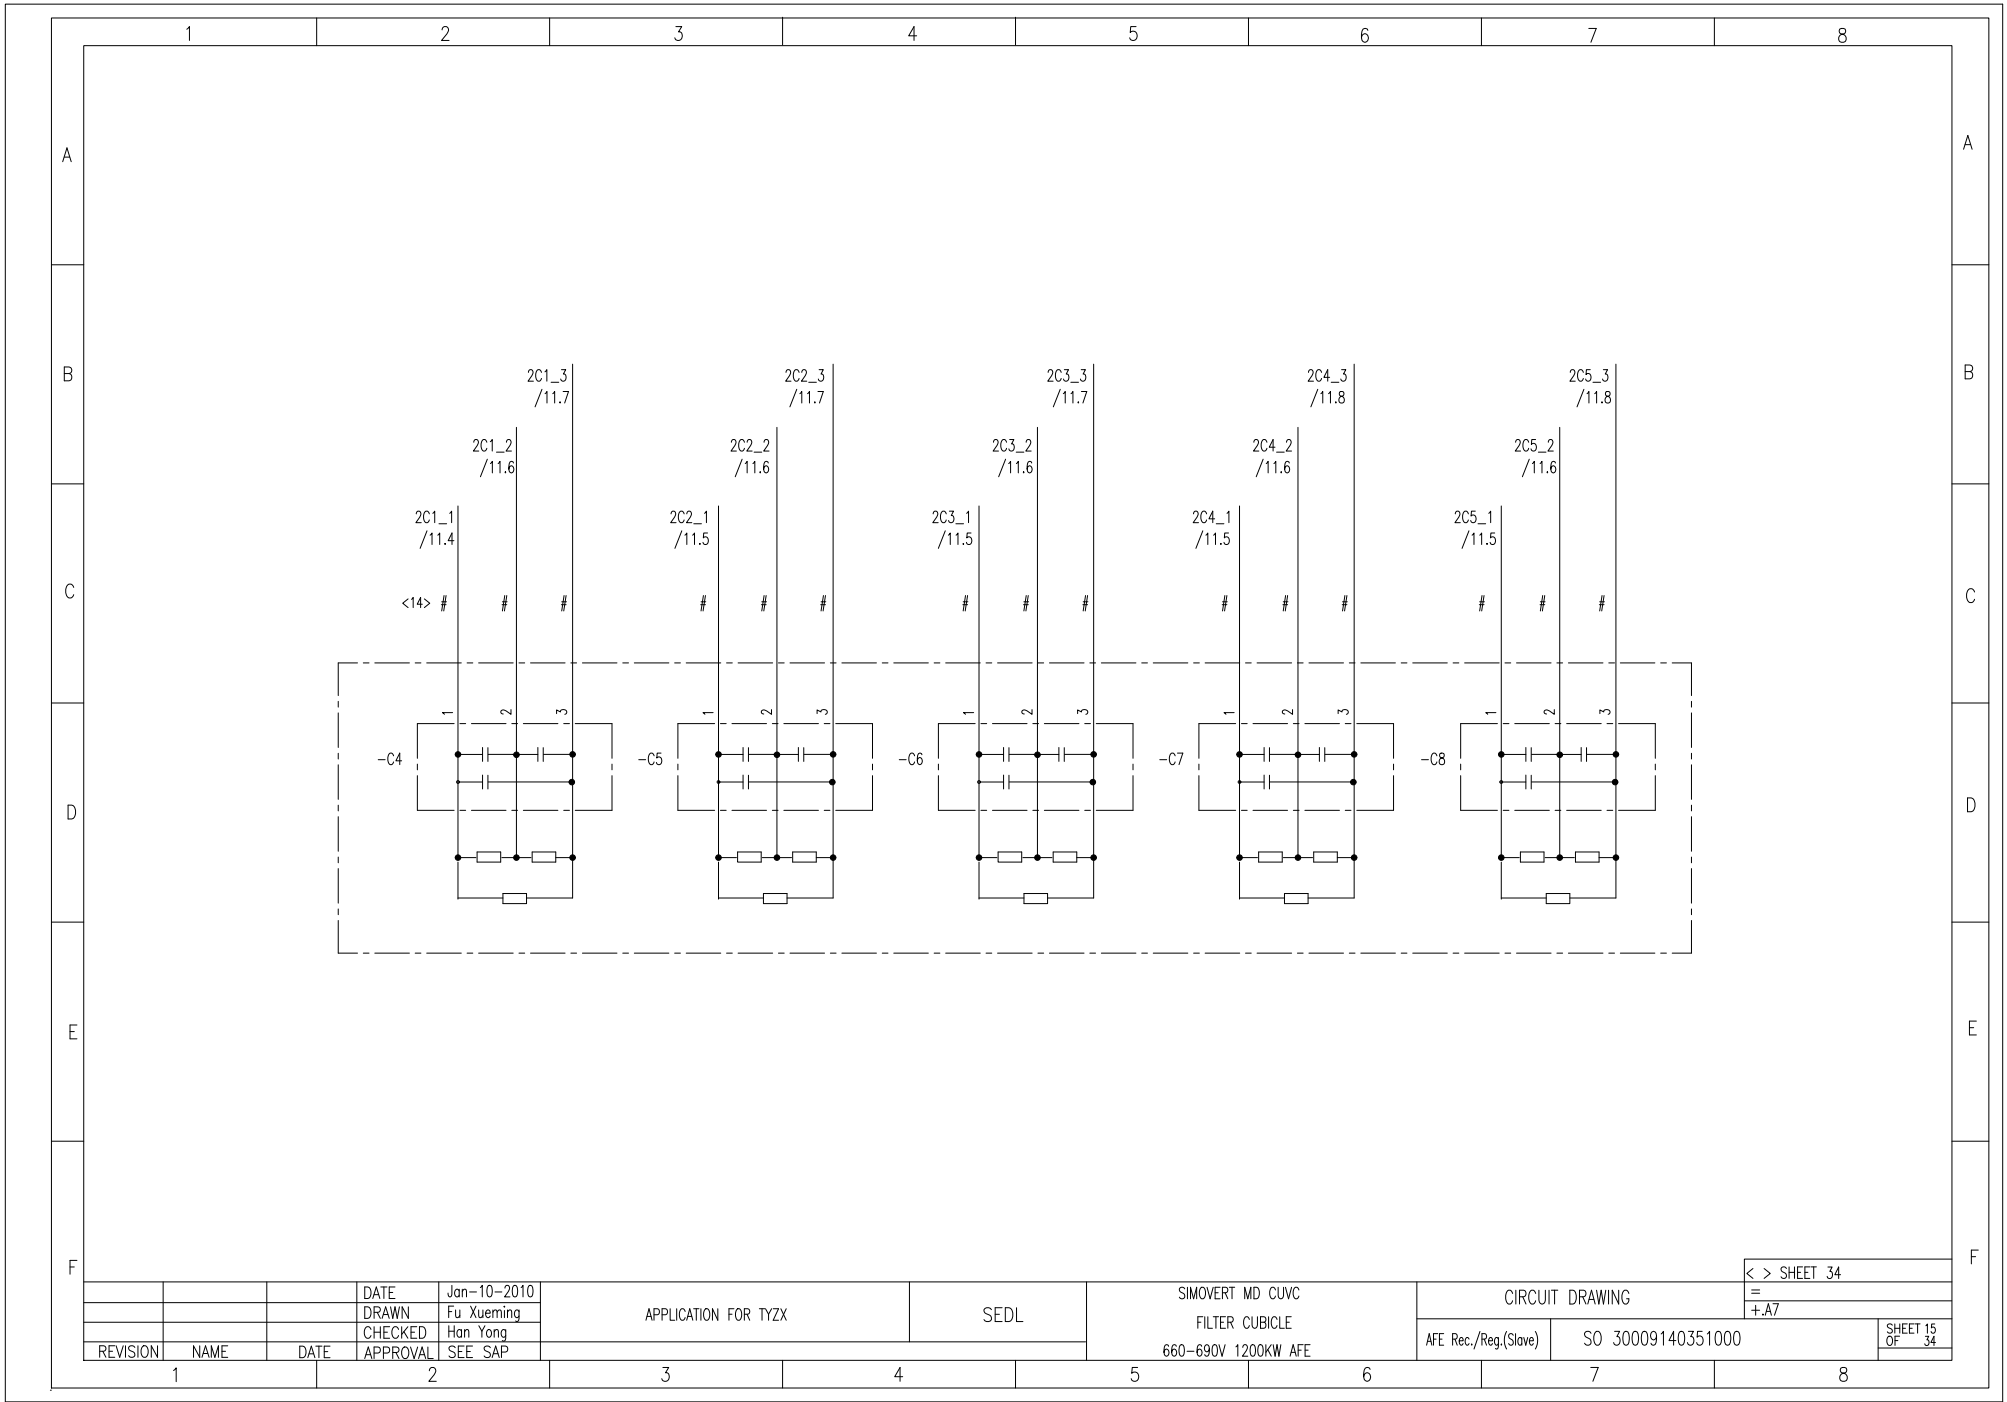



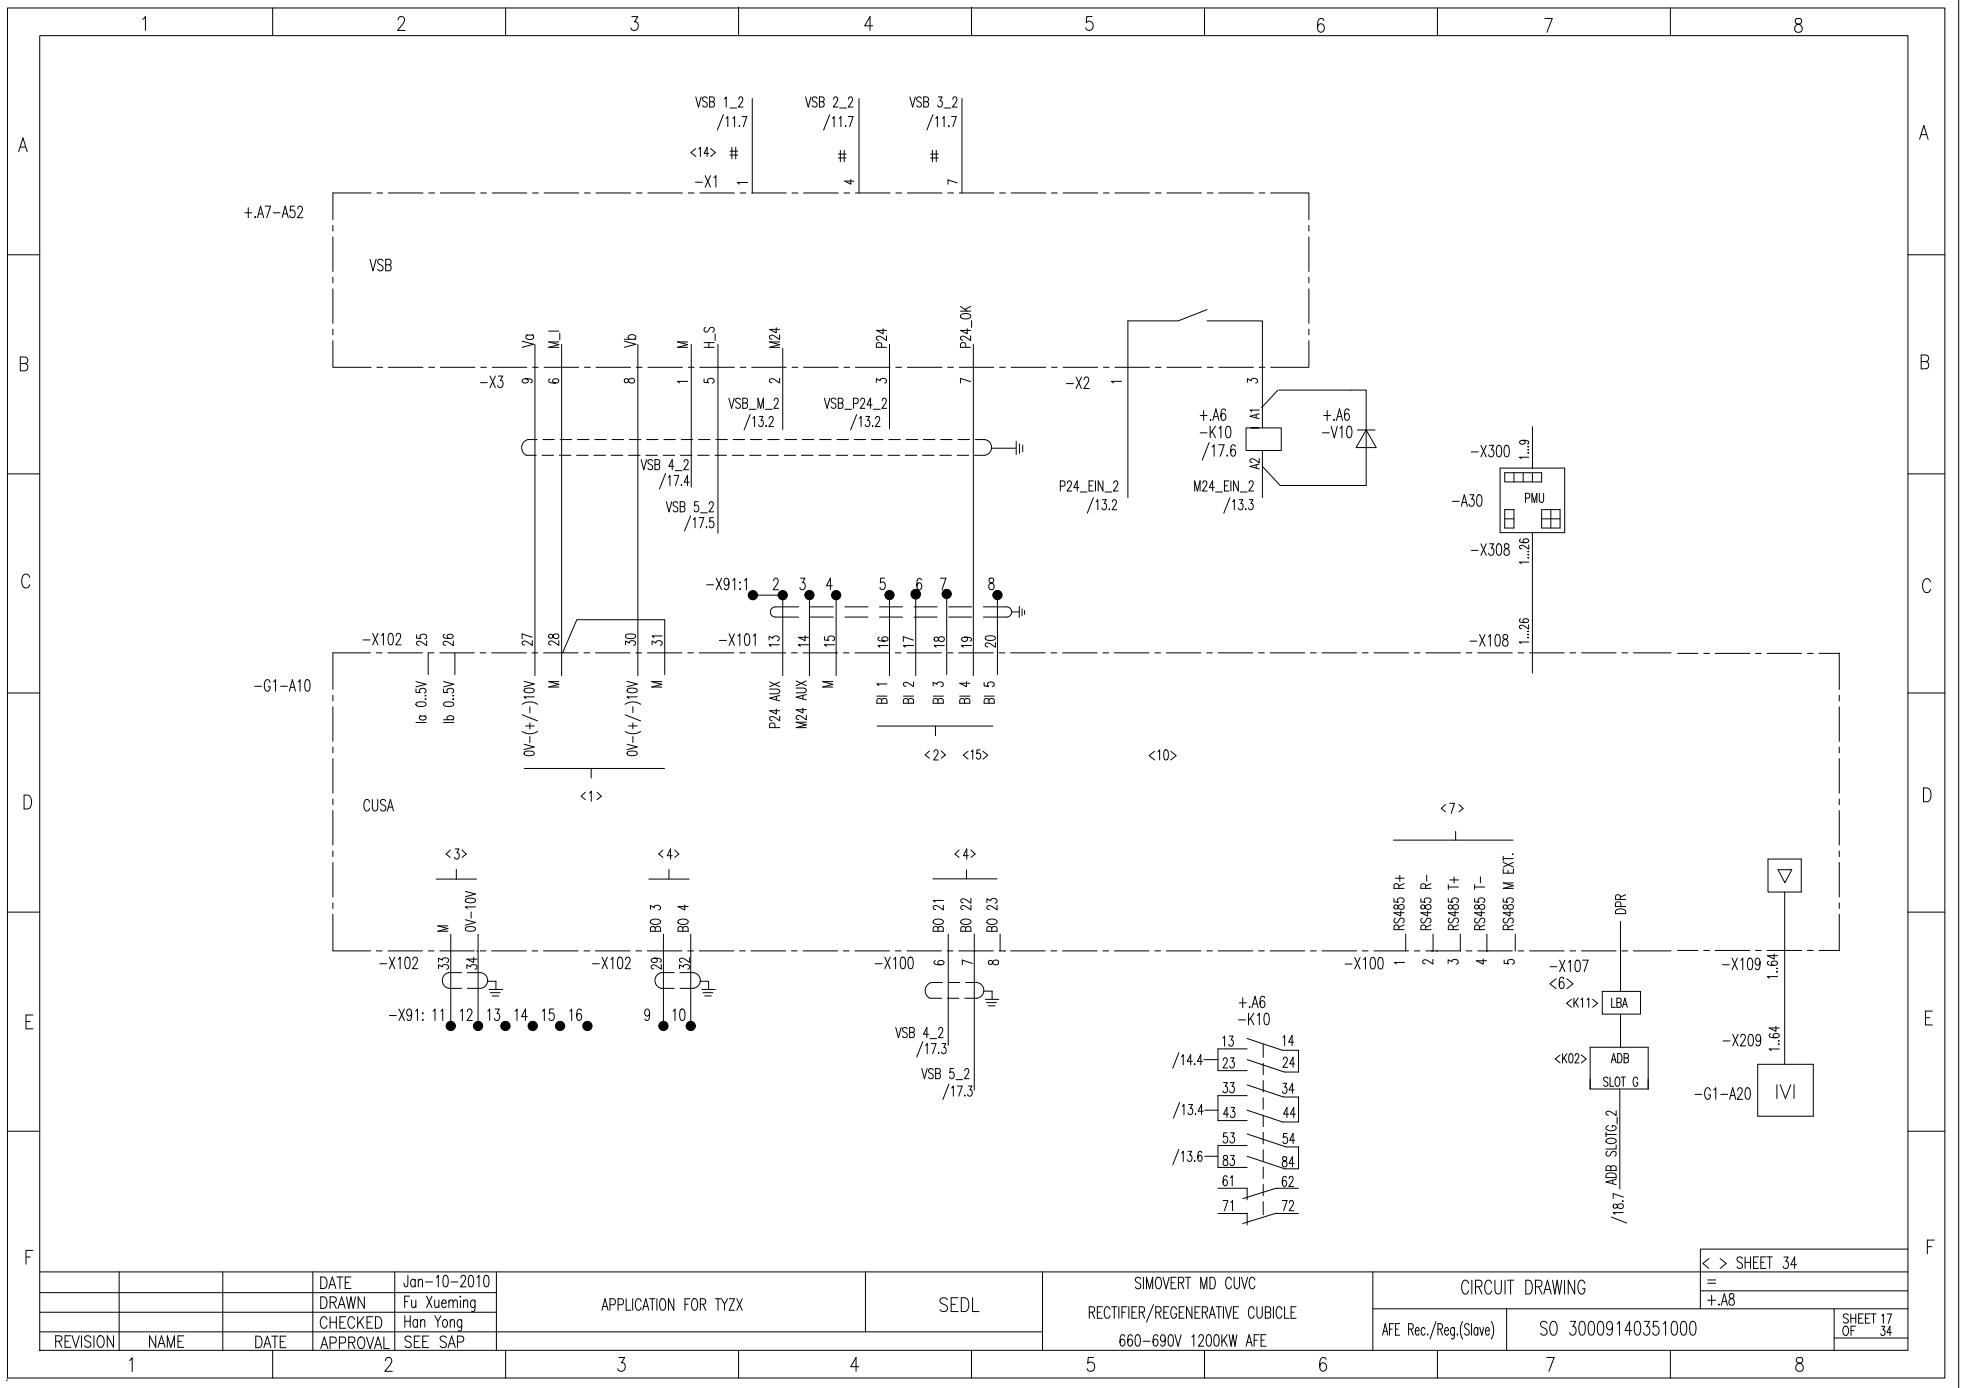

REVISION	NAME	DATE	DATE	Jan-10-2010
		DRAWN	Fu Xueming	
		CHECKED	Han Yong	
		APPROVAL	SEE SAP	

APPLICATION FOR TYZX

SEDL

SIMOVERT MD CUVC
RECTIFIER/REGENERATIVE CUBICLE
660-690V 1200KW AFE

CIRCUIT DRAWING

AFE Rec./Reg.(Slave)


SO 30009140351000

< > SHEET 34

=

+A8


SHEET 17
OF 34

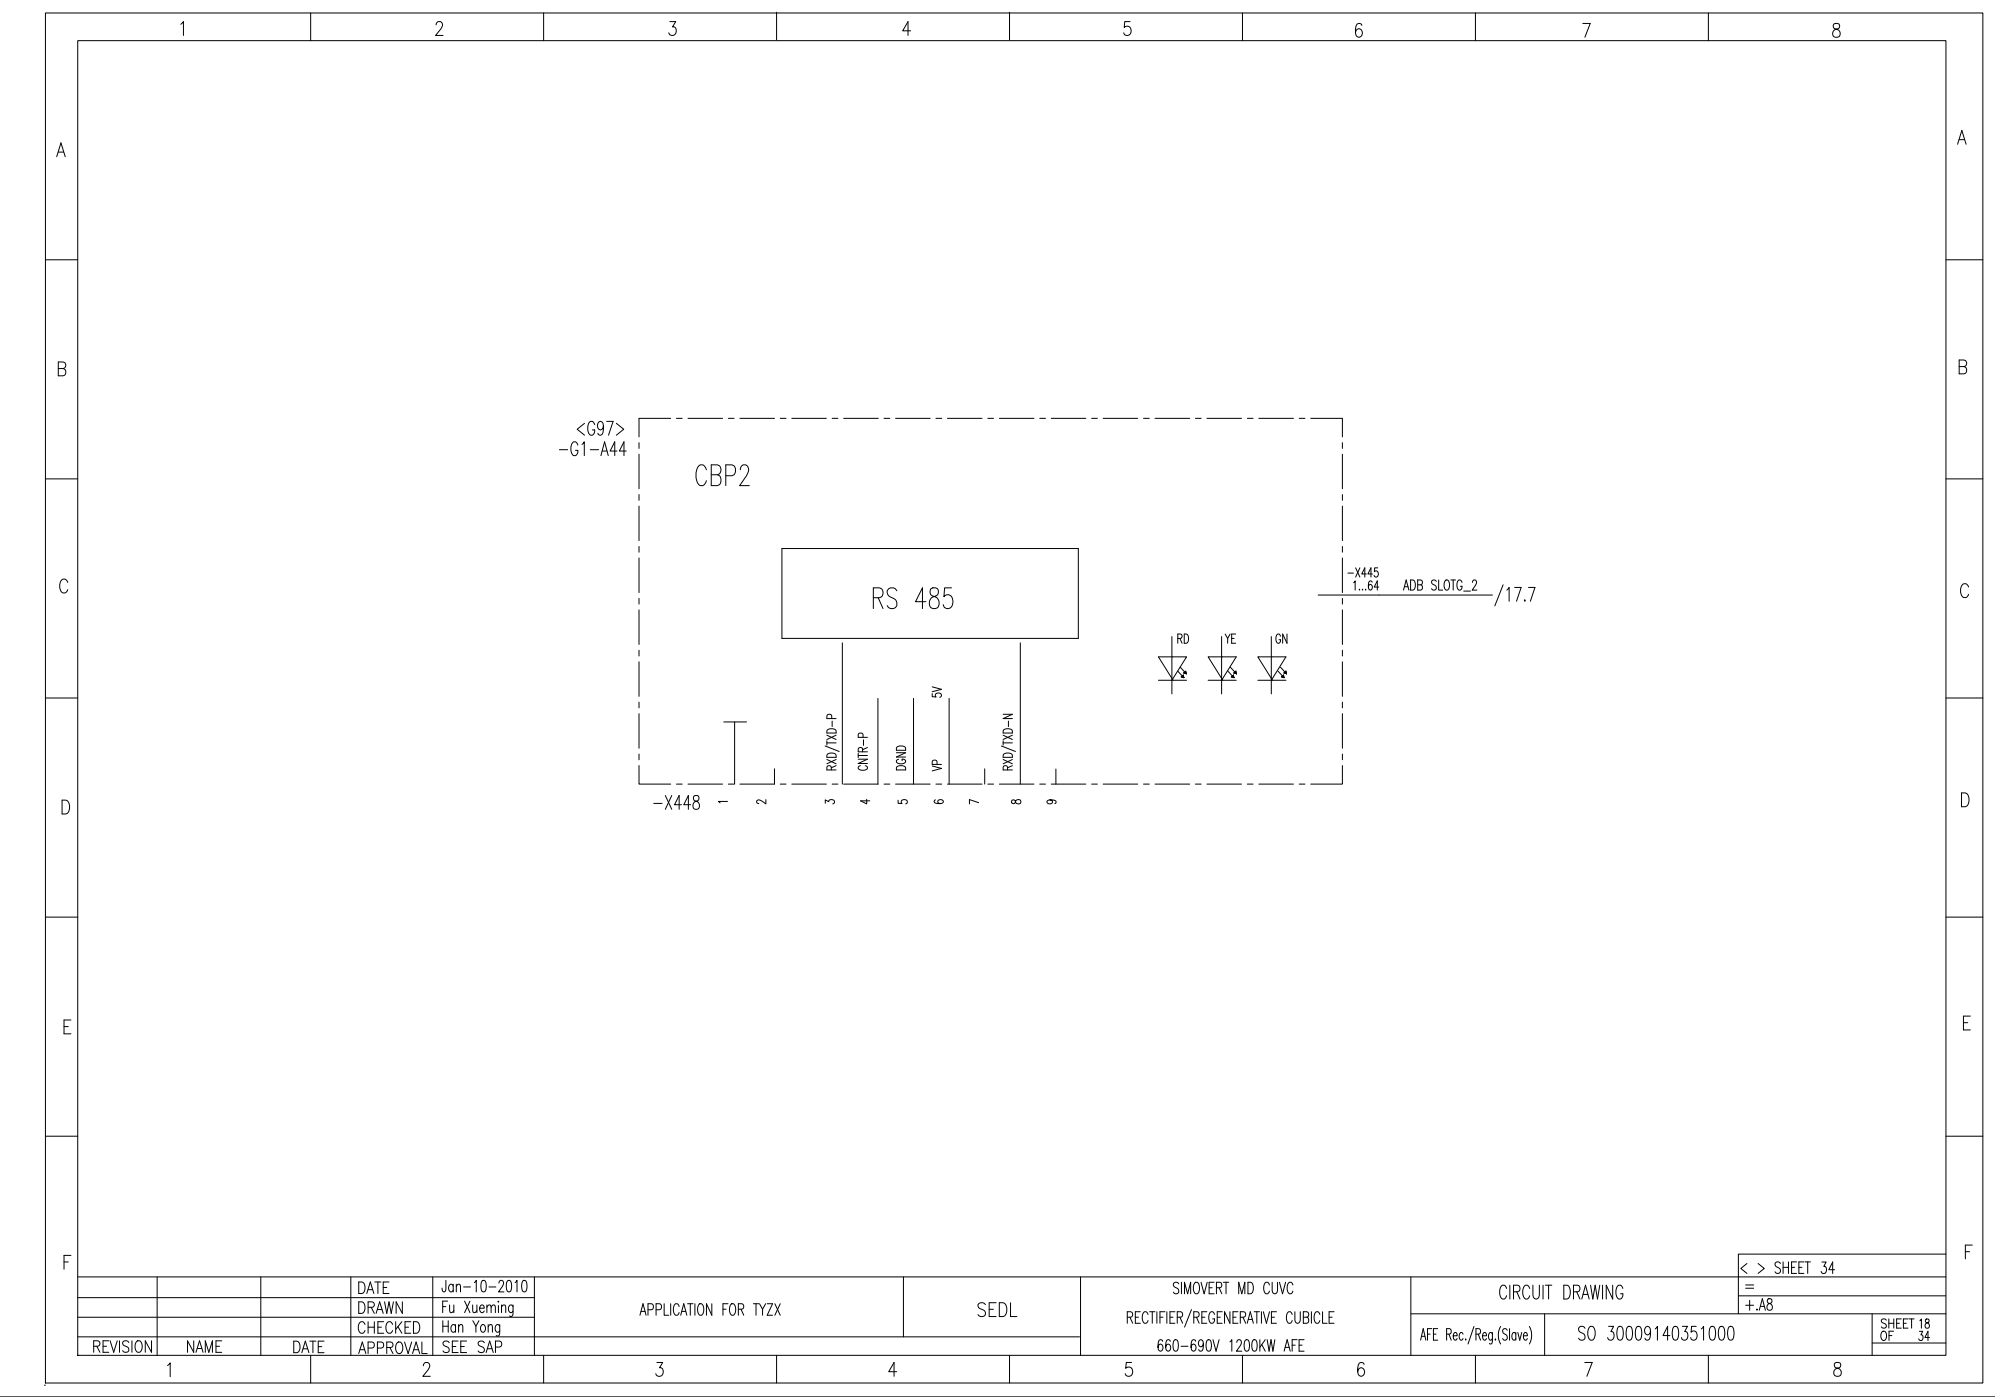


			DATE	Jan-10-2010				< > SHEET 34	
			DRAWN	Fu Xueming	APPLICATION FOR TYZX		SEDL	SIMOVERT MD CUVC	=
			CHECKED	Han Yong				RECTIFIER/REGENERATIVE CUBICLE	+A8
REVISION	NAME	DATE	APPROVAL	SEE SAP				660-690V 1200KW AFE	AFE Rec./Reg.(Slave)
1					2	3	4	5	6

CIRCUIT DRAWING		SO 30009140351000		SHEET 18 OF 34	
7		8			



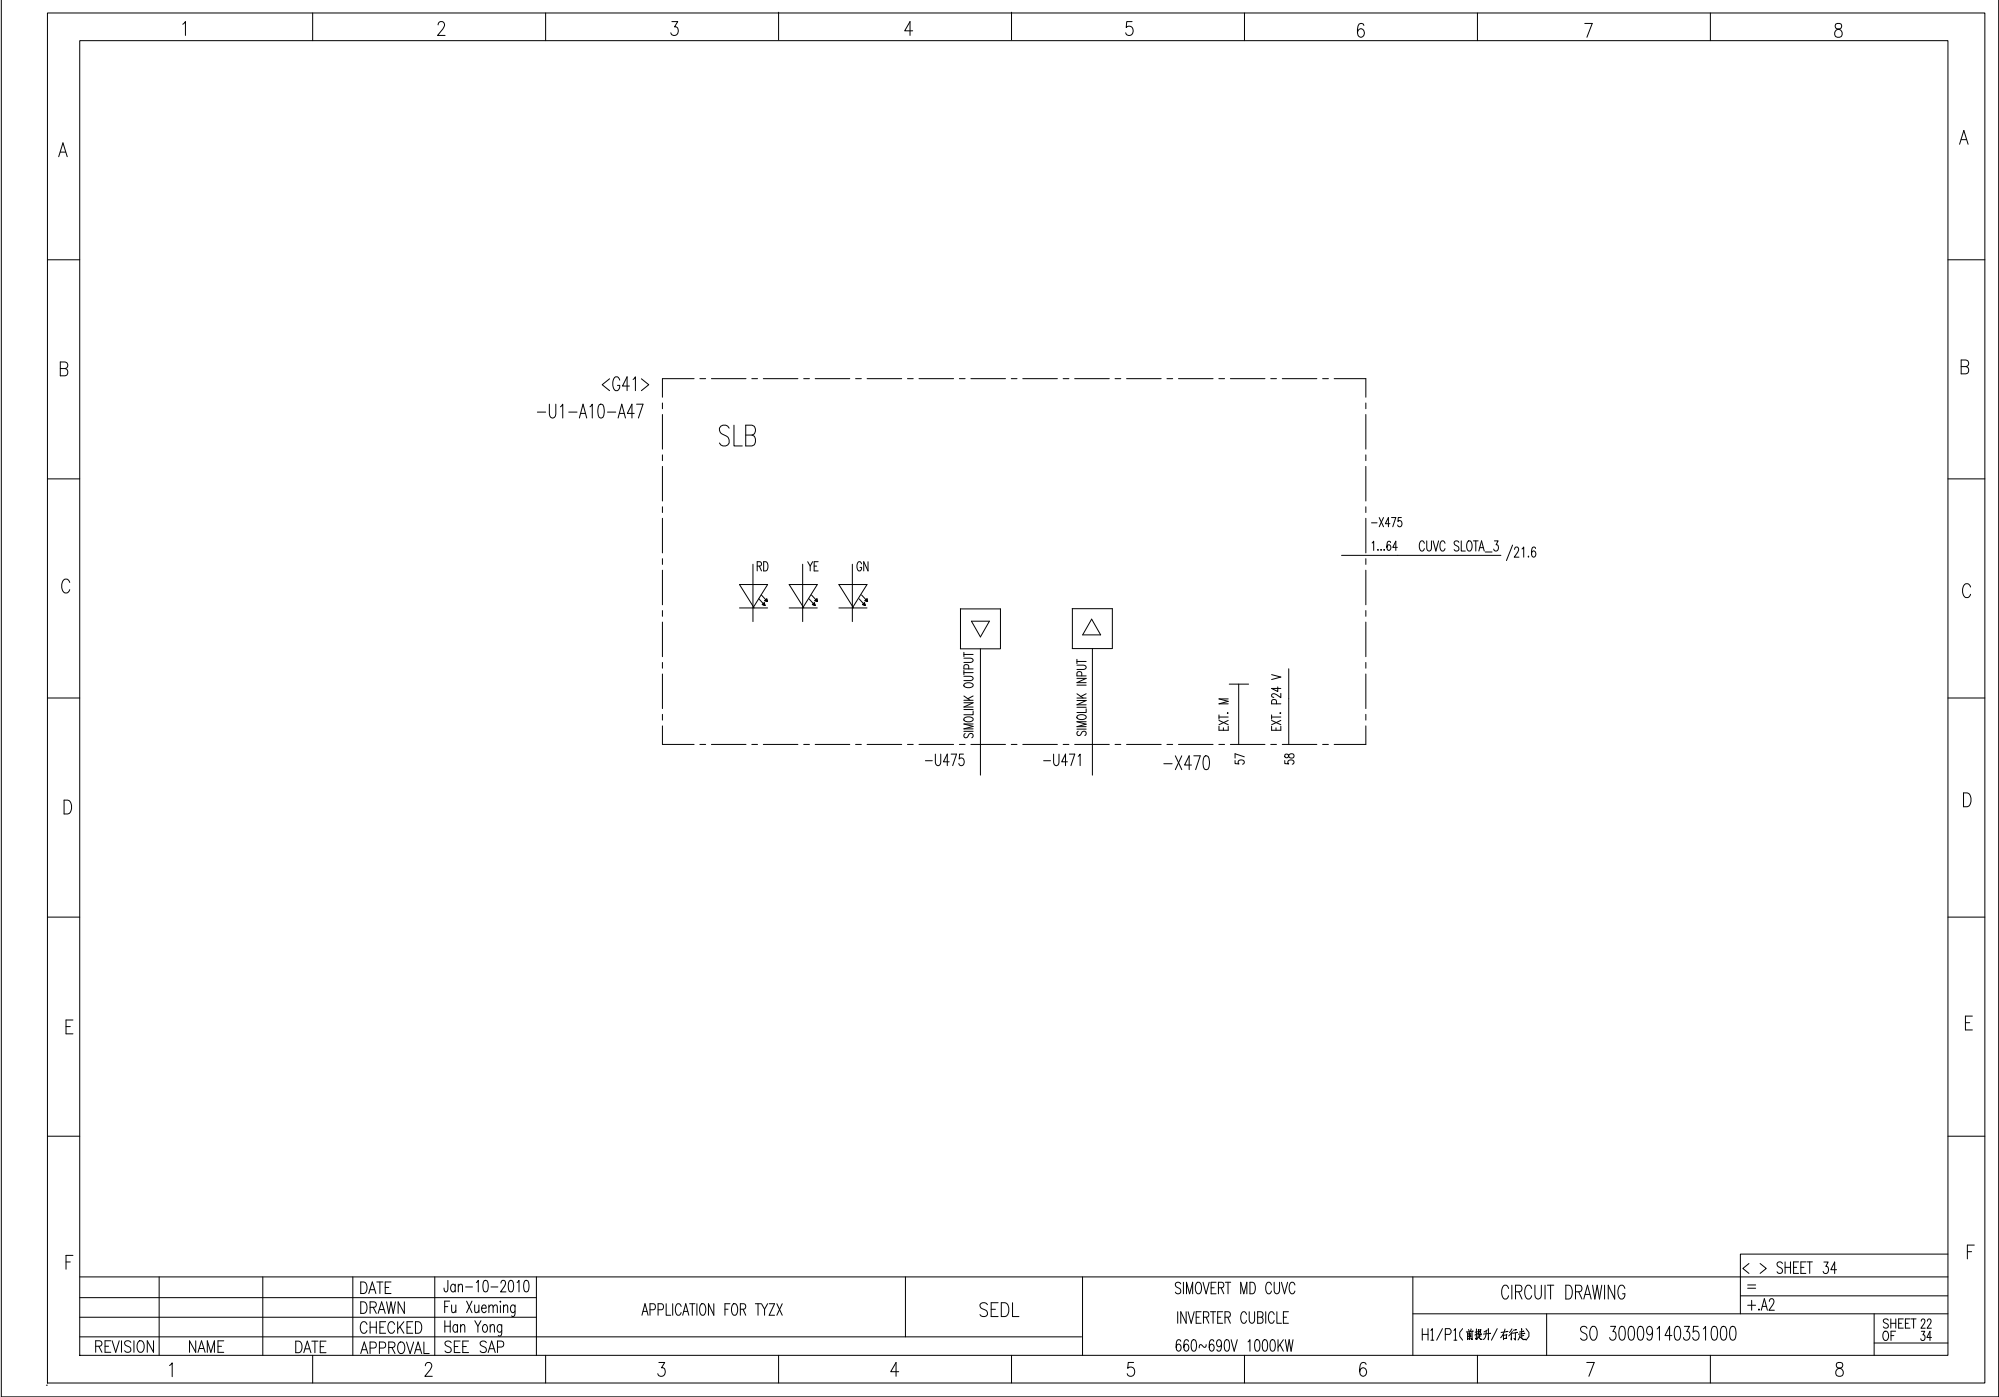

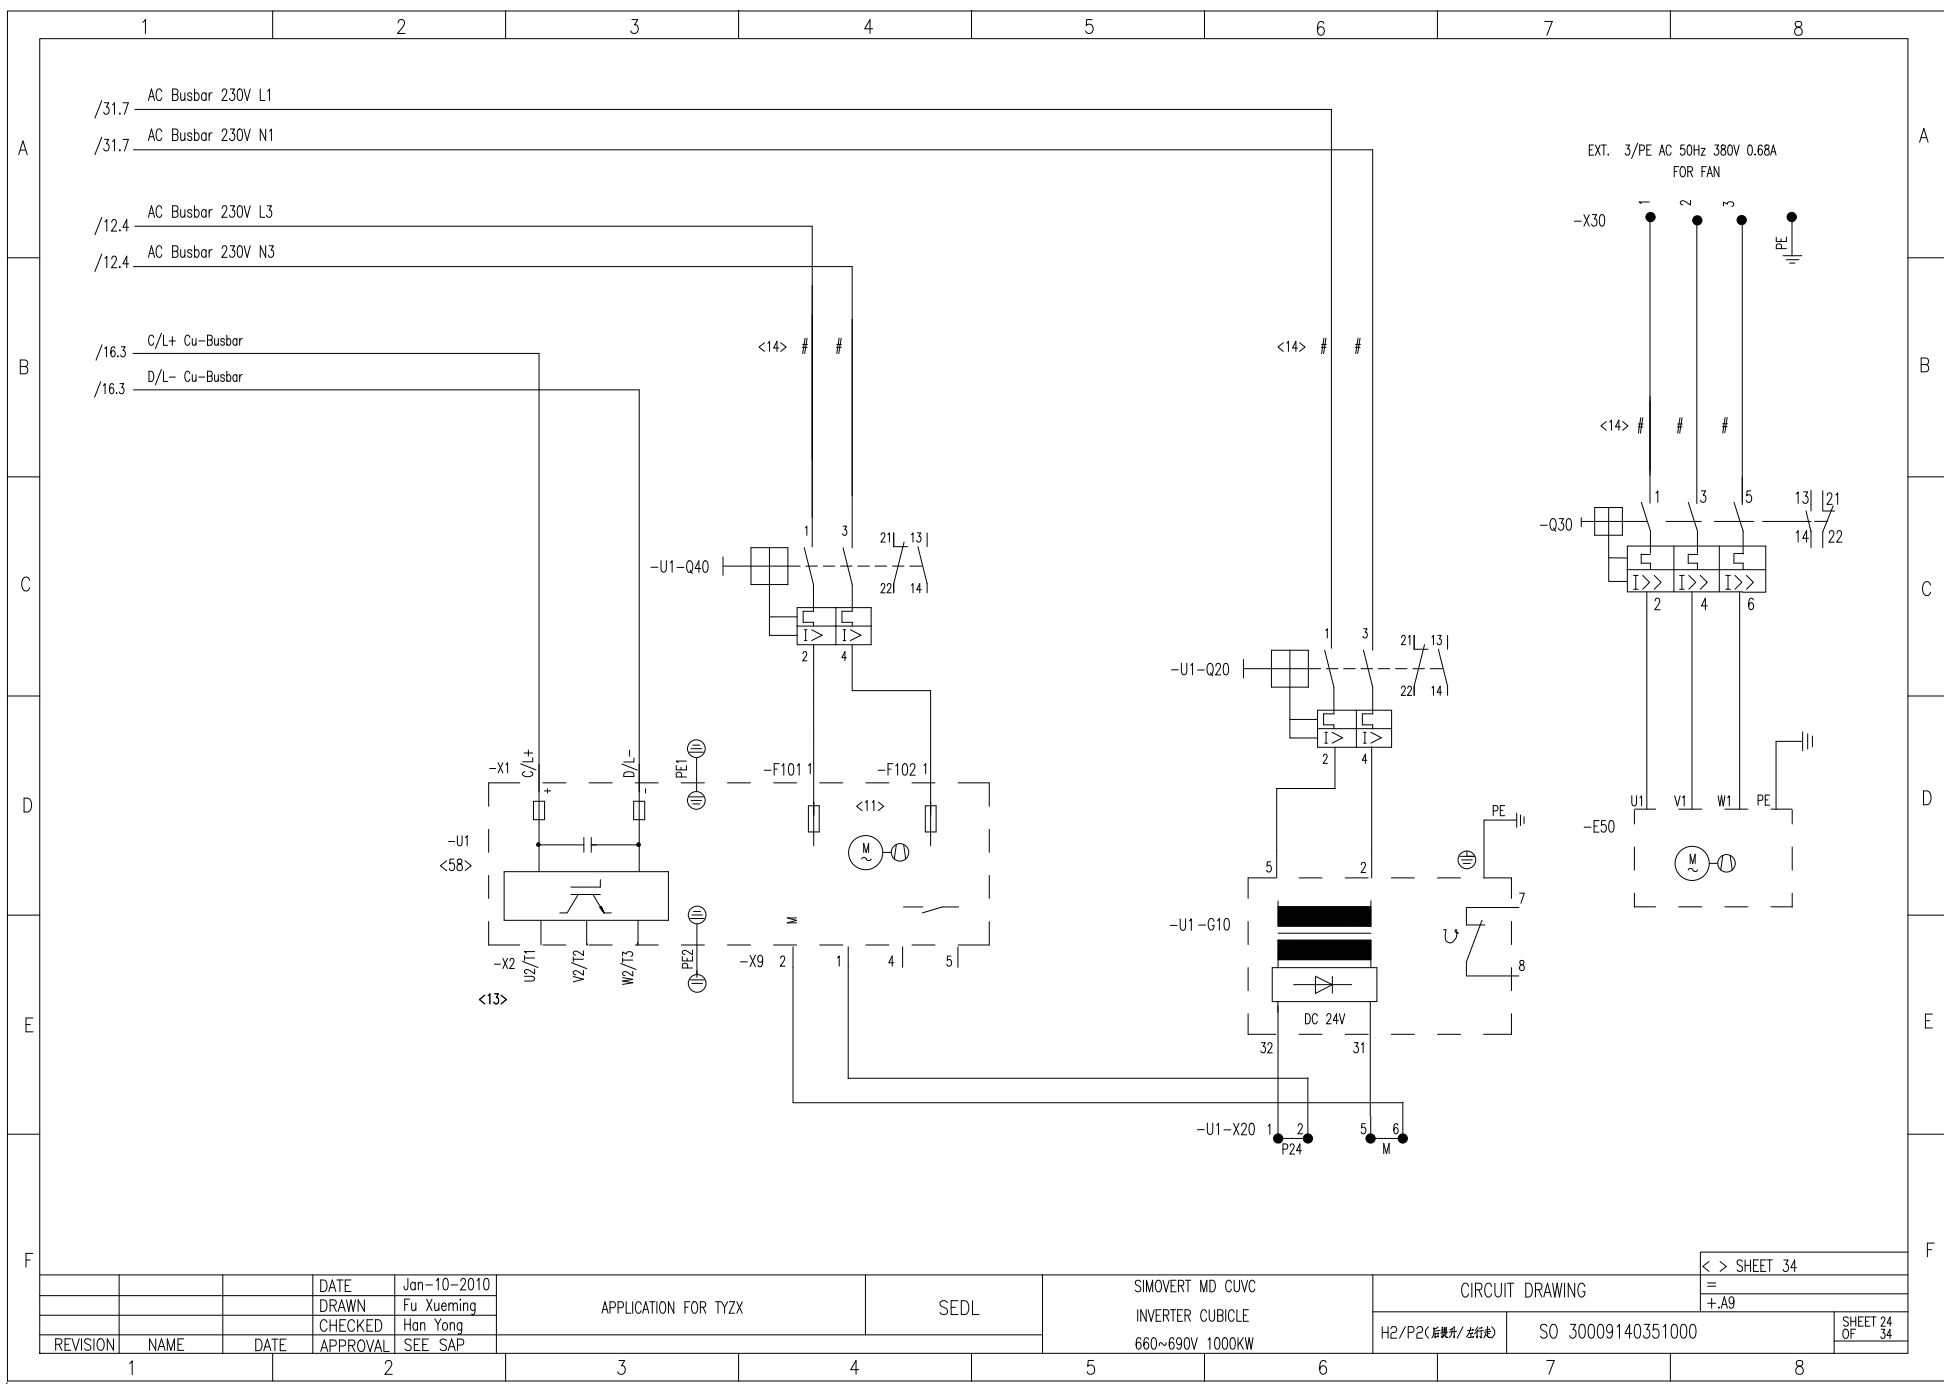

REVISION	NAME	DATE	DATE	Jan-10-2010
			DRAWN	Fu Xueming
			CHECKED	Han Yong
			APPROVAL	SEE SAP

APPLICATION FOR TYZX

SEDL

SIMOVERT MD CUVC
INVERTER CUBICLE
660~690V 1000KW

CIRCUIT DRAWING

H2/P2<后翼升/左箱柜>


SO 30009140351000

< > SHEET 34


=

+A9


SHEET 24
OF 34

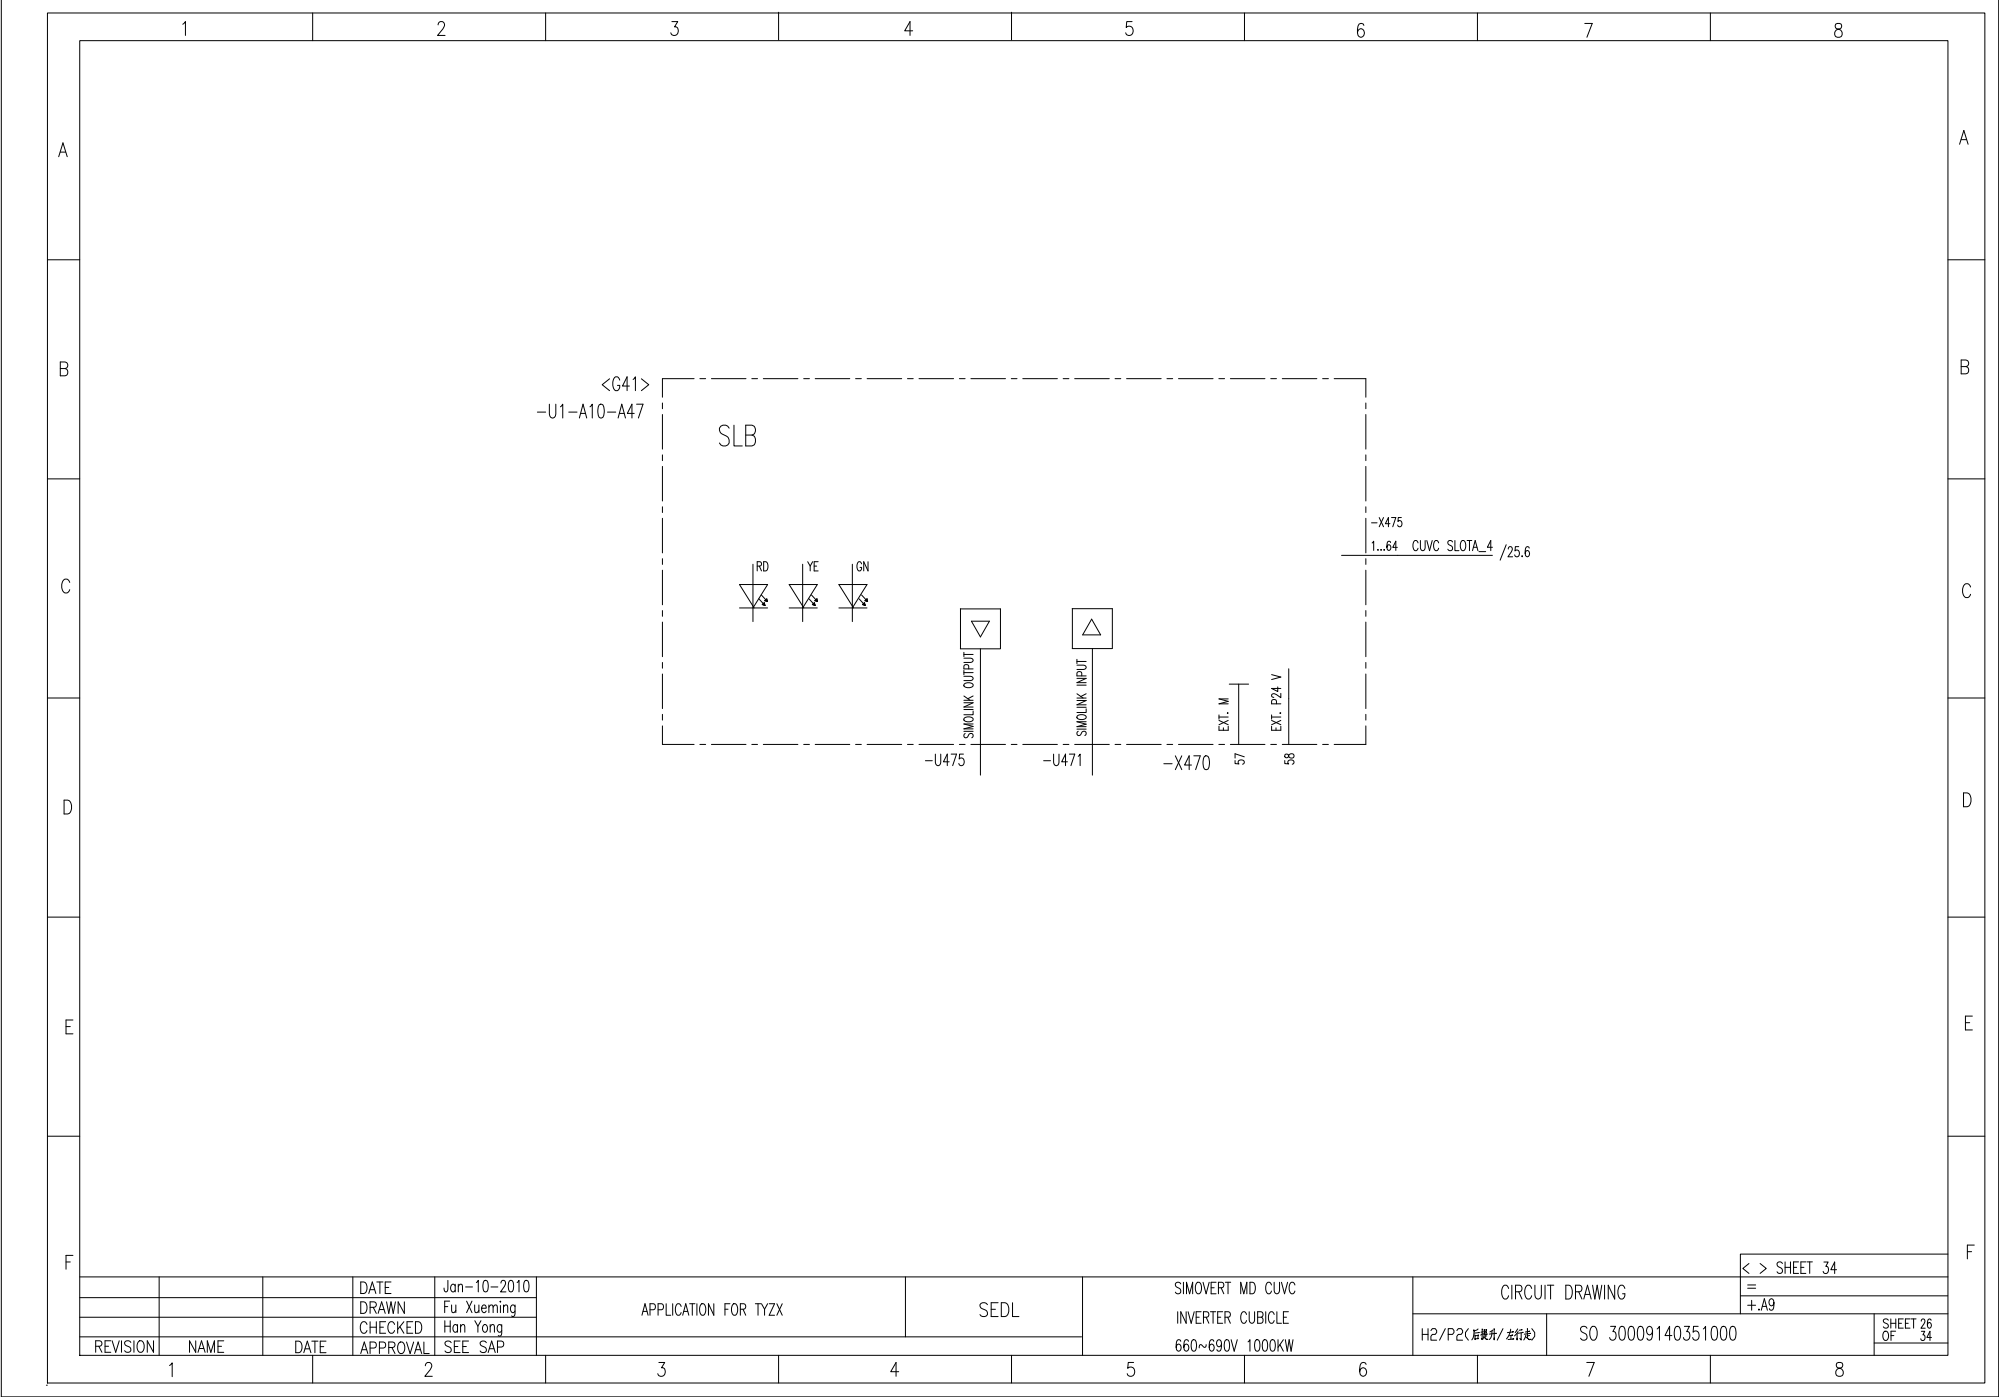

			DATE	Jan-10-2010	APPLICATION FOR TYZX		SED L		SIMOVERT MD CUV INVERTER CUBICLE 660~690V 1000KW		CIRCUIT DRAWING		< > SHEET 34	
			DRAWN	Fu Xueming									=	
			CHECKED	Han Yong									+A9	
REVISION	NAME	DATE	APPROVAL	SEE SAP							H2/P2(后翼升/左桁架)	SO 30009140351000		SHEET 26 OF 34









1		2		3		4		5		6		7		8	
A															A
B															B
C															C
D															D
E															E
F															F

No. < >	DESCRIPTION ENGLISH				中文描述			
1	ANALOG INPUTS				模拟量输入			
2	BINARY INPUTS				开关量输入			
3	ANALOG OUTPUTS				模拟量输出			
4	BINARY OUTPUTS				开关量输出			
5	BINARY IN-/OUTPUTS				开关量输入/输出			
6	INTERFACE DPR				DPR 接口			
7	SERIAL INTERFACE RS485				串行口RS485			
8	CONNECTION DIGITAL TACHOMETER				数字测速机接线			
9	CONNECTION MOTOR TEMPERATURE SENSOR				电机温度传感器接线			
10	ALL IN-AND OUTPUTS REFERRING TO GROUND HAVE THE SAME POTENTIAL				所有输入输出对地的参考电位相同			
11	CHASSIS FAN SUPPLY AC 230V				装置风扇 AC230V 供电			
12	POWER INPUT				功率输入			
13	POWER OUTPUT				功率输出			
14	ALL WIRES WITH # MARK ARE UNFUSED WIRES,SHOULD BE LAYED FOLLOW THE RULES OF UNFUSED WIRE				所有标#的导线为无熔断器保护的导线应遵循无熔断器保护导线的相关规定进行布线			
15	WORK SHOP SETTING FOR CUBICLES	CUSA	CUVC		工厂设定	CUSA	CUVC	
	EXT. FAULT 1		BI 5		外部故障		BI 5	
	EXT. ALARM	BI 2	BI 6		外部警告	BI 2	BI 6	
	ON/OFF1	BI 1	BI 7		起动/停止	BI 1	BI 7	
	ACKNOWLEDGE/RESET	BI 3	BIO 1		故障确认/复位	BI 3	BIO 1	
	REASON/STANDBY	BI 5	BIO 2		基本/备用	BI 5	BIO 2	
	P24-OK	BI 4			P24 准备好	BI 4		
	FAULT		BIO 3		故障		BIO 3	
19	MONITORING THE AUX CONTACTS OF THE FILTER CONTACTORS -K7 BY THE PLC TO PREVENT THE WELDING OF THE CONTACTS				通过PLC监测滤波器接触器K7的辅助触点.防止在AFE工作时, K7不正常的通断			
21	THE LAYOUT OF 2 SETS AFE CUB. IS MIRROR				AFE 整流/回馈单元互为镜像			
57	AFE RECTIFIER/REGENERATIVE				AFE 整流/回馈单元			
58	INVERTER				逆变器			
K02	OPTION: ADAPTER BOARD				选件:适配板 ADB			
K11	OPTION: LBA BUS ADAPTER				选件:母线适配器 LBA			
G93,G97	OPTION: CBP2 COMMUNICATION BOARD				选件:CBP2 通讯板			
G41	OPTION: SLB-COMMUNICATION BOARD FOR SIMOLINK				选件:SLB-SIMOLINK通讯板			
K20	OPTION:SERIAL INTERFACE BOARD SCB1				选件: 串行接口板SCB1			

			DATE	Jan-10-2010	APPLICATION FOR TYZX		SEDL	SIMOVERT MD CUVC TEXT DESCRIPTION		CIRCUIT DRAWING					
			DRAWN	Fu Xueming											
			CHECKED	Han Yong											
REVISION	NAME	DATE	APPROVAL	SEE SAP						S0 30009140351000		SHEET 34 OF 34			
1		2		3		4		5		6		7		8	