



# **AC\$B Camp Block 822 Monthly Report - Building Owner**

## **2023-05**





# Table of Contents




- 1. Electricity Consumption.....page 3
- 2. Water Consumption..... page 5
- 3. Anomaly Detection..... page 7



1. Electricity Consumption

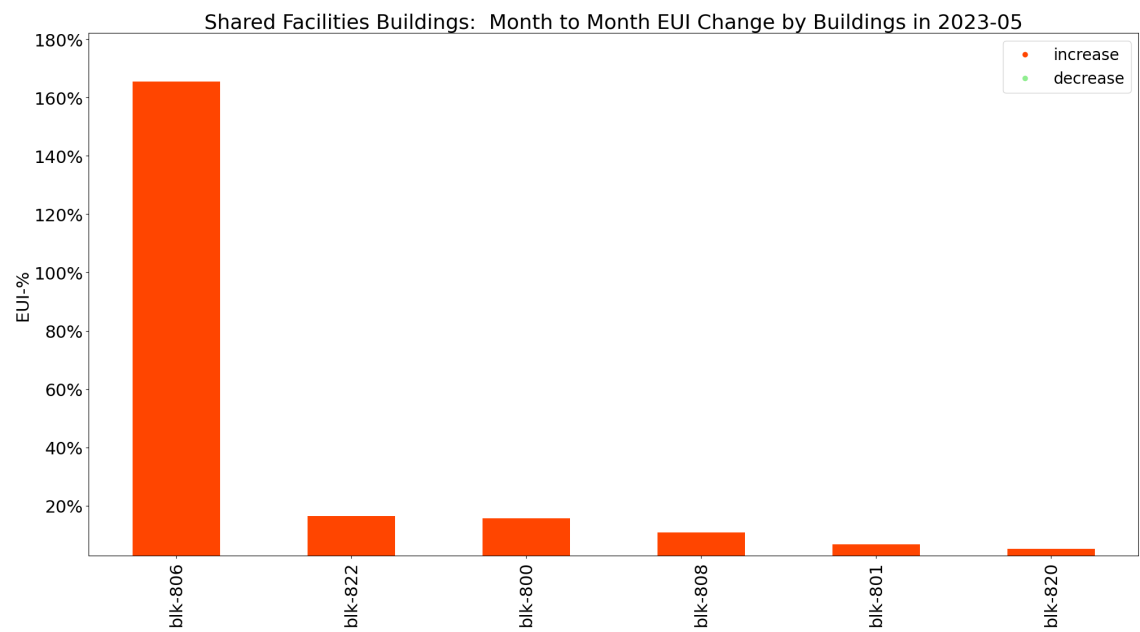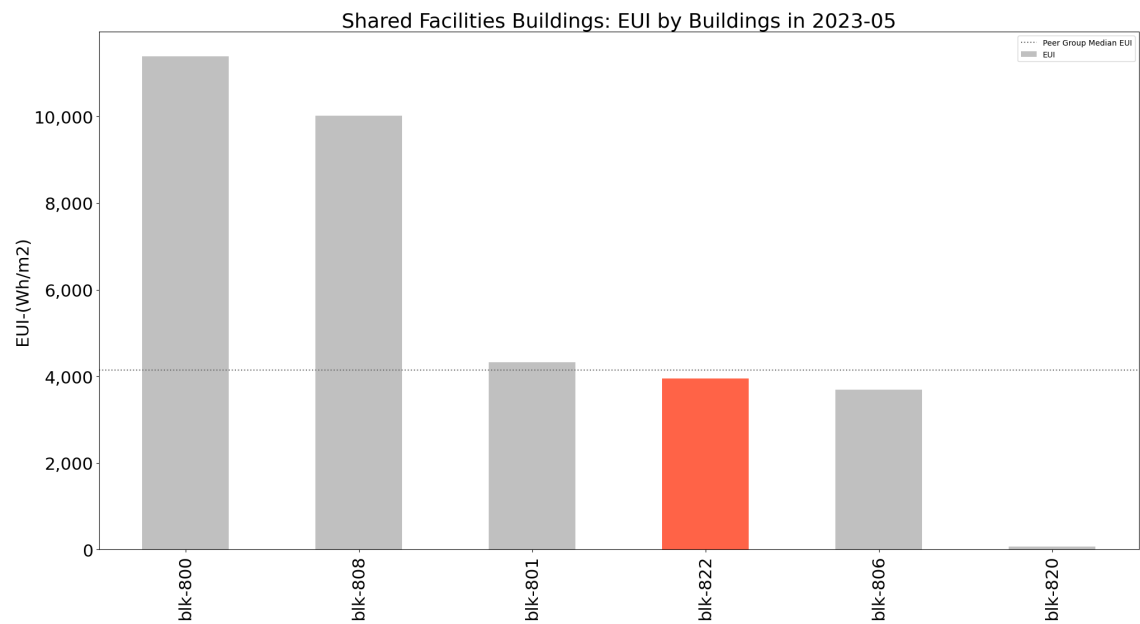



Block 822 Peer Comparison in 2023-05	
EUI for blk-822	3,954 Wh/m2
EUI for Best Performing Peer	65 Wh/m2
EUI % Against Best Performing Peer	5,977%
EUI % Against Median Peer	-5%

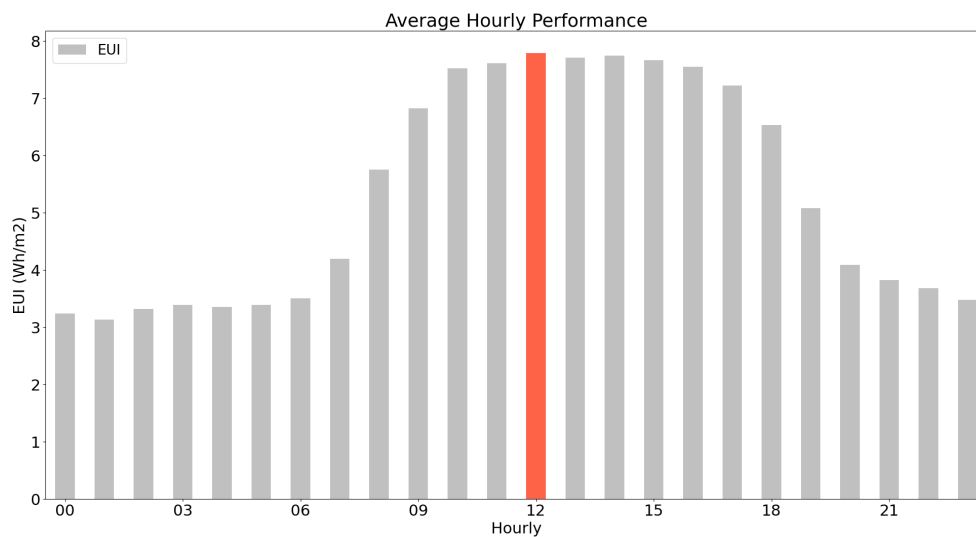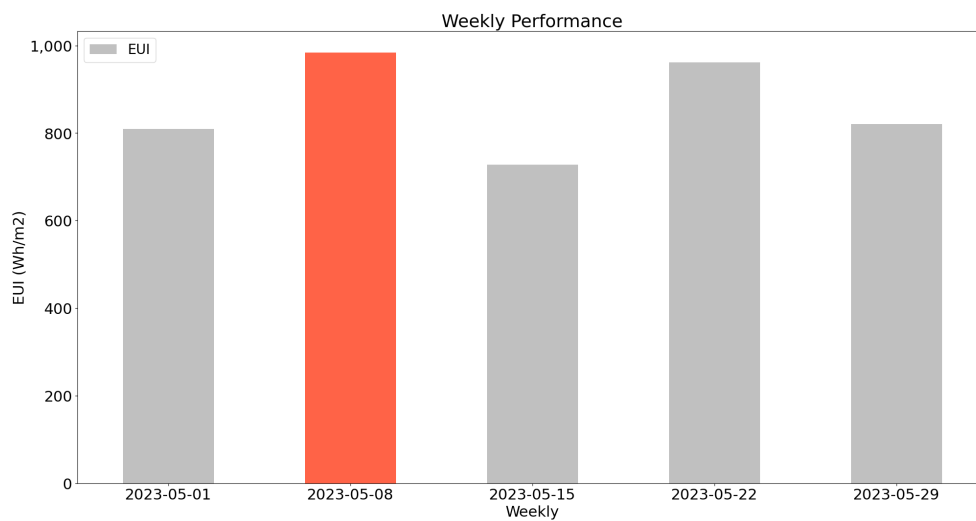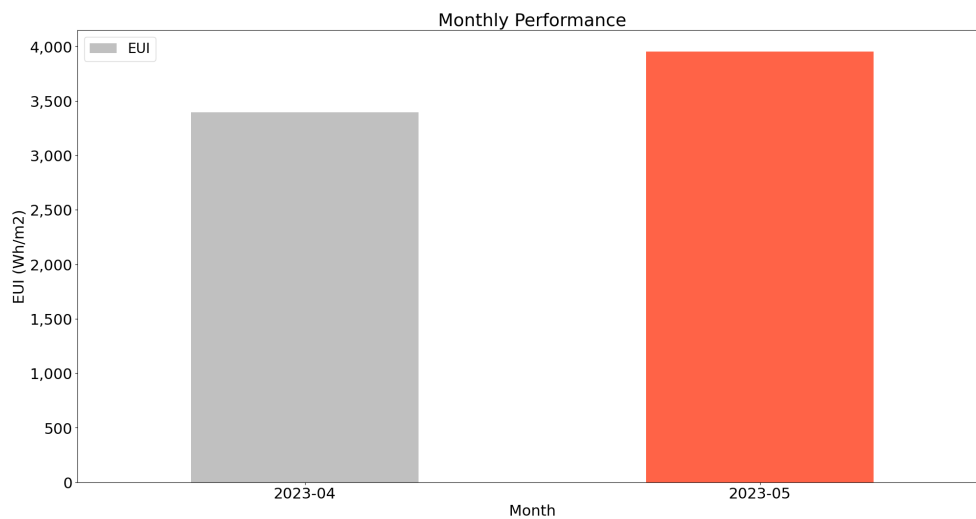




Block 822 Self Comparison in 2023-05	
EUI This Month	3,954 Wh/m2
EUI Last Month	3,397 Wh/m2
EUI Month to Month Comparison	increase 16%
Highest EUI Week	984 Wh/m2, Week Starting From 2023-05-08
Highest EUI Hour	8 Wh/m2 in 12:00-13:00 hr



2. Water Consumption

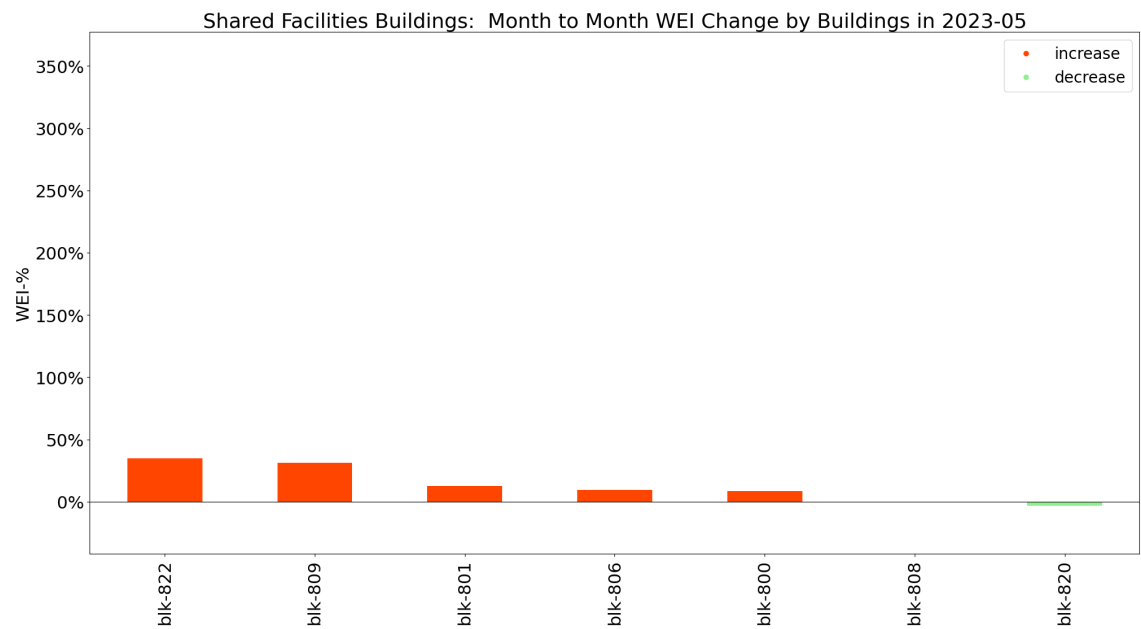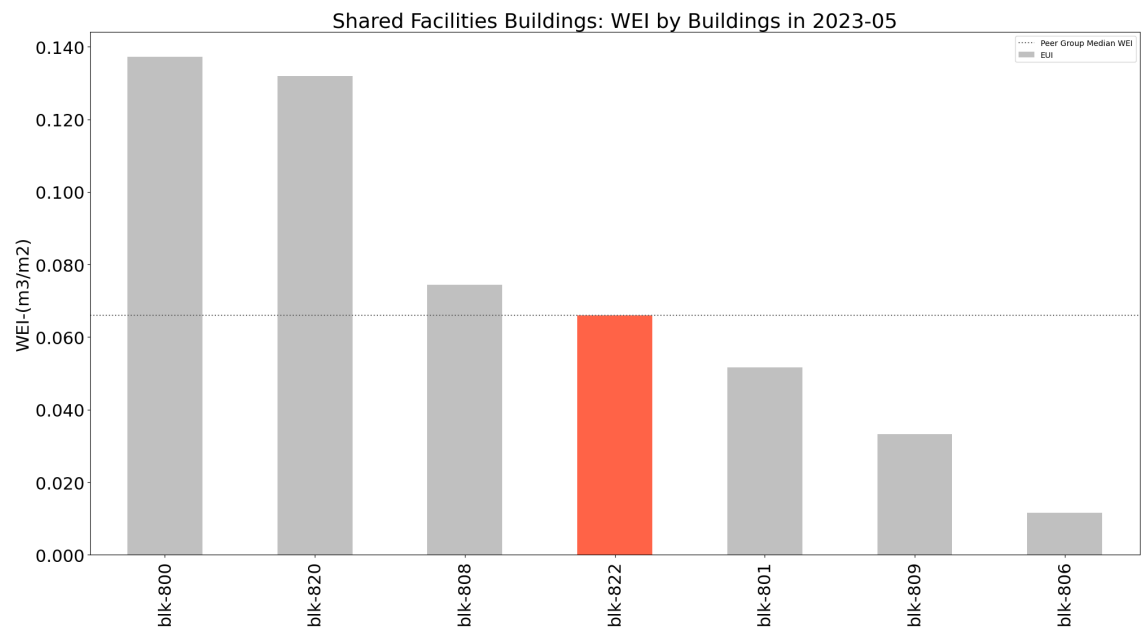

Block 822 Peer Comparison in 2023-05	
WEI for blk-822	0.066 m3/m2
WEI for Best Performing Peer	0.012 m3/m2
WEI % Against Best Performing Peer	472%
WEI % Against Median Peer	0%

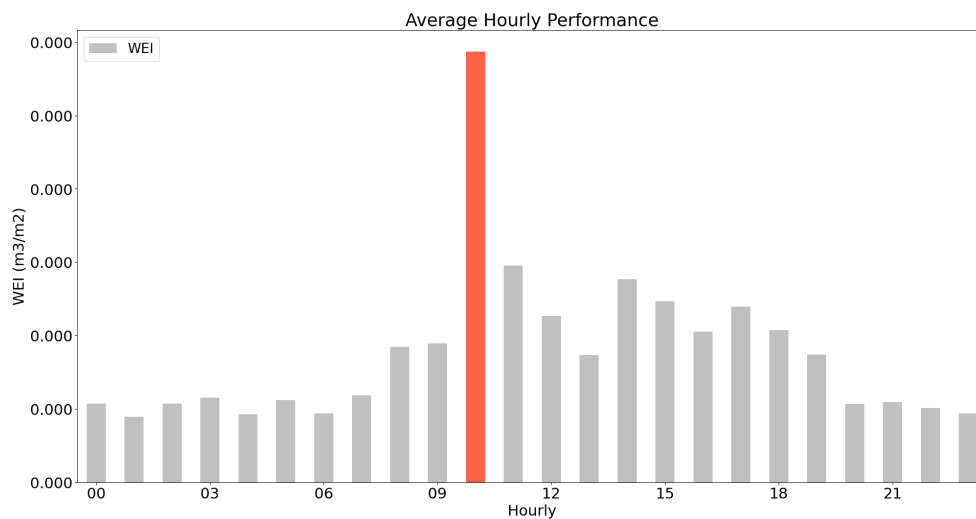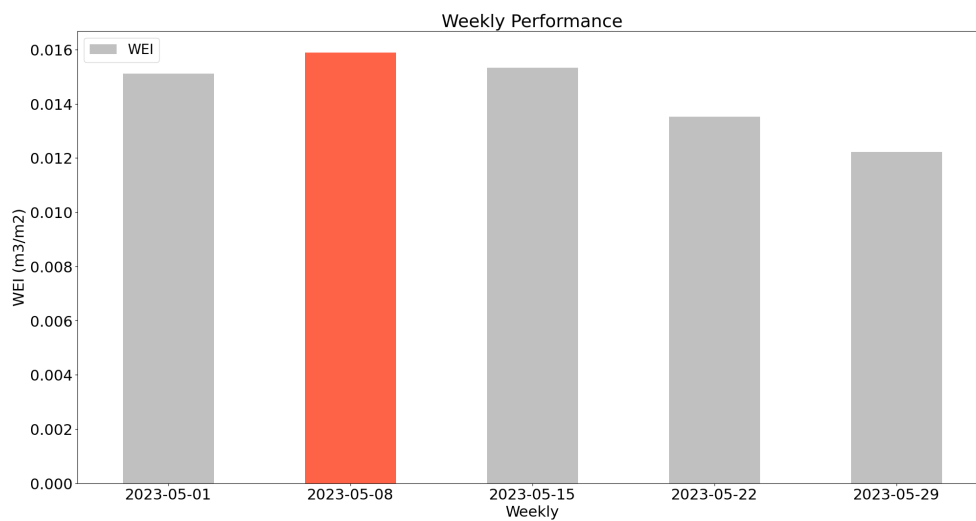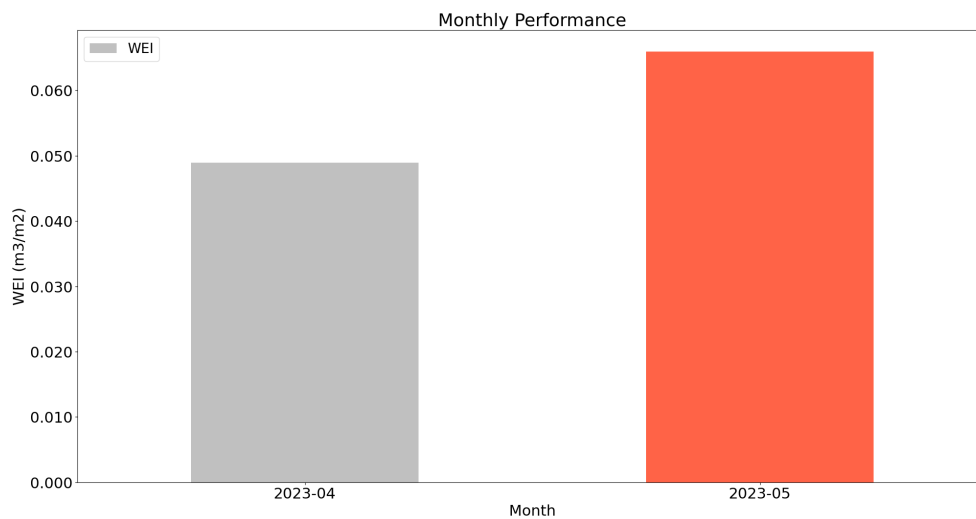

Block 822 Self Comparison in 2023-05	
WEI This Month	0.066 m3/m2
WEI Last Month	0.049 m3/m2
WEI Month to Month Comparison	increase 35%
Highest WEI Week	0.016 m3/m2, Week Starting From 2023-05-08
Highest WEI Hour	0.0003 m3/m2 in 10:00-11:00 hr



### 3. Anomaly Detection