



AC\$B Camp Unit A7Rf Monthly Report - Unit Commander 2023-05



Table of Contents



1. Electricity Consumption.....page 3

2. Water Consumption..... page 5




3. Anomaly Detection..... page 7



1. Electricity Consumption

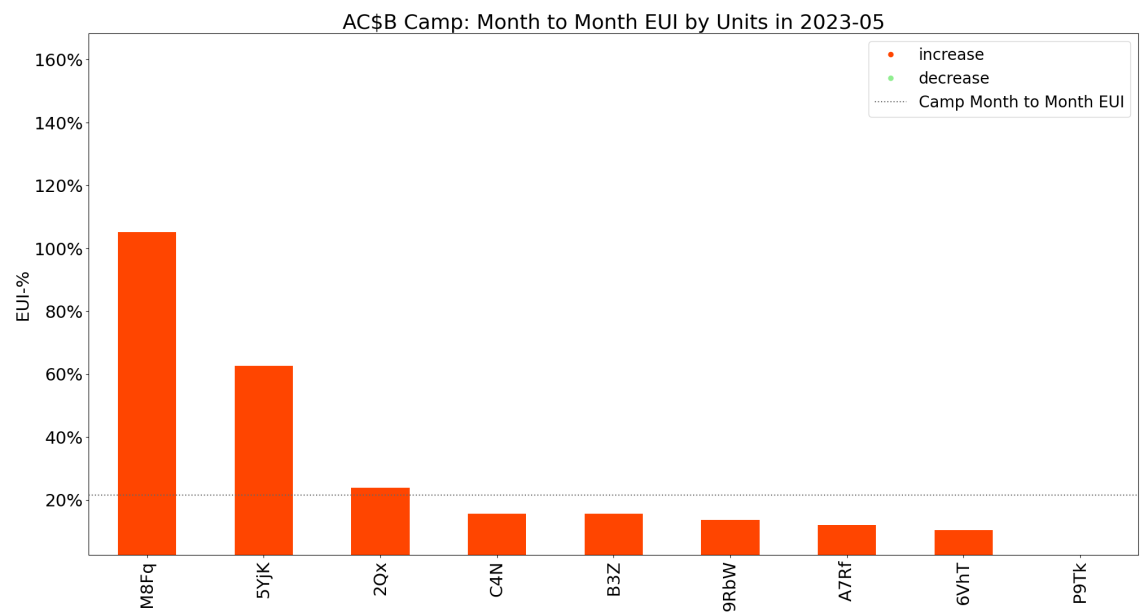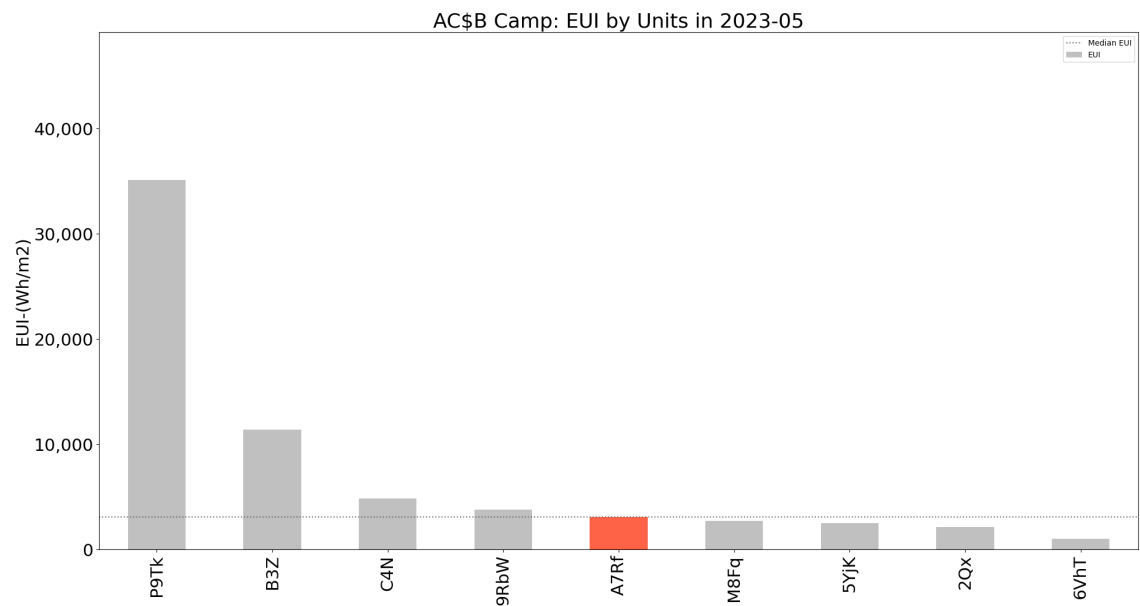



Unit A7Rf Peer Comparison in 2023-05	
EUI for A7Rf	3,070 Wh/m2
EUI for Best Performing Peer	1,031 Wh/m2
EUI % Against Best Performing Peer	198%
EUI % Against Median Peer	0%

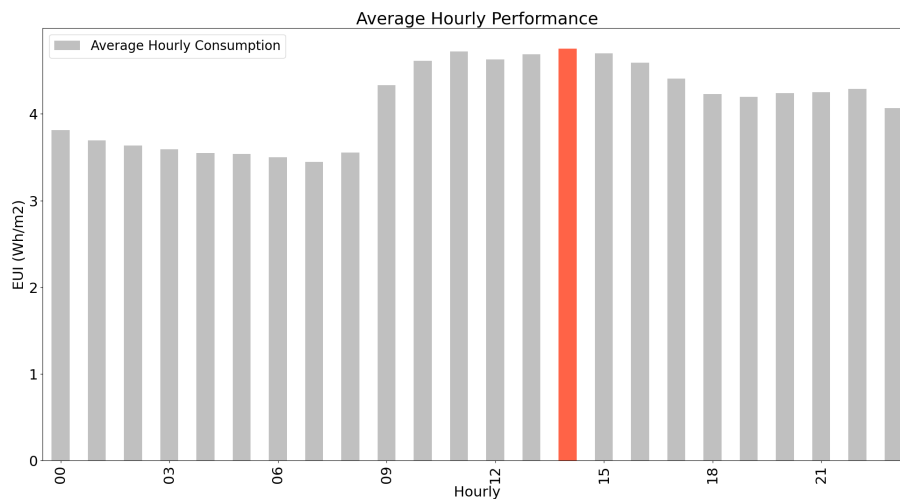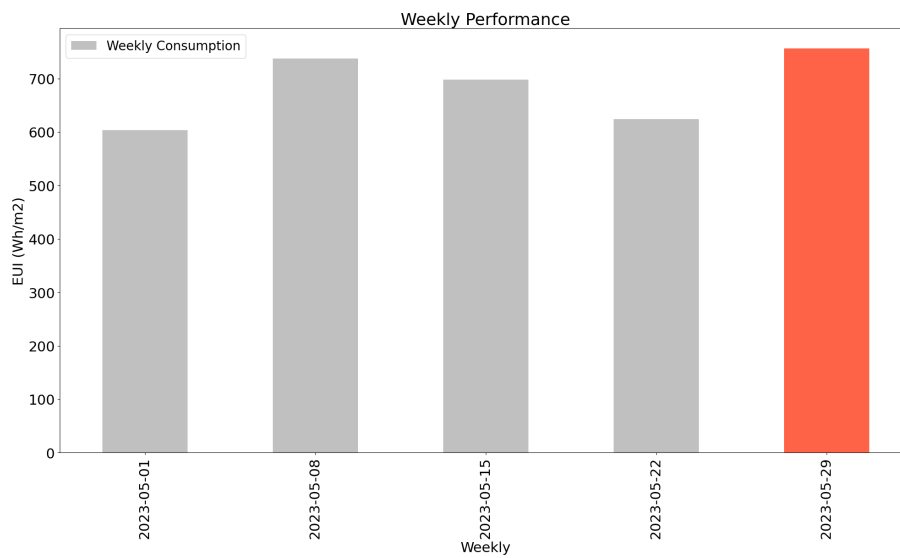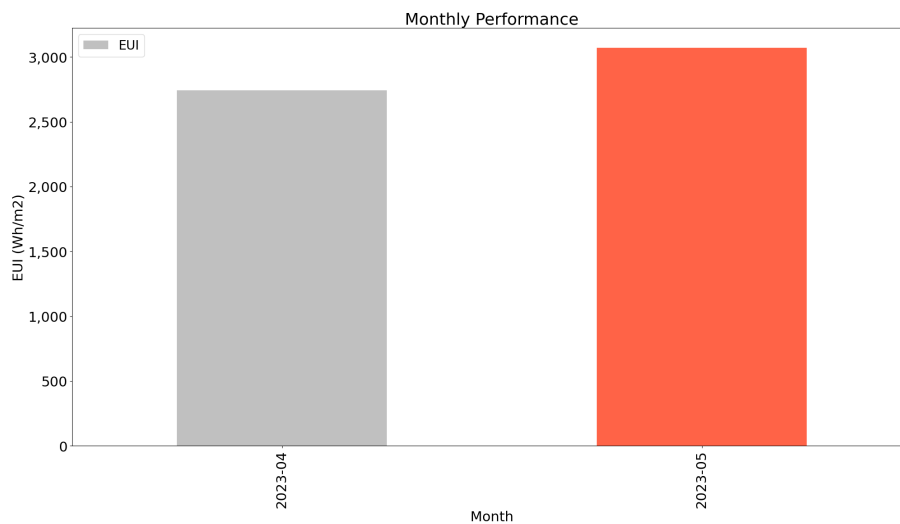




Unit A7Rf Self Comparison in 2023-05	
EUI This Month	3,070 Wh/m2
EUI Last Month	2,742 Wh/m2
EUI Month to Month Comparison	increase 12%
Highest EUI Week	756 Wh/m2, Week Starting From 2023-05-29
Highest EUI Hour	5 Wh/m2 in 14:00-15:00 hr



2. Water Consumption

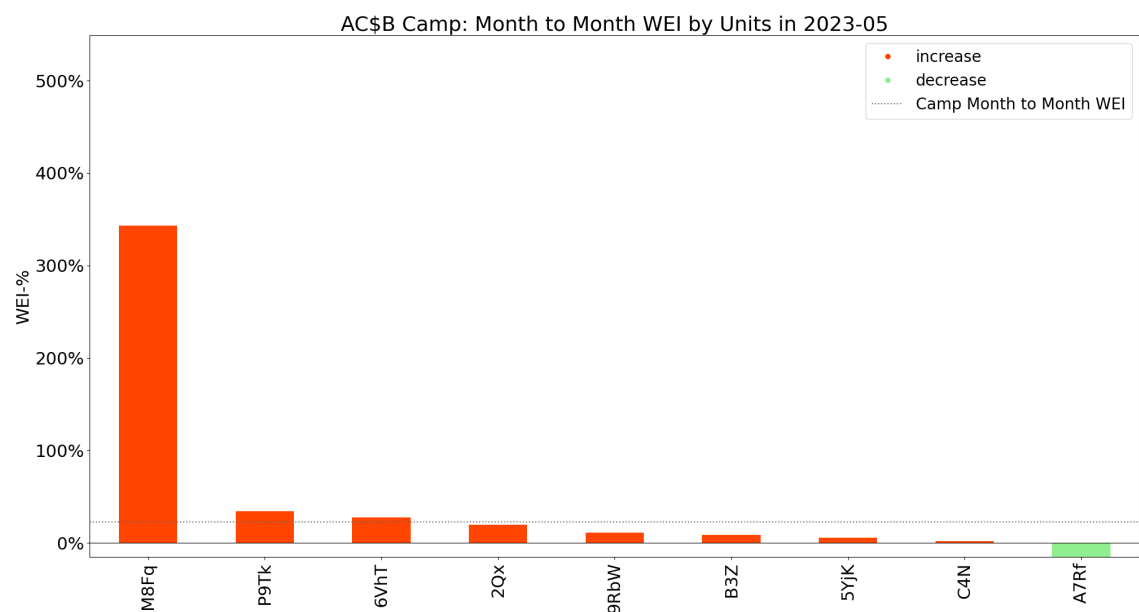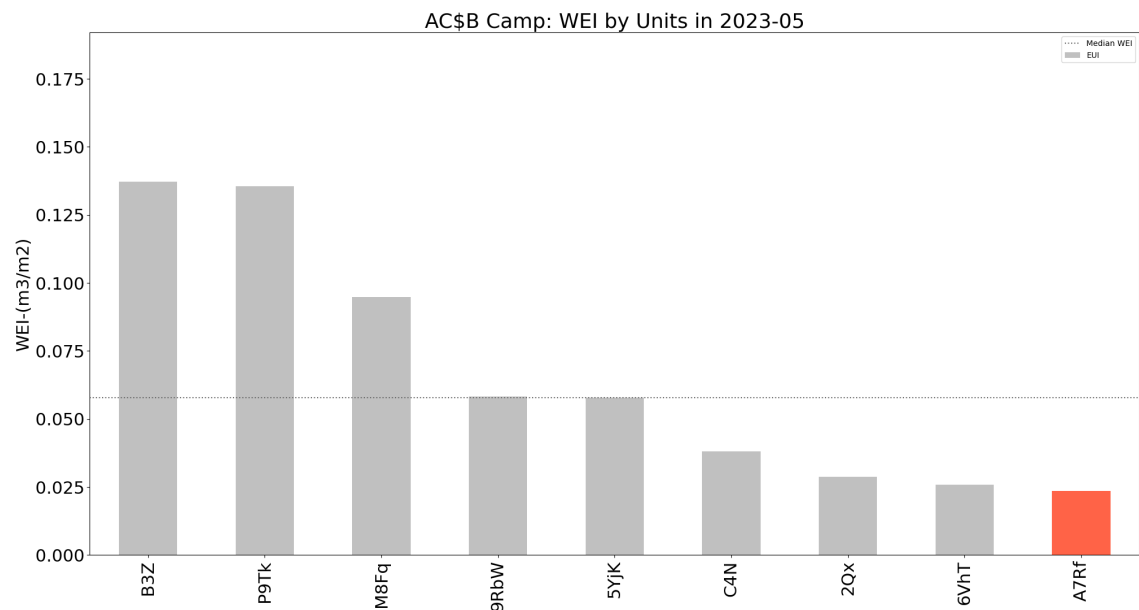


Unit A7Rf Peer Comparison in 2023-05	
WEI for A7Rf	0.023 m3/m2
WEI for Best Performing Peer	0.023 m3/m2
WEI % Against Best Performing Peer	0%
WEI % Against Median Peer	-59%

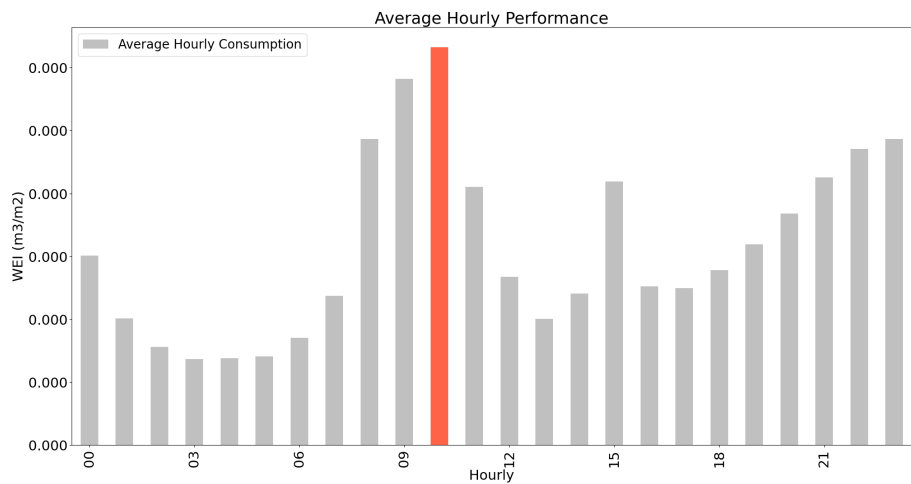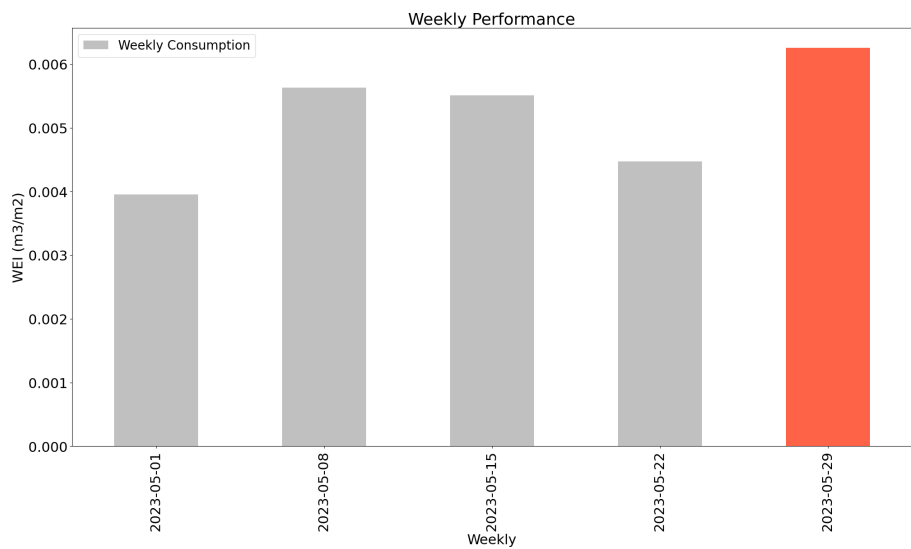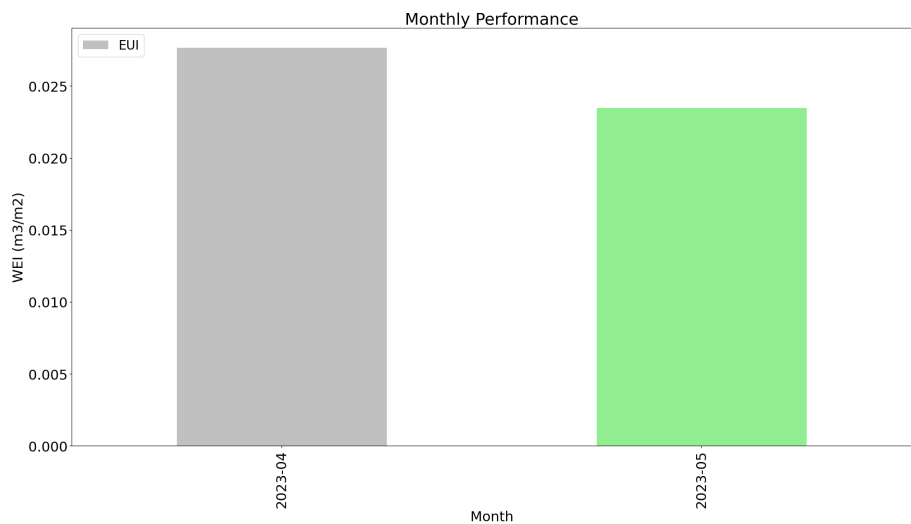

Unit A7Rf Peer Comparison in 2023-05	
WEI This Month	0.023 m3/m2
WEI Last Month:	0.028 m3/m2
WEI Month to Month Comparison	decrease -15%
Highest WEI Week	0.006 m3/m2, Week Starting From 2023-05-29
Highest WEI Hour	0.0001 m3/m2 in 10:00-11:00 hr


3. Anomaly Detection

3.1. Top 1 Highest Daily Anomaly - Block 902 on 2023-05-20

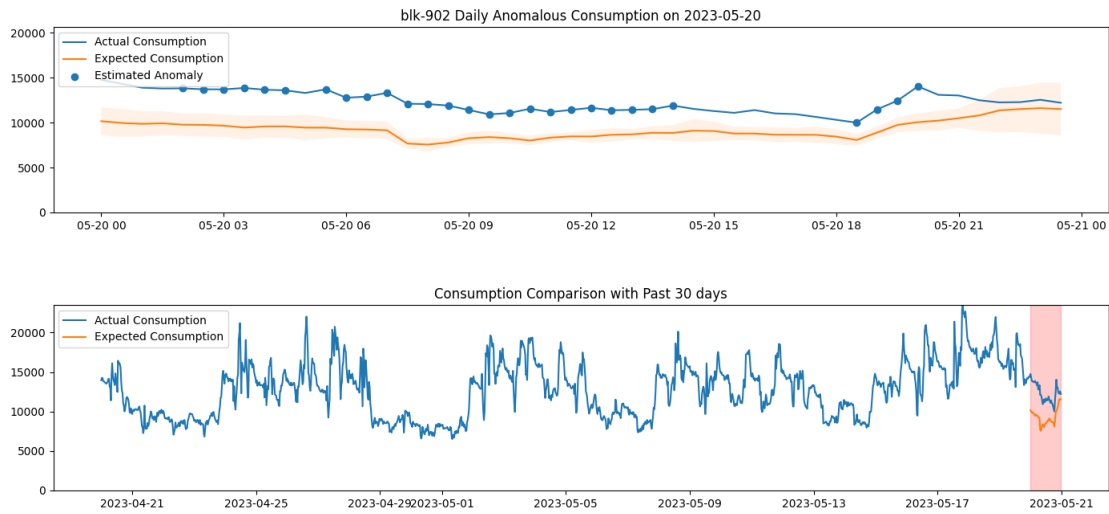



In 2023-05, the top 1 highest daily anomaly in blk-902 is observed on 2023-05-20 with total anomalous consumption of 96542.21 Wh 21.69% deviation from expected consumption.

3.2. Top 2 Highest Daily Anomaly - Block 900 on 2023-05-08

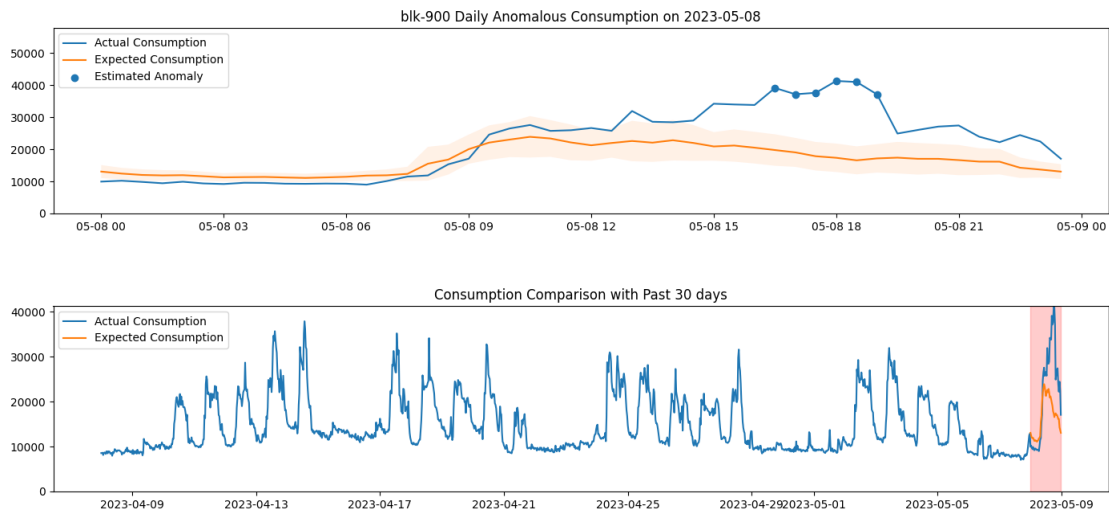



In 2023-05, the top 2 highest daily anomaly in blk-900 is observed on 2023-05-08 with total anomalous consumption of 125396.72 Wh 15.71% deviation from expected consumption.

3.3. Top 3 Highest Daily Anomaly - Block 900 on 2023-05-30

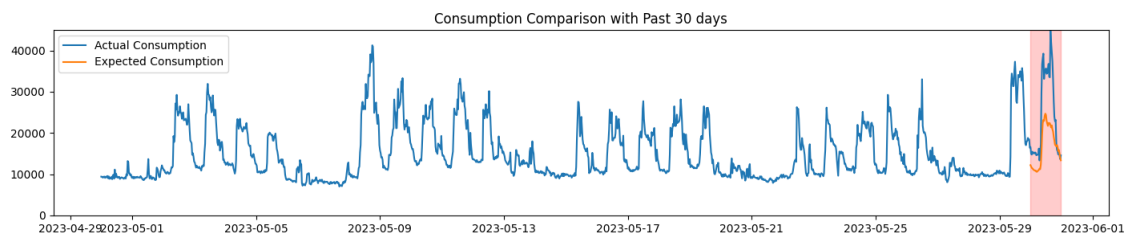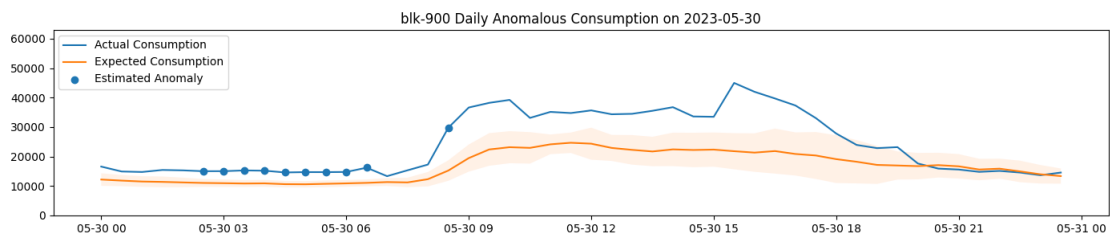

In 2023-05, the top 3 highest daily anomaly in blk-900 is observed on 2023-05-30 with total anomalous consumption of 52415.81 Wh 6.53% deviation from expected consumption.

3.4. Top 4 Highest Daily Anomaly - Block 902 on 2023-05-13

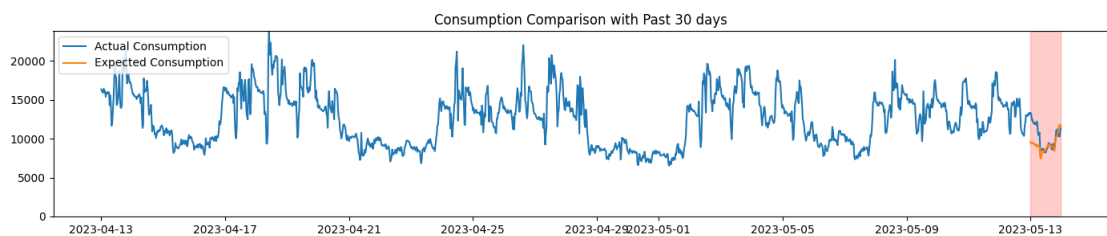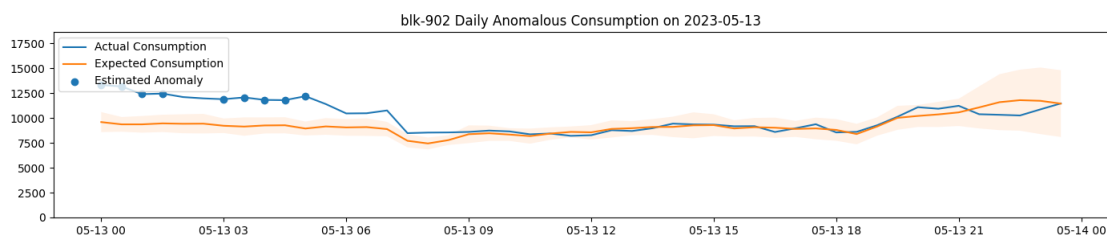

In 2023-05, the top 4 highest daily anomaly in blk-902 is observed on 2023-05-13 with total anomalous consumption of 27531.4 Wh 6.18% deviation from expected consumption.