



AC\$B Camp Block 921 Monthly Report - Building Owner 2023-05

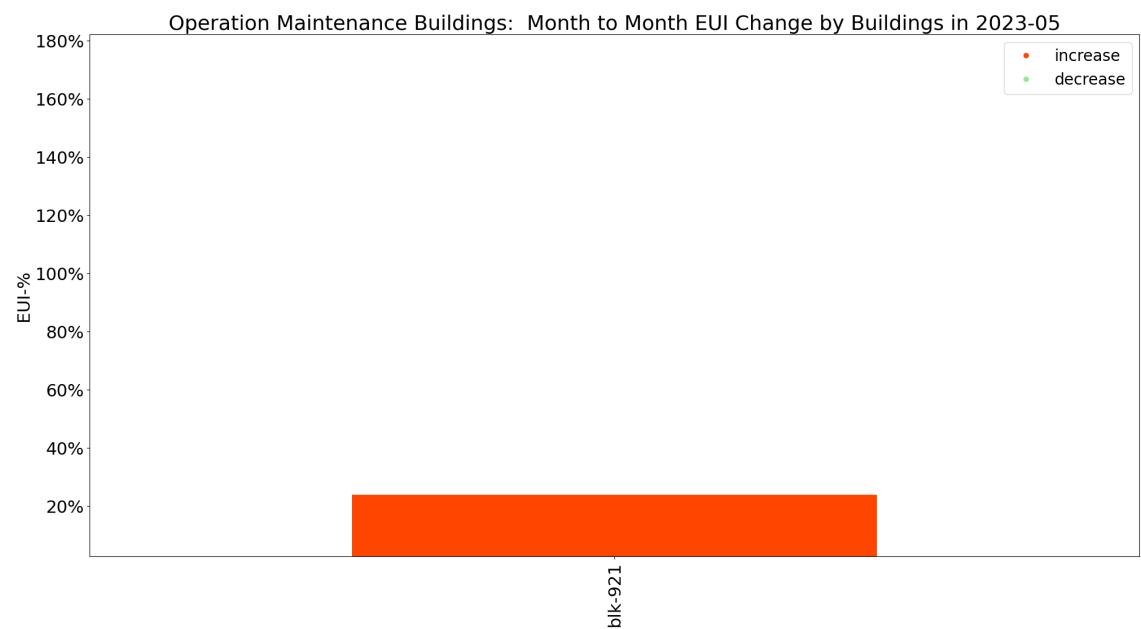


Table of Contents




- 1. Electricity Consumption.....page 3
- 2. Water Consumption..... page 5
- 3. Anomaly Detection..... page 7



1. Electricity Consumption





Block 921 Peer Comparison in 2023-05	
EUI for blk-921	2,113 Wh/m2
EUI for Best Performing Peer	2,113 Wh/m2
EUI % Against Best Performing Peer	0%
EUI % Against Median Peer	0%

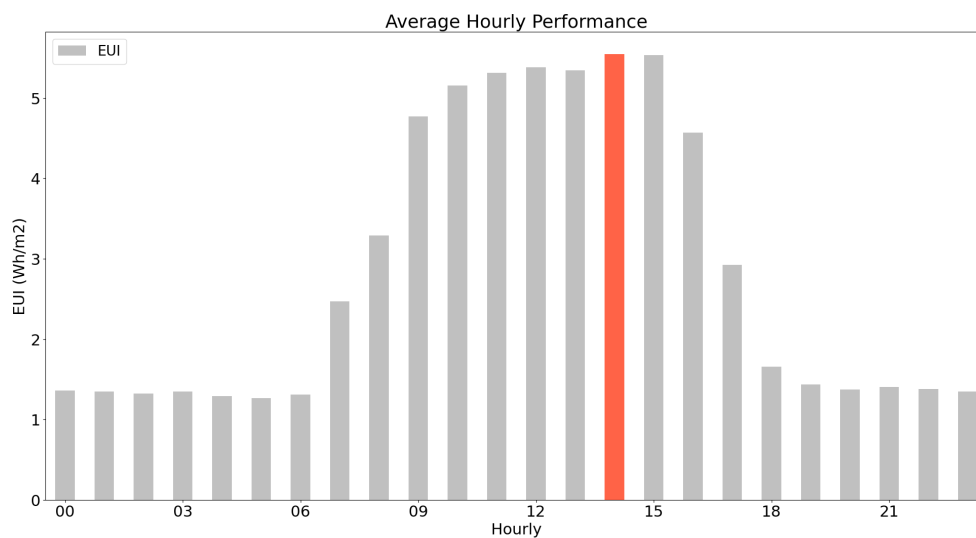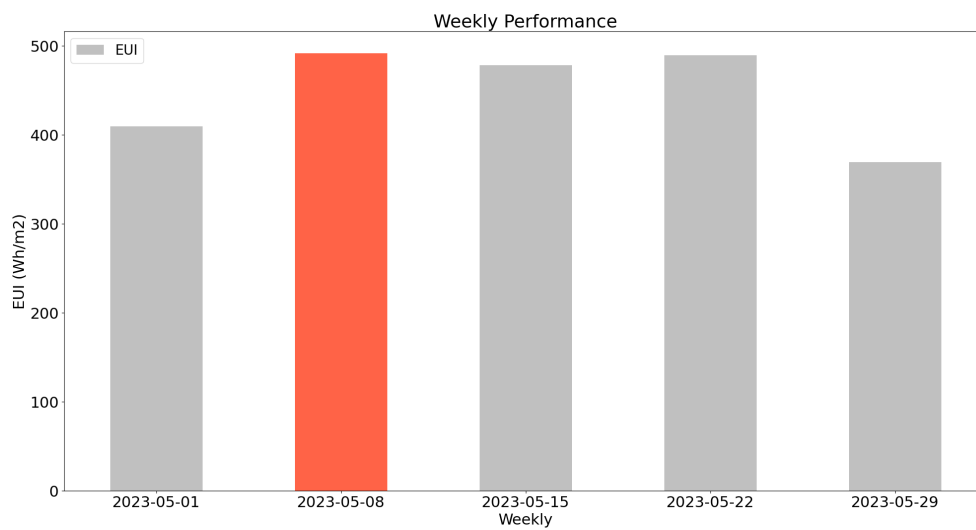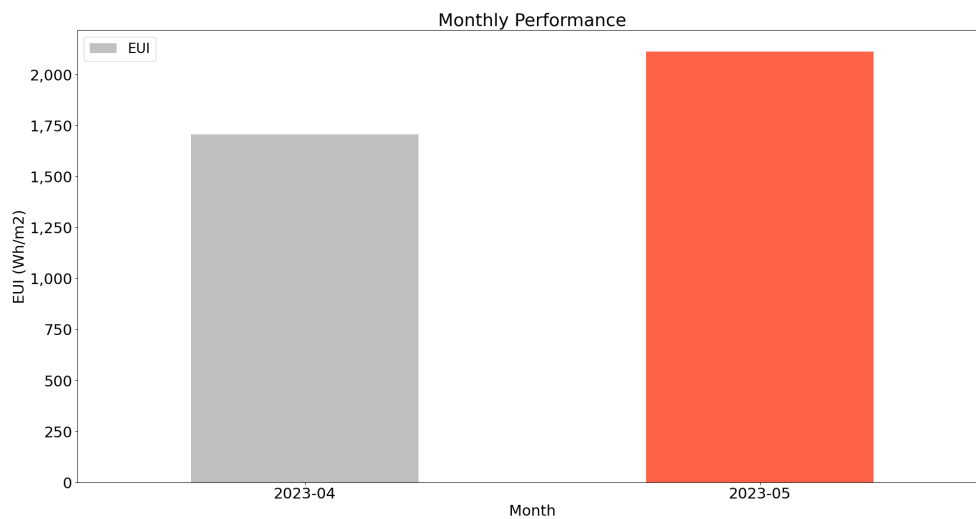




Block 921 Self Comparison in 2023-05	
EUI This Month	2,113 Wh/m2
EUI Last Month	1,706 Wh/m2
EUI Month to Month Comparison	increase 24%
Highest EUI Week	492 Wh/m2, Week Starting From 2023-05-08
Highest EUI Hour	6 Wh/m2 in 14:00-15:00 hr



2. Water Consumption

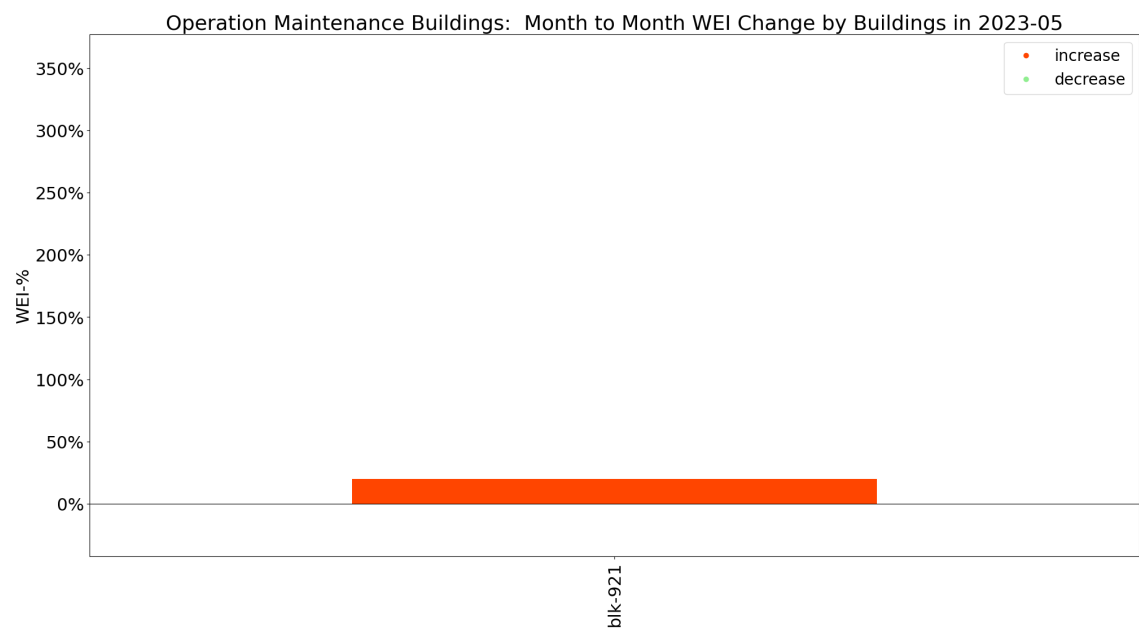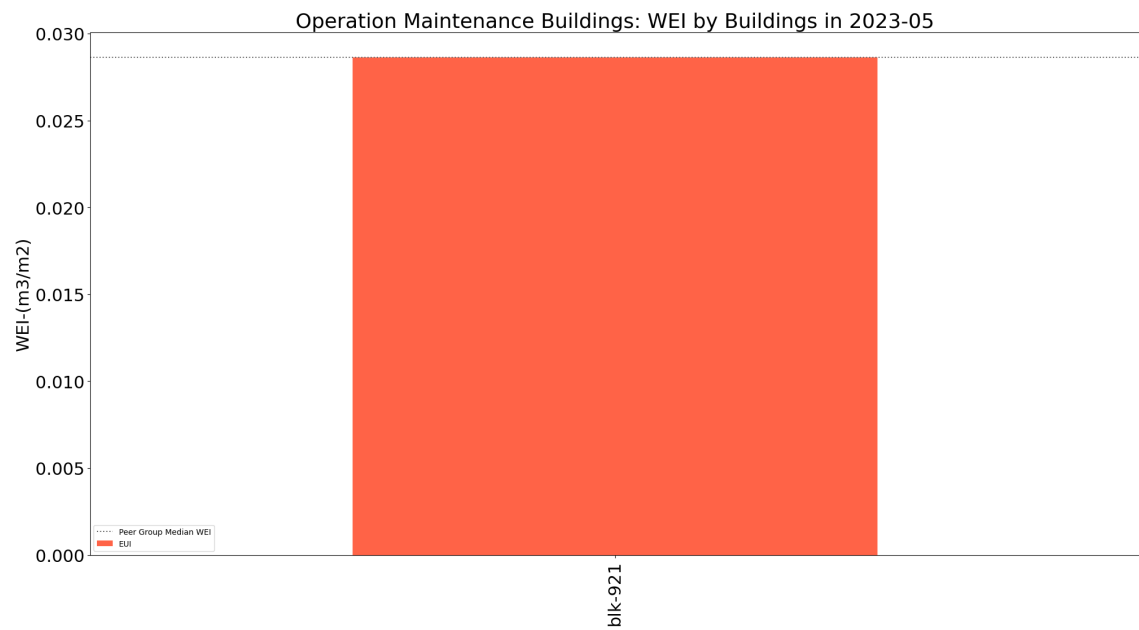

Block 921 Peer Comparison in 2023-05	
WEI for blk-921	0.029 m3/m2
WEI for Best Performing Peer	0.029 m3/m2
WEI % Against Best Performing Peer	0%
WEI % Against Median Peer	0%

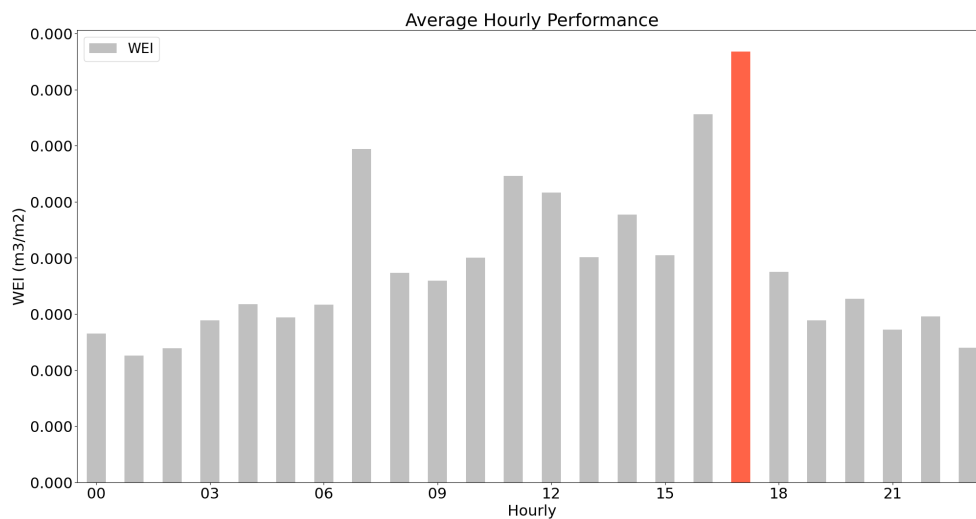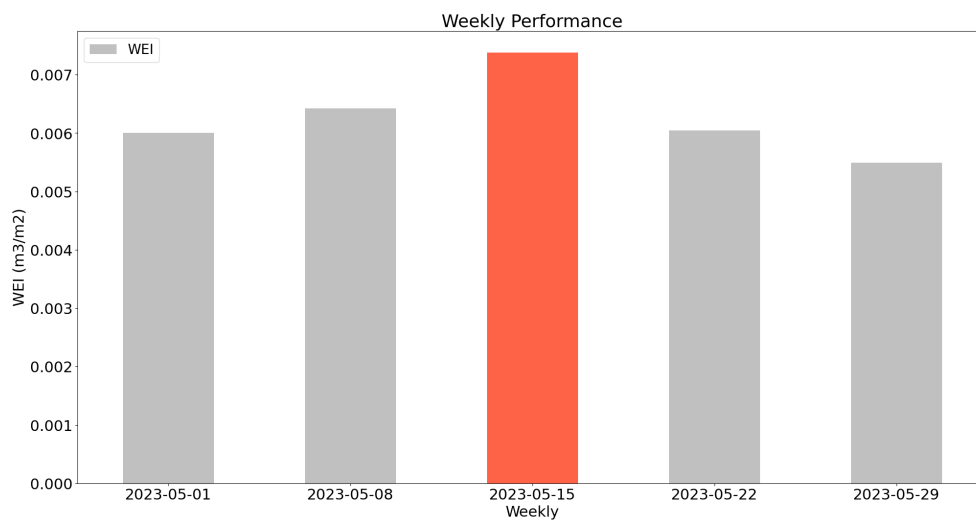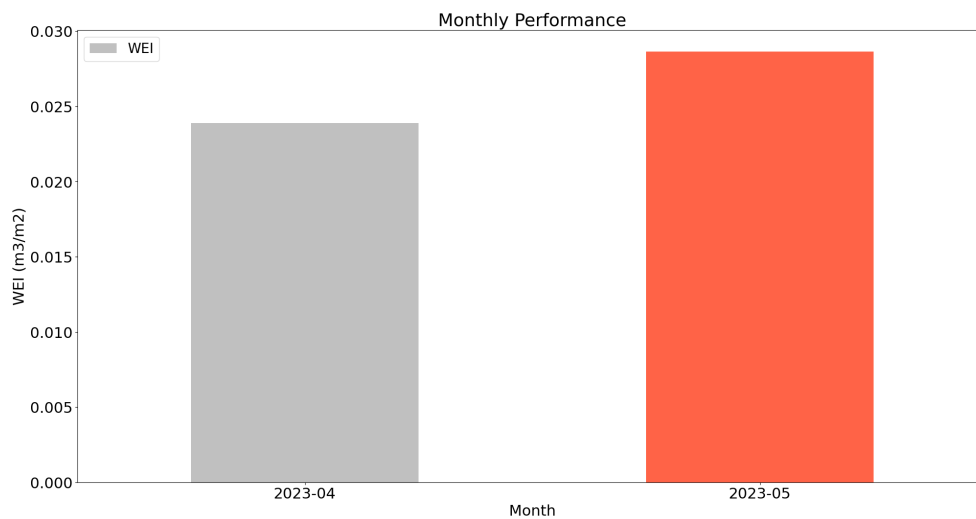

Block 921 Self Comparison in 2023-05	
WEI This Month	0.029 m3/m2
WEI Last Month	0.024 m3/m2
WEI Month to Month Comparison	increase 20%
Highest WEI Week	0.007 m3/m2, Week Starting From 2023-05-15
Highest WEI Hour	0.0001 m3/m2 in 17:00-18:00 hr



3. Anomaly Detection