



AC\$B Camp Unit P9Tk Monthly Report - Unit Commander 2023-05



Table of Contents



1. Electricity Consumption.....page 3

2. Water Consumption..... page 5



3. Anomaly Detection..... page 7



1. Electricity Consumption

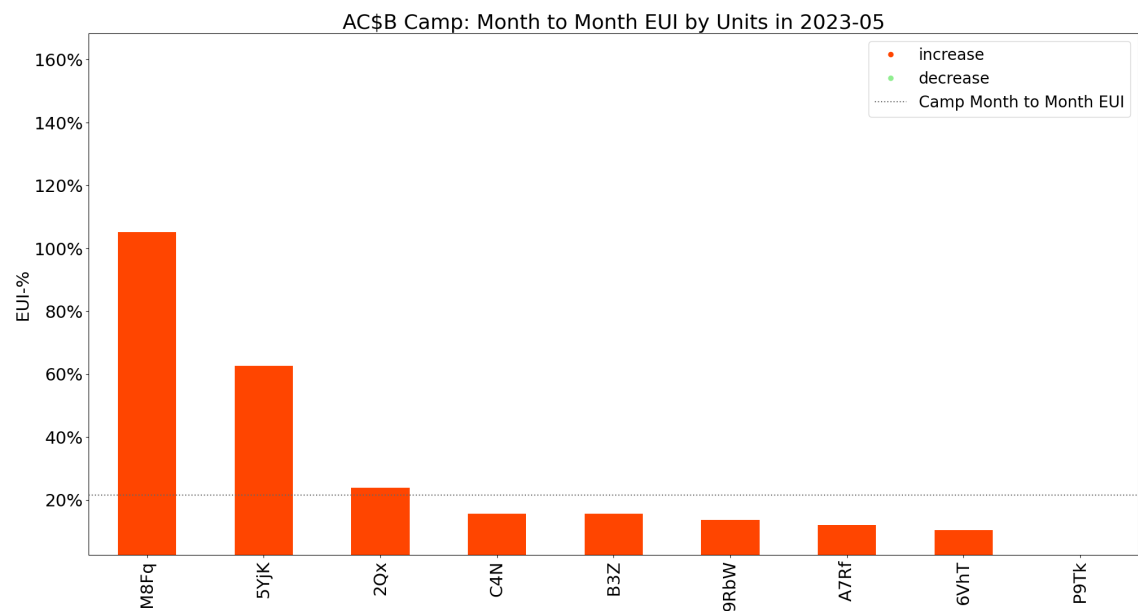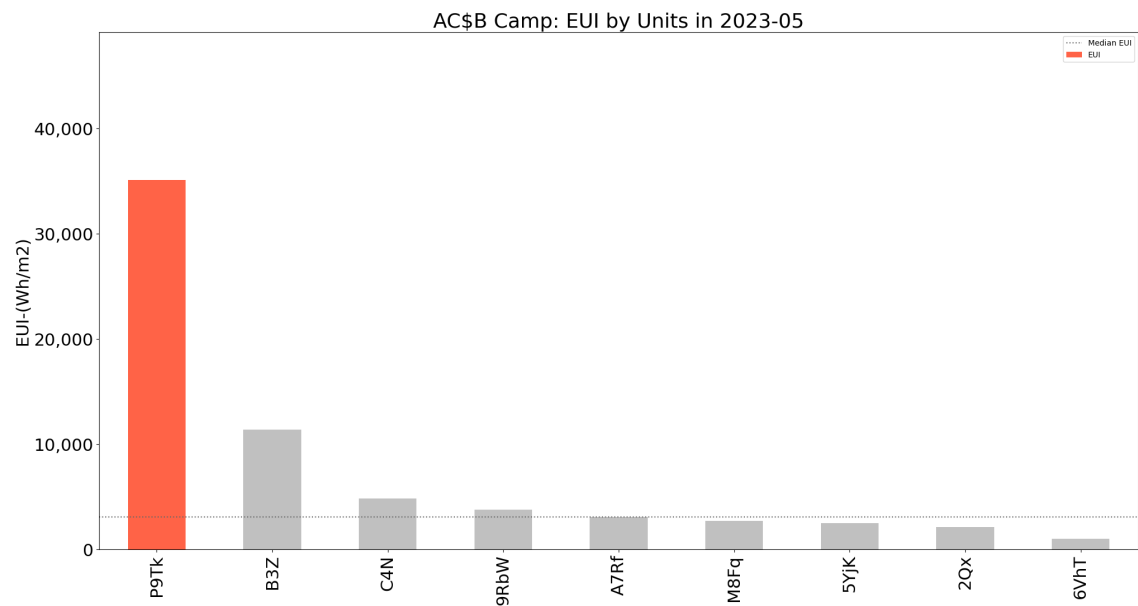



Unit P9Tk Peer Comparison in 2023-05	
EUI for P9Tk	35,119 Wh/m2
EUI for Best Performing Peer	1,031 Wh/m2
EUI % Against Best Performing Peer	3,306%
EUI % Against Median Peer	1,044%

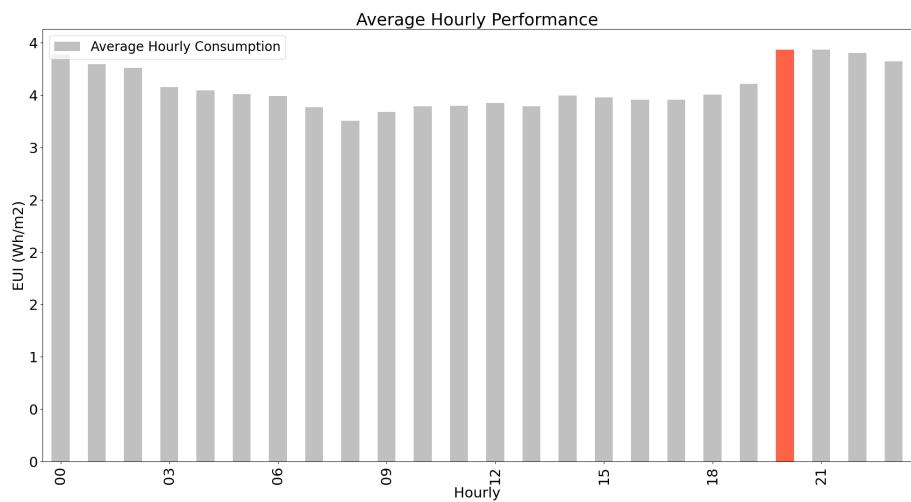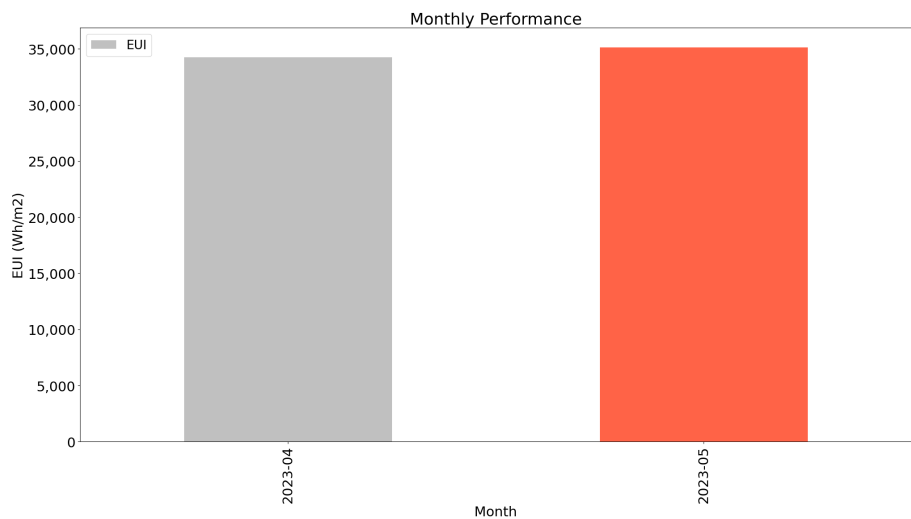



Unit P9Tk Self Comparison in 2023-05	
EUI This Month	35,119 Wh/m2
EUI Last Month	34,261 Wh/m2
EUI Month to Month Comparison	increase 3%
Highest EUI Week	8,387 Wh/m2, Week Starting From 2023-05-08
Highest EUI Hour	4 Wh/m2 in 20:00-21:00 hr



2. Water Consumption

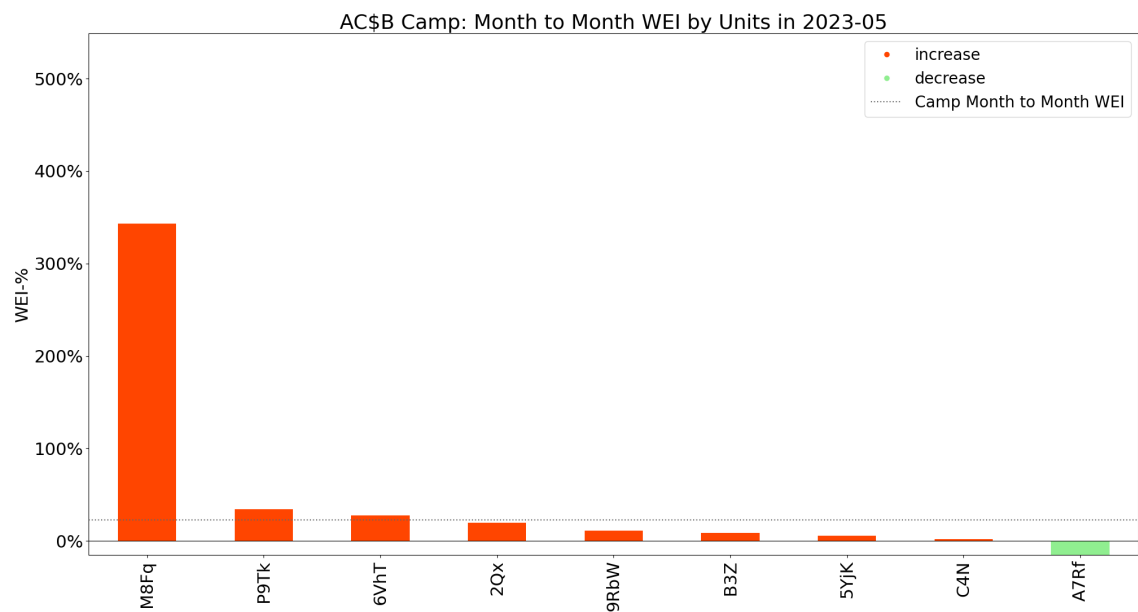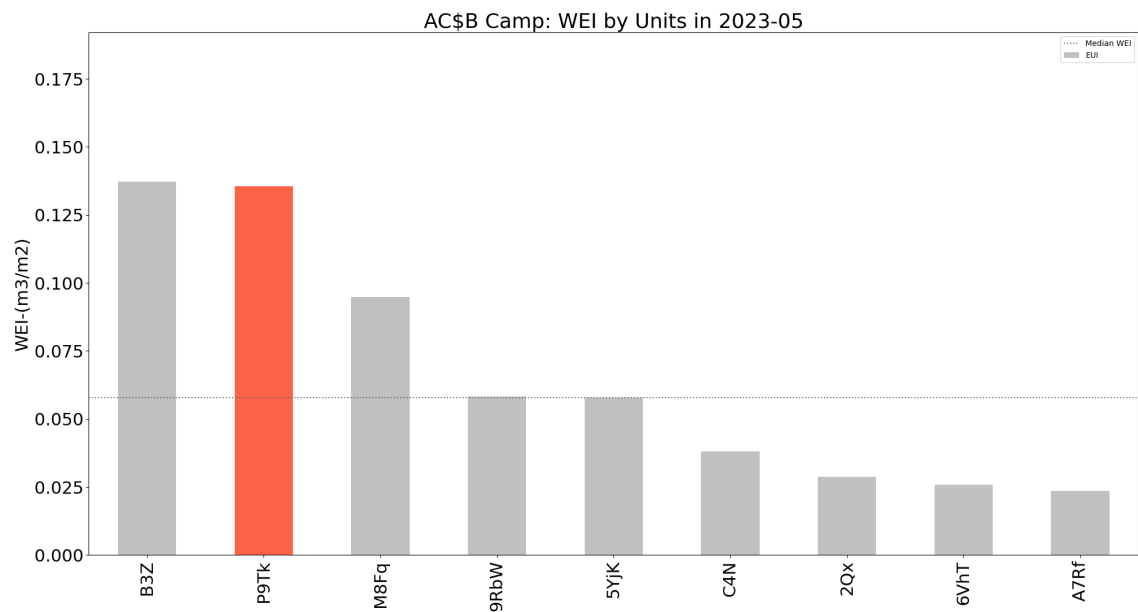

Unit P9Tk Peer Comparison in 2023-05	
WEI for P9Tk	0.136 m3/m2
WEI for Best Performing Peer	0.023 m3/m2
WEI % Against Best Performing Peer	478%
WEI % Against Median Peer	134%

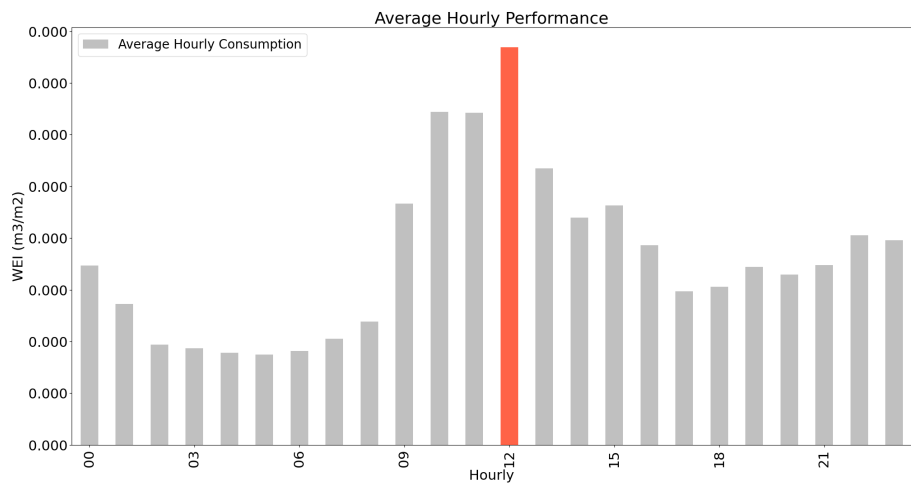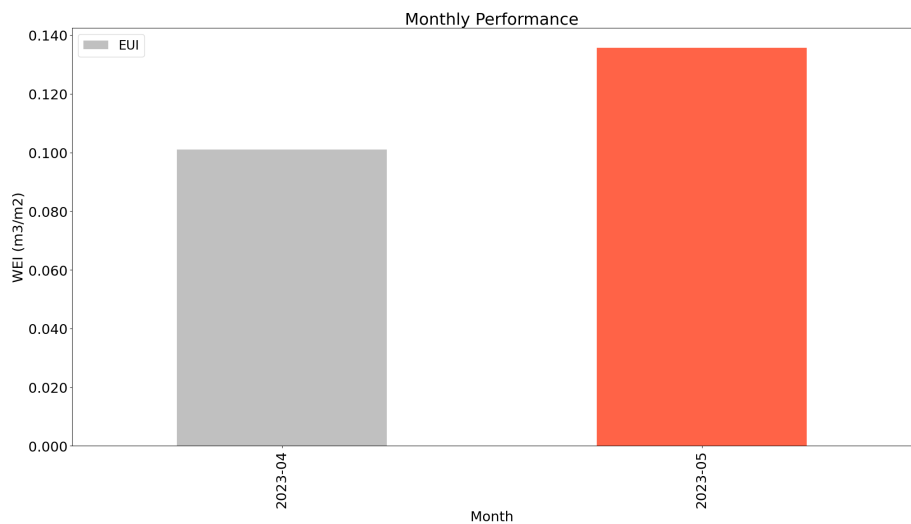

Unit P9Tk Peer Comparison in 2023-05	
WEI This Month	0.136 m3/m2
WEI Last Month:	0.101 m3/m2
WEI Month to Month Comparison	increase 34%
Highest WEI Week	0.070 m3/m2, Week Starting From 2023-05-08
Highest WEI Hour	0.0004 m3/m2 in 12:00-13:00 hr



3. Anomaly Detection

No anomalies detected or too much missing data.