



AC\$B Camp Block 801 Monthly Report - Building Owner

2023-05



Table of Contents



1. Electricity Consumption.....page 3

2. Water Consumption..... page 5




3. Anomaly Detection..... page 7



1. Electricity Consumption

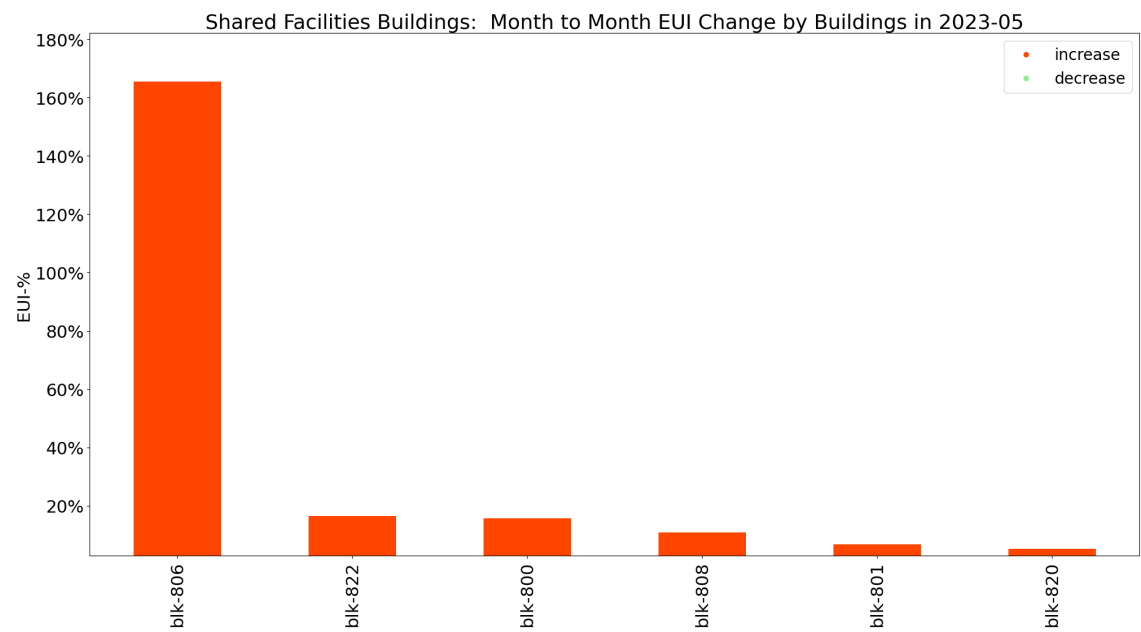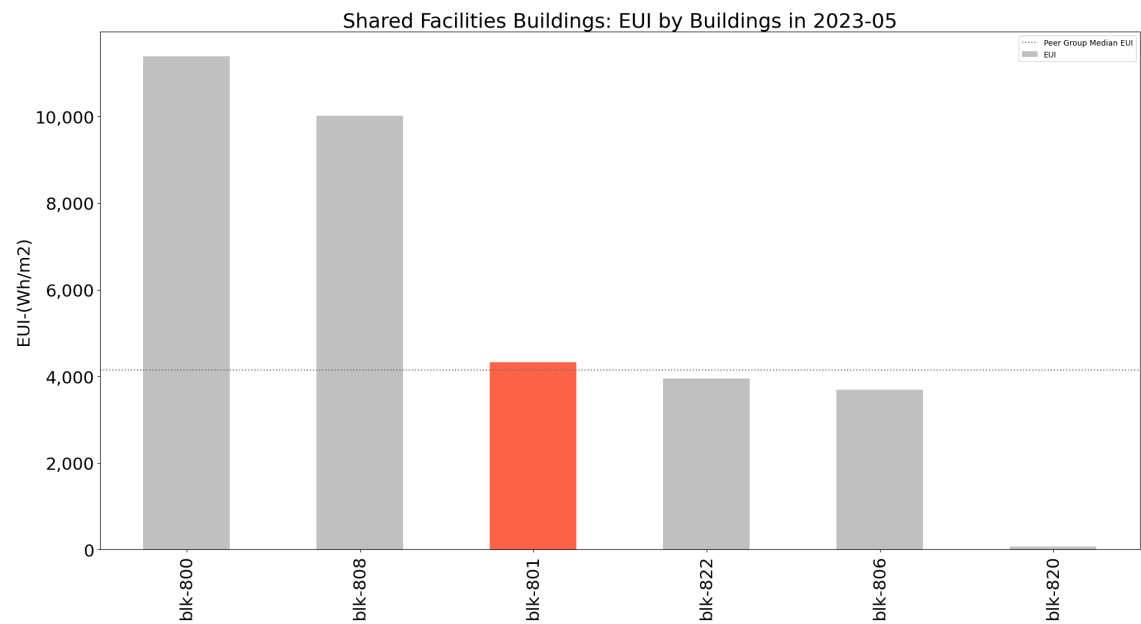



Block 801 Peer Comparison in 2023-05	
EUI for blk-801	4,328 Wh/m2
EUI for Best Performing Peer	65 Wh/m2
EUI % Against Best Performing Peer	6,552%
EUI % Against Median Peer	5%

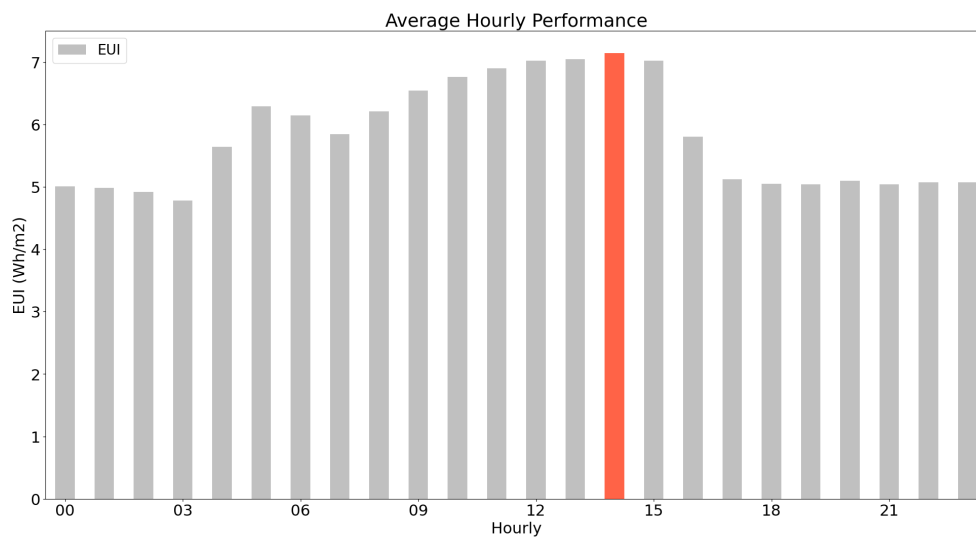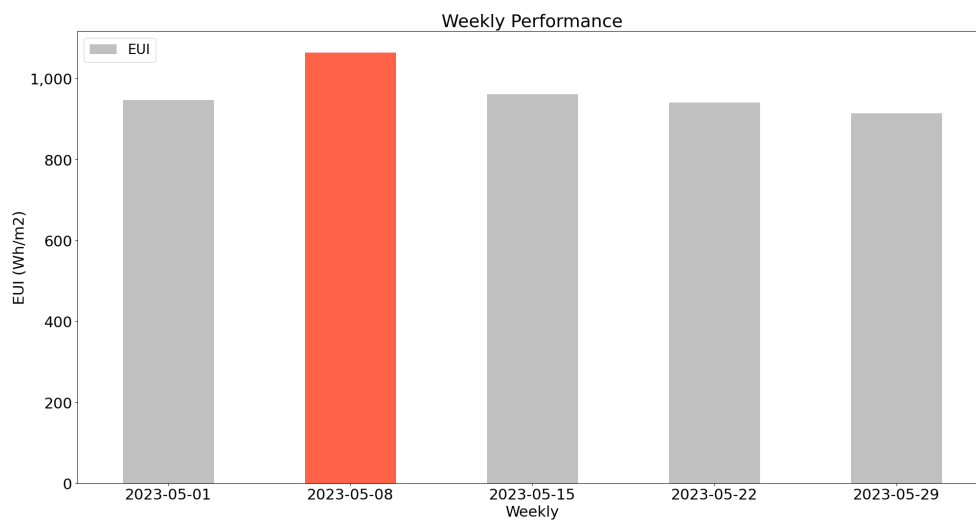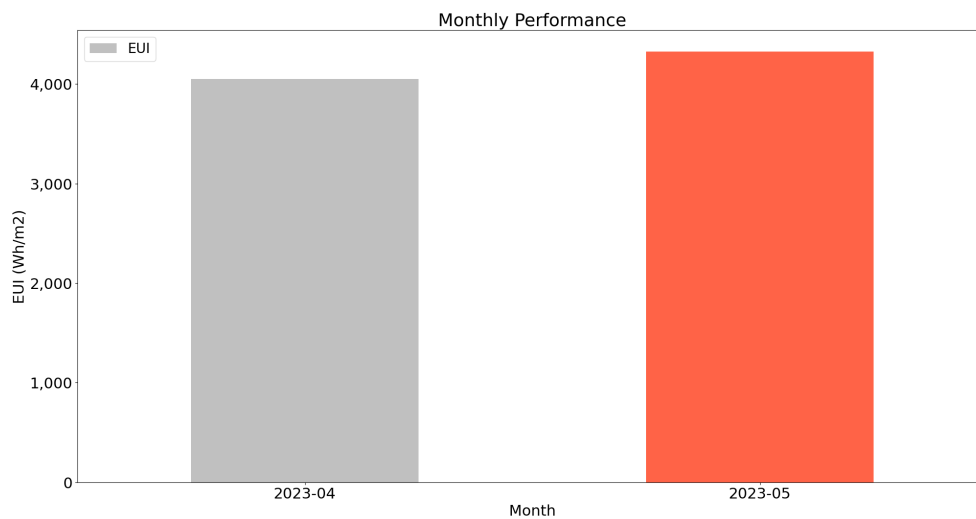




Block 801 Self Comparison in 2023-05	
EUI This Month	4,328 Wh/m2
EUI Last Month	4,052 Wh/m2
EUI Month to Month Comparison	increase 7%
Highest EUI Week	1,065 Wh/m2, Week Starting From 2023-05-08
Highest EUI Hour	7 Wh/m2 in 14:00-15:00 hr



2. Water Consumption

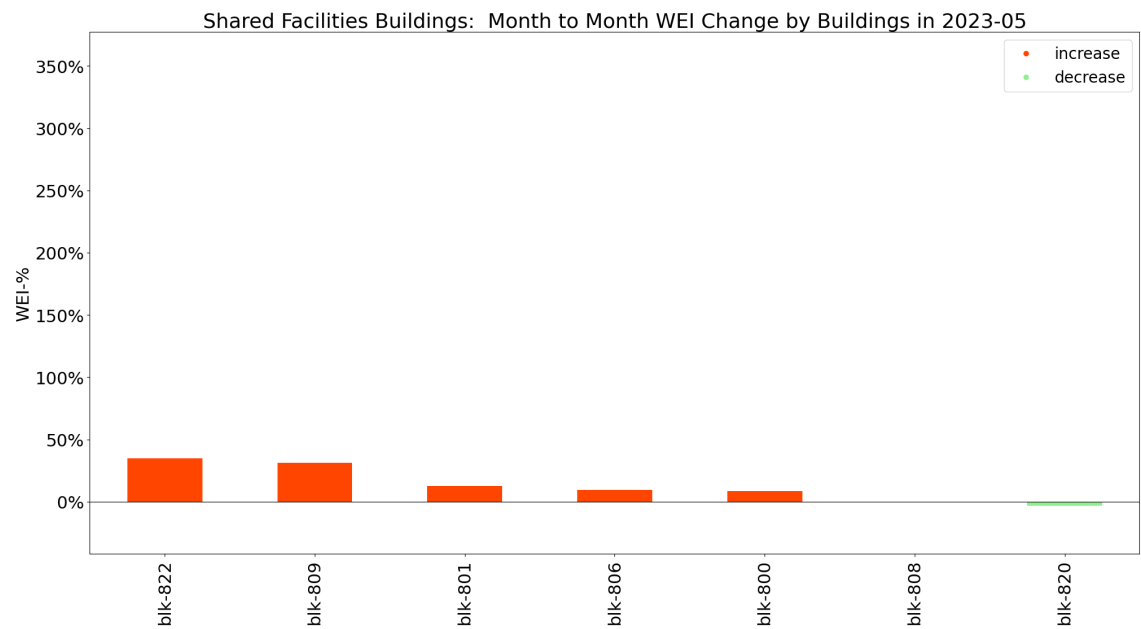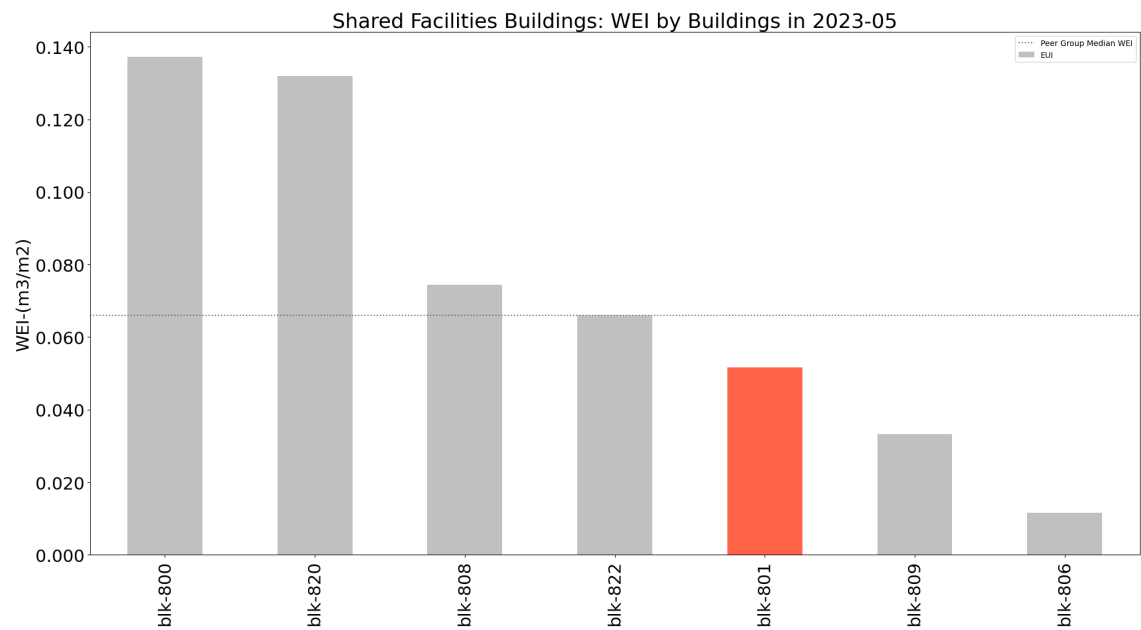

Block 801 Peer Comparison in 2023-05	
WEI for blk-801	0.052 m3/m2
WEI for Best Performing Peer	0.012 m3/m2
WEI % Against Best Performing Peer	347%
WEI % Against Median Peer	-22%

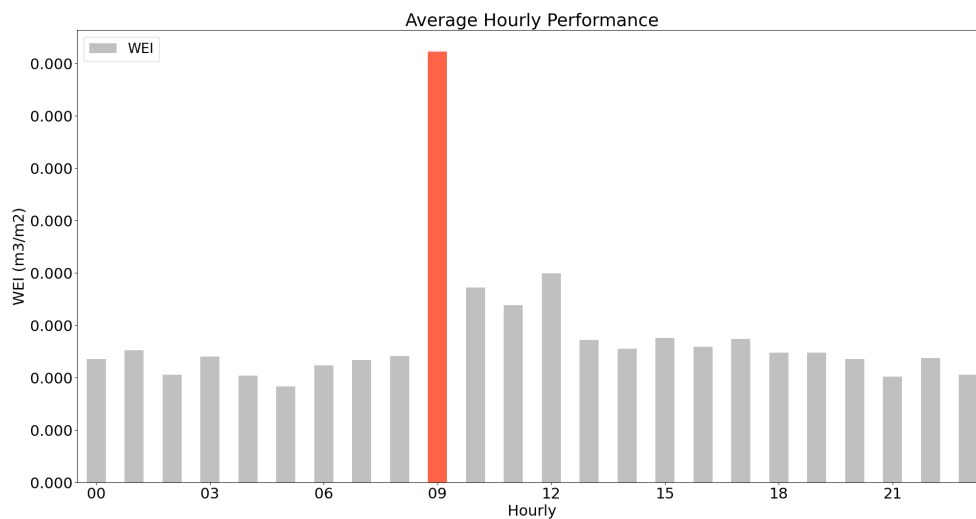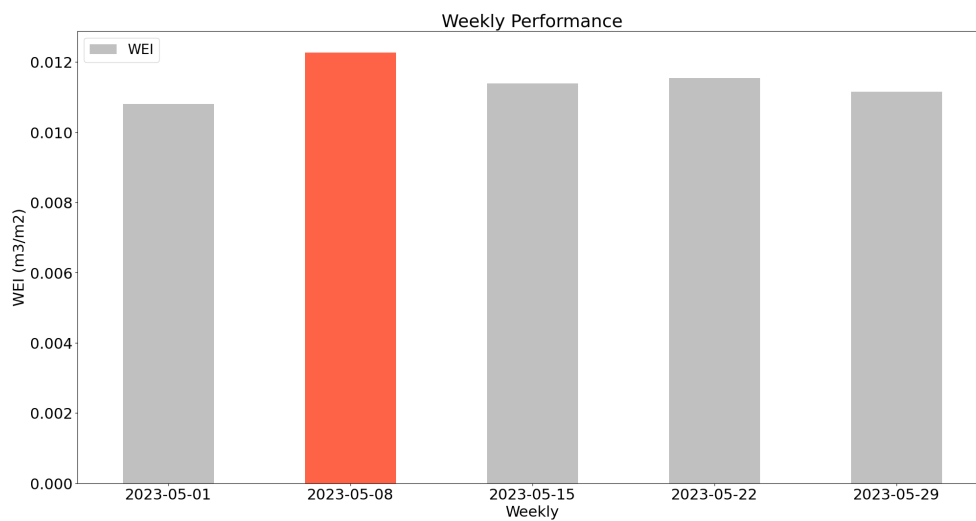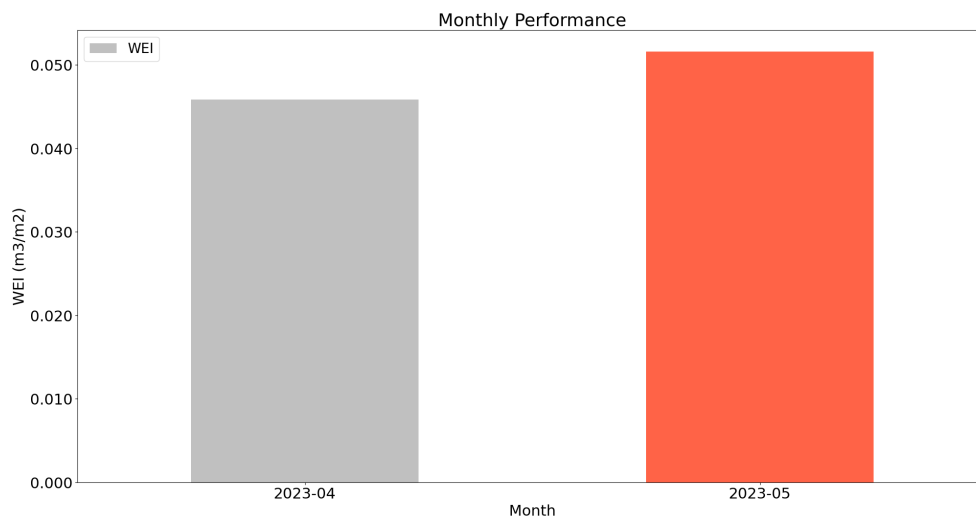

Block 801 Self Comparison in 2023-05	
WEI This Month	0.052 m3/m2
WEI Last Month	0.046 m3/m2
WEI Month to Month Comparison	increase 13%
Highest WEI Week	0.012 m3/m2, Week Starting From 2023-05-08
Highest WEI Hour	0.0002 m3/m2 in 9:00-10:00 hr



3. Anomaly Detection

No anomalies detected or too much missing data.