



AC\$B Camp Block 806 Monthly Report - Building Owner

2023-05


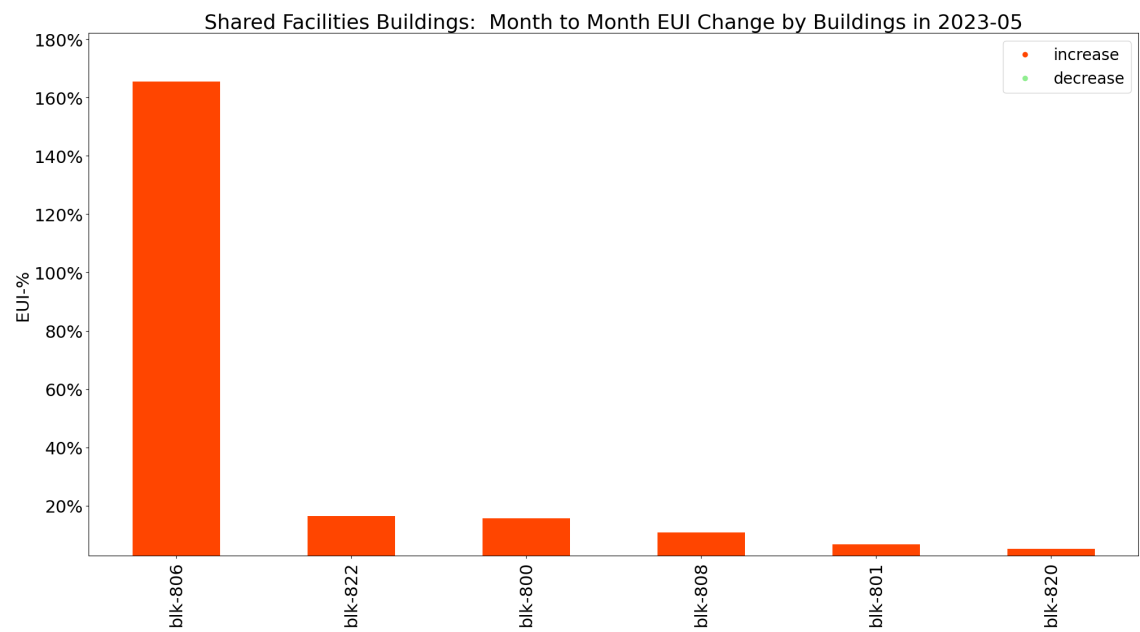


Table of Contents




- 1. Electricity Consumption.....page 3
- 2. Water Consumption..... page 5
- 3. Anomaly Detection..... page 7



1. Electricity Consumption

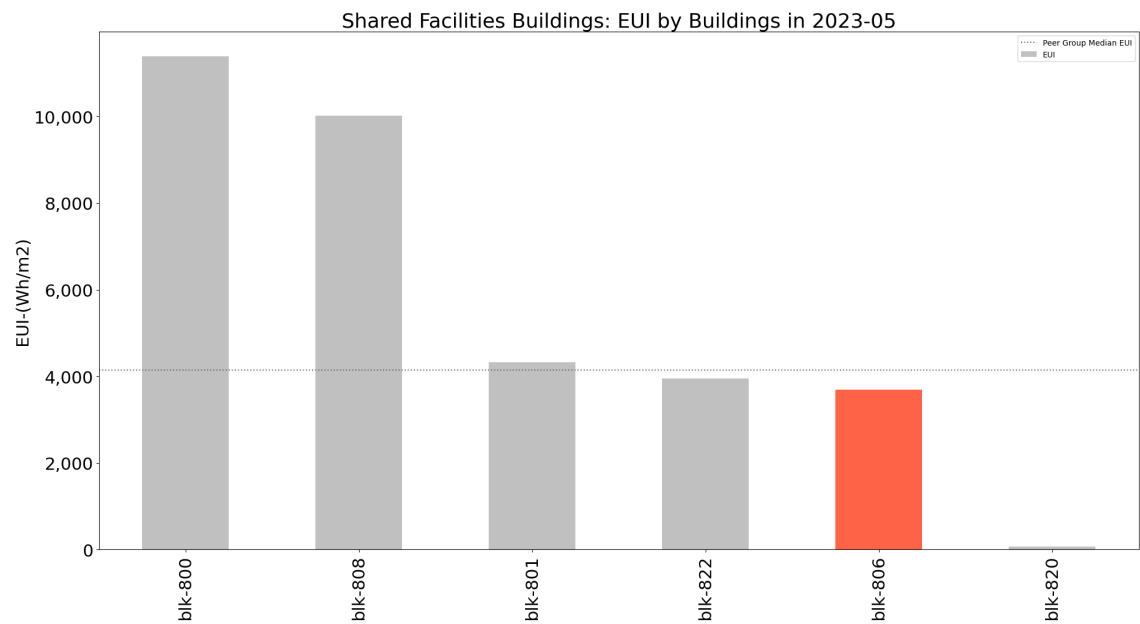



Block 806 Peer Comparison in 2023-05	
EUI for blk-806	3,695 Wh/m2
EUI for Best Performing Peer	65 Wh/m2
EUI % Against Best Performing Peer	5,579%
EUI % Against Median Peer	-11%

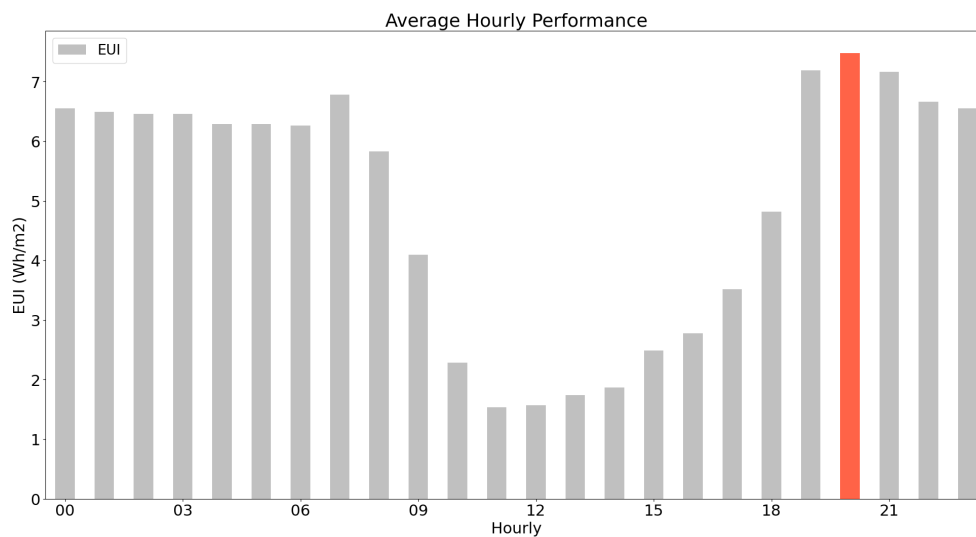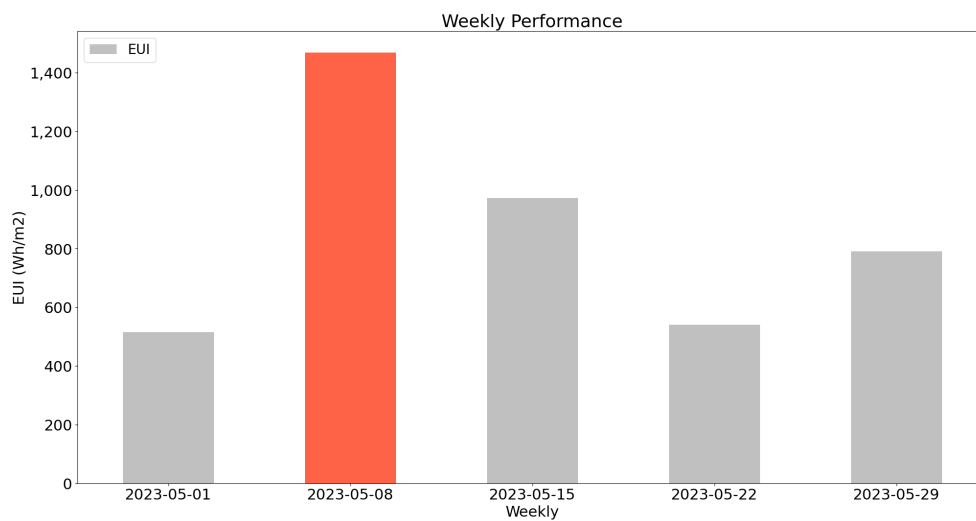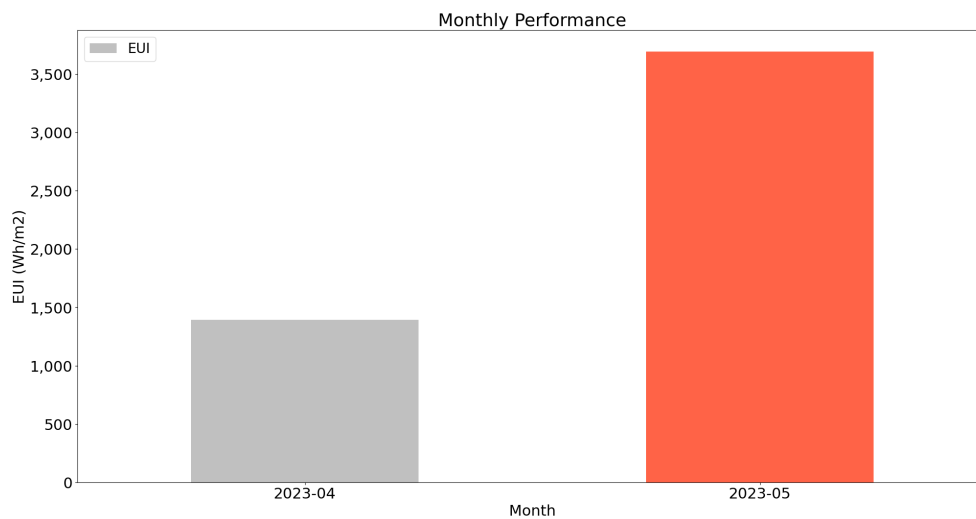




Block 806 Self Comparison in 2023-05	
EUI This Month	3,695 Wh/m2
EUI Last Month	1,391 Wh/m2
EUI Month to Month Comparison	increase 166%
Highest EUI Week	1,469 Wh/m2, Week Starting From 2023-05-08
Highest EUI Hour	7 Wh/m2 in 20:00-21:00 hr



2. Water Consumption

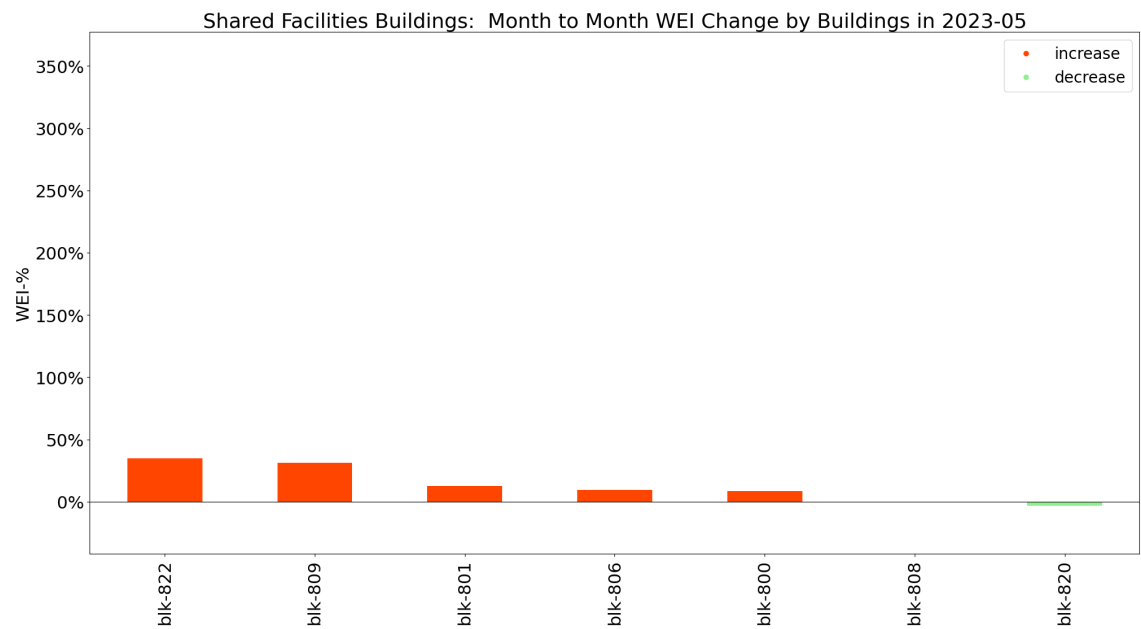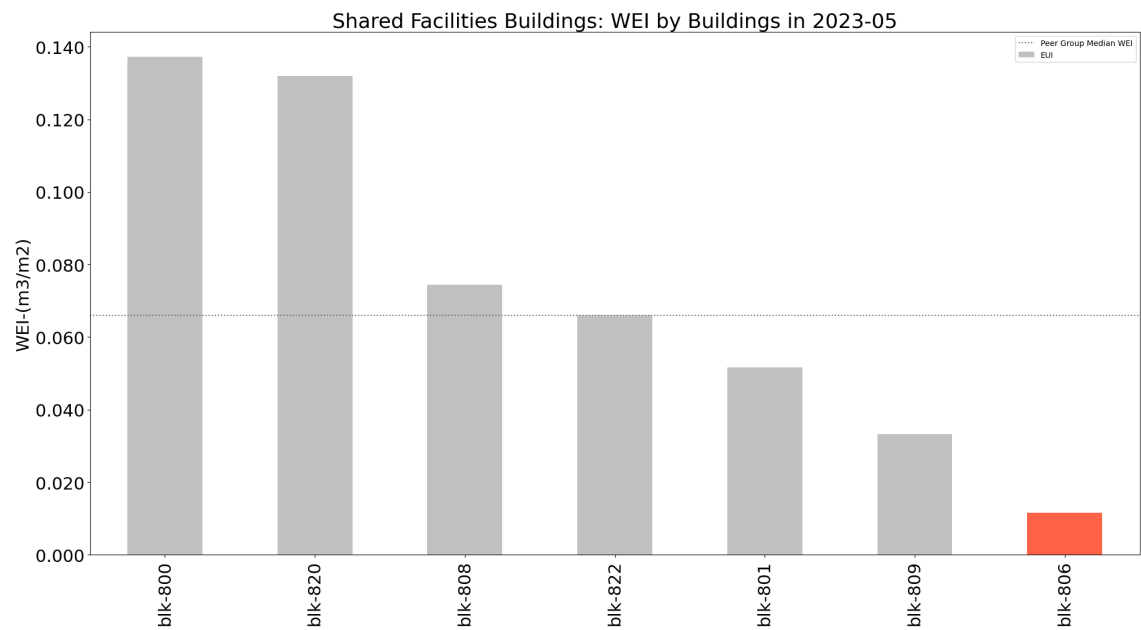

Block 806 Peer Comparison in 2023-05	
WEI for blk-806	0.012 m3/m2
WEI for Best Performing Peer	0.012 m3/m2
WEI % Against Best Performing Peer	0%
WEI % Against Median Peer	-83%

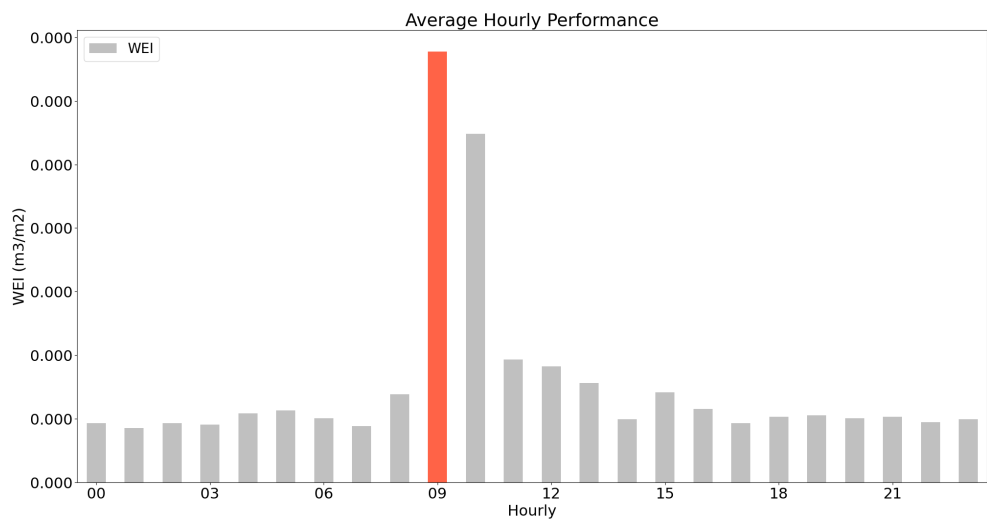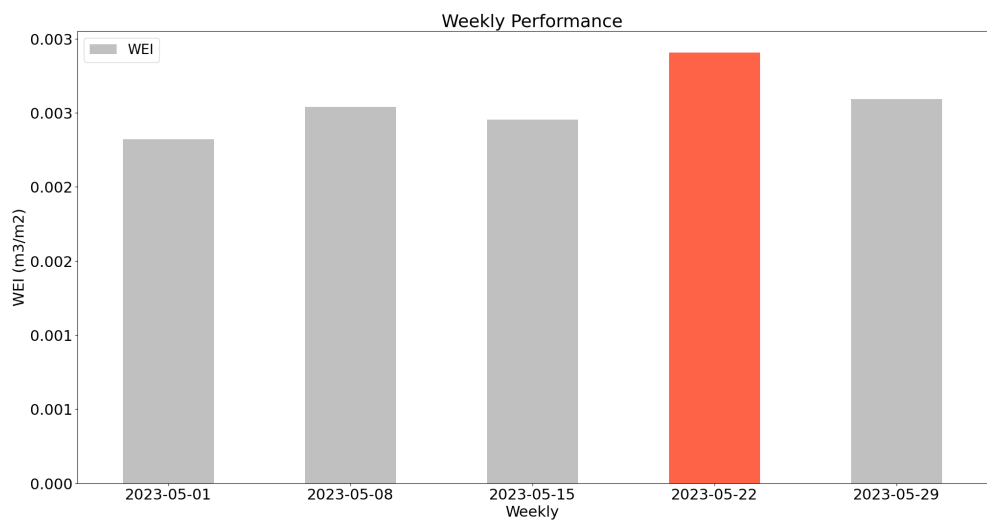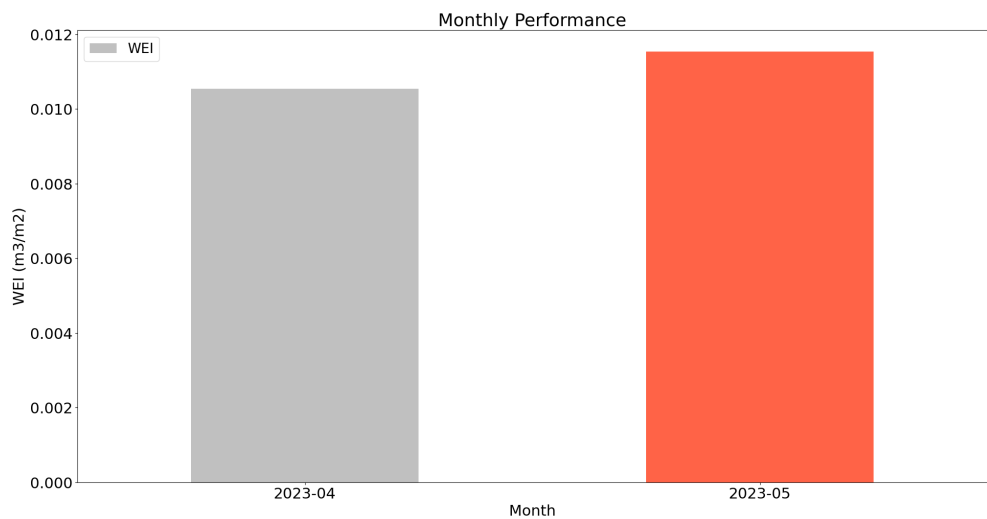

Block 806 Self Comparison in 2023-05	
WEI This Month	0.012 m3/m2
WEI Last Month	0.011 m3/m2
WEI Month to Month Comparison	increase 9%
Highest WEI Week	0.003 m3/m2, Week Starting From 2023-05-22
Highest WEI Hour	0.0001 m3/m2 in 9:00-10:00 hr



3. Anomaly Detection