

Model vs cardiologist labels — record 213

Threshold: 0.0434
Beats scored: 3226

Confusion matrix:

TP (model+annot agree abnormal):	308
TN (both agree normal):	2589
FP (model says abn, annot N):	34
FN (annot abn, model says N):	295

Sensitivity (recall): 0.511
Specificity: 0.987
Precision: 0.901
F1 score: 0.652


Per-beat-type breakdown:

N Normal	2623	flagged	1.3%
F Fusion (V+N)	362	flagged	19.3%
V PVC (ventricular ectopic)	213	flagged	99.1%
A Atrial premature	25	flagged	96.0%
a Aberrated atrial	3	flagged	100.0%


Legend on next pages:

Blue line: bandpass-filtered ECG
Green tick: annotated NORMAL beat (cardiologist)
Magenta tick: annotated ABNORMAL beat (cardiologist)
Red shading: beat the MODEL flagged as anomaly
An ideal model has red shading exactly under magenta ticks.


Record 213 — t=30-50 s

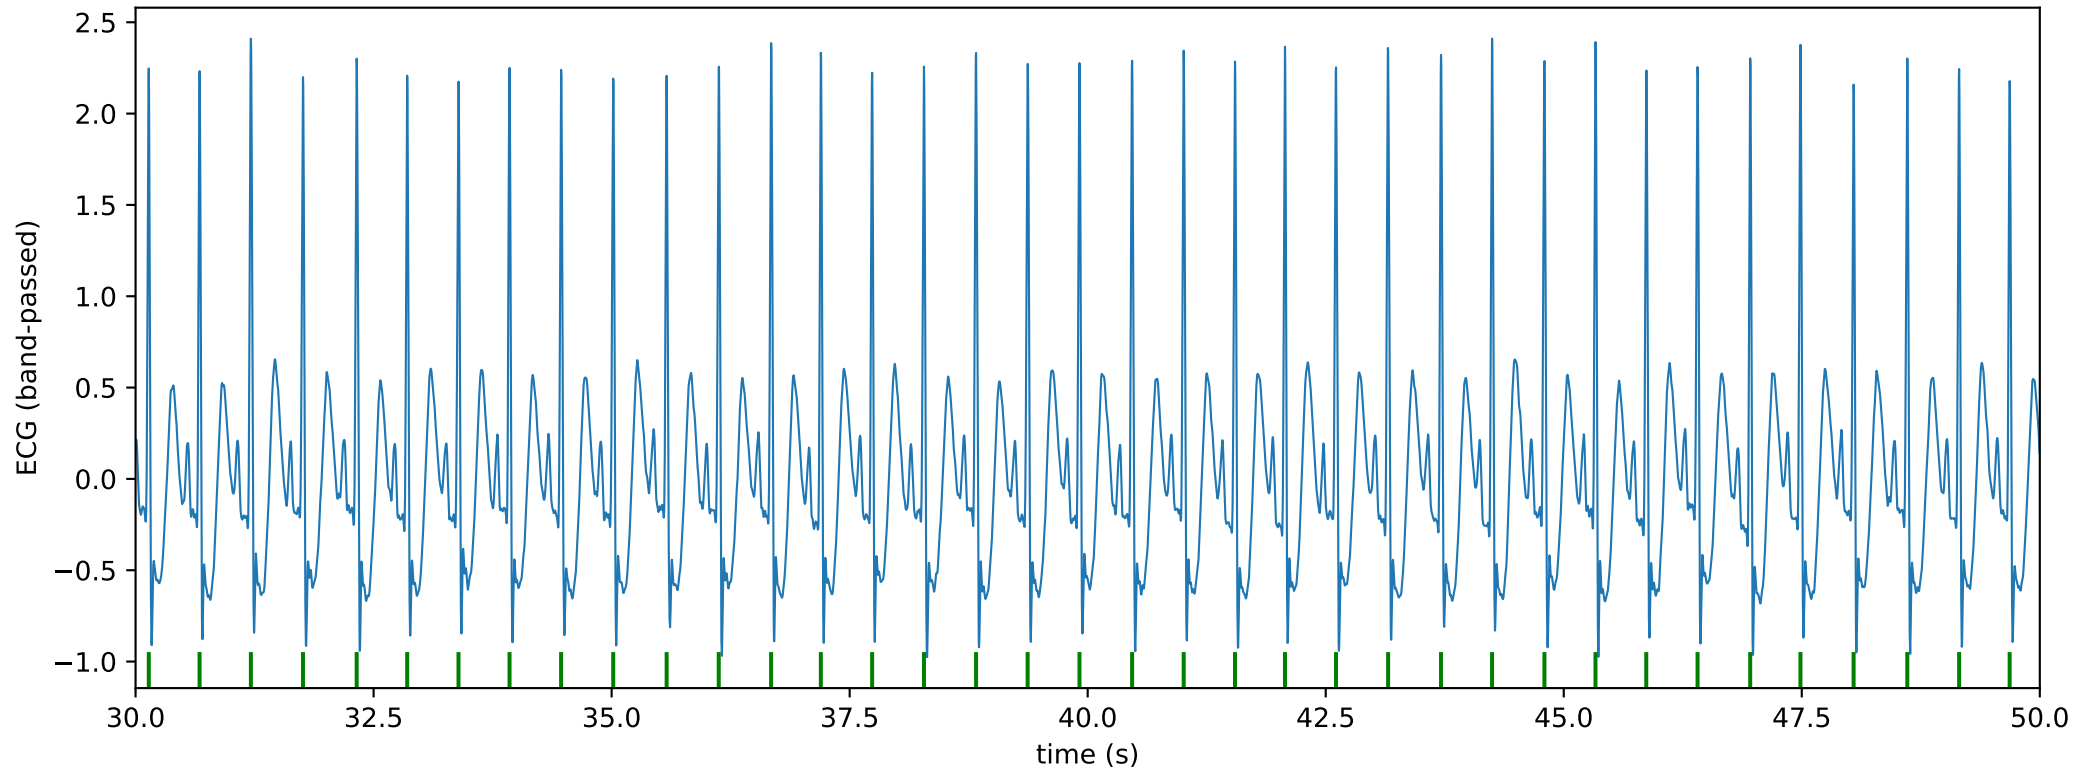


Record 213 — t=50-70 s

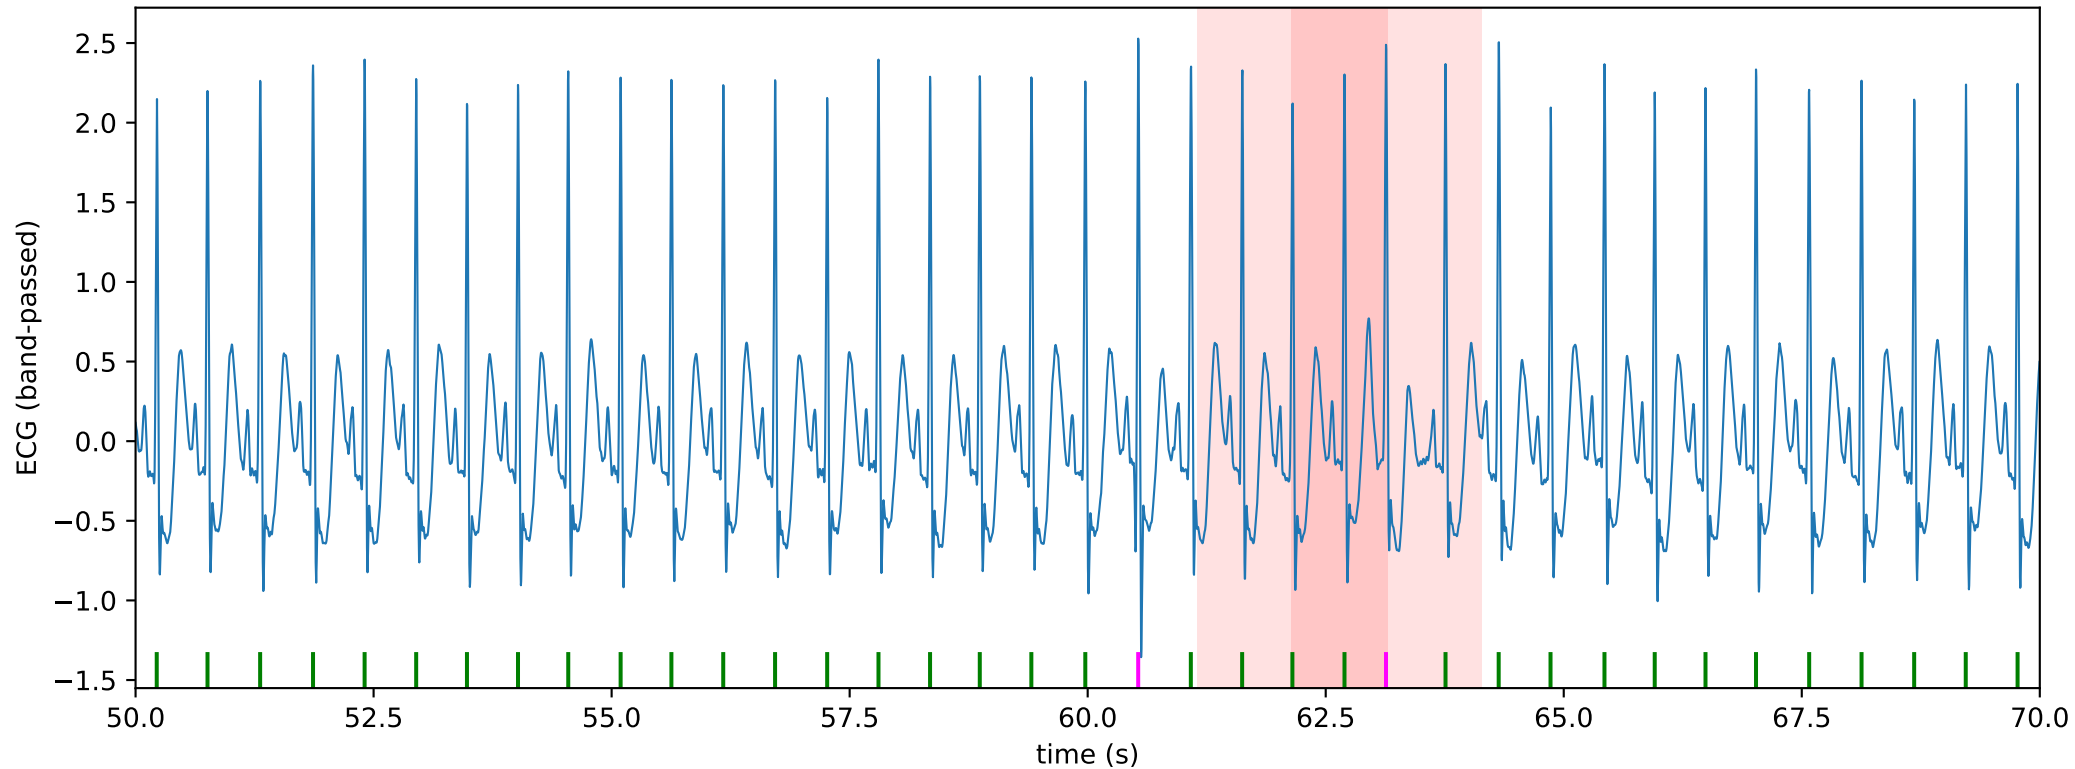


Record 213 — t=70-90 s

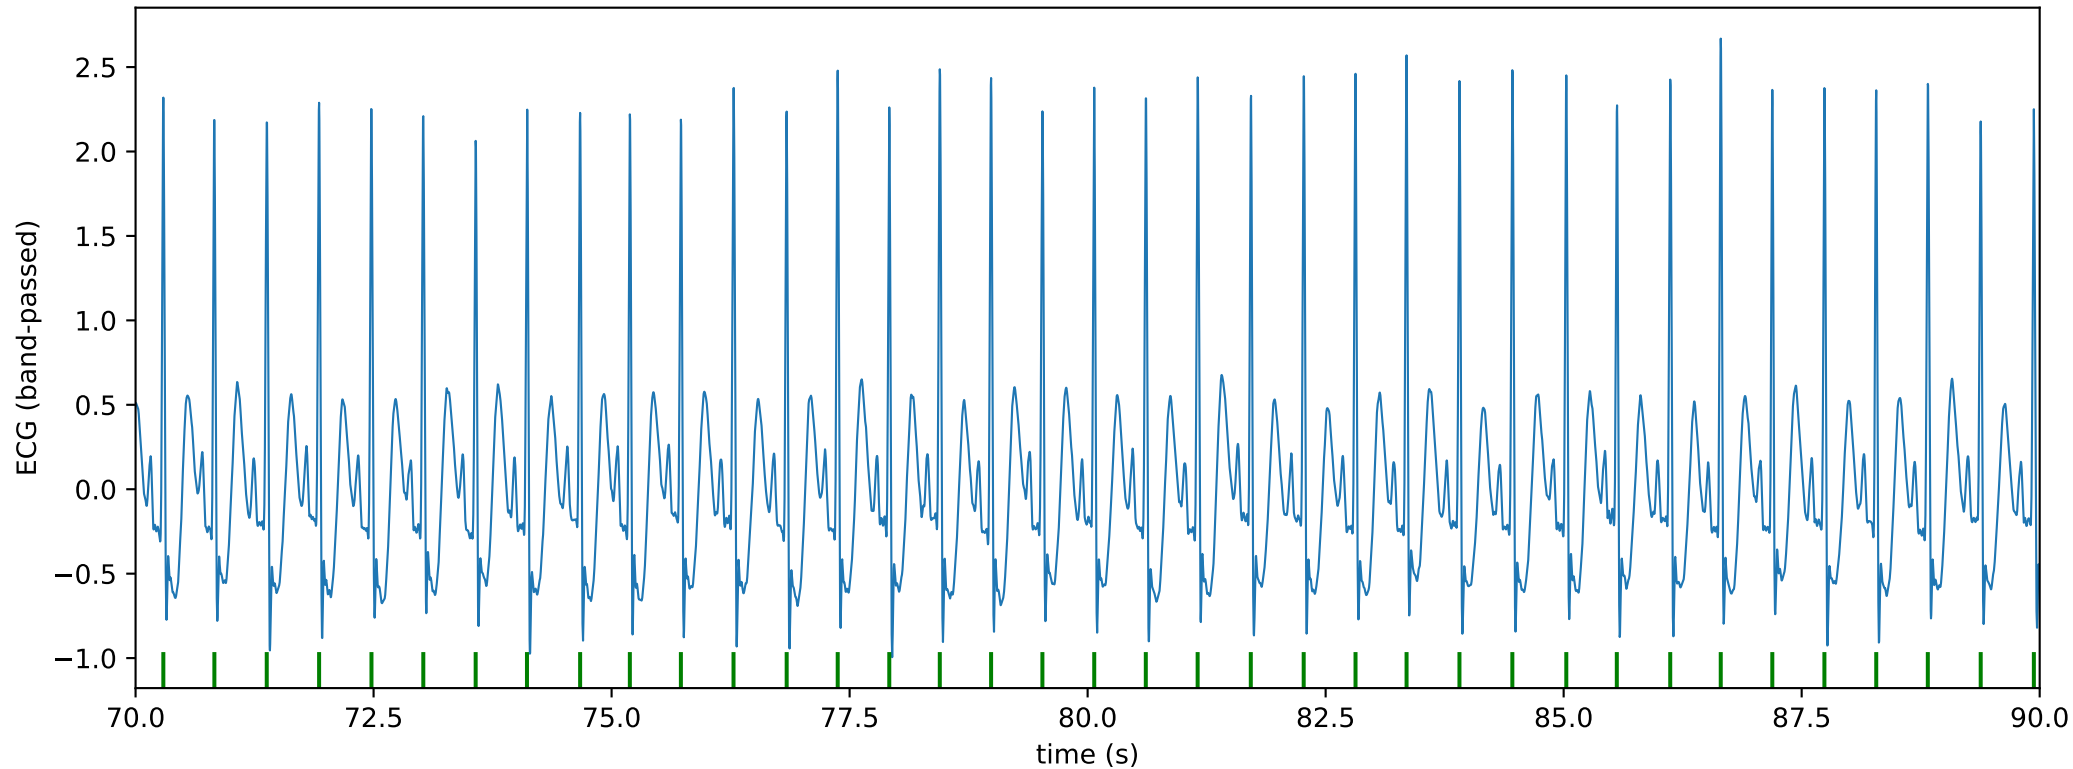

Record 213 — t=90-110 s

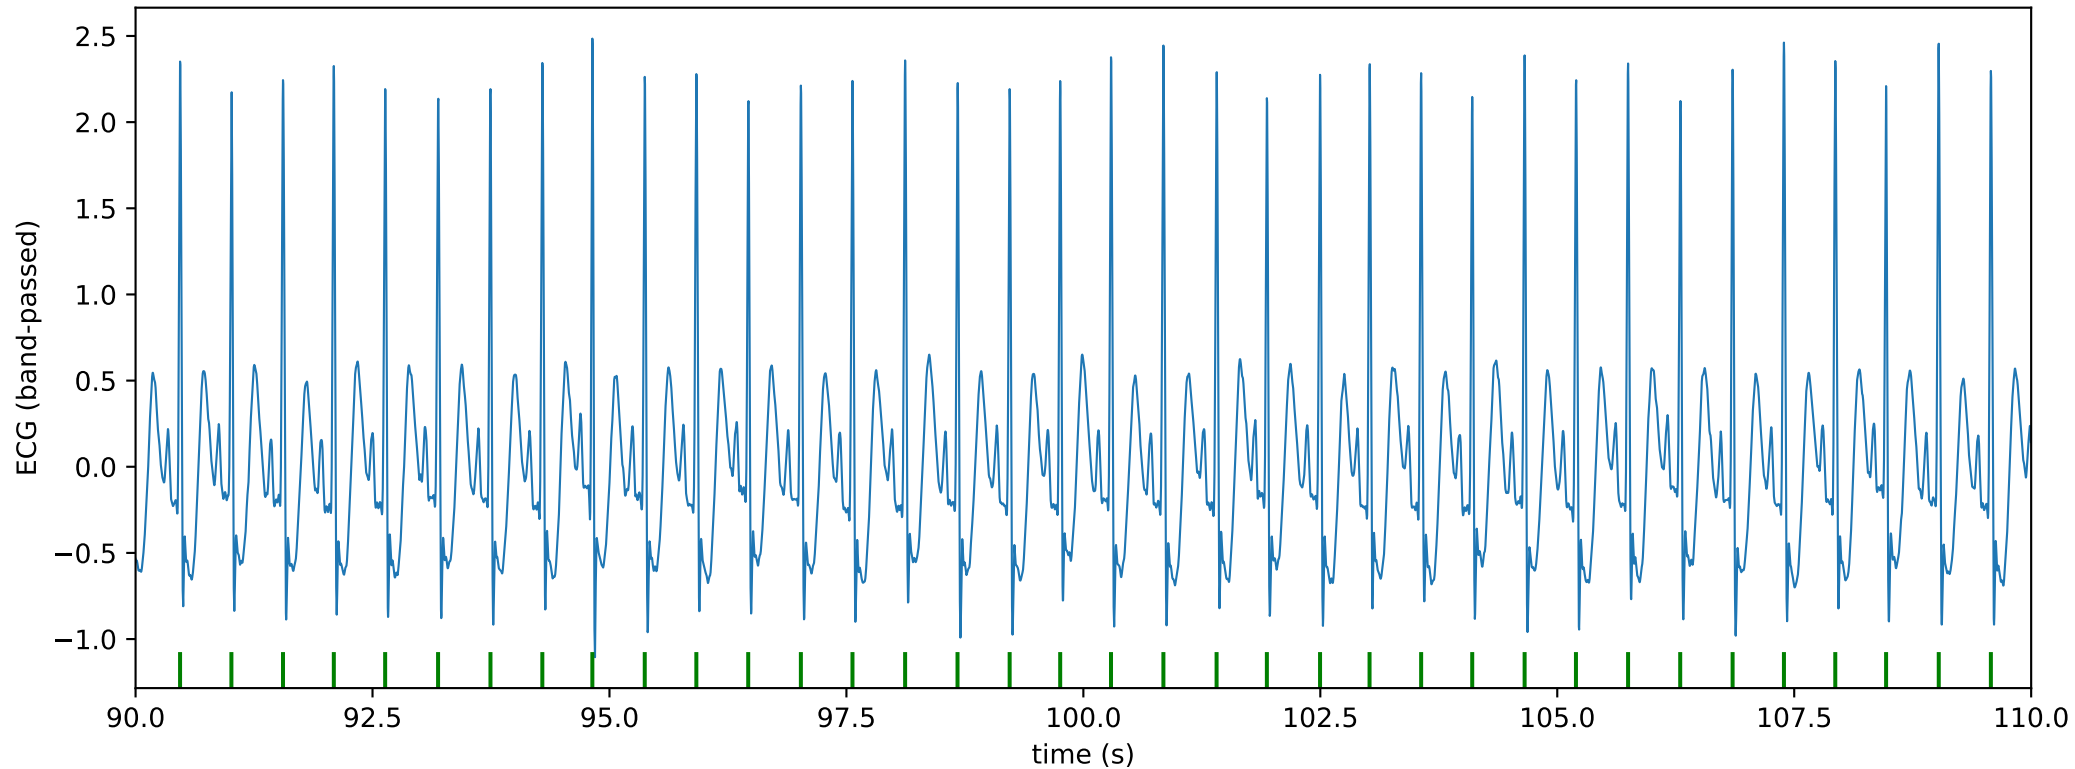

Record 213 — t=110-130 s

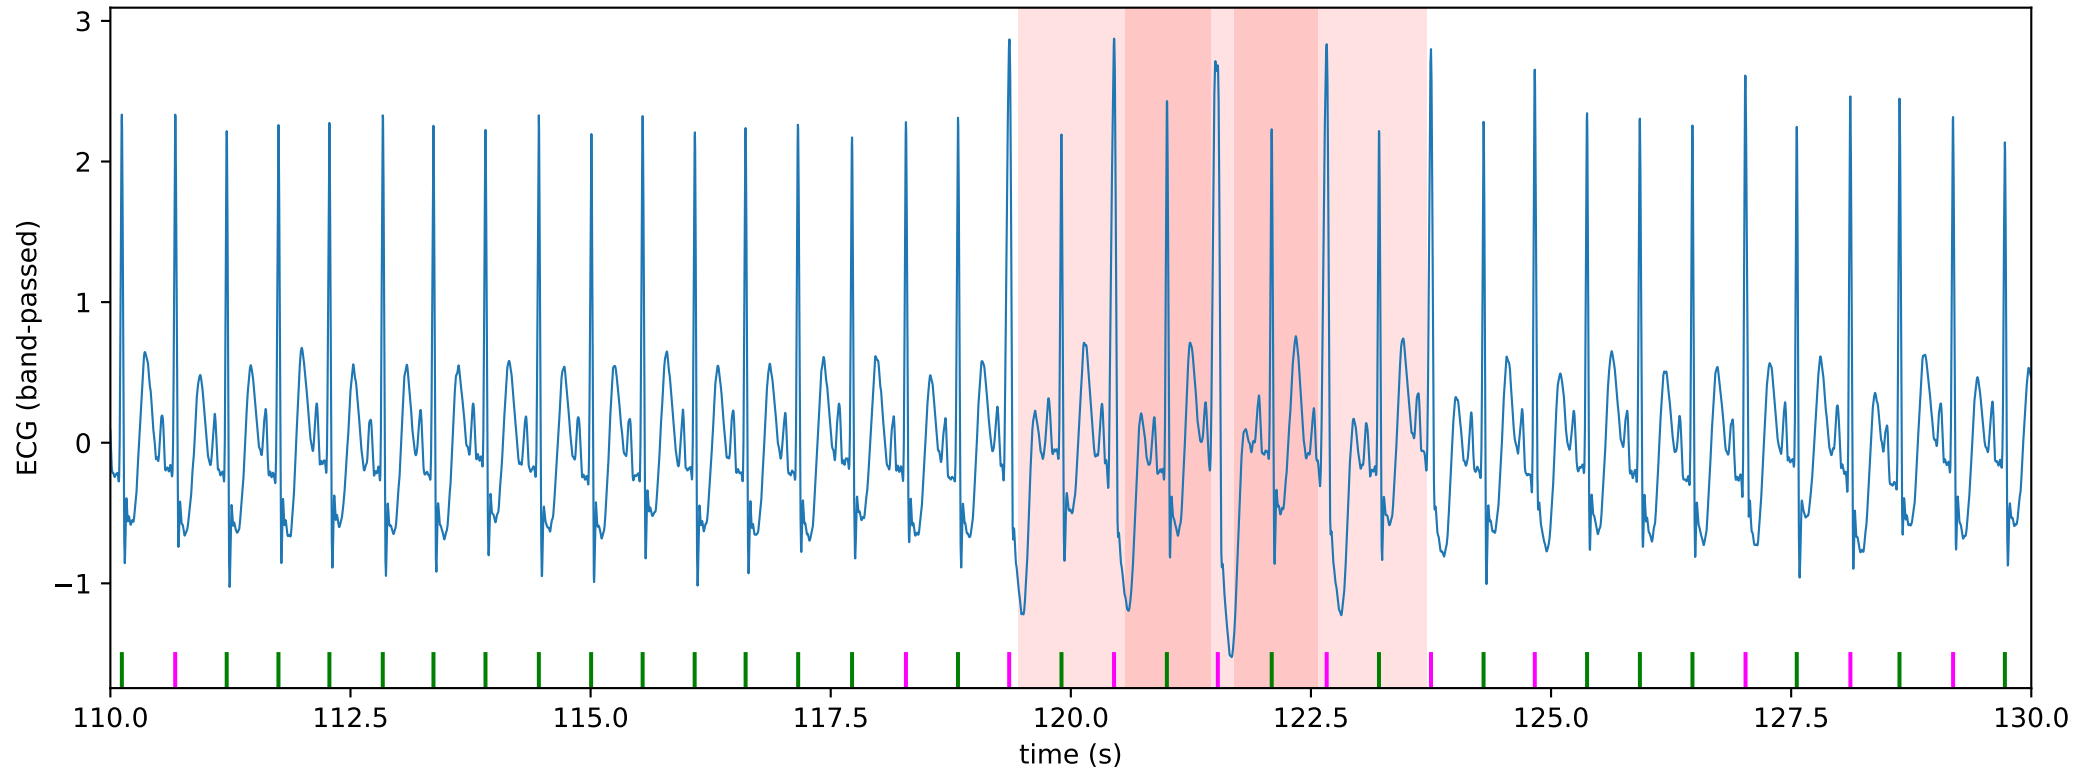

Record 213 — t=130-150 s

