

भारतीय मानक

भवनों की भूकम्प प्रतिरोधी डिजाइन और  
संरचना — रीति संहिता  
( तीसरा पुनरीक्षण )

*Indian Standard*

EARTHQUAKE RESISTANT DESIGN AND  
CONSTRUCTION OF BUILDINGS — CODE OF PRACTICE  
( *Third Revision* )

ICS 91.120.25

© BIS 2013

BUREAU OF INDIAN STANDARDS  
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG  
NEW DELHI 110002

## FOREWORD

This Indian Standard (Third Revision) was adopted by the Bureau of Indian Standards, after the draft finalized by the Earthquake Engineering Sectional Committee had been approved by the Civil Engineering Division Council.

Himalayan-Naga Lushai region, Indo-Gangetic Plain, Western India and Kutch and Kathiawar regions are geologically unstable parts of the country and some devastating earthquakes of the world have occurred there. A major part of the peninsular India has also been visited by moderate earthquakes, but these were relatively few in number and had considerably lesser intensity. It has been a long felt need to rationalize the earthquake resistant design and construction of structures taking into account seismic data from studies of these Indian earthquakes, particularly in view of the heavy construction programme at present all over the country. It is to serve this purpose that IS 1893 : 1966 ‘Criteria for earthquake resistant design of structures’ was formulated. It covered the seismic design considerations for various structures. As an adjunct to IS 1893 : 1966, IS 4326 : 1967 ‘Code of practice for earthquake resistant design and construction of buildings’ was formulated and subsequently revised in 1976 to be in line with IS 1893 : 1975. Since 1984 revision of IS 1893 was minor, it did not require a revision of IS 4326. An expansion of IS 4326 was in fact thought of immediately after the Bihar earthquake of August 1988 when greater attention was needed on low-strength brickwork and stone masonry as well as earthen buildings; also repair, restoration and strengthening of earthquake damaged buildings posed a serious issue. After intense deliberations, the Committee decided to issue separate standards to cover these topics. It was further decided to cover detailing of reinforced concrete for achieving ductility in a separate standard to be used with IS 456 : 1978 ‘Code of practice for plain and reinforced concrete (*third revision*)’. Hence IS 4326 was third revised in 1993.

IS 1893 (Part 1) has been revised in 2002 with a view to keep abreast with the rapid development and extensive research that has been carried out in the field of earthquake resistant design of various structures. IS 456 has been also revised in 2000. Further, four amendments have been issued to IS 4326 : 1993. Therefore, it has been decided to take up the revision of IS 4326 : 1993.

In this standard, it is intended to cover the specified features of design and construction for earthquake resistance of buildings of conventional types. In case of other buildings, detailed analysis of earthquake forces shall be necessary. Recommendations regarding restrictions on openings, provision of steel in various horizontal bands and vertical steel at corners and junctions in walls and at jambs of openings are based on a range of calculations made using steel design seismic coefficient and the ductility of steel reinforcement. Many of the provisions have also been verified experimentally on models by shake table tests.

The Committee responsible for the formulation of this standard has taken into consideration the views of all who are interested in this field and has related the standard to the prevailing practices in the country. Due weightage has also been given to the need for international co-ordination among the standards and practices prevailing in different countries of the world.

The composition of the Committee responsible for the formulation of this standard is given in Annex A.

For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS 2 : 1960 ‘Rules for rounding off numerical values (*revised*)’. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

*Indian Standard*

# EARTHQUAKE RESISTANT DESIGN AND CONSTRUCTION OF BUILDINGS — CODE OF PRACTICE

## ( *Third Revision* )

### **1 SCOPE**

**1.1** This standard deals with the selection of materials, special features of design and construction for earthquake resistant buildings including masonry construction using rectangular masonry units, timber construction and buildings with pre-fabricated flooring/roofing elements.

**1.2** Guidelines for earthquake resistant buildings constructed using masonry of low strength and earthen buildings are covered in separate Indian Standards.

### **2 REFERENCES**

The standards listed below contain provisions which through reference in this text, constitute provisions of this standard. At the time of publication, the editions indicated were valid. All standards are subject to revision and parties to agreements based on this standard are encouraged to investigate the possibility of applying the most recent edition of the standards indicated below:

<i>IS No.</i>	<i>Title</i>
456 : 2000	Plain and reinforced concrete — Code of practice ( <i>third revision</i> )
883 : 1994	Code of practice for design of structural timber in building ( <i>fourth revision</i> )
1077 : 1992	Common burnt clay building bricks — Specification ( <i>fifth revision</i> )
1597 (Part 2) : 1992	Code of practice for construction of stone masonry: Part 2 Ashlar masonry ( <i>first revision</i> )
1641 : 1988	Code of practice for fire safety of buildings (general): General principles of fire grading and classification ( <i>first revision</i> )
1642 : 1989	Code of practice for fire safety of buildings (general): Details of construction ( <i>first revision</i> )
1643 : 1988	Code of practice for fire safety of buildings (general): Exposure hazard ( <i>first revision</i> )
1644 : 1988	Code of practice for fire safety of buildings (general): Exit requirements and personal hazard ( <i>first revision</i> )

<i>IS No.</i>	<i>Title</i>
1646 : 1997	Code of practice for fire safety of buildings (general): Electrical installations ( <i>second revision</i> )
1893 : 1984	Criteria for earthquake resistant design of structures ( <i>fourth revision</i> )
1893 (Part 1) : 2002	Criteria for earthquake resistant design of structures: Part 1 General provisions and buildings ( <i>fifth revision</i> )
1904 : 1986	Code of practice for design and construction of foundations in soils: General requirements ( <i>third revision</i> )
1905 : 1987	Code of practice for structural use of unreinforced masonry ( <i>third revision</i> )
2185 (Part 1) : 2005	Concrete masonry units — Specification: Part 1 Hollow and solid concrete blocks ( <i>third revision</i> )
2212 : 1991	Code of practice for brickwork ( <i>first revision</i> )
2751 : 1979	Code of practice of welding mild steel plain and deformed bars for reinforced construction ( <i>first revision</i> )
3414 : 1968	Code of practice for design and installation of joints in buildings
9417 : 1989	Recommendations for welding cold worked bars for reinforced steel construction ( <i>first revision</i> )
13920 : 1993	Ductility detailing of reinforced concrete structures subjected to seismic forces — Code of practice

### **3 TERMINOLOGY**

For the purpose of this standard, the following definitions shall apply.

**3.1 Separation Section** — A gap of specified width between adjacent buildings or parts of the same building either left uncovered or covered suitably to permit movement in order to avoid pounding due to earthquake.

**3.1.1 Crumple Section** — The separation gap filled with appropriate material that crumples or factures in the event of an earthquake.

**3.2 Centre of Rigidity** — The point in a structure where application of lateral force produces equal deflections of its components at any level in any particular direction.

**3.3 Shear Wall** — A wall designed to resist lateral force in the own plane. Braced frames, subjected primarily to axial stresses, shall be considered as shear walls for the purpose of this definition.

**3.4 Space Frame** — A three-dimensional structural system comprised of interconnected members, without shear or bearing walls, so that to function as a complete self-contained unit with or without the aid of horizontal diaphragms or floor bracing systems.

**3.4.1 Vertical Load Carrying Frame** — A space frame designed to carry all the vertical loads, the horizontal loads being resisted by shear walls.

**3.4.2 Moment Resistant Frame** — A space frame capable of carrying all vertical and horizontal loads, by developing bending moments in the members and at joints.

**3.4.3 Moment Resistant Frame with Shear Walls** — A space frame with moment resistant joints and strengthened by shear walls to assist in carrying horizontal loads.

**3.5 Box System** — A bearing wall structure without a space frame, the horizontal forces being resisted by the walls that act as shear walls.

**3.6 Band** — A reinforced concrete or reinforced brick runner provided in the walls to tie them together and to impart horizontal bending strength in them.

**3.7 Seismic Zone and Seismic Coefficient** — The seismic zones II to IV as classified in IS 1893 (Part 1) and corresponding basic seismic coefficient  $\alpha$  as specified in **3.4** of IS 1893.

**3.8 Design Horizontal Seismic Coefficient** — The value of horizontal seismic coefficient  $A_h$  computed taking into account the soil-foundation system and the importance factor as specified in **4.4** of IS 1893 (Part 1).

**3.9 Concrete Grades** — 28 day compressive strength of concrete cubes of 150 mm size, in MPa; for example, for Grade M20 of IS 456, the concrete strength equal to 20 MPa.

## 4 GENERAL PRINCIPLES

**4.0** The general principles given in **4.1** to **4.9** shall be observed in construction of earthquake resistant buildings.

### 4.1 Lightness

Since the earthquake force is a function of mass, the weight of the building shall be as minimum as possible,

consistent with structural safety and functional requirements. Roofs and upper storeys of buildings, in particular, should be designed as light as possible.

### 4.2 Continuity of Construction

**4.2.1** As far as possible, the parts of the building should be tied together in such a manner that the building acts as one unit.

**4.2.2** For parts of buildings between separation or crumple sections to expansion joints, floor slabs shall be continuous throughout as far as possible. Concrete slabs shall be rigidly connected or integrally cast with the support beams.

**4.2.3** Additions to the structures shall be accompanied by the provision of separation or crumple sections between the new and the existing structures as far as possible, unless positive measures are taken to establish continuity between the existing and the new construction.

**4.2.4** Alteration to the building structure shall be done by maintaining its structural stability by ensuring proper load path.

### 4.3 Projecting and Suspended Parts

**4.3.1** Projecting parts shall be avoided as far as possible. If the projecting parts cannot be avoided, they shall be properly reinforced and firmly tied to the main structure, and their design shall be in accordance with IS 1893.

**4.3.2** Ceiling plaster shall preferably be avoided. When it is unavoidable, the plaster shall be as thin as possible.

**4.3.3** Suspended ceiling shall be avoided as far as possible. Where provided they shall be light, adequately framed and secured to which electrical fixtures shall be fully secured.

### 4.4 Building Configuration

**4.4.1** In order to minimize torsion and stress concentration, provisions given in **4.4.2** to **4.4.4** should be complied with as relevant.

**4.4.2** The building should have a simple rectangular plan and be symmetrical both with respect to mass and rigidity so that the centre of mass and rigidity of the building coincide with each other in which case no separation sections other than expansion joints are necessary. For provision of expansion joints reference may be made to IS 3414.

**4.4.3** If symmetry of the structure is not possible in plan, elevation or mass, provision shall be made for torsional and other effects due to earthquake forces in the structural design or the parts of different rigidities may be separated through crumple sections. The length

of such building between separation sections shall not preferably exceed three times the width.

**NOTE** — As an alternative to separation section to reduce torsional moments, the centre of rigidity of the building may be brought close or coincident to the centre of mass by adjusting the locations and/or sizes of columns and walls.

**4.4.4** Buildings having plans with shapes like L, T, E and Y shall preferably be separated into rectangular parts by providing separation sections at appropriate places. Typical examples are shown in Fig. 1.

#### NOTES

1 The buildings with small lengths of projections forming L, T, E or Y shapes need not be provided with separation section. In each cases the length of the projection may not exceed 15 to 20 percent of the total dimension of the building in the direction of the projection (see Fig. 2).

2 For buildings with minor asymmetry in plan and elevation separation sections may be omitted.



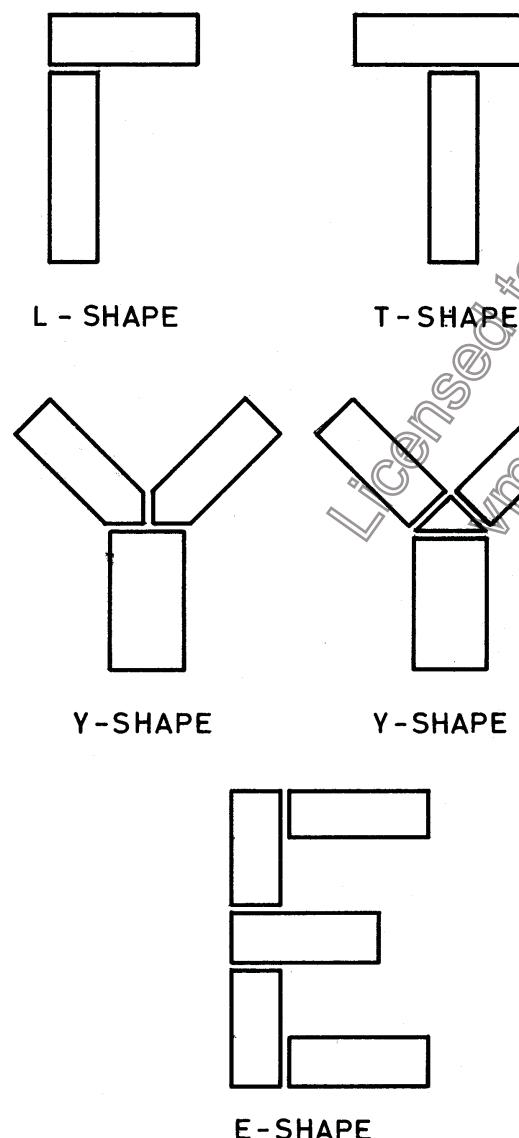


FIG. 1 TYPICAL SHAPES OF BUILDING WITH SEPARATION SECTIONS

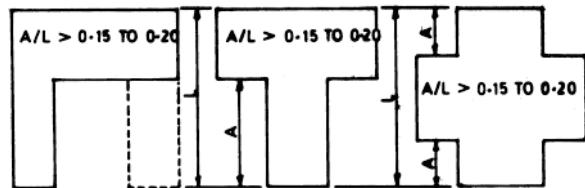

2A Plan Irregularities

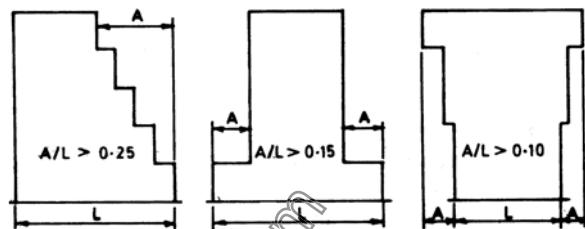

2B Vertical Irregularities

FIG. 2 PLAN AND VERTICAL IRREGULARITIES

#### 4.5 Strength in Various Directions

The structure shall be designed to have adequate strength against earthquake effects along both the horizontal axes. The design shall also be safe considering the reversible nature of earthquake forces.

#### 4.6 Foundations

The structure shall not be founded on such soils which shall subside or liquefy during an earthquake, resulting in large differential settlements (see also 5.3.3).

#### 4.7 Ductility

The main structural elements and their connection shall be designed to have a ductile failure. This shall enable the structure to absorb energy during earthquakes to avoid sudden collapse of the structure. Providing reinforcing steel in masonry at critical sections, as specified in this standard shall not only increase strength and stability but also ductility. The details for achieving ductility in reinforced concrete structures is given in IS 13920.

#### 4.8 Damage to Non-structural Parts

Suitable details shall be worked out to connect the non-structural parts with the structural framing so that the deformation of the structural frame leads to minimum damage of the non-structural elements.

#### 4.9 Fire Safety

Fire frequently follows an earthquake and therefore, buildings shall be constructed to make them fire resistant in accordance with the provisions of following Indian Standards for fire safety, as relevant:

IS 1641, IS 1642, IS 1643, IS 1644 and IS 1646.

## 5 SPECIAL CONSTRUCTION FEATURES

### 5.1 Separation of Adjoining Structures

**5.1.1** Separation of adjoining structures or parts of the same structure is required for structures having different total heights or storey heights and different dynamic characteristics. This is to avoid collision during an earthquake.

**5.1.2** Minimum width of separation gaps as mentioned in **5.1.1**, shall be as specified in Table 1. The design seismic coefficient to be used shall be in accordance with IS 1893 (Part 1).

**Table 1 Gap Width for Adjoining Structures**

Sl No.	Type of Construction	Gap Width/Number of Storey in mm for Design Seismic Coefficient $A_h = 0.12 \text{ mm}$
(1)	(2)	(3)
i)	Box system or frames with shear walls	15.0
ii)	Moment resistant reinforced concrete frame	20.0
iii)	Moment resistant steel frame	30.0

NOTE — Minimum total gap shall be 25 mm. For any other value of  $A_h$  the gap width shall be determined proportionately.



**5.1.2.1** For buildings of height greater than 40 m, it shall be desirable to carry out model or dynamic analysis of the structures in order to compute the drift at each storey, and the gap width between the adjoining structures shall not be less than the sum of their dynamic deflection at any level.

**5.1.3** Where separation is necessary, a complete separation of the parts shall be made except below the plinth level. The plinth beams, foundation beams and footings may be continuous. Where separation sections are provided in a long building, they shall take care of movement owing to temperature changes also.


### 5.2 Separation or Crumple Section

**5.2.1** In case of framed construction, members shall be duplicated on either side of the separation or crumple section. As an alternative, in certain cases, such duplication may not be provided, if the portions on either side can act as cantilevers to take the weight of the building and other relevant loads.


**5.2.2** Typical details of separation and crumple sections are shown in Fig. 3. For other types of joint details, reference may be made to IS 3414.

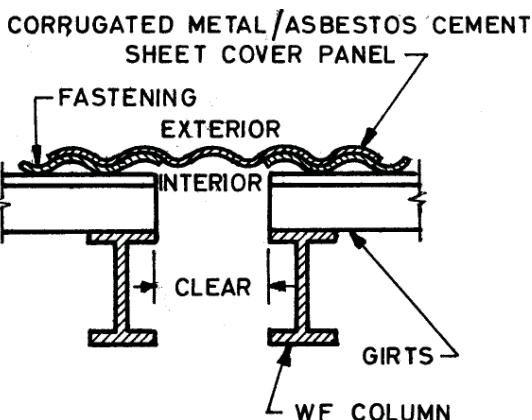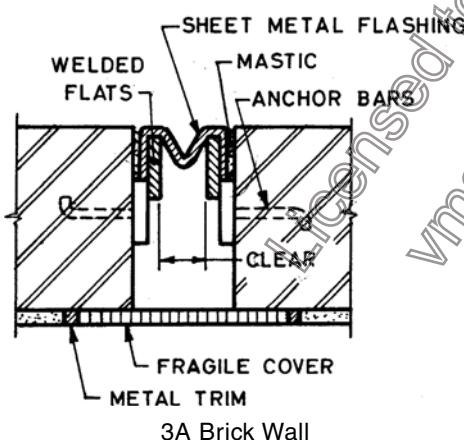

3C Metal Siding Industrial Work



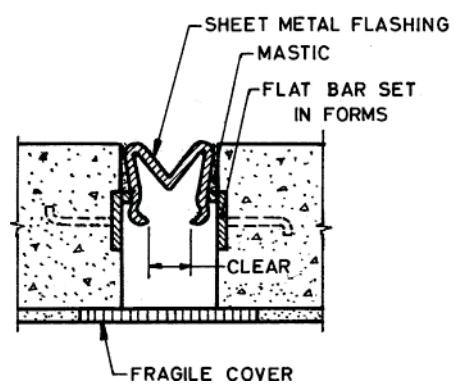


3B Concrete Walls

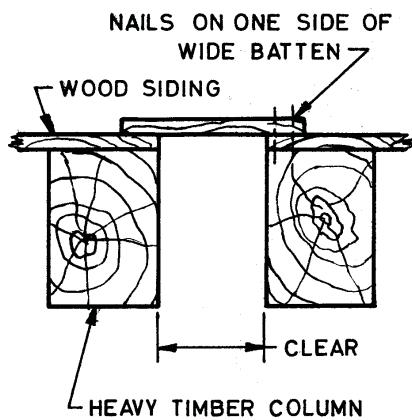

3D Wood Sheathing Industrial Work

FIG. 3 TYPICAL DETAILS OF SEPARATION OR CRUMBLE SECTION (*Continued*)

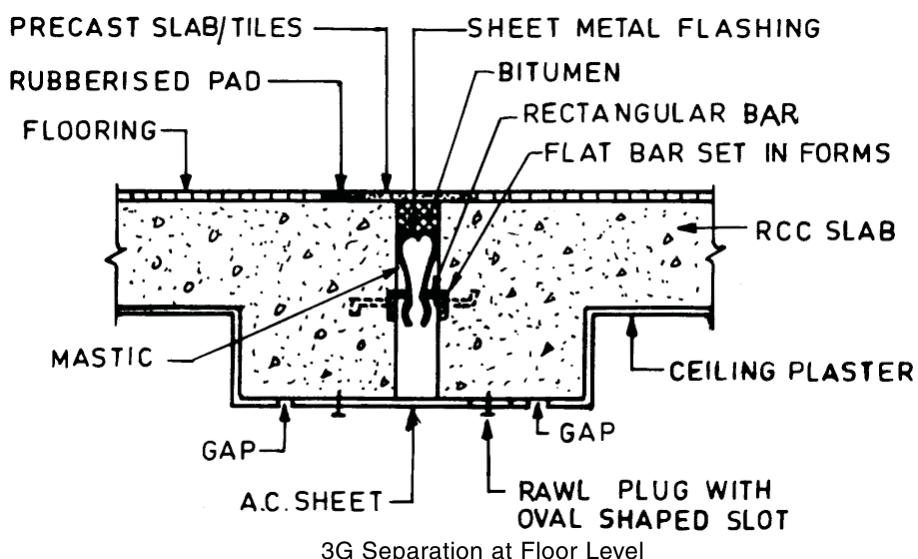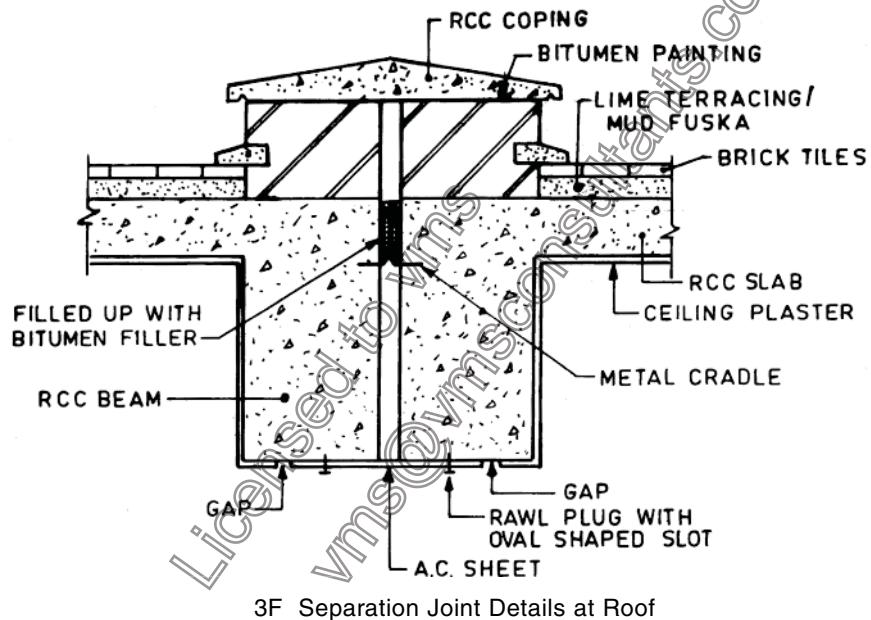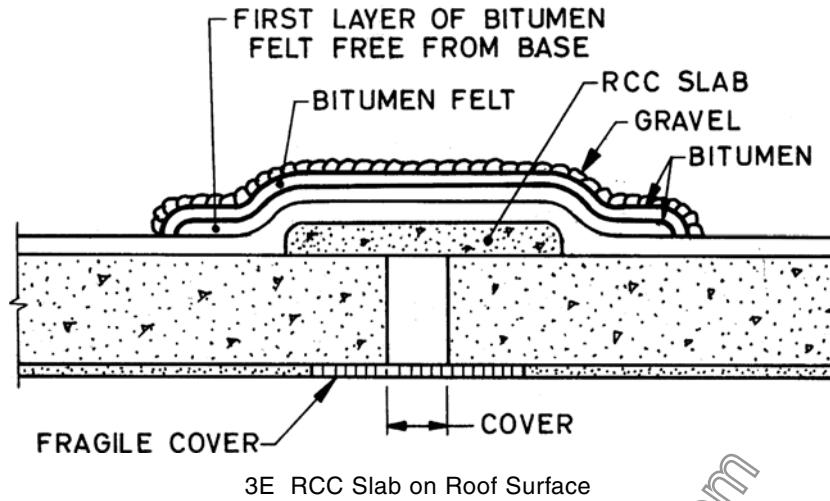

NOTE — Fragile cover may consist of asbestos cement sheet, particle board and like.

FIG. 3 TYPICAL DETAILS OF SEPARATION OR CRUMBLE SECTION

### 5.3 Foundations

**5.3.1** For the design of foundations, the provisions of IS 1904 in conjunction with IS 1893 (Part 1) shall generally be followed.

**5.3.2** The subgrade below the entire area of the building shall preferably be of the same type of the soil. Wherever this is not possible, a suitably located separation or crumple section shall be provided.

**5.3.3** Loose fine sand, soft silt and expansive clays should be avoided. If unavoidable, the building shall rest either on a rigid raft foundation or on piles taken to a firm stratum. However, for light constructions the following measures may be taken to improve the soil on which the foundation of the building may rest:

- a) Sand piling; and
- b) Soil stabilization.

### 5.3.4 Isolated Footings for Columns

All the individual footings or pile caps where used in Type III soft soils [see Table 1 of IS 1893 (Part 1)], shall be connected by reinforced concrete ties at least in two directions approximately at right angles to each other. For buildings with no basement, the ties may be placed at or below the plinth level and for buildings with basement they may be placed at the level of basement floor. They shall need to be designed to carry the load of the panel walls also.

NOTE — The ties may not be necessary where structural floor connects the columns at or below the plinth level.

**5.3.4.1** Where ties are used, their sections shall be designed to carry in tension as well as in compression, an axial load not less than the earthquake force in the direction the tie acting on the heavier of the columns connected, but the sections shall not be less than 200 mm × 200 mm with M20 concrete reinforced with 4 bars of 12 mm diameter plain mild steel bars or 10 mm diameter high strength deformed bars, one at each corner, bound by 8 mm diameter stirrups not more than 150 mm apart.

NOTE — In working out the buckling strength of ties, the lateral support provided by the soil may be taken into account. Calculations show that for such buried ties, lateral buckling is not a problem and the full section of the tie may be taken effective as a short column.

**5.3.4.2** In the case of reinforced concrete slab, the thickness shall not be less than 1/50th of the clear distance between the footings, but not less than 100 mm in any case. It shall be reinforced with not less than 0.15 percent mild steel bars or 0.12 percent high strength deformed bars in each direction placed symmetrically at top and bottom.

## 5.4 Roofs and Floors

**5.4.1** Flat roof or floor shall not preferably be made of

terrace of ordinary bricks supported on steel, timber or reinforced concrete joists, nor they shall be of a type which in the event of an earthquake is likely to be loosened and parts of all of which may fall. If this type of construction cannot be avoided, the joists should be blocked at ends and bridged at intervals such that their spacing is not altered during an earthquake.

**5.4.1.1** For pitched roofs, corrugated iron or asbestos sheets shall be used in preference to country, Allahabad or Mangalore tiles or other loose roofing units. All roofing materials shall be properly tied to the supporting members. Heavy roofing materials shall generally be avoided.

### 5.4.2 Pent Roofs

**5.4.2.1** All roof trusses shall be supported on reinforced concrete or reinforced brick band (see 8.4.3). The holding down bolts shall have adequate size and length as required for earthquake forces in accordance with IS 1893 (Part 1).

Where a trussed roof adjoins a masonry gable, the ends of the purlins shall be carried on and secured to a plate or bearer which shall be adequately bolted to reinforced concrete or reinforced brick band at the top of gable end masonry (see 8.4.4).

NOTE — Hipped roof in general have shown better structural behaviour during earthquakes than gable ended roofs.

**5.4.2.2** At tie level all the trusses and the gable end shall be provided with diagonal braces in plan so as to transmit the lateral shear due to earthquake force to the gable walls acting as shear walls at the ends as specified in 8.4.

### 5.4.3 Jack Arches

Jack arched roofs or floors, where used shall be provided with mild steel ties in all spans along with diagonal braces in plan to ensure diaphragms actions.

## 5.5 Staircases

**5.5.1** The inter-connection of the stairs with the adjacent floors should be appropriately treated by providing sliding joints at the stairs to eliminate their bracing effect on the floors. Large stair halls shall preferably be separated from the rest of the building by means of separation or crumple sections.

**5.5.2** Three types of stair construction may be adopted as described below:

- a) *Separated staircases* — One end of the staircase rests on a wall and the other end is carried by columns and beams which have no connection with the floors. The gap at the vertical joints between the floor and the staircase may be covered either with a tread



plate attached to one side of the joint and sliding on the other side, or covered with some appropriate material which could crumple or fracture during an earthquake without causing structural damage. The supporting members, columns or walls, are isolated from the surrounding floors by means of separation or crumple sections. A typical example is shown in Fig. 4.

- b) *Built-in staircase* — When stairs are built monolithically with floors, they can be protected against damage by providing rigid walls at the stair opening. An arrangement, in which the staircase is enclosed by two walls,

is given in Fig. 5. In such cases, the joints, as mentioned in respect of separated staircases, shall not be necessary.

The two walls mentioned above, enclosing the staircase, shall extend through the entire height of the stairs and to the building foundations.

- c) *Staircases with sliding joints* — In case it is not possible to provide rigid walls around stair openings for built-in staircase or to adopt the separated staircases, the staircases shall have sliding joints so that they shall not act as diagonal bracing.

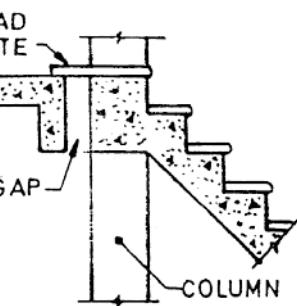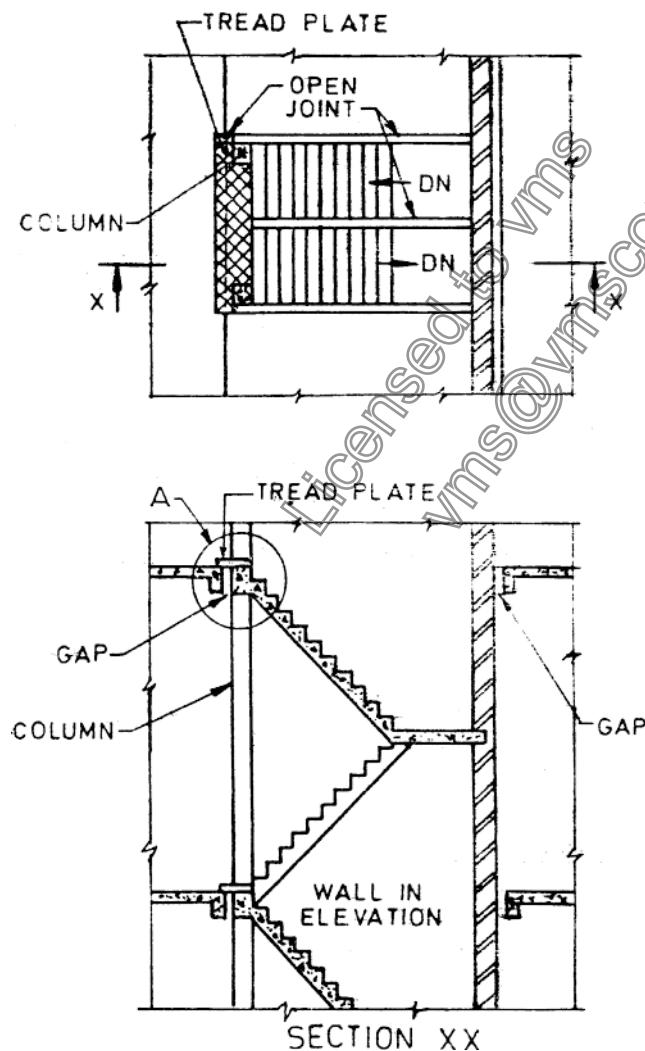

DETAIL AT A

FIG. 4 SEPARATED STAIRCASE

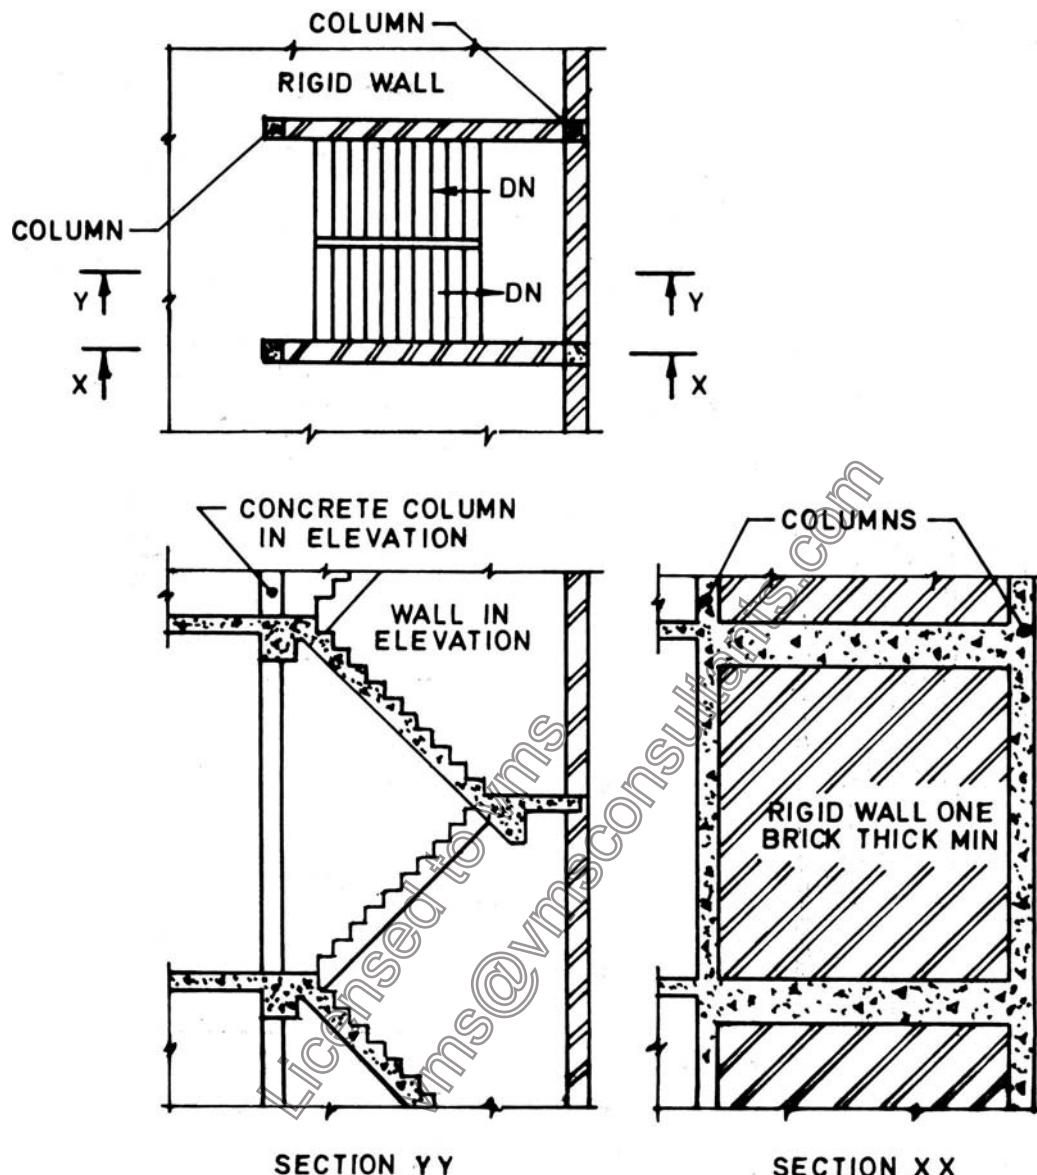


FIG. 5 RIGIDLY BUILD-IN STAIR CASE

## 6 TYPES OF CONSTRUCTION

**6.1** The types of construction usually adopted in buildings are as follows:

- Framed construction; and
- Box type construction.

### 6.2 Framed Construction

This type of construction is suitable for multi-storied and industrial buildings as described in **6.2.1** and **6.2.2**.

#### 6.2.1 Vertical Load Carrying Frame Construction

This type of construction consists of frames with flexible (hinged) joints and bracing members. Steel multi-storied building or industrial frames and timber construction usually are of this type.

**6.2.1.1** Such buildings shall be adequately strengthened against lateral forces by shear walls and/or other bracing systems in plan, elevation and sections such that earthquake forces shall be resisted by them in any direction.

#### 6.2.2 Moment Resistant Frames with Shear Walls

The frames may be of reinforced concrete or steel with semi-rigid or rigid joints. The walls are rigid capable of acting as shear walls and may be of reinforced concrete or of brickwork reinforced or unreinforced bounded by framing members through shear connectors.

**6.2.2.1** The frame and wall combinations shall be designed to carry the total lateral force due to earthquake acting on the building. The frame acting

alone shall be designed to resist at least 25 percent of the total lateral force.

**6.2.2.2** The shear walls shall preferably be distributed evenly over the whole building. When concentrated at one location, forming what is called a rigid core in the building, the design shall be checked for torsional effects and the shear connection between the core and the floors conservatively designed for the total shear transfer.

**6.2.2.3** The shear walls should extend from the foundation either to the top of the building or to a lesser height as required from design consideration. In design, the interaction between frame and the shear walls should be considered properly to satisfy compatibility and equilibrium conditions.

NOTE — Studies show that shear walls of height about 85 percent of total height of building are advantageous.

### 6.3 Box Type Construction

This type of construction consists of prefabricated or *in-situ* masonry, concrete or reinforced concrete walls along both the axes of the building. The walls support vertical loads and also act as shear walls for horizontal loads acting in any direction. All traditional masonry construction falls under this category. In prefabricated construction, attention shall be paid to the connection between wall panels so that transfer of shear between them is ensured.

## 7 CATEGORIES OF BUILDINGS

**7.1** For the purpose of specifying the earthquake resisting features in masonry and wooden buildings, the buildings have been categorized in four categories B to E based on the seismic zone and the importance of the building *I*, where

*I* = Importance factor applicable to the building [see **6.4.2** and Table 6 of IS 1893 (Part 1)].

**7.1.1** The building categories are given in Table 2.

**Table 2 Building Categories for Earthquake Resisting Features**

Sl No.	Importance Factor (1)	Seismic Zone				
		II (3)	III (4)	IV (5)	V (6)	
i)	1.0	B	C	D	E	
ii)	1.5	C	D	E	E	

NOTE — Category A is now defunct as zone I does not exist any more.

## 8 MASONRY CONSTRUCTION WITH RECTANGULAR MASONRY UNITS

**8.1** The design and construction of masonry walls using rectangular masonry units in general shall be governed by IS 1905 and IS 2212.

### 8.1.1 Masonry Units

**8.1.1.1** Well burnt bricks conforming to IS 1077 or solid concrete blocks conforming to IS 2185 (Part 1) and having a crushing strength not less than 3.5 MPa shall be used. The strength of masonry unit required shall depend upon number of storeys and thickness of walls (see IS 1905).

**8.1.1.2** Squared stone masonry, stone block masonry or hollow concrete block masonry, as specified in IS 1597 (Part 2) of adequate strength, may also be used.

### 8.1.2 Mortar

**8.1.2.1** Mortars, such as those given in Table 3 or of equivalent specification, shall preferably be used for masonry construction for various categories of buildings.

**8.1.2.2** Where steel reinforcing bars are provided in masonry the bars shall be embedded with adequate cover in cement sand mortar not leaner than 1 : 3 (minimum clear cover 10 mm) or in cement concrete of grade M20 (minimum clear cover 15 mm or bar diameter whichever more), so as to achieve good bond and corrosion resistance.

### 8.2 Walls

**8.2.1** Masonry bearing walls built in mortar, as specified in **8.1.2.1** unless rationally designed as reinforced masonry shall not be built of greater height than 15 m subject to a maximum of four storeys when measured from the mean ground level to the roof slab or ridge level. The masonry bearing walls shall be reinforced in accordance with **8.4.1**.

**8.2.2** The bearing walls in both directions shall be straight and symmetrical in plan as far as possible.

**8.2.3** The wall panels formed between cross walls and floors or roof shall be checked for their strength in bending as a plate or as a vertical strip subjected to the earthquake force acting on its own mass.

NOTE — For panel walls of 200 mm or larger thickness having a storey height not more than 3.5 m and laterally supported at the top, this check need not be exercised.

### 8.2.4 Masonry Bond

For achieving full strength of masonry, the usual bonds specified for masonry should be followed so that the vertical joints are broken properly from course to course. To obtain full bond between perpendicular walls, it is necessary to make a slopping (stepped) joint by making the corners first to a height of 600 mm and then building the wall in between them. Otherwise, the toothed joint should be made in both the walls alternatively in lifts of about 450 mm (see Fig. 6).

**8.2.5** Ignoring tensile strength, free standing walls shall be checked against overturning under the action of design seismic coefficient  $\gamma_h$  allowing for a factor safety of 1.5.

**8.2.6** Panel or filler walls in framed buildings shall be properly bonded to surrounding framing members by means of suitable mortar (see Table 3) or connected through dowels. If the walls are so bonded they shall be checked according to **8.2.3** otherwise checked as in **8.2.5**.

### 8.3 Openings in Bearing Walls

**8.3.1** Door and window openings in walls reduce their lateral load resistance and hence, should preferably be small and more centrally located. The guidelines on the size and position of opening are given in Table 4 and Fig. 7.

**8.3.2** Openings in any storey shall preferably have their top at the same level so that a continuous band could be provided over them, including the lintels throughout the building.

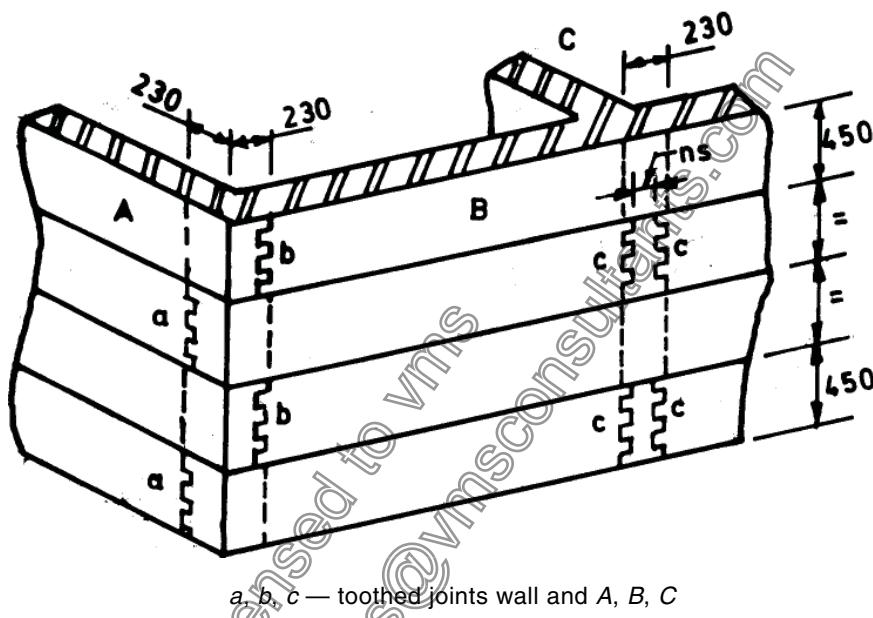


FIG. 6 ALTERNATING TOOTHED JOINTS IN WALLS AT CORNER AND T-JUNCTION

**Table 3 Recommended Mortar Mixes**

(Clauses 8.1.2.1 and 8.2.6)

Sl No.	Building Category	Sl No. as given in Table 1 of IS 1905	Grade of Mortar	Mix Proportions (By Loose Volume)			Minimum Compressive Strength at 28 Days N/mm <sup>2</sup>
				Cement (5)	Lime (6)	Sand (7)	
i)	E	2(a)	H2	1	1/4 C or B	4	7.5
		2(b)	—	1	1/2 C or B	4½	6.0
ii)	D	3(a)	M1	1	—	5	5.0
		3(B)	—	1	1 C or B	6	3.0
iii)	C	4(a)	M2	1	—	6	3.0
		4(b)	—	1	2 B	9	2.0
iv)	B	5(a)	M3	1	—	7	1.5
		5(b)	—	1	3 B	12	1.5

#### NOTES

- 1 Sand for making mortar should be well graded. In case sand is not well graded, its proportion shall be reduced in order to achieve the minimum specified strength.
- 2 For mixes in Sl No. 2(a) and 2(b), use of lime is not essential from consideration of strength as it does not result in increase in strength. However, its use is highly recommended since it improves workability.
- 3 For mixes in Sl No. 3(a), 4(a) and 5(a), either lime C or B to the extent of 1/4 part of cement (by volume) or some plasticizer should be added for improving workability.
- 4 For mixes in Sl No. 4(b) and 5(b), lime and sand should first be ground in mortar mill and then cement added to coarse stuff.
- 5 A, B and C denote eminently hydraulic lime, semi-hydraulic lime and fat lime respectively as specified in relevant Indian Standards.


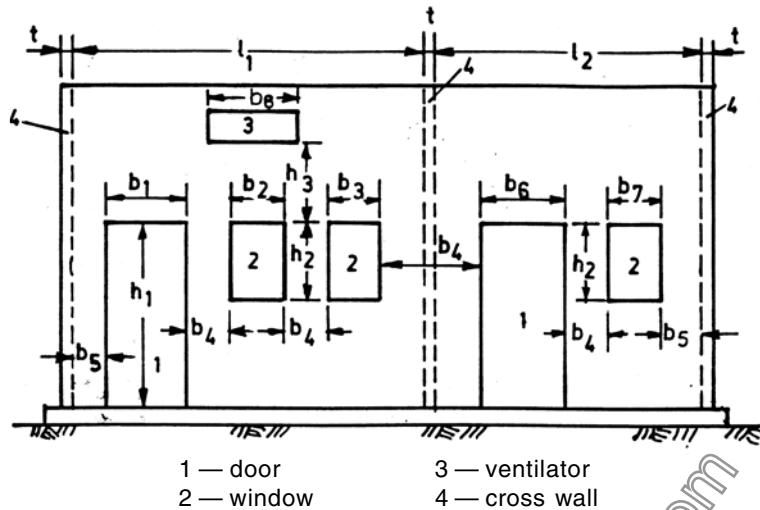


FIG. 7 DIMENSIONS OF OPENINGS AND PIERS FOR RECOMMENDATIONS IN TABLE 4

**8.3.3** Where openings do not comply with the guidelines of Table 4, they should be strengthened by providing reinforced concrete or reinforcing the brickwork, as shown in Fig. 8 with high strength deformed (H.S.D.) bars of 8 mm diameter but the quantity of steel shall be increased at the jambs to comply with **8.4.9**, if so required.

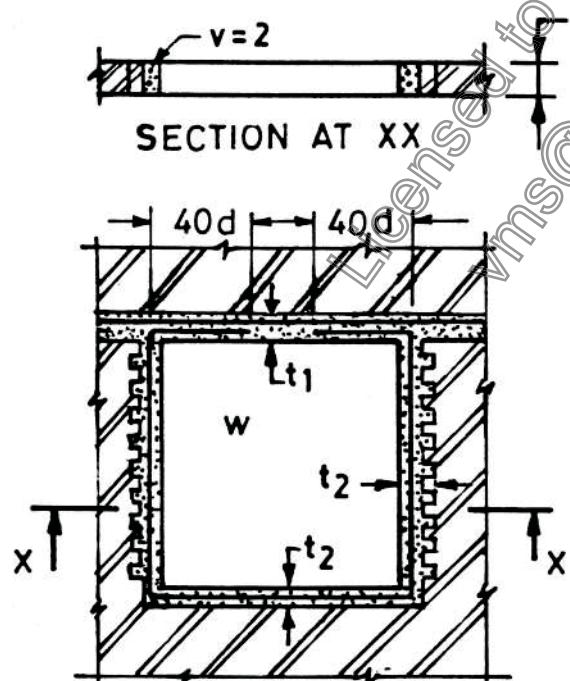

w — window      t — wall thickness  
 $t_1$  — lintel thickness  $t_2$  — thickness of concrete in jamb  
 $v$  — vertical bar      d — diameter of reinforcing bar

FIG. 8 STRENGTHENING MASONRY AROUND OPENINGS

**8.3.4** If a window or ventilator is to be projected out, the projection shall be in reinforced masonry or concrete and well anchored.

**8.3.5** If an opening is tall from bottom to almost top of a storey, thus dividing the wall into two portions, these portions shall be reinforced with horizontal reinforcement of 6 mm diameter bars at not more than 450 mm intervals, one on inner and one on outer face, properly tied to vertical steel at jambs, corners or junction of walls, where used.

**8.3.6** The use of arches to span over the openings is a source of weakness and shall be avoided. Otherwise, steel ties should be provided.

**Table 4 Size and Position of Openings in Bearing Walls**  
(Clause 8.3.1)

Sl No.	Position of Opening	Details of Opening for Building Category		
		B	C	D and E
(1)	(2)	(3)	(4)	(5)
i)	Distance $b_5$ from the inside corner of outside wall, Min	0	230	450
ii)	For total length of openings, the ratio $(b_1 + b_2 + b_3)/l_1$ or $(b_6 + b_7)/l_2$ shall not exceed:			
a)	one-storeyed building	0.60	0.55	0.50
b)	two-storeyed building	0.50	0.46	0.42
c)	3 or 4 storeyed building	0.42	0.37	0.33
iii)	Pier width between consecutive openings $b_4$ , Min, in mm	340	450	560
iv)	Vertical distance between two openings one above the other $h_3$ , Min, in mm	600	600	600
v)	Width of opening of ventilator $b_8$ , Max, in mm	900	900	900

NOTE — Four storeys building not allowed in Category E.

#### 8.4 Seismic Strengthening Arrangements

**8.4.1** All masonry buildings shall be strengthened by the methods, as specified for various categories of

buildings, as listed in Table 5, and detailed in subsequent clauses. Figures 9 and 10 show, schematically, the overall strengthening arrangements to be adopted for category D and E buildings which consist of horizontal bands of reinforcement at critical levels, vertical reinforcing bars at corners, junctions of walls and jambs of openings.

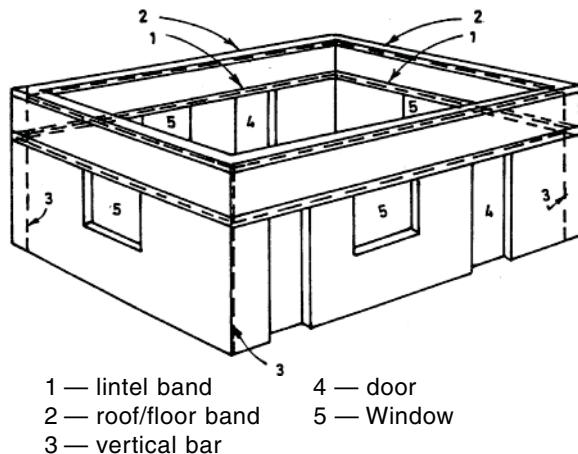


FIG. 9 OVERALL ARRANGEMENT OF REINFORCING LOW STRENGTH MASONRY BUILDINGS

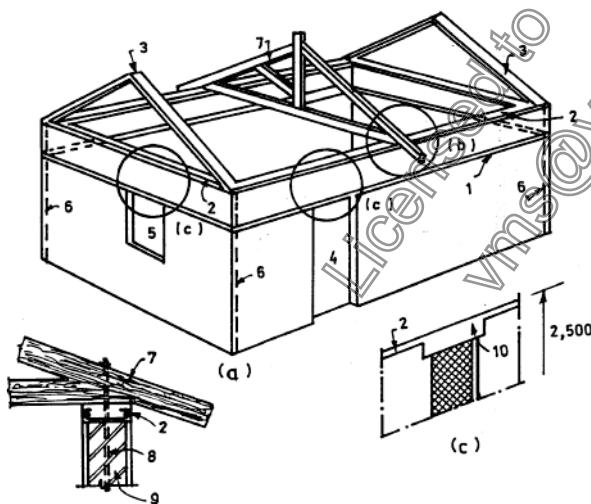


FIG. 10 OVERALL ARRANGEMENT OF REINFORCING LOW STRENGTH MASONRY BUILDING HAVING PITCHED ROOF

**8.4.2** Lintel band is a band (*see 3.6*) provided at lintel level on all load bearing internal, external longitudinal

and cross walls. The specifications of the band are given in **8.4.5**.

NOTE — Lintel band, if provided in panel or partition walls also shall improve their stability during severe earthquake.

**8.4.3** Roof band is a band (*see 3.6*) provided immediately below the roof or floors. The specifications of the band are given in **8.4.5**. Such a band need not be provided underneath reinforced concrete or brick-work slabs resting on bearing walls, provided that the slabs are continuous over the intermediate wall up to the crumple sections, if any, and cover the width of end walls, fully or at least  $\frac{3}{4}$  of the wall thickness.

**Table 5 Strengthening Arrangements Recommended for Masonry Buildings (Rectangular Masonry Units) (Clause 8.4.1)**

Sl No.	Building Category	Number of Storeys	Strengthening to be Provided in All Storeys
(1)	(2)	(3)	(4)
i)	B	a) 1 to 3 b) 4	a, b, c, f, g a, b, c, d, f, g
ii)	C	a) 1 and 2 b) 3 and 4	a, b, c, f, g a to g
iii)	D	a) 1 and 2 b) 3 and 4	a to g a to h
iv)	E	1 to 3 <sup>1)</sup>	a to h

a = masonry mortar (*see 8.1.2*);

b = lintel band (*see 8.4.2*);

c = roof band and gable band where necessary (*see 8.4.3* and *8.4.4*);

d = vertical steel at corners and junctions of walls (*see 8.4.8*);

e = vertical steel at jambs of openings (*see 8.4.9*);

f = bracing in plan at tie level of roofs (*see 5.4.2.2*);

g = plinth band where necessary (*see 8.4.6*); and

h = dowel bars (*see 8.4.7*).

NOTE — In case of four storey buildings of category B, the requirements of vertical steel may be checked through a seismic analysis using a design seismic co-efficient equal to four times the one given in IS 1893 (Part 1). (This is because the brittle behaviour of masonry in the absence of a vertical steel results in much higher effective seismic force than that envisaged in the seismic coefficient, provided in the code.) If this analysis shows that vertical steel is not required the designer may take the decision accordingly.

<sup>1)</sup> 4th storey not allowed in category E.

**8.4.4** Gable band is a band provided at the top of gable masonry below the purlins. The specifications of the band are given in **8.4.5**. This band shall be made continuous with the roof band at the eaves level.

#### 8.4.5 Section and Reinforcement of Band

The band shall be made of reinforced concrete of grade not leaner than M15 or reinforced brickwork in cement mortar not leaner than 1 : 3. The bands shall be of the full width of the wall not less than 75 mm in depth and reinforced with steel, as indicated in Table 6.

NOTE — In coastal areas, the concrete grade shall be M20 concrete and the filling mortar of 1 : 3 (cement-sand with water proofing admixture).

**8.4.5.1** In case of reinforced brickwork, the thickness of joints containing steel bars shall be increased so as to have a minimum mortar cover of 10 mm around the bar. In bands of reinforced brickwork the area of steel provided should be equal to that specified above for reinforced concrete bands.

**8.4.5.2** For full integrity of walls at corners and junctions of walls and effective horizontal bending resistance of bands continuity of reinforcement is essential. The details as shown in Fig. 11 are recommended.

**8.4.6** Plinths band is a band provided at plinth level of walls on top of the foundation wall. This is to be provided where strip footings of masonry (other than reinforced concrete or reinforced masonry) are used and the soil is either soft or uneven in its properties, as frequently happens in hill tracts. Where used, its section may be kept same as in **8.4.5**. This band shall serve as damp proof course as well.

**8.4.7** In category D and E buildings, to further enhance the box action of walls, steel dowel bars may be used at corners and T-junctions of walls at the sill level of windows to length of 900 mm from the inside corner in each wall. Such dowel may be in the form of U stirrups 8 mm diameter. Where used, such bars must be laid in 1 : 3 cement-sand-mortar with a minimum clear cover of 10 mm on all sides to minimize corrosion.

**Table 6 Recommended Longitudinal Steel in Reinforced Concrete Bands**  
(Clause 8.4.5)

Sl No.	Span (1) m	Building Category B		Building Category C		Building Category D		Building Category E			
		No. of Bars (2)		Dia (3) mm		No. of Bars (5)		Dia (6) mm		No. of Bars (7)	
		No. of Bars (3)	Dia (4) mm	No. of Bars (5)	Dia (6) mm	No. of Bars (7)	Dia (8) mm	No. of Bars (9)	Dia (10) mm		
i)	5 or less	2	8	2	8	2	8	2	10		
ii)	6	2	8	2	8	2	10	2	12		
iii)	7	2	8	2	10	2	12	4	10		
iv)	8	2	10	2	12	4	10	4	12		

#### NOTES

1 Span of wall shall be the distance between centre lines of its cross walls or buttresses. For spans greater than 8 m it shall be desirable to insert pilasters or buttresses to reduce the span or special calculation shall be made to determine the strength of wall and section of band.


2 The number and diameter of bars given above pertain to high strength deformed bars.

3 Width of R.C. band is assumed same as the thickness of the wall. Wall thickness shall be 200 mm minimum. A clear cover of 20 mm from face of wall shall be maintained.

4 The vertical thickness of R.C. Band be kept 75 mm minimum, where two longitudinal bars are specified, one on each face; and 150 mm, where four bars are specified.

5 Concrete mix shall be of grade M 20 of IS 456 of 1 : 1½ : 3 by volume.

The longitudinal steel bars shall be held in position by steel links or stirrups 6 mm diameter spaced at 150 mm apart.

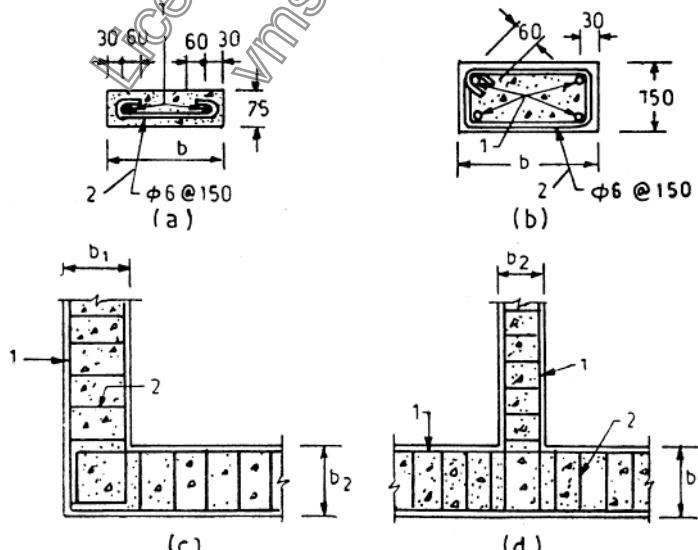

- 1 — longitudinal bars
- 2 — lateral ties
- $b_1, b_2$  — wall thickness

- a) Section of band with two bars
- b) Section of band with four bars
- c) Structural plan at corner junction
- d) Section plan at T-junction of walls

All dimensions in millimetres.

FIG. 11 REINFORCEMENT AND BENDING DETAIL IN R. C. BAND

#### 8.4.8 Vertical Reinforcement

Vertical steel at corners and junctions of walls, which are up to 340 mm (1½ brick) thick, shall be provided as specified in Table 7. For walls thicker than 340 mm the area of the bars shall be proportionately increased. For earthquake resistant framed wall construction, see 8.5.

**Table 7 Vertical Steel Reinforcement in Masonry Walls with Rectangular Masonry Units**

Sl No. No. of Storeys	Storey No.	Diameter of H.S.D Single Bar at Each Critical Section, mm				
			Category B (4)	Category C (5)	Category D (6)	Category E (7)
(1)	(2)	(3)				
i)	One	-	Nil	Nil	10	12
ii)	Two	a) Top b) Bottom	Nil	Nil	10 12	12 16
iii)	Three	a) Top b) Middle c) Bottom	Nil	10 10	10 12	12 16
iv)	Four	a) Top b) Third c) Second d) Bottom	10 10 10 12	10 10 12 12	10 12 16 20	Four storied building not permitted

NOTES

- 1 The diameters given above are for H.S.D. bars.
- 2 The vertical bars shall be covered with concrete M 20 or mortar 1:3 grade in suitably created pockets around the bars (see Fig. 12). This shall ensure their safety from corrosion and good bond with masonry.
- 3 In case of floors/roofs with small Precast components, see also 9.2.3 for floor/roof band details.

**8.4.8.1** The vertical reinforcement shall be properly embedded in the plinth masonry of foundations and roof slab or roof band so as to develop its tensile strength in bond. It shall be passing through the lintel bands and floor slabs or floor level bands in all storeys.

Bars in different storeys may be welded (see IS 2751 and IS 9417, as relevant) or suitably lapped.

NOTE — Typical details of providing vertical steel in brickwork masonry with rectangular solid units at corners and T-junctions are shown in Fig. 12.

**8.4.9** Vertical reinforcement at jambs of window and door openings shall be provided as per Table 7. It may start from foundation of floor and terminate in lintel band (see Fig. 8).

#### 8.5 Framing of Thin Load Bearing Walls (see Fig. 13)

Load bearing walls can be made thinner than 200 mm say 150 mm inclusive of plastering on both sides. Reinforced concrete framing columns and collar beams shall be necessary to be constructed to have full bond with the walls. Columns are to be located at all corners and junctions of walls and spaced not more than 1.5 m apart but so located as to frame up the doors and windows. The horizontal bands or ring beams are

located at all floors roof as well as lintel levels of the openings. The sequence of construction between walls and columns shall be first to build the wall up to 4 to 6 courses height leaving toothed gaps (tooth projection being about 40 mm only) for the columns and second to pour M 20 (1 : 1½ : 3) concrete to fill the columns against the walls using wood forms only on two sides. The columns steel should be accurately held in position all along. The band concrete should be cast on the wall masonry directly so as to develop full bond with it.

Such construction may be limited to only two storeys maximum in view of its vertical load carrying capacity. The horizontal length of walls between cross walls shall be restricted to 7 m and the storey height to 3 m.

#### 8.6 Reinforcing Details for Hollow Block Masonry

The following details may be followed in placing the horizontal and vertical steel in hollow block masonry using cement-sand or cement-concrete blocks.

##### 8.6.1 Horizontal Band

U-shaped blocks may be used for construction of horizontal bends at various levels of the storeys as shown in Fig. 14, where the amount of horizontal reinforcement shall be taken 25 percent more than that given in Table 6 and provided by using four bars and 6 mm diameter stirrups. Other continuity details shall be followed, as shown in Fig. 11.

##### 8.6.2 Vertical Reinforcement

Bars, as specified in Table 7 shall be located inside the cavities of the hollow blocks, one bar in each cavity (see Fig. 15). Where more than one bar is planned these can be located in two or three consecutive cavities. The cavities containing bars are to be filled by using micro-concrete 1 : 2 : 3 or cement coarse sand mortar 1 : 3, and properly rodded for compaction. The vertical bars should be spliced by welding or overlapping for developing full tensile strength. For proper bonding, the overlapped bars should be tied together by winding the binding wire over the lapped length. To reduce the number of overlaps, the blocks may be made U-shaped as shown in Fig. 15 which shall avoid lifting and threading of bars into the hollows.


### 9 FLOORS/ROOFS WITH SMALL PRECAST COMPONENTS

#### 9.1 Types of Precast Floors/Roofs

Earthquake resistance measures for floors and roofs with small precast components, as covered in this standard, have been dealt with as typical examples.

##### 9.1.1 Precast Reinforced Concrete Unit Roof/Floor

The unit is a precast reinforced concrete component, channel (inverted trough) shaped in section

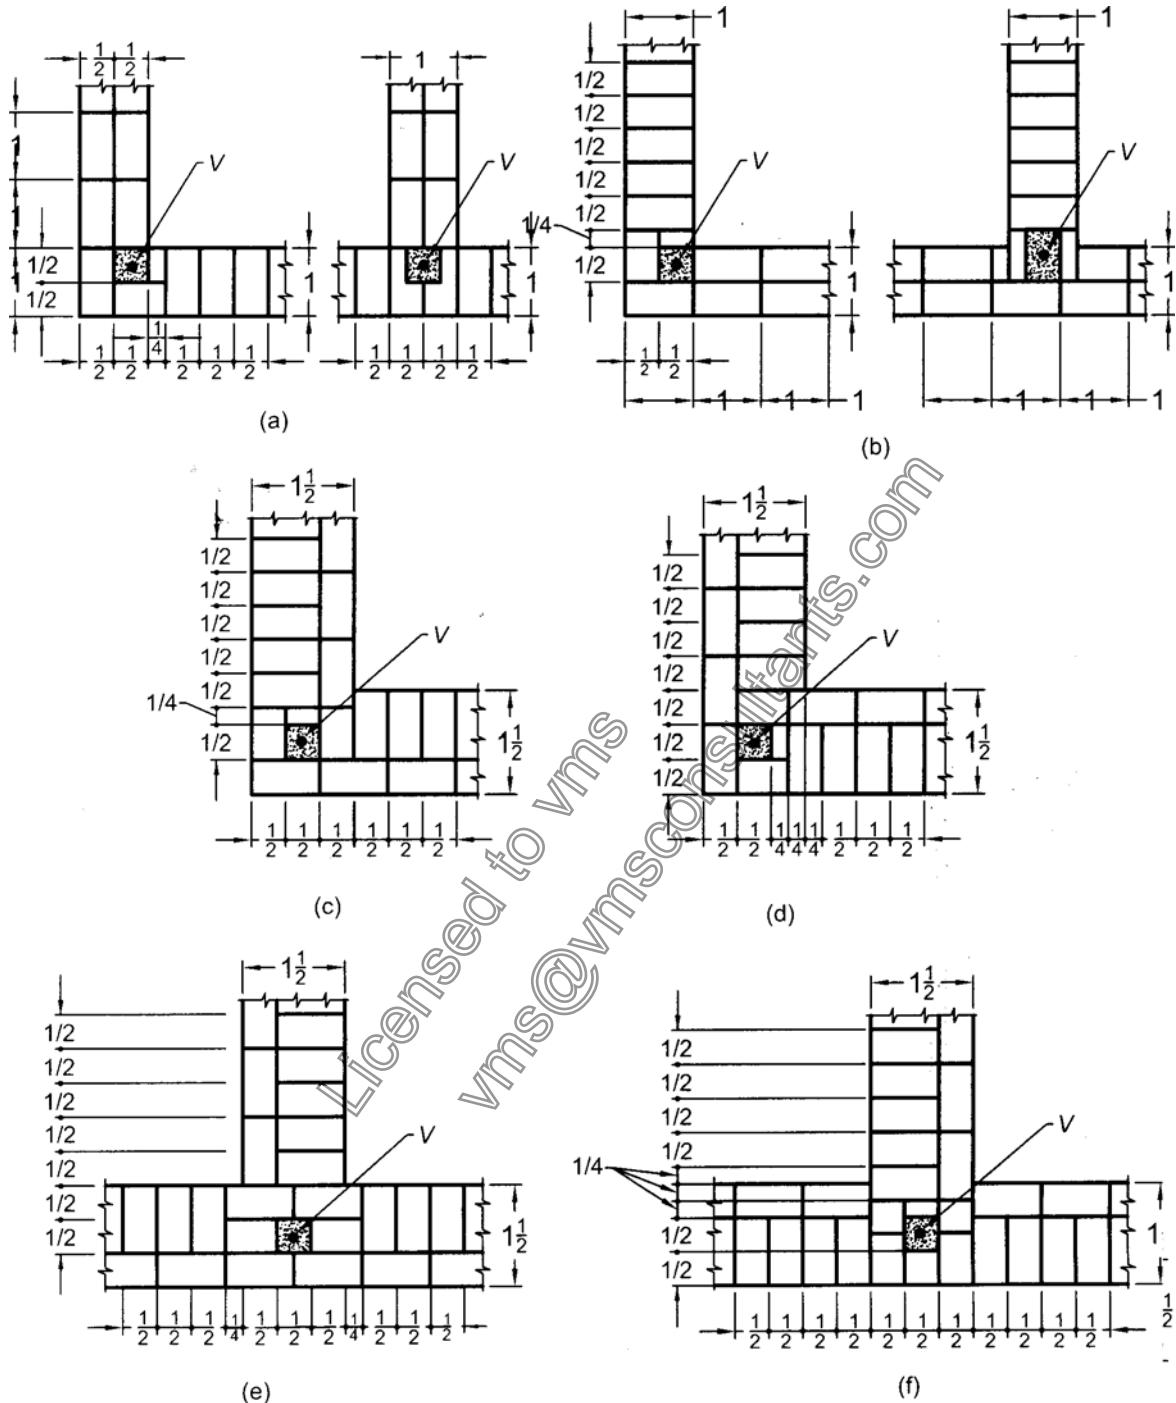


1— one-brick length,  $\frac{1}{2}$  — half - brick length, v — vertical steel bar with mortar/concrete filling in pocket

(a) and (b) — alternate courses in one brick

(c) and (d) — alternate courses at corner junction of  $1\frac{1}{2}$  - brick wall

(e) and (f) — alternate courses at T-junction of  $1\frac{1}{2}$  - brick wall

FIG. 12 TYPICAL DETAILS OF PROVIDING VERTICAL STEEL BARS IN BRICK MASONRY

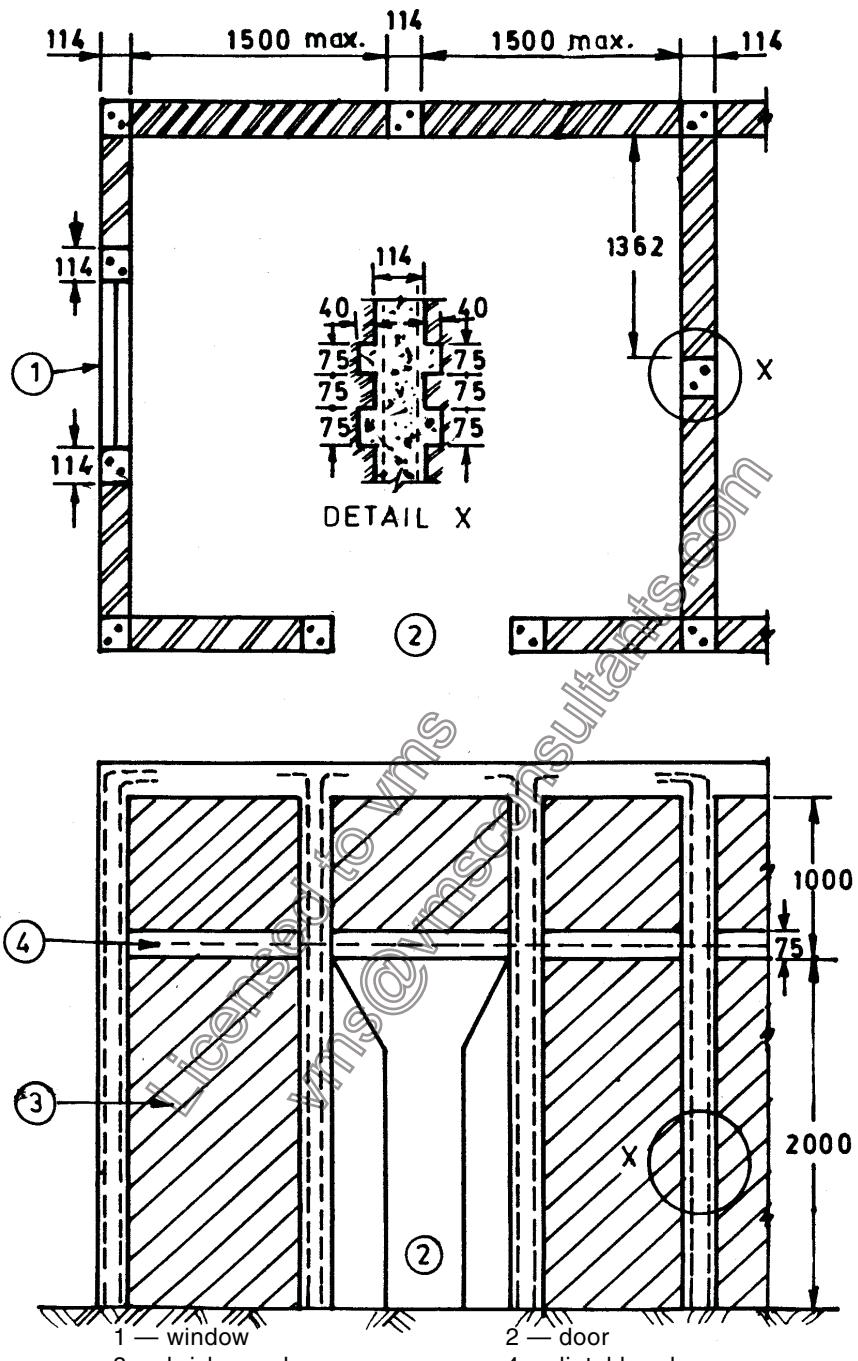

All dimensions in millimetres.

FIG. 13 FRAMING OF THIN LOAD-BEARING BRICK WALLS

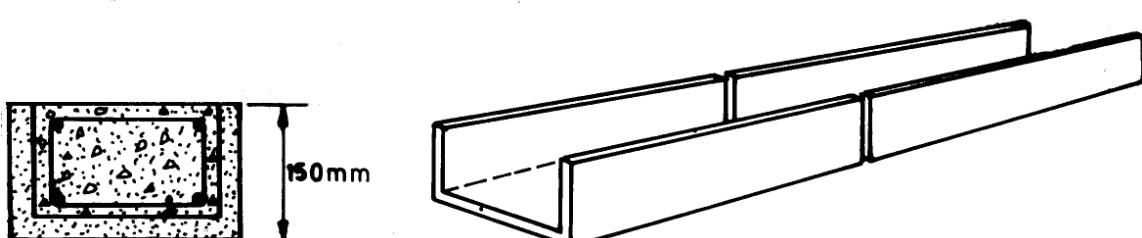


FIG. 14 U-BLOCKS FOR HORIZONTAL BANDS

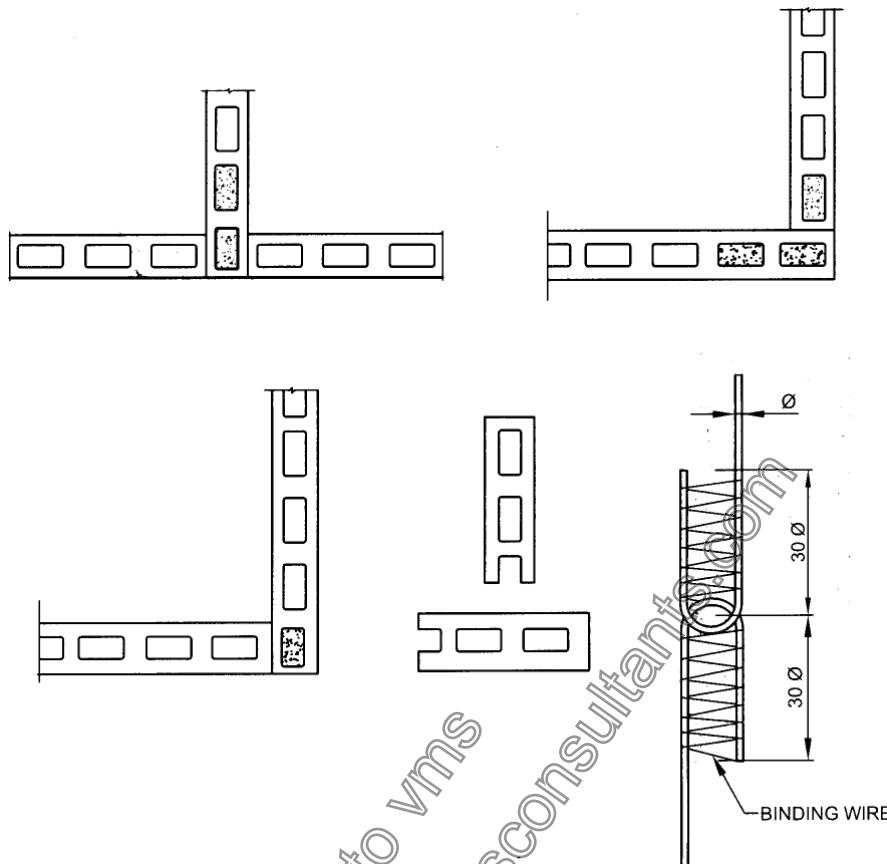


FIG. 15 VERTICAL REINFORCEMENT IN CAVITIES

(see Fig. 16). The nominal width of the unit varies from 300 to 600 mm, its height from 150 to 200 mm and a minimum flange thickness of 30 mm. Length of unit shall vary according to room dimensions, but the maximum length is restricted to 4.2 m from stiffness considerations. Horizontal corrugations are provided on the two longitudinal faces of the units so that the structural roof/floor acts monolithic after concrete grouted in the joints between the units attains strength (see Fig. 17).

#### **9.1.2 Precast Reinforced Concrete Cored Unit Roof/Floor**



The unit is a reinforced concrete component having a nominal width of 300 to 600 mm and thickness of 130 to 150 mm having two circular hollows 90 mm diameter, throughout the length of the unit (see Fig. 18). The minimum flange/web thickness of the unit shall be 20 mm. Length of unit varies according to room dimensions, but the maximum length shall be restricted to 4.2 m from stiffness considerations. Horizontal corrugations are provided on the two longitudinal faces of the units so that the structural roof/floor acts monolithic after concrete grouted in the joints between the units attains strength (see Fig. 19).

#### **9.1.3 Precast Reinforced Concrete Plank and Joist Scheme for Roof/Floor**

The scheme consists of precast reinforced concrete planks supported on partially precast reinforced concrete joists. The reinforced concrete planks are 300 mm wide and the length varies according to the spacing of the joists, but it shall not exceed 1.5 m (see Fig. 20). To provide monolithicity to the roof/floor and to have T-beam effect with the joists, the planks shall be made partially 30 mm thick and the partially 60 mm thick and *in-situ* concrete shall be filled in the depressed portions to complete the roof/floor structurally (see Fig. 21).

#### **9.1.4 Prefabricated Brick Panel System for Roof/Floor**

It consists of prefabricated reinforced brick panels (see Fig. 22) supported on precast reinforced concrete joists with nominal reinforced 35 mm thick structural deck concrete over the brick panels and joists (see Fig. 23). The width of the brick panels shall be 530 mm for panels made of bricks of conventional size and 450 mm for panels made of bricks of modular size. The thickness of the panels shall be 75 mm or 90 mm respectively depending upon whether conventional or modular bricks are used. The length of the panels shall

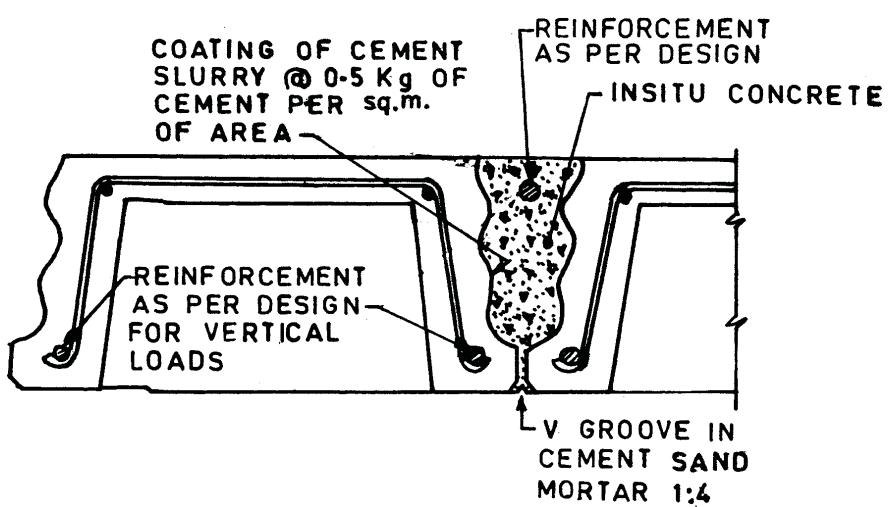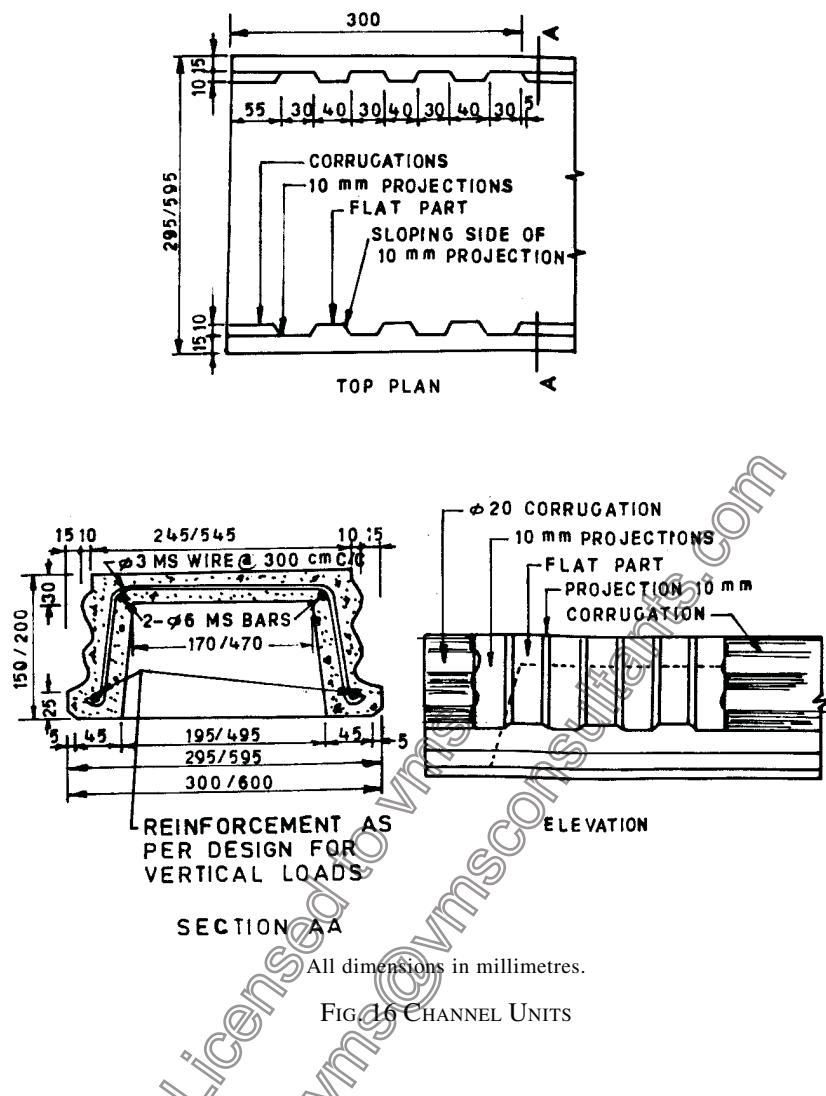

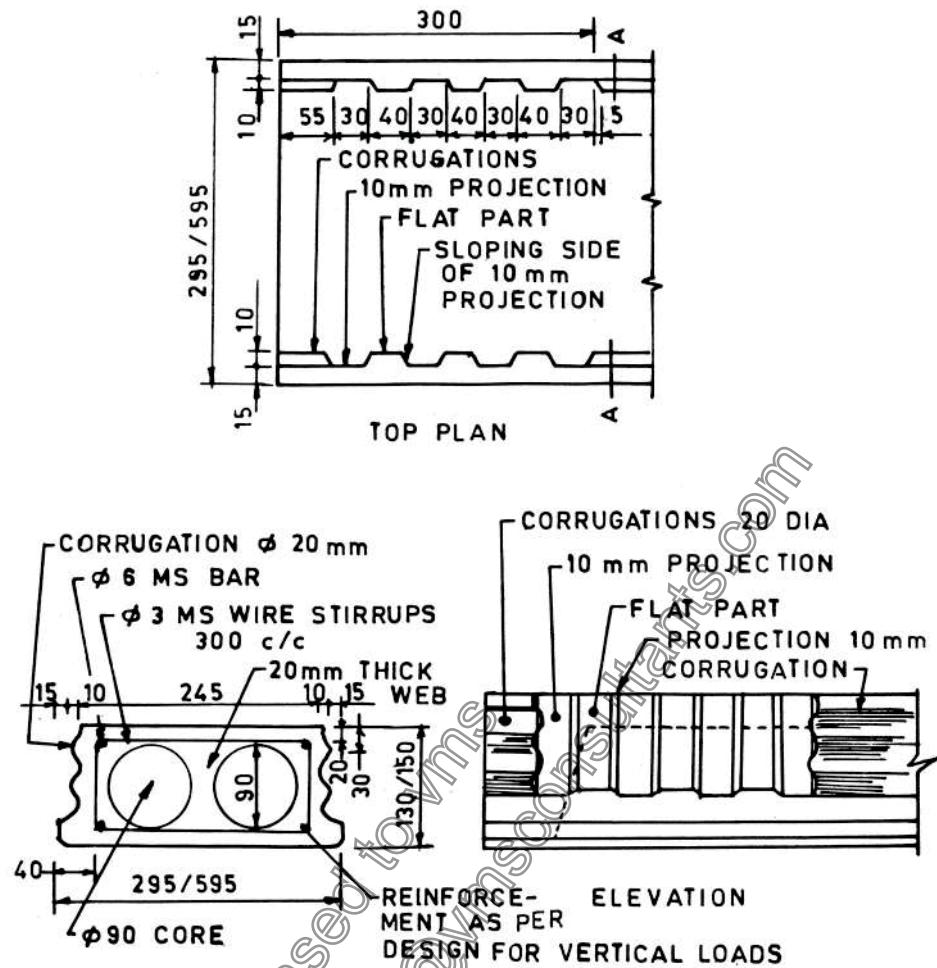


FIG. 18 CORE UNITS



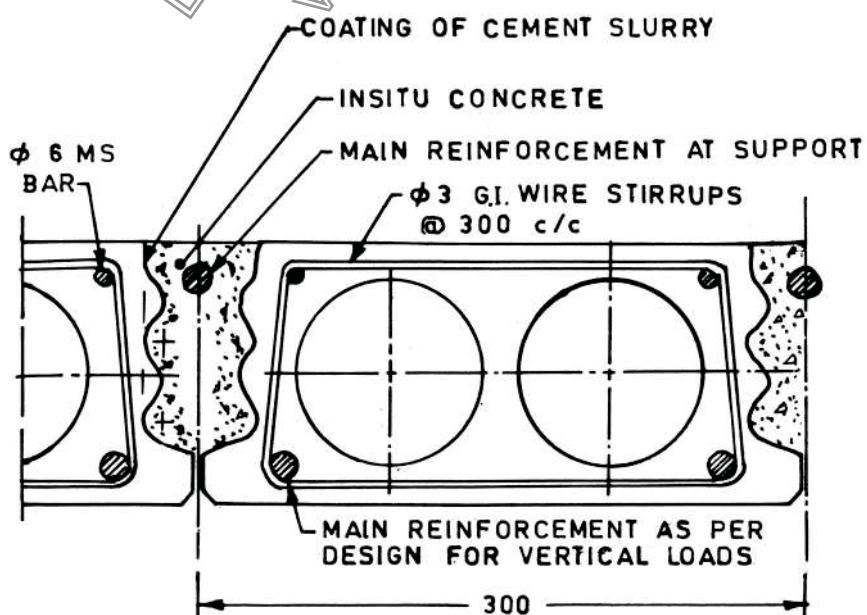


FIG. 19 CORED, UNIT FLOOR

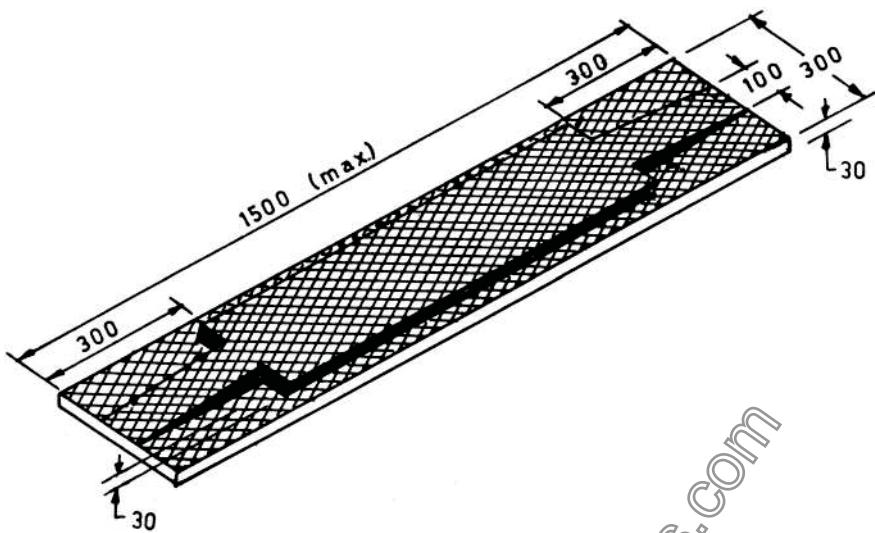

All dimensions in millimetres.

FIG. 20 PRECAST REINFORCED CONCRETE PLANK

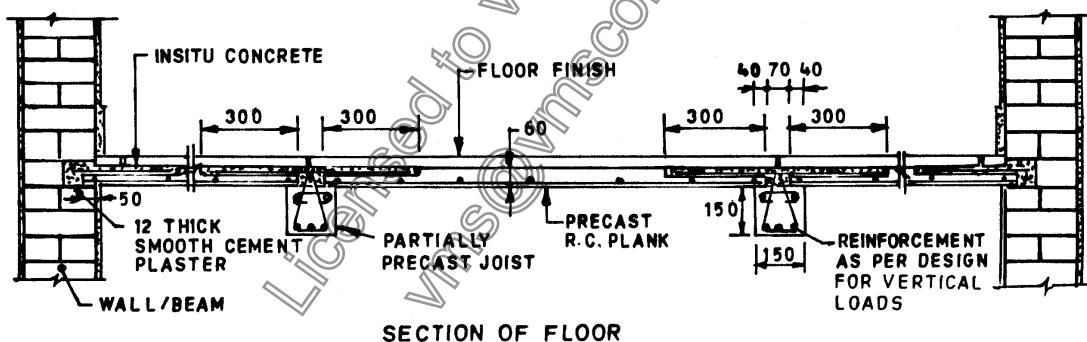

SECTION OF FLOOR

All dimensions in millimetres.

FIG. 21 PRECAST REINFORCED CONCRETE PLANK FLOOR

vary depending upon the spacing of the joists, but the maximum length shall not exceed 1.2 m.


#### **9.1.5 Precast Reinforced Concrete Waffle Unit Roof/Floor**

Waffle units are of the shape of inverted troughs, square or rectangular in plan, having lateral dimensions up to 1.2 m and depth depending upon the span of the roof/floor to be covered (see Fig. 24 and Fig. 25). The minimum thickness of flange/web shall be 35 mm. Horizontal projections may be provided on all the four external faces of the unit and the unit shall be so shaped that it shall act monolithic with *in-situ* concrete to ensure load transfer. Vertical castellations, called shear

keys, shall be provided on all the four external faces of the precast units to enable them to transfer horizontal shear force from one unit to adjacent unit through *in-situ* concrete filled in the joints between the units. The waffle units shall be laid in a grid pattern with gaps between two adjacent units, and reinforcement, as per design, and structural concrete shall be provided in the gaps between the units in both the directions. The scheme is suitable for two way spanning roofs and floors of buildings having large spans.


#### **9.2 Seismic Resistance Measures**

**9.2.1** All floors and roofs to be constructed with small precast components shall be strengthened as

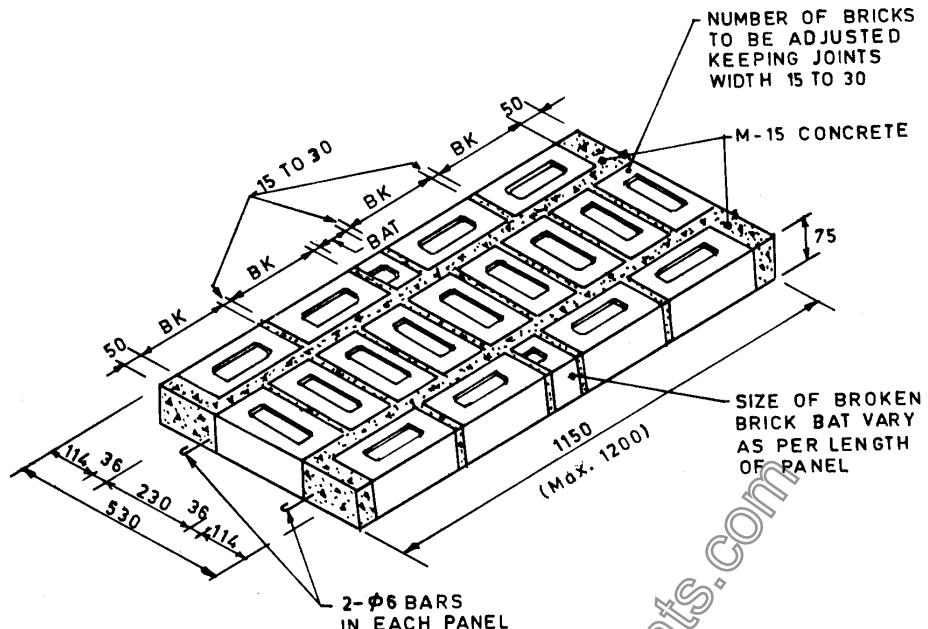

All dimensions in millimetres.

FIG. 22 PREFAB BRICK PANEL

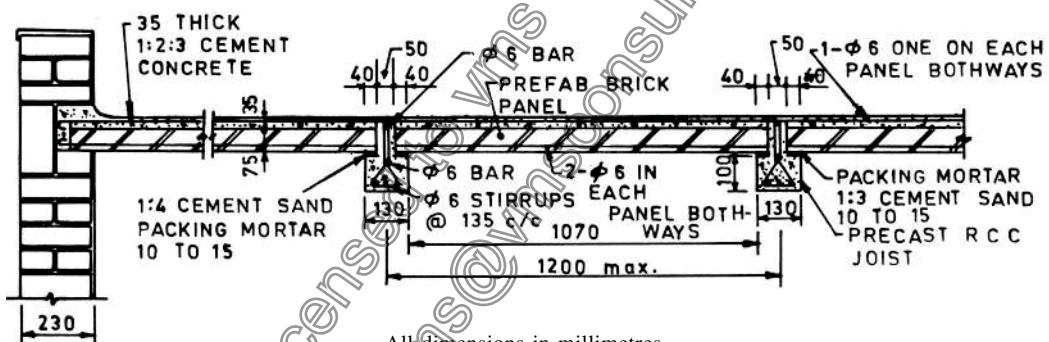

All dimensions in millimetres.

FIG. 23 BRICK PANEL FLOOR

specified for various categories of buildings in Table 8. The strengthening measures are detailed in 9.2.3 and 9.2.8.

**9.2.2** Vertical castellations, called shear keys, shall be provided on the longitudinal faces of the channel, cored and waffle units to enable them to transfer horizontal shear force from one unit to the adjacent unit through the *in-situ* concrete filled in the joints between the units. The minimum percentage of area of shear keys as calculated below, on each face of the unit, shall be 15.

Shear keys shall have a minimum width of 40 mm at its root with the body of the component and shall be to the full height of the component and preferably at uniform spacing. Percentage of area of shear keys shall be calculated as:

$$\frac{\text{No. of shear keys on one face}}{\text{Length of the face of the component, in mm}} \times 100 = 40$$



**Table 8 Strengthening Measures for Floors/Roofs with Small Precast Components**

(Clause 9.2.1)

Sl No.	Building Category	Number of Storeys	Strengthening to be Provided in Floor/Roof with			
			Channel/ Cored Unit	R.C. Planks and Joists	Brick Panels and Joists	Waffle Units
(1)	(2)	(3)	(4)	(5)	(6)	(7)
i)	B	1 to 3	a	a	a	a
		4	a, c	a, c	a, d	a
ii)	C	1 and 2	a, b	a	a	a
		3 and 4	a, b, c	a, c	a, d	a, e
iii)	D	1 - 4	a, b, c	a, c	a, d	a, c, e
iv)	E	1 - 3	a, b, c	a, c	a, d	a, c, e


NOTE:

- a — tie beam as per 9.2.3;
- b — reinforcing bars of precast unit and tied to tie beam reinforcement as per 9.2.4;
- c — reinforced deck concrete as per 9.2.5;
- d — reinforced deck concrete as per 9.2.6; and
- e — reinforced bars in joint between precast waffle units tied to tie beam reinforcement as per 9.2.7.

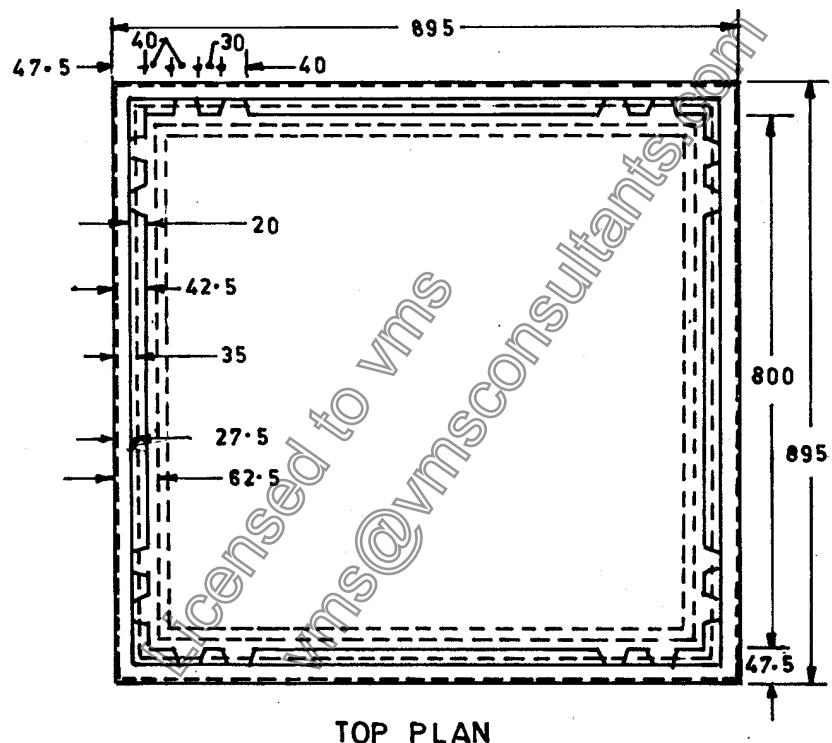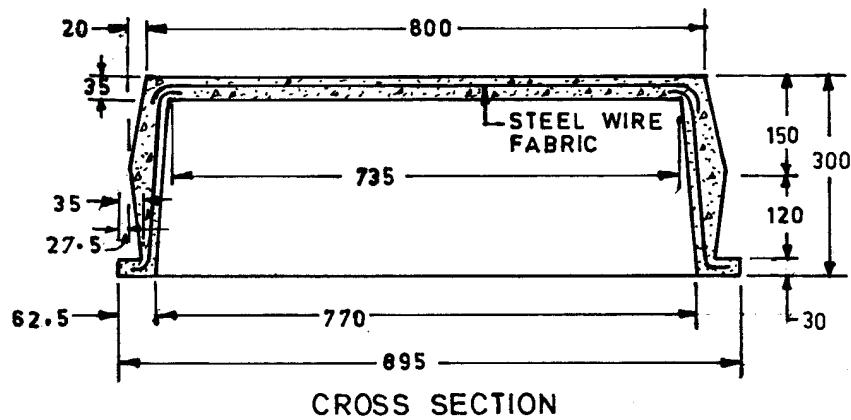

All dimensions in millimetres.

FIG. 24 WAFFLE UNITS

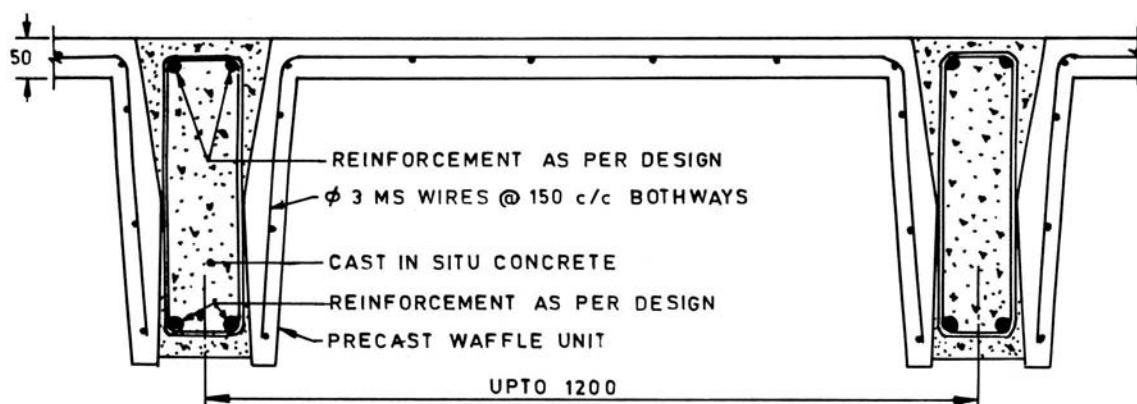

All dimensions in millimetres.

FIG. 25 WAFFLE UNIT FLOOR

**9.2.3** Tie beam (*see Table 8*) is a beam provided all round the floor or roof to bind together all the precast components to make it a diaphragm. The beams shall be to the full width of the supporting wall or beam less the bearing of the precast components. The depth of the beam shall be equal to the depth of the precast components plus the thickness of structural deck concrete, where used over the components. The beam shall be made of cement concrete of grade not leaner than M15 and shall be reinforced as indicated in Table 6. If depth of tie is more than 75 mm, equivalent reinforcement shall be provided with one bar of minimum diameter 8 mm at each corner. Tie beams shall be provided on all longitudinal and cross walls. Typical details of the beams are shown in Fig. 26 to Fig. 30.

NOTE — Adequate edge support say 60 mm, shall be provided to precast element on the wall so as to avert its slippage during seismic ground motion.

**9.2.4** Top reinforcement in the channel or cored units (*see Table 8*) shall be projected out at both the ends for anchorage length and tied to tie beam reinforcement.

**9.2.5** Structural deck concrete (*see Table 8*) of grade not leaner than M15 shall be provided over precast components or act monolithic. Wherever, deck concrete is to be provided, the top surface of the components shall be finished rough. Cement slurry with 0.5 kg of cement/m<sup>2</sup> of the surface area shall be applied over the components immediately before laying the deck concrete and the concrete shall be compacted using plate vibrators. The minimum thickness of deck concrete shall be 35 mm or 40 mm reinforced with 6 mm diameter bars and 150 mm apart both ways and anchored into the tie beam placed all round. The maximum size of coarse aggregate used in deck concrete shall not exceed 12 mm.

NOTE — Under conditions of economic constraints, the deck concrete itself could serve as floor finish. The concrete is laid in one operation (*see Fig. 30*) without joints.

**9.2.6** The deck concrete normally used over the brick panel with joist floor shall be reinforced with 6 mm diameter bars spaced 150 mm apart both ways (*see Table 8*).

**9.2.7** For floors/roofs with precast waffle units, two 16 mm diameter high strength deformed bars shall be provided as top reinforcement in the joints between waffle units, in addition to reinforcement required for taking bending moment for vertical loads. This reinforcement (*see Table 8*) shall be fixed to tie beam reinforcement.

**9.2.8** In case of floors/roofs with precast components other than those indicated in Table 8, the buildings shall be analyzed for maximum expected seismic forces and the floor/roof shall be designed to act as diaphragm and take care of the resulting forces.

## 10 TIMBER CONSTRUCTION

**10.1** Timber has higher strength per unit weight and is, therefore, very suitable for earthquake resistant construction. Materials, design and construction in timber shall generally conform to IS 883.

**10.2** Timber construction shall generally be restricted to two storeys with or without the attic floor.

**10.3** In timber construction attention shall be paid to fire safety against electric short circuiting, kitchen fire, etc.

**10.4** The superstructure of timber buildings shall be made rigid against deformations by adopting suitable construction details at the junctions of the framing members and in wall panels as given in **10.6** to **10.10** so that the construction as a whole behaves as one unit against earthquake forces.

## 10.5 Foundations

**10.5.1** Timber construction shall preferably start above the plinth level, the portion below shall be in masonry or concrete.


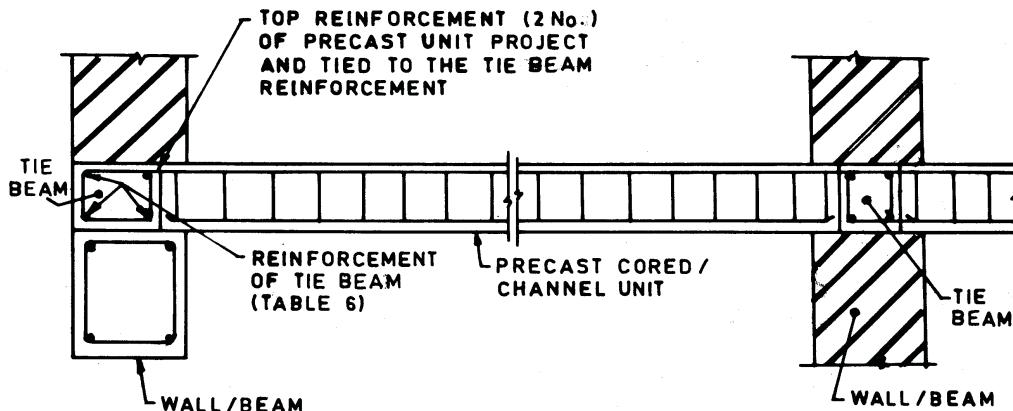


FIG. 26 CONNECTION OF PRECAST CORED/CHANNEL UNIT WITH TIE BEAM

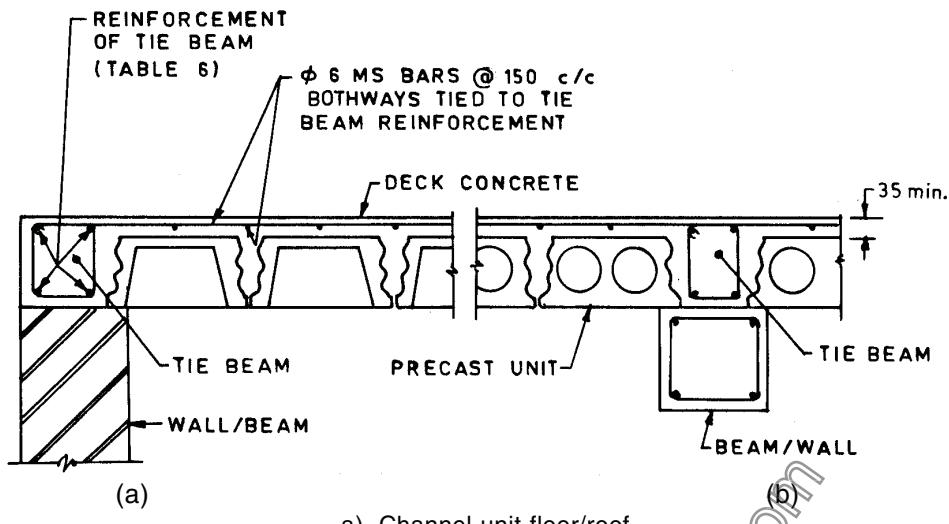


a) Channel unit floor/roof.

b) Cored unit floor/roof.


All dimensions in millimetres.

FIG. 27 CONNECTION OF CHANNEL/CORED UNIT FLOOR/ROOF (WITH DECK CONCRETE) WITH TIE BEAM

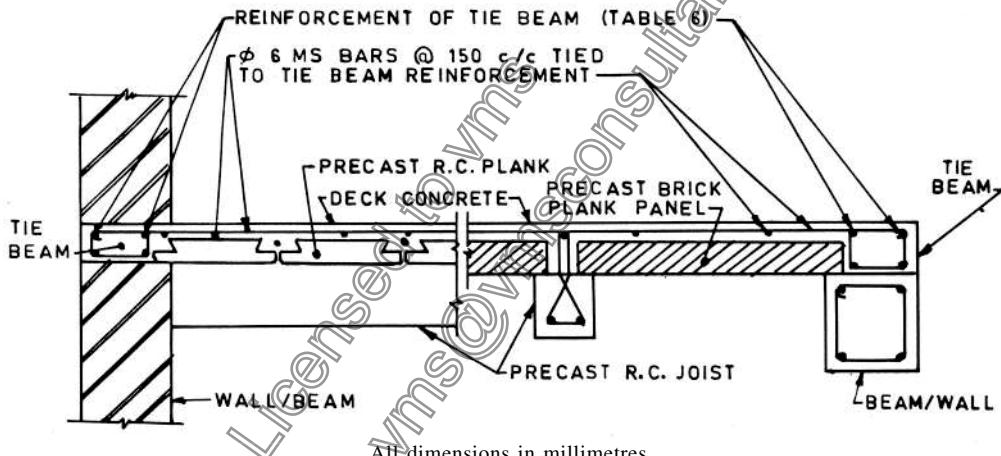

All dimensions in millimetres.

FIG. 28 CONNECTION OF PRECAST REINFORCED CONCRETE PLANK AND PRECAST BRICK PANEL FLOOR/ROOF (WITH DECK CONCRETE) WITH TIE BEAM

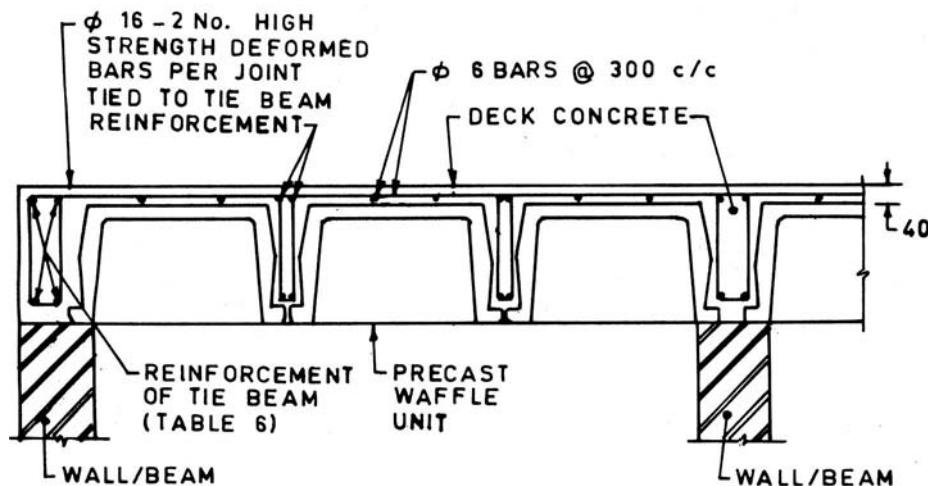

All dimensions in millimetres.

FIG. 29 CONNECTION OF PRECAST WAFFLE UNIT FLOOR/ROOF (WITH DECK CONCRETE) WITH TIE BEAM

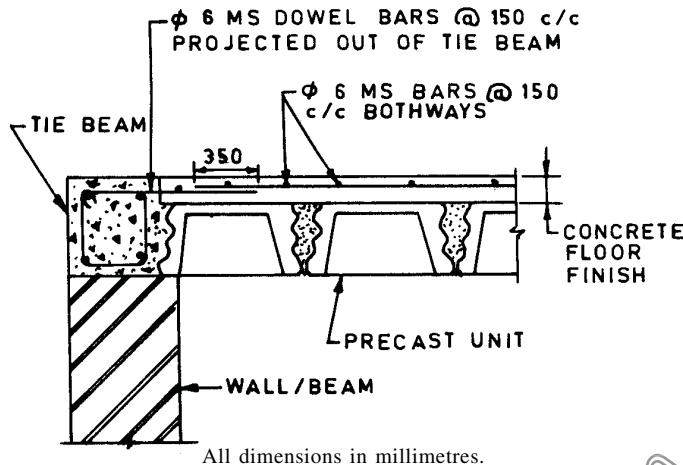


FIG. 30 PROVISION OF REINFORCEMENT IN CONCRETE FLOOR FINISH

**10.5.2** The superstructure may be connected with the foundation in one of the two ways as given in **10.5.2.1** to **10.5.2.2**.

**10.5.2.1** The superstructure may simply rest on the plinth masonry, or in the case of small buildings of one storey having plan area less than about  $50 \text{ m}^2$ , it may rest on firm plane ground so that the building is free to slide laterally during ground motion.

#### NOTES

- 1 Past experience has shown that superstructure of the buildings not fixed with the foundation escaped collapse even in a severe earthquake although they were shifted sideways.
- 2 Where fittings for water supply or water borne sanitation from the house are to be installed, proper attention should be given to permit movement so as to avoid fracture or damage to pipes.

**10.5.2.2** The superstructure may be rigidly fixed into the plinth masonry or concrete foundation as given in Fig. 31 or in case of small building having plan area less than  $50 \text{ m}^2$ , it may be fixed to vertical poles embedded into the ground. In each case the building is

likely to move along with its foundation. Therefore, the superstructure shall be designed to carry the resulting earthquake shears.


## 10.6 Types of Framing

The types of construction usually adopted in timber building are as follows:

- a) Stud wall construction; and
- b) Brick nogged timber frame construction.

## 10.7 Stud Wall Construction

**10.7.1** The stud wall construction consists of timber studs and corner posts framed into sills, top plates and wall plates. Horizontal struts and diagonal braces are used to stiffen the frame against lateral loads. The wall covering may consist of EKRA, timber or like. Typical details of stud walls are shown in Fig. 32. Minimum sizes and spacing of various members used are specified in **10.7.2** to **10.7.10**.

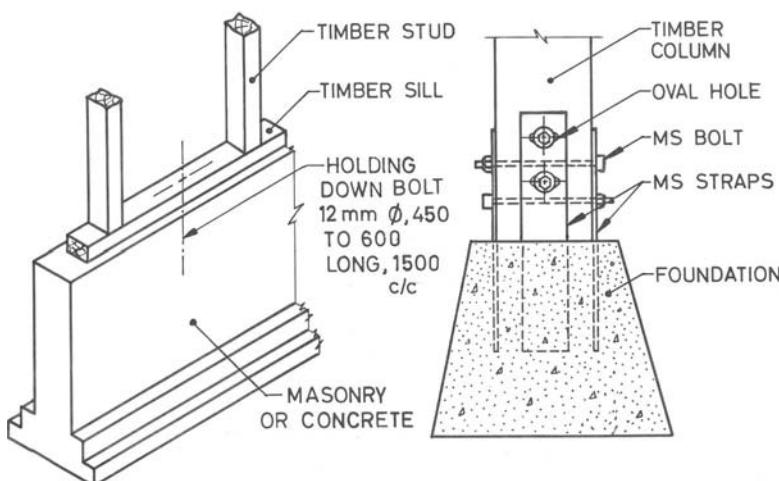

31A Suitable for Strip Foundation

31B Suitable for Isolated Column Footings

All dimensions in millimetres.

FIG. 31 DETAILS OF CONNECTION OF COLUMN WITH FOUNDATION

**10.7.2** The timber studs for use in load bearing walls shall have a minimum finished size of  $40 \times 90$  mm and their spacing shall not exceed those given in Table 9.

**Table 9 Maximum Spacing of  $40 \text{ mm} \times 90 \text{ mm}$  Finished Size Studs in Stud Wall Construction**

Sl No.	Group of Timber [Grade I <sup>1)</sup> ]	Single Storeyed or First Floor of the Double Storeyed Buildings		Ground Floor of Double Storeyed Buildings	
		Exterior Wall cm	Interior Wall cm	Exterior Wall cm	Interior Wall cm
(1)	(2)	(3)	(4)	(5)	(6)
i)	Group A, B	100	80	50	40
ii)	Group C	100	100	50	50

<sup>1)</sup>Grade I timbers as defined in Table 5 of IS 883.

**10.7.3** The timber studs in non-load bearing walls shall not be less than  $40 \times 70$  mm in finished cross-section. Their spacing shall not exceed 1 m.

**10.7.4** There shall be at least one diagonal brace for every  $1.6 \text{ m} \times 1 \text{ m}$  area of load bearing walls. Their minimum finished sizes shall be in accordance with Table 10.

**10.7.5** The horizontal struts shall be spaced not more than 1 m apart. They shall have a minimum size of  $30 \times 40$  mm for all locations.

**10.7.6** The finished sizes of the sill, the wall plate and top plate shall not be less than the size of the studs used in the wall.

**10.7.7** The corner posts shall consist of three timbers, two being equal in size to the studs used in the walls meeting at the corner and the third timber being of a size to fit so as to make a rectangular sections (see Fig. 32).

**10.7.8** The diagonal braces shall be connected at their ends with the stud wall members by means of wire nails having 6 gauge (4.88 mm diameter) and 10 cm length.

Their minimum number shall be 4 nails for  $20 \text{ mm} \times 40 \text{ mm}$  braces and 6 nails for  $30 \text{ mm} \times 40 \text{ mm}$  braces. The far end of nails may be clutched as far as possible.

**10.7.9** Horizontal bracing shall be provided at corners of T-junctions of walls at sill, first floor and eave levels. The bracing members shall have a minimum finished size of  $20 \text{ mm} \times 90 \text{ mm}$  and shall be connected by means of wire nails to the wall plates at a distance between 1.2 m and 1.8 m measured from the junction of the walls. There shall be a minimum number of six nails of 6 gauge (4.88 mm diameter) and 10 cm length with clutching as far ends.

**10.7.10** Unsheathed studding shall not be used adjacent to the wall of another building. The studding must be sheathed with close jointed 20 mm or thicker boards.

## 10.8 Brick Nogged Timber Frame Construction

**10.8.1** The brick nogged timber frame consists of intermediate verticals, columns, sills, wall plates, horizontal nogging members and diagonal braces framed into each other and the space between framing members filled with tight-fitting brick masonry in stretcher bond. Typical details of brick nogged timber frame construction are shown in Fig. 33. Minimum sizes and spacing of various elements used are specified in **10.8.2** to **10.8.9**.

**10.8.2** The vertical framing members in brick nogged load bearing walls shall have minimum finished sizes as specified in Table 10.

**10.8.3** The minimum finished size of the vertical members in non-load bearing walls shall be  $40 \text{ mm} \times 100 \text{ mm}$  spaced not more than 1.5 m apart.


**10.8.4** The sizes of diagonal bracing members shall be the same as in Table 10.

**10.8.5** The horizontal framing members in brick-nogged construction shall be spaced not more than 1 m apart. Their minimum finished sizes shall be in accordance with Table 11 and Table 12.

**Table 10 Minimum Finished Sizes of Diagonal Braces**  
(Clause 10.8.4)

Sl No.	Building Category (see Table 2)	Group of Timber [Grade I <sup>1)</sup> ]	Single Storeyed or First Floor of Double Storeyed Buildings		Ground Floor of Double Storeyed Buildings	
			Exterior Wall mm × mm	Interior Wall mm × mm	Exterior Wall mm × mm	Interior Wall mm × mm
(1)	(2)	(3)	(4)	(5)	(6)	(7)
i)	B, C	All	20 × 40	20 × 40	20 × 40	20 × 40
ii)	D and E	Group A and Group B	20 × 40	20 × 40	20 × 40	30 × 40
iii)	Group C	Group C	20 × 40	30 × 40	30 × 40	30 × 40


<sup>1)</sup>Grade I timber as defined in Table 5 of IS 883.

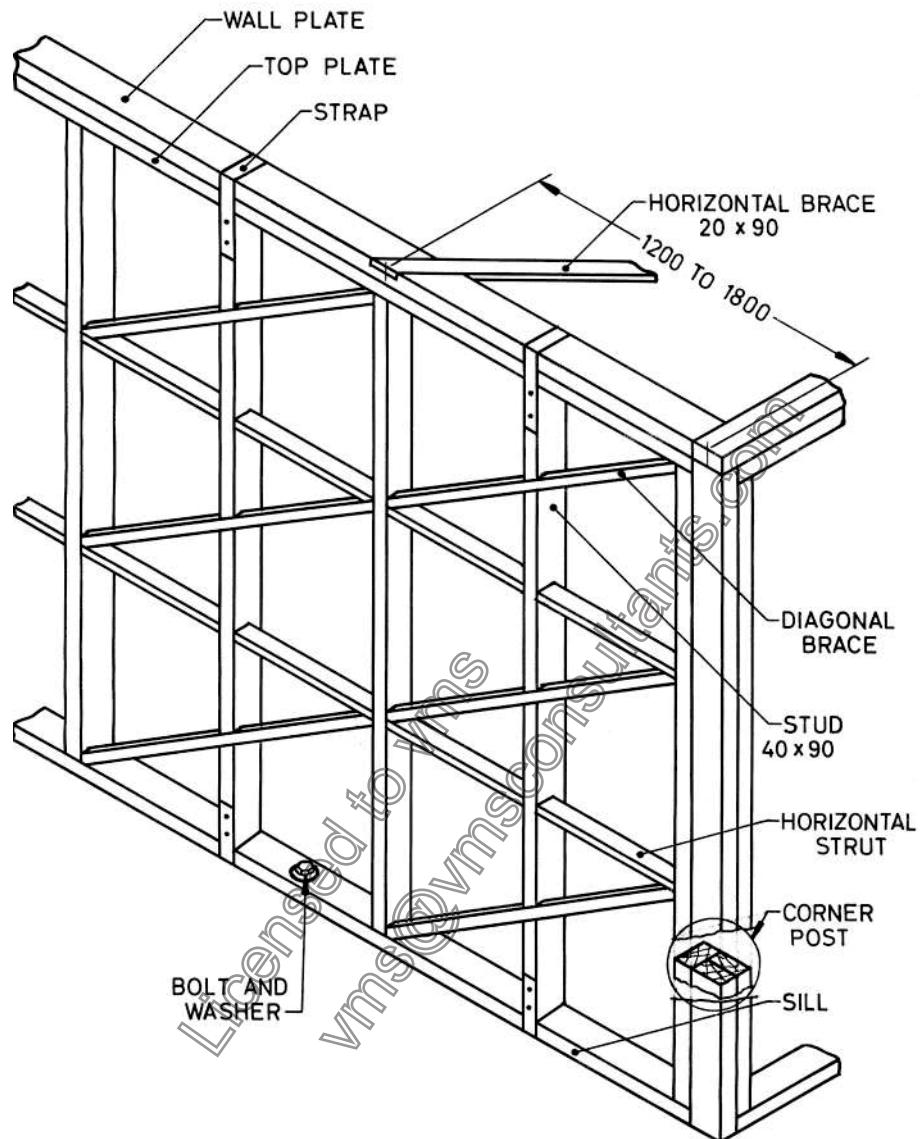

32A Timber Framing in Stud Wall Construction without Opening in Wall

All dimensions in millimetres.


FIG. 32 STUD WALL CONSTRUCTION (*Continued*)

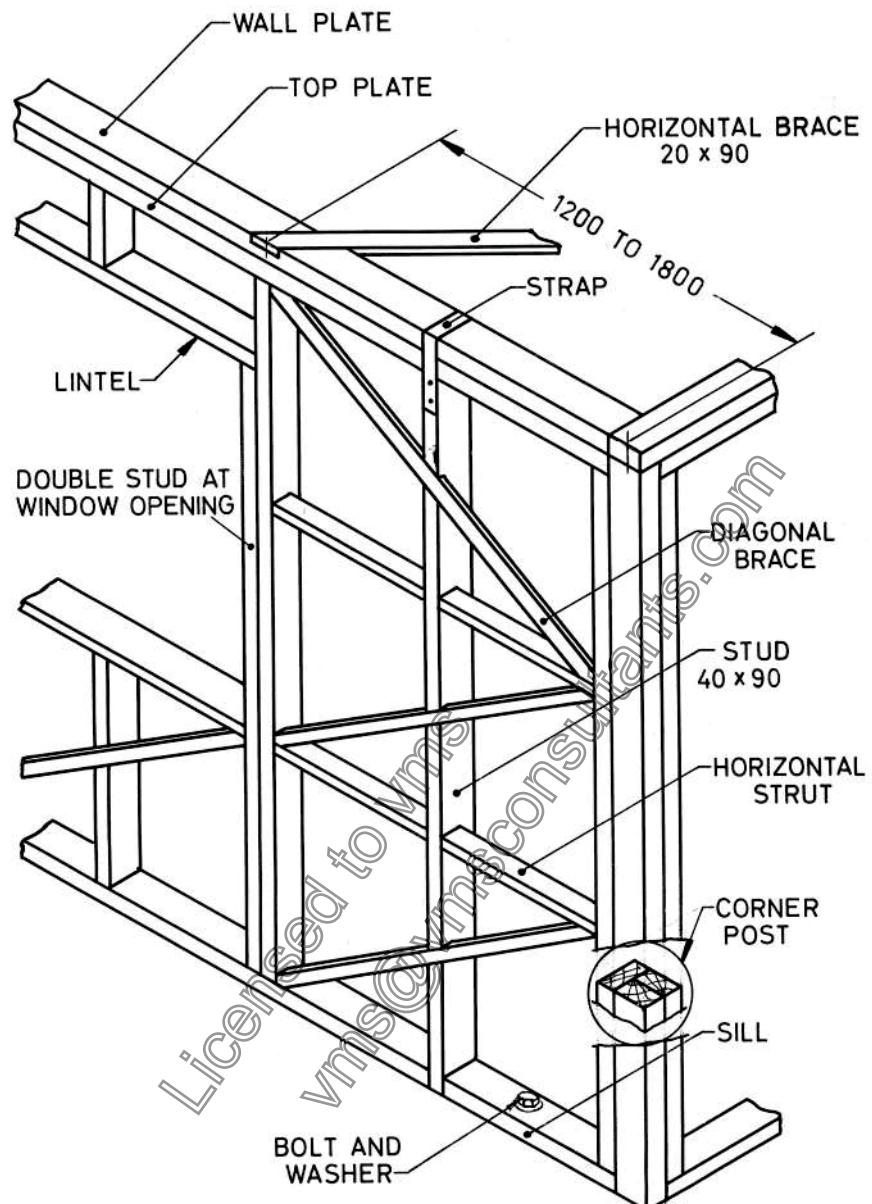

32B Timber Framing in Stud Wall Construction with Opening in Wall

All dimensions in millimetres.

FIG. 32 STUD WALL CONSTRUCTION

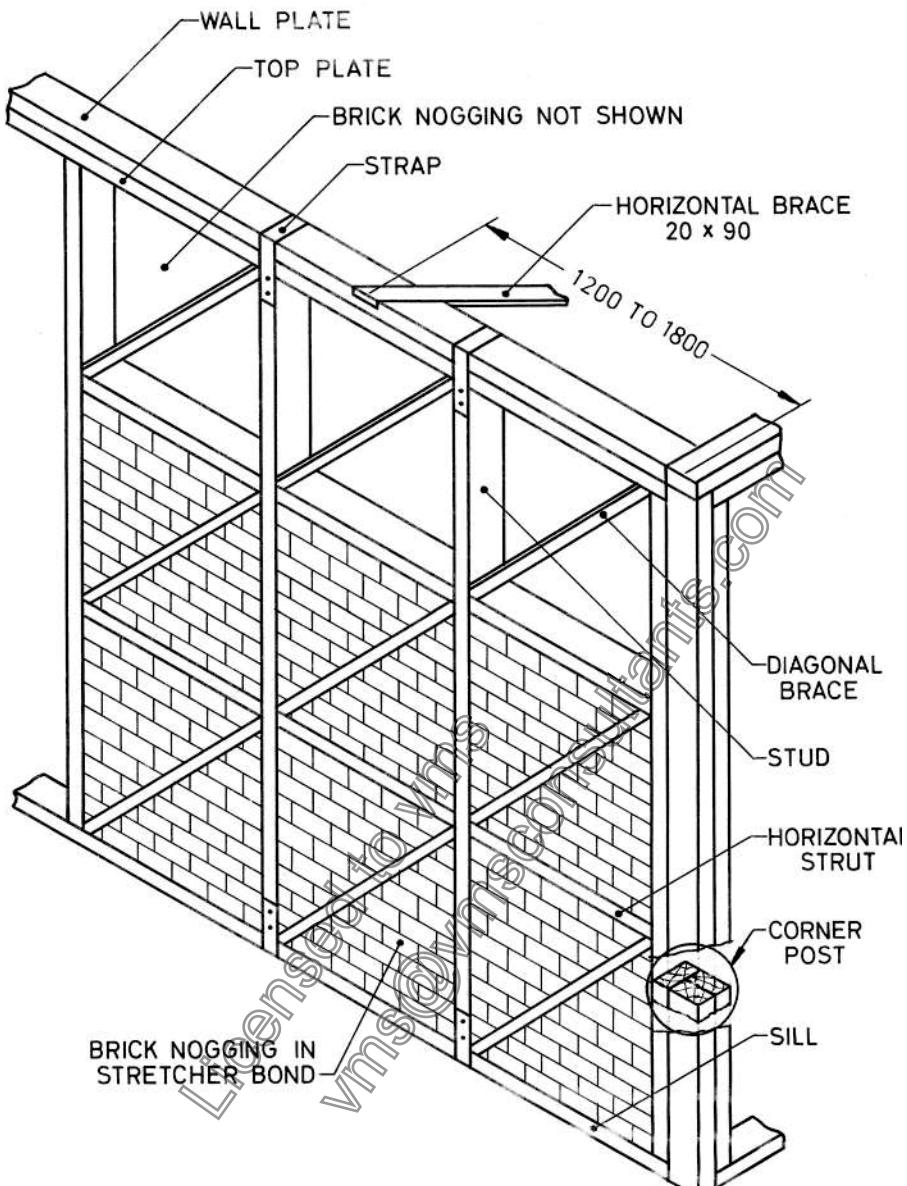

All dimensions in millimetres.

FIG. 33 BRICK NOGGED TIMBER FRAME CONSTRUCTION

**Table 11 Minimum Finished Sizes of Vertical in Brick Nogged Timber Frame Construction**  
(Clause 10.8.5)

Sl No.	Spacing m	Group of Timber [Grade I <sup>1)</sup> ]	Single Storeyed or First Floor of Double Storeyed Buildings		Ground Floor of Double Storeyed Buildings	
			Exterior Wall mm × mm	Interior Wall mm × mm	Exterior Wall mm × mm	Interior Wall mm × mm
(1)	(2)	(3)	(4)	(5)	(6)	(7)
i)	1	Group A, B	50 × 100	50 × 100	50 × 100	50 × 100
		Group C	50 × 100	70 × 100	70 × 100	90 × 100
ii)	1.5	Group A, B	50 × 100	70 × 100	70 × 100	80 × 100
		Group C	70 × 100	80 × 100	80 × 100	100 × 100

<sup>1)</sup>Grade I timber as defined in Table 5 of IS 883.

**Table 12 Minimum Finished Size of Horizontal Nogging Members**  
(Clause 10.8.5)

Sl No.	Spacing of Verticals	Size
(1)	m (2)	mm (3)
i)	1.5	70 × 100
ii)	1	50 × 100
iii)	0.5	25 × 100

**10.8.6** The finished sizes of the sill, wall plate and top plate shall be not less than the size of the vertical members used in the wall.

**10.8.7** Corner posts shall consist of three vertical timbers as described in **10.7.7**.

**10.8.8** The diagonal braces shall be connected of their ends with the other members of the wall by means of wire nails as specified in **10.7.8**.

**10.8.9** Horizontal bracing members of corners of T-junctions of wall shall be as specified in **10.7.9**.

#### 10.9 Notching and Cutting

**10.9.1** Timber framing frequently requires notching and cutting of the vertical members. The notching or cutting should in general be limited to 20 mm in depth unless steel strips are provided to strengthen the notched face of the members. Such steel strips, where

necessary shall be at least 1.5 mm thick and 35 mm wide extending at least 15 cm beyond each side of the notch or cut and attached to the vertical member by means of bolts or screws at each end.


**10.9.2** The top plate, the wall plate or the sill of a wall may be notched or cut, if reinforcing strip of iron is provided as specified in **10.9.1**. In case the member is notched or cut not to exceed 40 mm in depth, such reinforcing strip may be placed along the notched edge only. Where the notch or cut is more than 40 mm in depth or the member is completely cut through, such reinforcing strips shall be placed on both edges of the member. The details of notching and cutting are shown in Fig. 34.

**10.9.3** Joints in timber shall preferably be bound by metallic fasteners.

#### 10.10 Bridging and Blocking

**10.10.1** All wooden joists shall have at least one row of cross bridging for every 3.5 m length of span. The cross-section of the bridging member shall be a minimum of 40 × 70 mm and the member shall be screwed or nailed to the joists.

**10.10.2** All spaces between joists shall be blocked at all bearing with solid blocks not less than 40 mm thick and the full depth of the joists. The block shall be screwed or nailed to the joists as well as to the bearings.

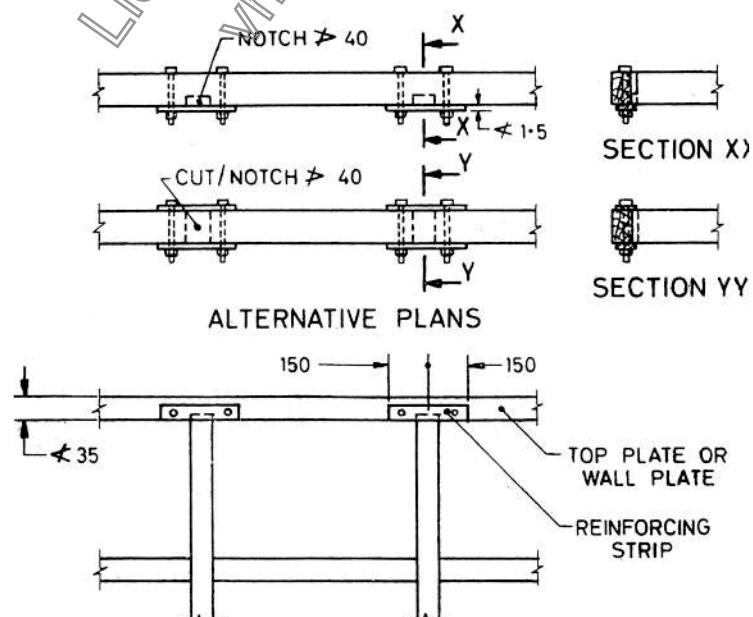

All dimensions in millimetres.

FIG. 34 NOTCHING AND CUTTING

## ANNEX A

*(Foreword)*

### COMMITTEE COMPOSITION

Earthquake Engineering Sectional Committee , CED 39

<i>Organization</i>	<i>Representative(s)</i>
In personal capacity ( <i>L 801, Design Arch Building Sector-5, Vaishali, Ghaziabad 201010</i> )	PROF A. S. ARYA ( <b>Chairman</b> )
Association of Consulting Engineers, Bangalore	SHRI UMESH B. RAO SHRI B. V. RAVINDRA NATH ( <i>Alternate</i> )
Atomic Energy Regulatory Board, Mumbai	DR P. C. BASU SHRI ROSHAN A. D. ( <i>Alternate</i> )
Bharat Heavy Electrical Limited, New Delhi, Hyderabad	SHRI RAVI KUMAR DR C. KAMESHWARA RAO ( <i>Alternate</i> )
Building Materials & Technology Promotion Council, New Delhi	SHRI J. K. PRASAD SHRI PANKAJ GUPTA ( <i>Alternate</i> )
Central Building Research Institute, Roorkee	SHRI ACHAL KUMAR MITTAL SHRI AJAY CHOURASIA ( <i>Alternate</i> )
Central Public Works Department, New Delhi	SHRI BHAGWAN SINGH SHRI A. V. KUJUR ( <i>Alternate</i> )
Central Soils and Materials Research Station, New Delhi	SHRI NAKUL DEV SHRI S. L. GUPTA ( <i>Alternate</i> )
Central Water & Power Research Station, Pune	SHRI T. D. GUPTA SHRI S. G. CHAPHALKAR ( <i>Alternate</i> )
Central Water Commission, New Delhi	DIRECTOR
Delhi College of Engineering, Delhi	DR (SHRIMATI) PRATIMA RANI BOSE SHRI ALOK VERMA ( <i>Alternate</i> )
Department of Atomic Energy, Kalpakkam	SHRI S. RAMANUJAM SHRI R. C. JAIN ( <i>Alternate</i> )
Directorate General of Border Roads, New Delhi	SHRI A. K. DIKSHIT
Engineer-in-Chief's Branch, New Delhi	BRIG B. D. PANDEY PROF S. C. SINHA ( <i>Alternate</i> )
Engineers India Limited, New Delhi	SHRI VINAY KUMAR MSILA DASS ( <i>Alternate</i> )
Gammon India Limited, Mumbai	SHRI V. N. HAGGADE SHRI J. N. DESAI ( <i>Alternate</i> )
Geological Survey of India, Lucknow	SHRI HARSH GUPTA DR KIRAN MAZUMDAR ( <i>Alternate</i> )
Housing & Urban Development Corporation Ltd, New Delhi	SHRIMATI BINDU JESWANI SHRI SURINDER GERA ( <i>Alternate</i> )
Indian Concrete Institute, Chennai	DR A. R. SANTHAKUMAR
Indian Institute of Technology Bombay, Mumbai	DR RAVI SINHA DR ALOK GOYAL ( <i>Alternate</i> )
Indian Institute of Technology Hyderabad, Hyderabad	DR C. V. R. MURTY
Indian Institute of Technology Kanpur, Kanpur	DR S. K. JAIN DR DURGESH C. RAI ( <i>Alternate</i> )
Indian Institute of Technology Madras, Chennai	DR A. MEHER PRASAD
Indian Institute of Technology Roorkee, Roorkee	DR D. K. PAUL PROF ASHOK JAIN ( <i>Alternate</i> )
Indian Meteorological Department, New Delhi	SHRI SURYA BALI JAISWAR SHRI RAJESH PRAKASH ( <i>Alternate</i> )
Indian Road Congress, New Delhi	SECRETARY GENERAL DIRECTOR ( <i>Alternate</i> )

## IS 4326 : 2013

<i>Organization</i>	<i>Representative(s)</i>
Indian Society of Earthquake Technology, Roorkee	PROF D. K. PAUL PROF H. R. WASON ( <i>Alternate</i> )
Maharashtra Engineering Research Institute, Nasik	SUPERINTENDING ENGINEER (Earth Dam) EXECUTIVE DIRECTOR( EARTH DAM) ( <i>Alternate</i> )
Ministry of Road Transport & Highways, New Delhi	SHRI R. K. PANDEY SHRI VIRENDRA KUMAR ( <i>Alternate</i> )
National Council for Cement and Building Meterials, Ballabgarh	SHRI V. V. ARORA
National Geophysical Research Institute (CSIR), Hyderabad	DR M. RAVI KUMAR DR N. PURANCHADRA RAO ( <i>Alternate</i> )
National Highway Authority of India, New Delhi	SHRI SURESH KUMAR PURI
National Thermal Power Corporation, Noida	DR PRAVEEN KHANDELWAL SHRI SAURABH GUPTA ( <i>Alternate</i> )
Nuclear Power Corporation India Limited, Mumbai	SHRI U. S. P. VERMA SHRIMATI MINI K. PAUL ( <i>Alternate</i> )
Public Works Department, Mumbai	SHRI M. M. KHAN
Research, Design & Standards Organization, Lucknow	SHRI PIYUSH AGARWAL SHRI R. K. GOEL ( <i>Alternate</i> )
RITES Limited, Gurgaon	SHRI K. N. SREENIVASA
School of Planning & Architecture, New Delhi	DR V. THIRUVENGADAM
Structural Engineering Research Centre, Chennai	DR K. MUTHUMANI SHRI N. GOPALAKRISHNAN ( <i>Alternate</i> )
Tandon Consultants Pvt Limited, New Delhi	DR MAHESH TANDON SHRI VINAY K. GUPTA ( <i>Alternate</i> )
Tata Consulting Engineers, Mumbai	SHRI K. V. SUBRAMANIAN SHRI C. K. RAVINDRANATHAN ( <i>Alternate</i> )
Vakil-Mehta-Sheth Consulting Engineers, Mumbai	MS ALPA R. SHETH SHRI R. D. CHAUDHARI ( <i>Alternate</i> )
Visvesvaraya National Institute of Technology, Nagpur	DR O. R. JAISWAL DR R. K. INGLE ( <i>Alternate</i> )
Wadia Institute of Himalayan Geology, Dehradun	DR SUSHIL KUMAR
In personal capacity ( <i>C-2/155, West Enclave, Pitampura, New Delhi</i> )	DR K. G. BHATIA
In personal capacity ( <i>36 Old Sneha Nagar, Wardha Road, Nagpur</i> )	SHRI L. K. JAIN SHRI ISH JAIN ( <i>Alternate</i> )
In personal capacity ( <i>K-L/2 Kavi Nagar, Ghaziabad</i> )	DR A. K. MITTAL
BIS Directorate General	SHRI A. K. SAINI, Scientist 'F' & Head (Civ Engg) [Representing Director General ( <i>Ex-officio</i> )]

*Member Secretary*  
SHRI S. CHATURVEDI  
Scientist 'E' (Civ Engg), BIS

## Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act, 1986* to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

### Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in the course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publications), BIS.

### Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Catalogue' and 'Standards : Monthly Additions'.

This Indian Standard has been developed from Doc No.: CED 39 (7620).

### Amendments Issued Since Publication

Amend No.	Date of Issue	Text Affected

### BUREAU OF INDIAN STANDARDS

#### Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002  
Telephones : 2323 0131, 2323 3375, 2323 9402      Website: [www.bis.org.in](http://www.bis.org.in)

#### Regional Offices:

		Telephones
Central	: Manak Bhavan, 9 Bahadur Shah Zafar Marg NEW DELHI 110002	{ 2323 7617 2323 3841
Eastern	: 1/14 C.I.T. Scheme VII M, V. I. P. Road, Kankurgachi KOLKATA 700054	{ 2337 8499, 2337 8561 2337 8626, 2337 9120
Northern	: SCO 335-336, Sector 34-A, CHANDIGARH 160022	{ 260 3843 260 9285
Southern	: C.I.T. Campus, IV Cross Road, CHENNAI 600113	{ 2254 1216, 2254 1442 2254 2519, 2254 2315
Western	: Manakalaya, E9 MIDC, Marol, Andheri (East) MUMBAI 400093	{ 2832 9295, 2832 7858 2832 7891, 2832 7892

**Branches:** AHMEDABAD. BANGALORE. BHOPAL. BHUBANESHWAR. COIMBATORE. DEHRADUN.  
FARIDABAD. GHAZIABAD. GUWAHATI. HYDERABAD. JAIPUR. KANPUR. LUCKNOW.  
NAGPUR. PARWANOO. PATNA. PUNE. RAJKOT. THIRUVANANTHAPURAM.  
VISAKHAPATNAM.