POWER PULSE

Power Generation Methods — Class Notes

Notes by BALAJI SIR

DAY-1 [8/9/25]

* Cost of electrical energy per kWhr must be minimum
  - Power Generation Methods
  - Power Transmission methods
  - Economic factors
  - Economic load Dispatch
  - Load flow studies
  - HVDC

* Rated Vtg has to be available within the safe limits
  -> Overvtg causes damage to the insulation.
  -> Undervtg causes overheating in the equipment due to high current.

* Rated frequency of 50 Hz has to be maintained within the limits
  -> Load frequency control :
  At low frequency X'mer core is saturated and performance of motors are affected.
  [$\because V = 4.44 f \Phi_m N$]


* At high frequency hysteresis losses are increased.

* Faster fault identification and isolation of fault from the healthy system has to be available - Fault analysis, switchgear & protection.

* More stable generator has to be available w/o losing synchronism during temporary fault conditions - "Stability".

BALAJI SIR

* Continuous reliable power supply has to be available to all the consumers - "Transmission, distribution, HVDC".

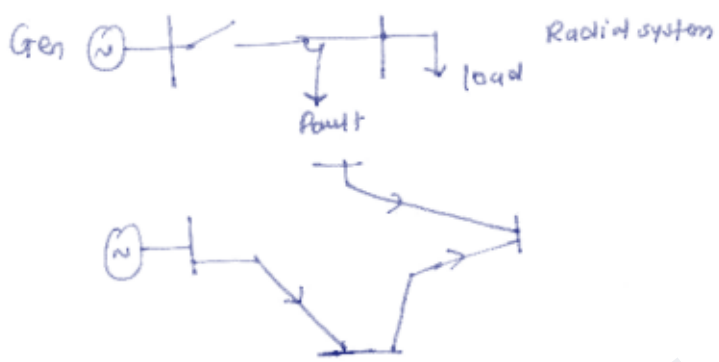


Radial system / interconnected system

* Flexible power transmission has to be available in all vtg levels - 'power cable'.


* Per capita power consumption in India is around 1,500 units.

* Total generator installed capacity in India is 500 GW, which is obtained from coal or thermal plants 47.63%, renewable energy 32.5%, hydro 10.6%, gas 5.6%, nuclear 1.85%, diesel 0.13%.

BALAJI SIR

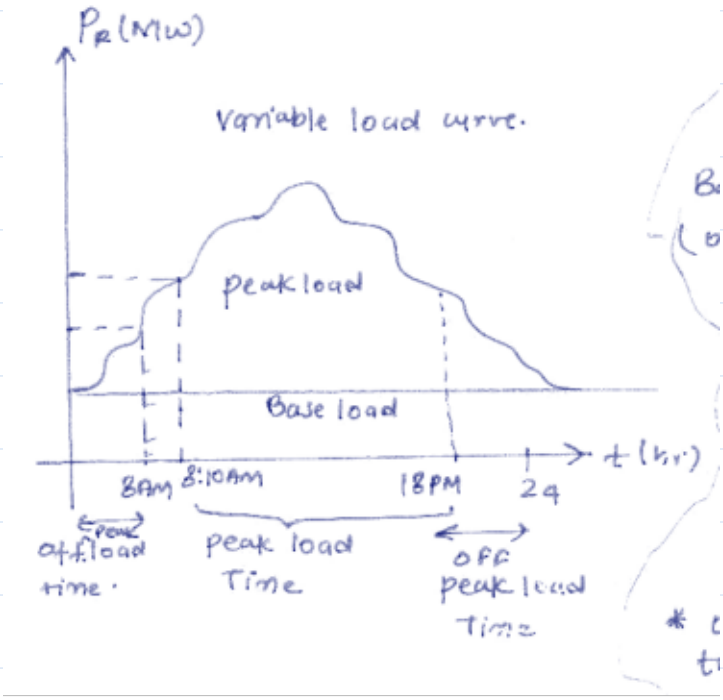


Variable load curve: peak load and base load

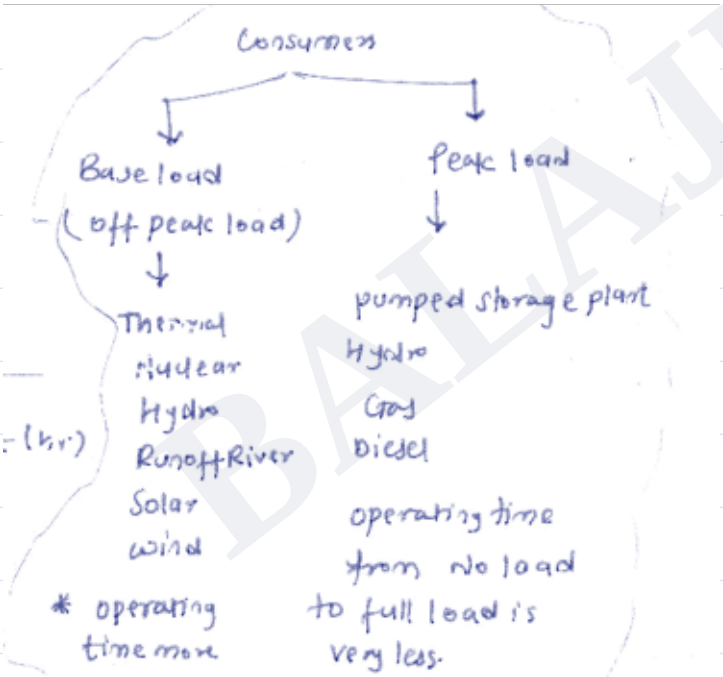


Consumers: base load and peak load plants

BALAJI SIR

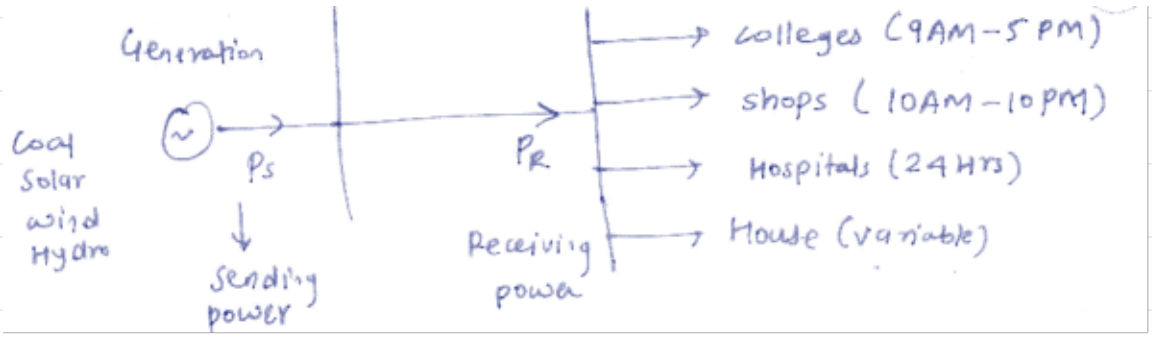

Generation, sending power Ps, receiving power PR and loads

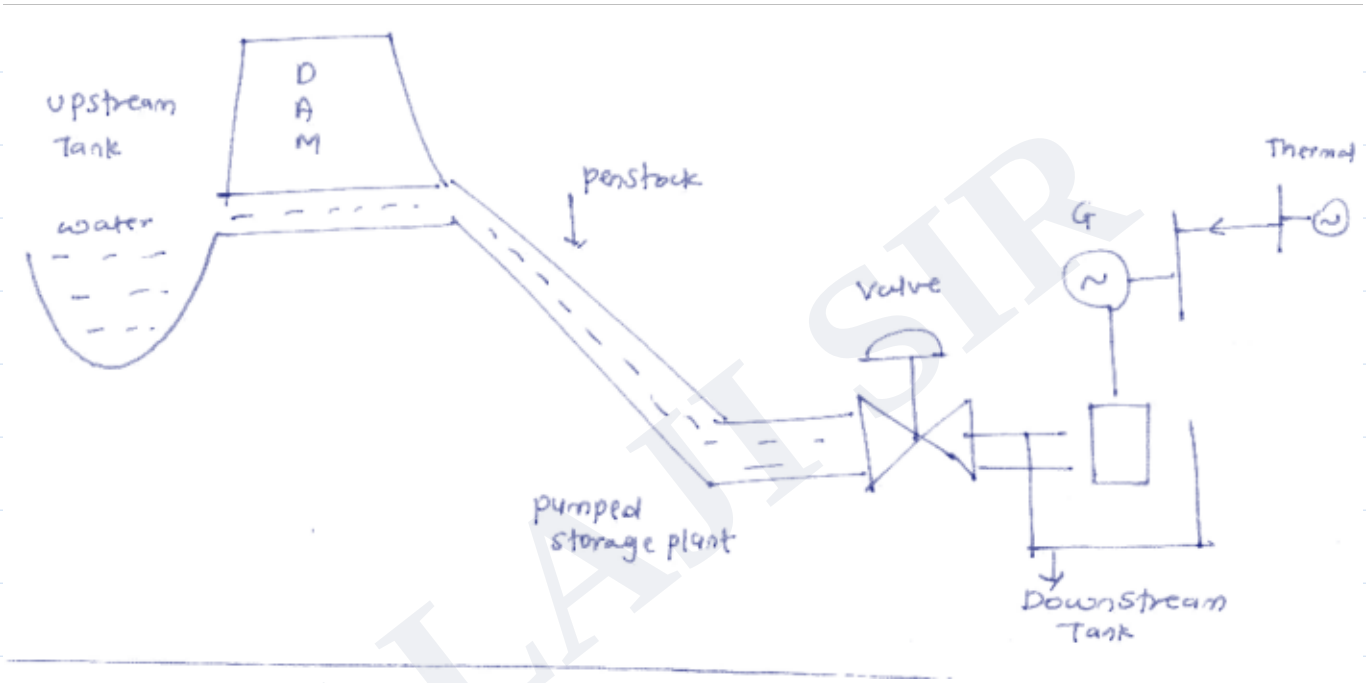

Pumped storage plant

* Out of 500 GW of total power generation, 35%, 28%, 25%, 12%, 1% are obtained from West, South, North, East, North-Eastern region respectively.

* Energy consumption in India: Domestic (30%), Industrial (28%), Irrigation (21%), Commercial (9%), Others - Railways (12%).

BALAJI SIR