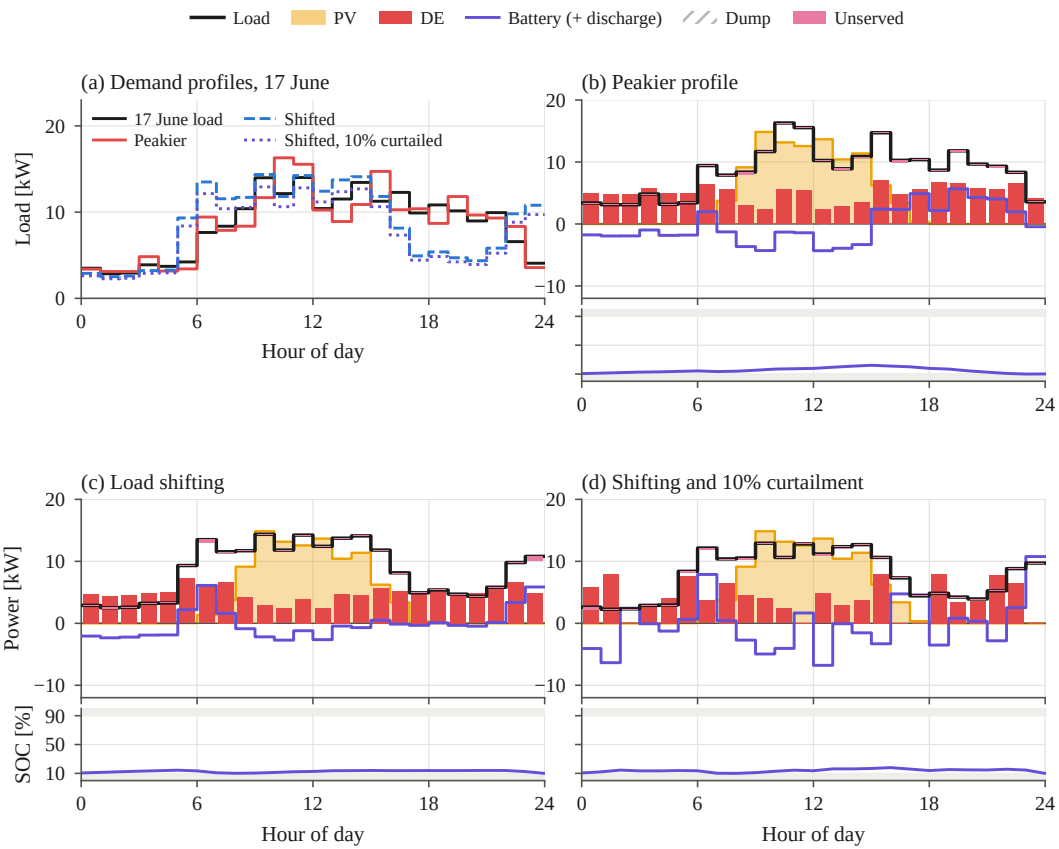
Load
PV
DE
Battery (+ discharge)
Dump
Unserved
(a) Demand profiles, 17 June
17 June load
Peakier
Shifted
Shifted, 10% curtailed
Load [kW]
Hour of day
(b) Peakier profile
(c) Load shifting
(d) Shifting and 10% curtailment
Power [kW]
SOC [%]
Hour of day
Hour of day