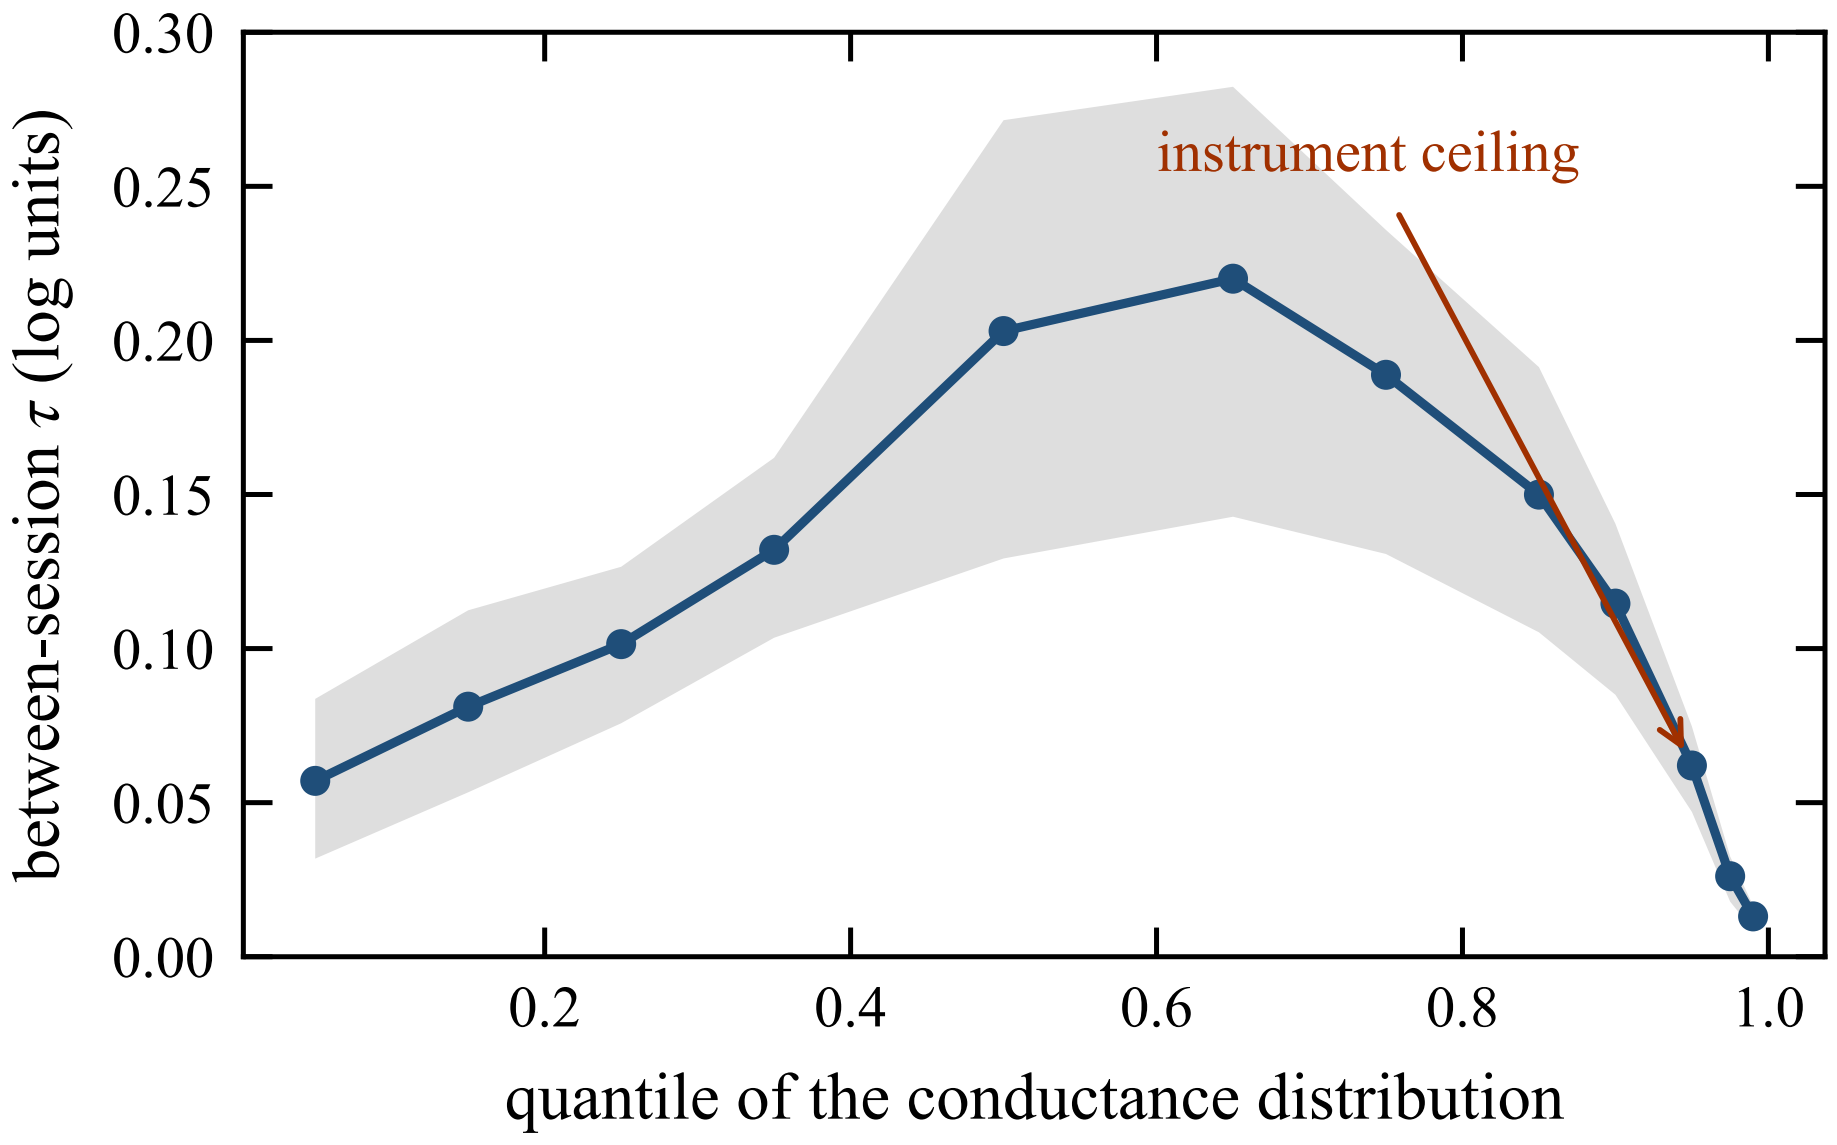
0.30
0.25
0.20
0.15
0.10
0.05
0.00
between-session τ (log units)
instrument ceiling
0.2
0.4
0.6
0.8
1.0
quantile of the conductance distribution