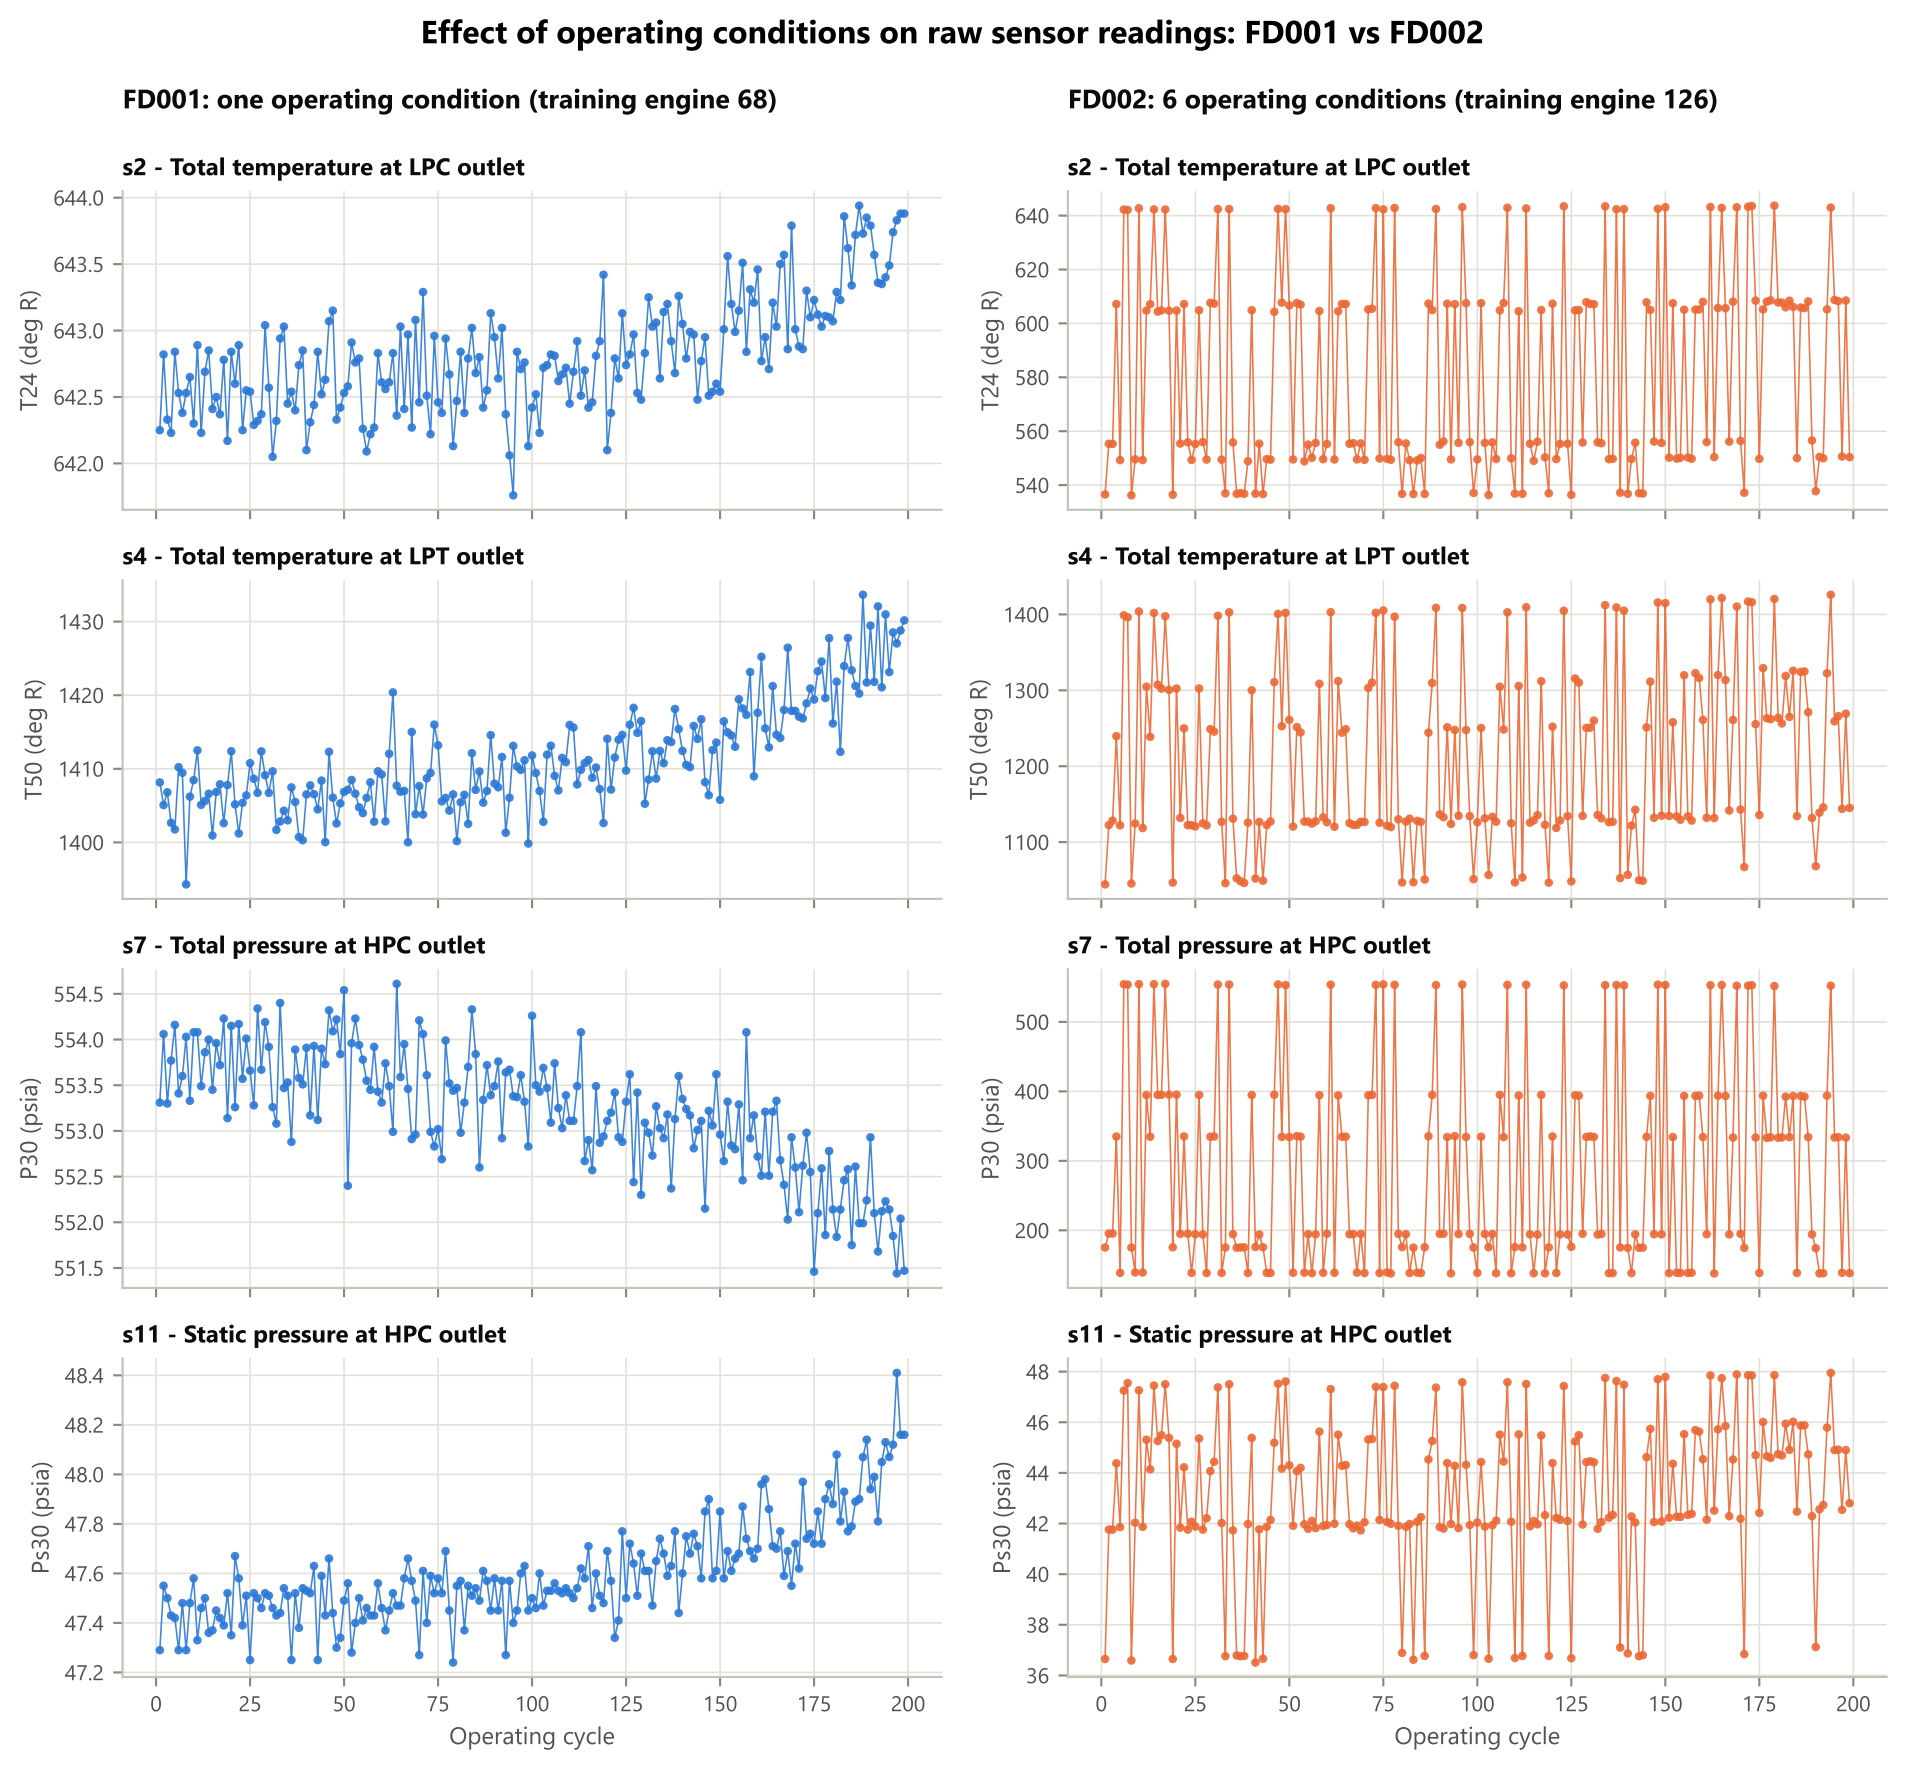

Effect of operating conditions on raw sensor readings: FD001 vs FD002
FD001: one operating condition (training engine 68)
FD002: 6 operating conditions (training engine 126)
s2 - Total temperature at LPC outlet
T24 (deg R)
644.0
643.5
643.0
642.5
642.0
s2 - Total temperature at LPC outlet
T24 (deg R)
640
620
600
580
560
540
s4 - Total temperature at LPT outlet
T50 (deg R)
1430
1420
1410
1400
s4 - Total temperature at LPT outlet
T50 (deg R)
1400
1300
1200
1100
s7 - Total pressure at HPC outlet
P30 (psia)
554.5
554.0
553.5
553.0
552.5
552.0
551.5
s7 - Total pressure at HPC outlet
P30 (psia)
500
400
300
200
s11 - Static pressure at HPC outlet
Ps30 (psia)
48.4
48.2
48.0
47.8
47.6
47.4
47.2
s11 - Static pressure at HPC outlet
Ps30 (psia)
48
46
44
42
40
38
36
0
25
50
75
100
125
150
175
200
Operating cycle
Operating cycle