



PS

N

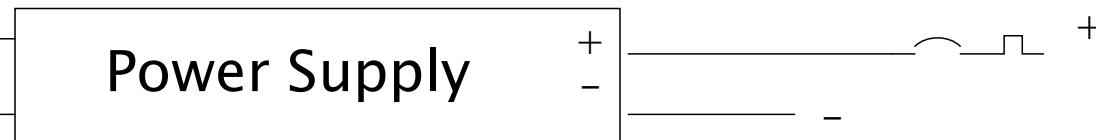

Power Supply

O\_Elev1 O\_Elev2 O\_S1 O\_S2 O\_M EMGC Spare1 Spare2

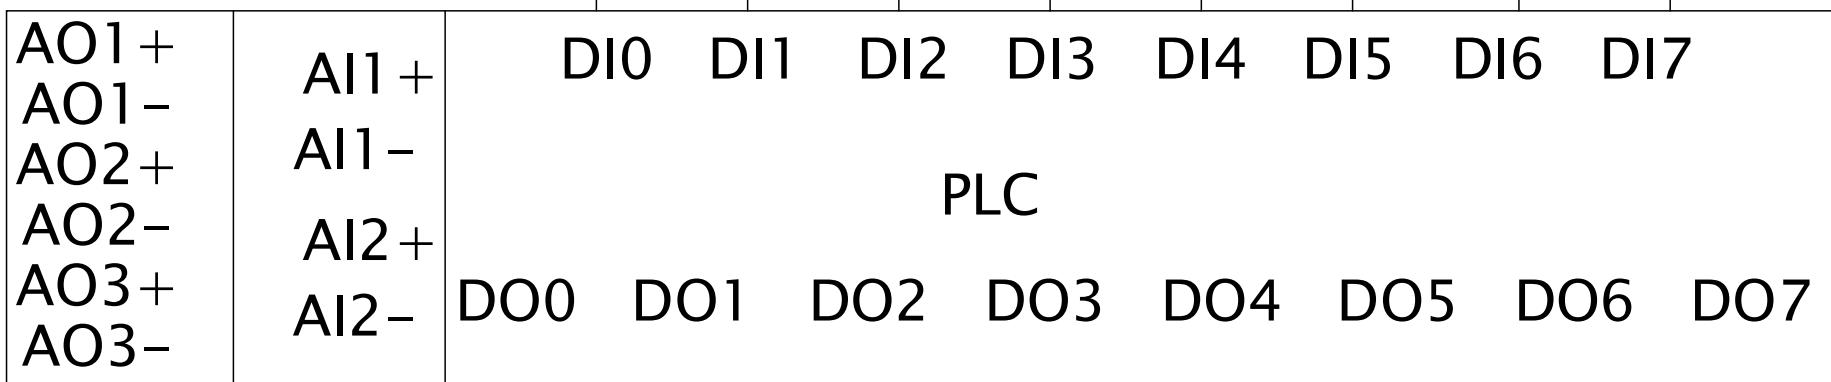

PLC

R1

R2

R3

R4

R5

R6

R7

R8

Elev1

Elev2

Spiral1

Spiral2

Mixer

MixerGate

SP1

SP2

A01- A01+ - R3

COM AI0 COM LI0

R1A R1B R1C VFD1

O\_S1 + Spiral1

A02- A02+ - R4

COM AI0 COM LI0

R1A R1B R1C VFD1

O\_S2 + Spiral2


A03- A03+ - R5

COM AI0 COM LI0


R1A R1B R1C VFD1

O\_M + Mixer

+  
O\_Elev1  
+  
O\_Elev2  
+  
EMGC

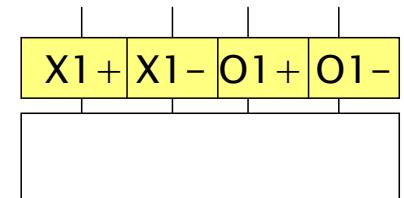

AI1+ AI1-

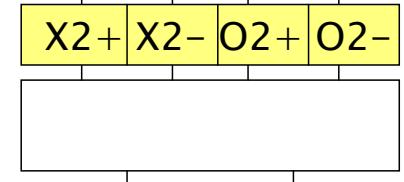

AI2+ AI2-