
Certificate Of Excellence







Presented To ..... *M. Vishwa* ..... Upon the Successful

Completion of ..... *MEP Designing & Drafting* .....

On ..... *07 - January - 2021* ..... Reg. No ..... *CADS17102015441* .....

Softwares Specialized ..... *Autodesk AutoCAD 2018 & Revit MEP 2018* .....

Christus Mathew
President / CEO

CAD POINT AUTHORIZED TRAINING CENTRE

CADPOINT

CADPOINT *Pudukkottai*
Centre Manager

INTERNATIONAL CADPOINT CERTIFICATION


CADPOINT®
AUTHORIZED TRAINING CENTRE

ISO 9001:2008 Certified Company

Cadpoint and the logo are registered trademarks of Cadpoint Engineering Solutions Pvt. Ltd., Chennai, India. All Rights Reserved.

www.cadpoint.in/certify.htm

International Certification Program From Cadpoint
برنامج الشهادة العالمية من كادبوينت

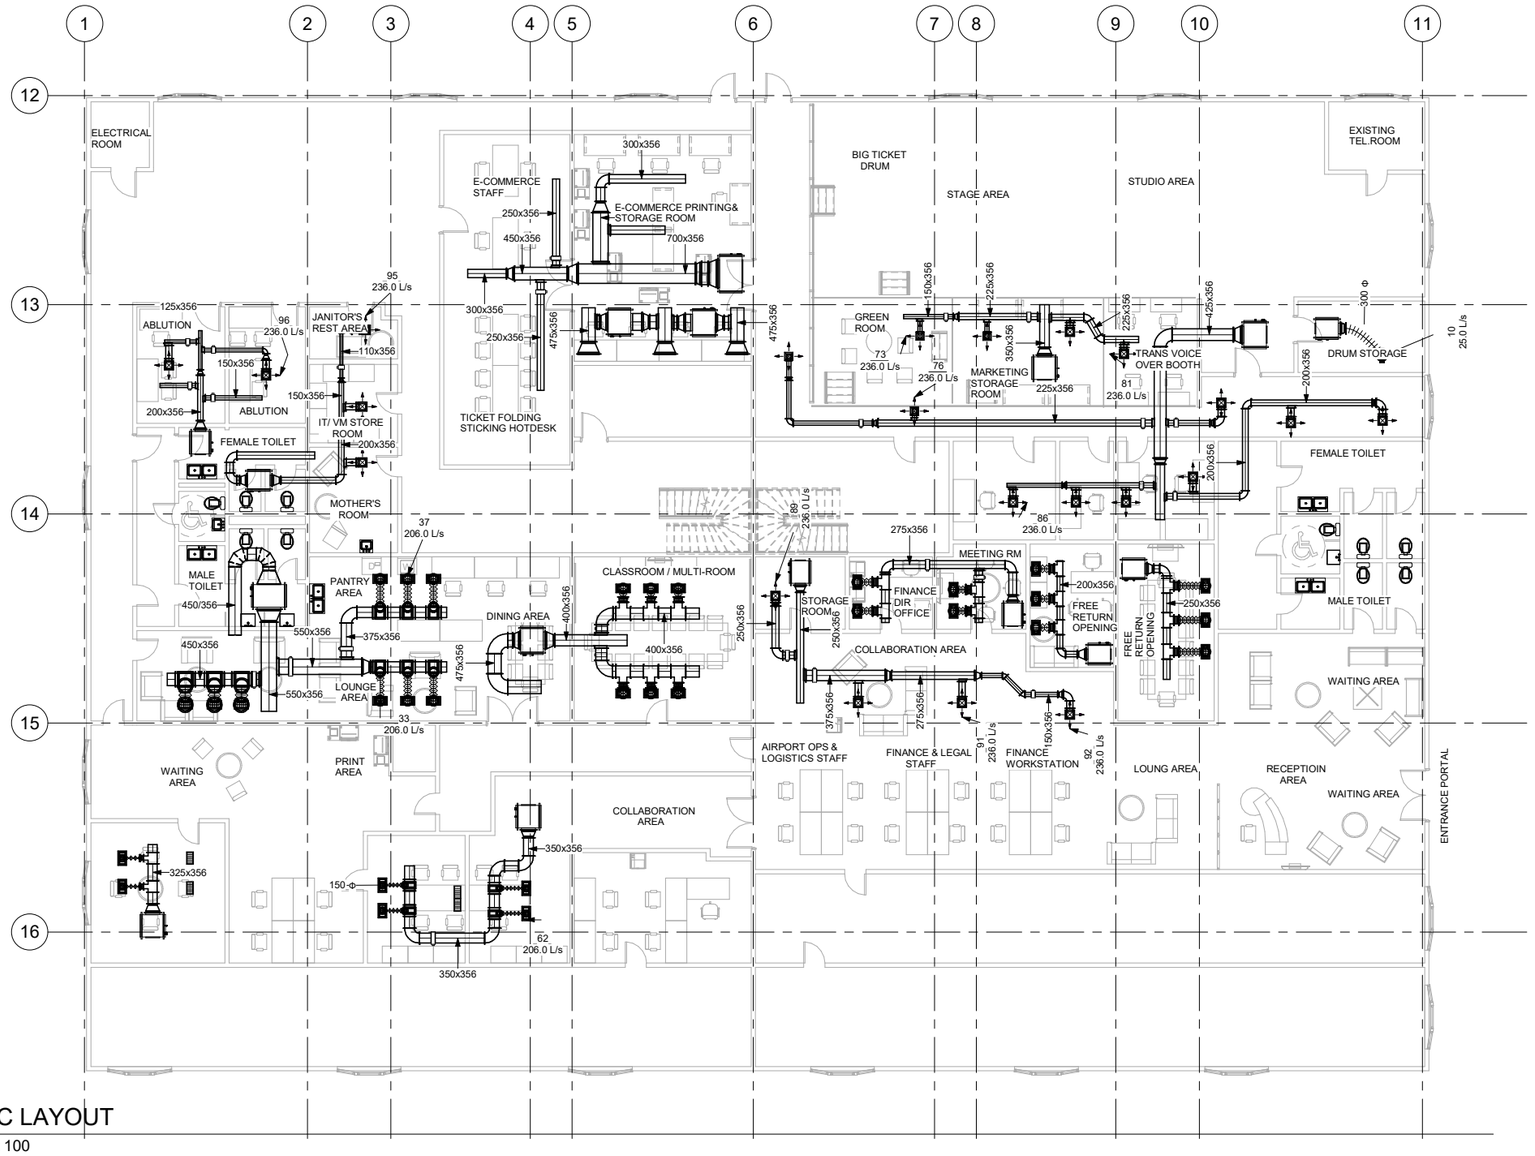

1 AC LAYOUT
1 : 100

HVAC LEGEND

	EXTRACT GRILLE
	RETURN DIFFUSER WITH PLENUM
	SUPPLY DIFFUSER
	SUPPLY DIFFUSER WITH PLENUM
	RETURN DIFFUSER
	FLEX DUCT RECTANGULAR
	FAN COIL UNIT

LEGEND

MEZZANINE GROUND FLOOR AC LAYOUT

NOTE:

1) ALL MAIN DUCTS AT DOUBLE HEIGHT AREAS ARE SIZED WITH 0.57 Pa/m HEAD LOSS.

2) ALL MAIN BRANCH DUCTS AT LOW LEVEL AREAS ARE SIZED WITH 0.4 Pa/m HEAD LOSS.

3) ALL BRANCH DUCTS ARE WITH 2.5m/s VELOCITY.

4) SOUND LINEAR UP TO 3 METERS FROM FCU

5) FCU HANGER ARE SPRING TYPE VIBRATION ISOLATOR

U-VALUES

S.NO	DESCRIPTION	U-VALUE (W/K)	REMARKS
01	EXTERNAL WALL	1.867	AS PER CUNDAL DESIGN REPORT
02	EXPOSED ROOF	0.467	MAX U- VALUE
03	GLASS	1.2	MAX U -VALUE
04	SHADING CF FOR GLASS	0.4	MAX SHADING COEFFICIENT

DRAWN BY: M.VISHWA

SOFTWARE USED: REVIT

INSTITUTION NAME:

CADPOINT®
AUTHORIZED TRAINING CENTRE
ISO 9001 : 2008 CERTIFIED COMPANY