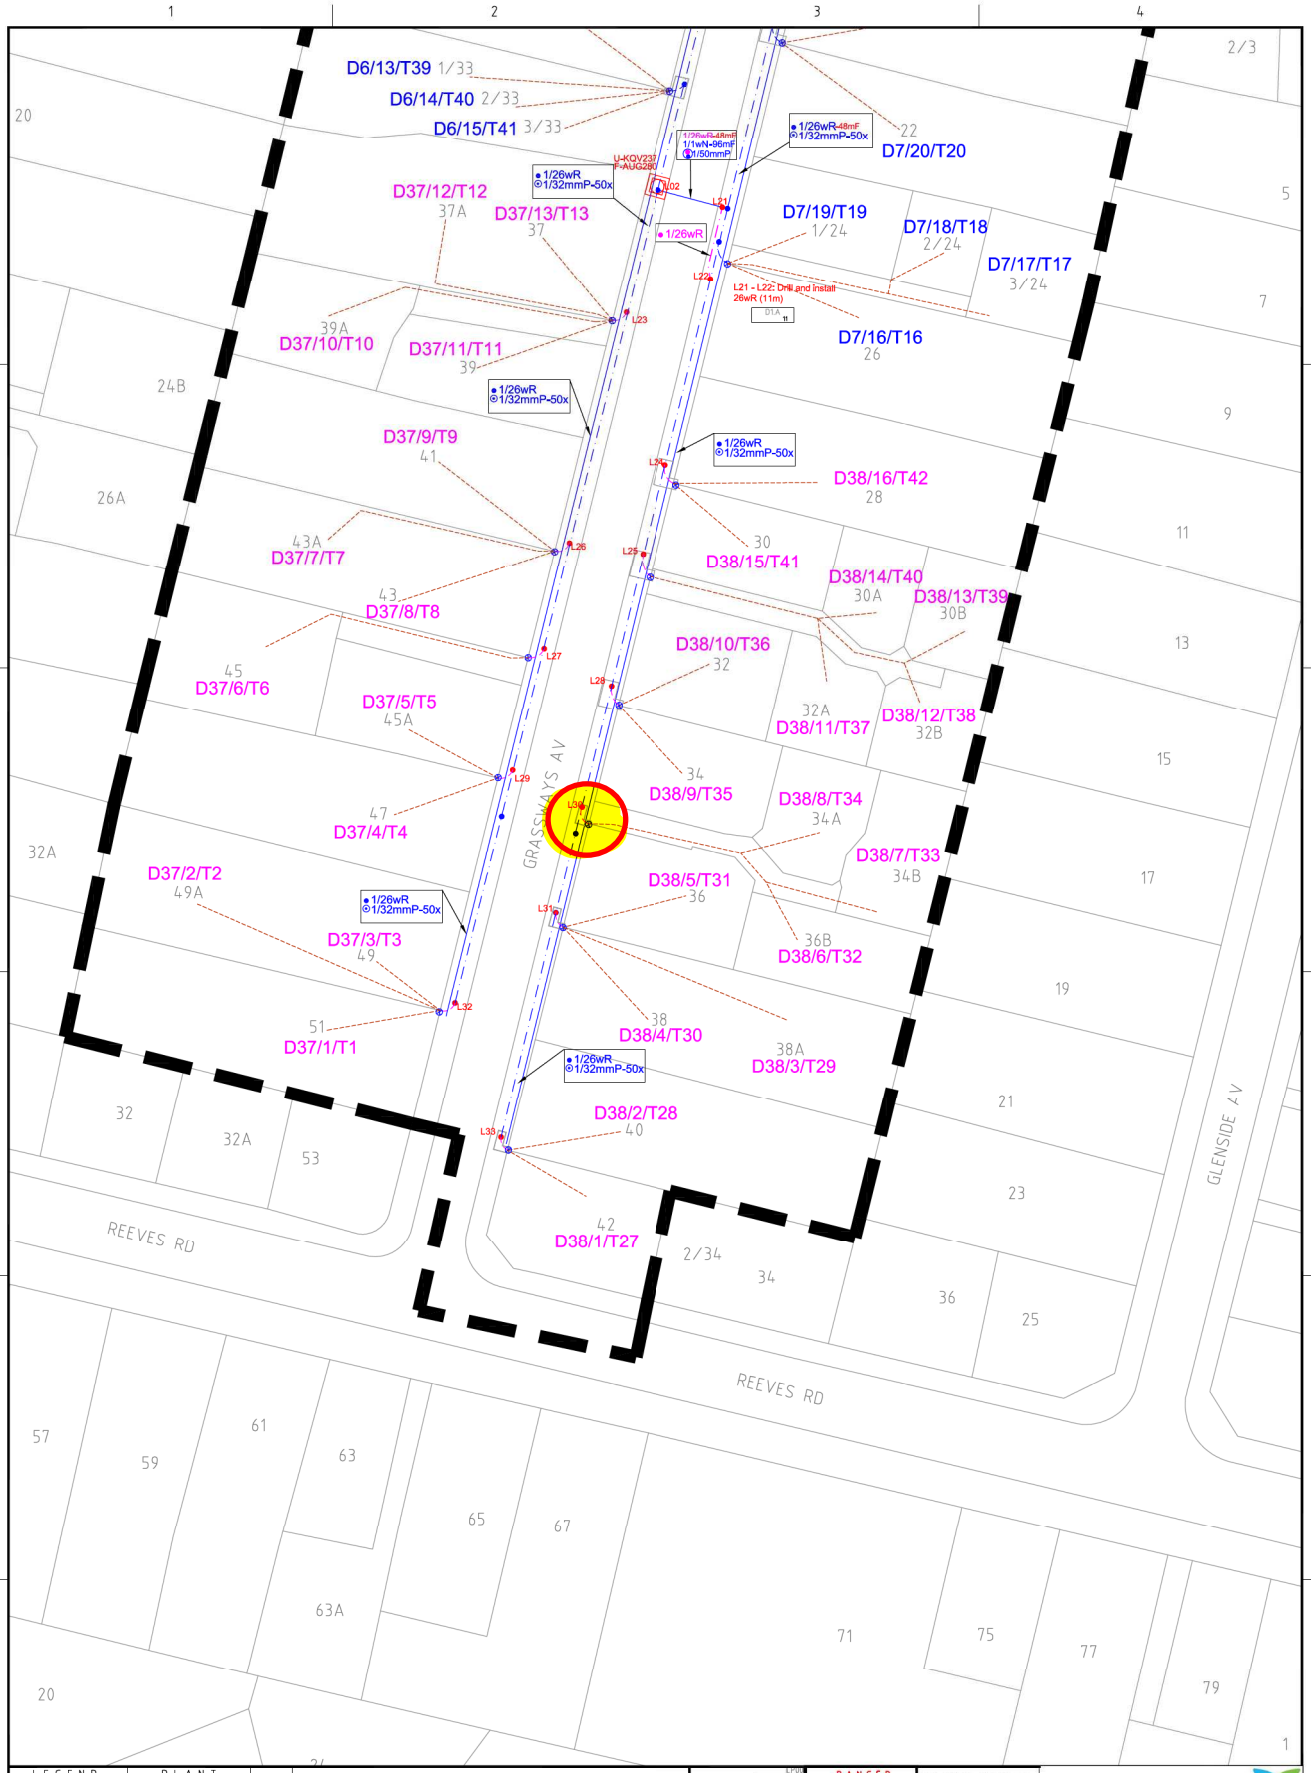

LEGEND

PROPOSED
EXISTING
FUTURE NETWORK
PROPOSED RIBBONET
1 WAY RIBBONET
4,7,12 & 26 WAY RIBBONET
Under Ground Feed
Aerial Feed
Proposed Aerial Fibre
FTP AREA

PLANT

CABINET
MANHOLE
BOD PIT
ABFAT
ABFFP
MASTER ABFFP
PILLAR/PEDESTAL
DUCT TEE
HANDHOLE
ROUTE TRANSITION
MS MASSLAB
JOINT
Cu-Pole
CVP_
VVP_
CHORUS POLE
VECTOR POLE
VECTOR POLE
WITH TRANSFORMER
FAT ON POLE

LP008 LP009 LP015 LP016 LP017 P006

DANGER

PEOPLE DIGGING MUST CHECK FOR POWER CABLES BEFORE DIGGING. IF YOU DISCOVER LIVE WIRE GROUND YOU HAVE CALLED

0800 842 802 0800 243 3441

CONSTRUCTORS NOTE

THE CONTRACTOR INSPECTING ON SITE PLAN MUST BE FOLLOWED WITHOUT VARIATION. IF ANY DIFFERENCE IS FOUND BETWEEN SITE PLAN AND REALITY ON SITE, THE SITE MUST BE REPORTED AS A LOCAL RETICULATION BY THE CONTRACTOR. THE CONTRACTOR MUST ALSO BE ALERTED BEFORE MOVING ANY POLES AND THOSE IT CONSTRUCTS. THE PLACE OF POLES, ANCHORS AND STAYS ON THE PLAN BEFORE EXECUTION AND VARIATION IN THE POLE, AS A RENEFICATION MAY BE REQUIRED TO CHANGE BEFORE THE CONSTRUCTION CAN PROCEED IN THE FIELD

PGA-FFP28-64446.DWG

BOQ ID: 20170419092530

DATE :	19/04/2017
TASK	NAME
DESIGNER	CHORUS
DESIGN QA	CHORUS
DRAFTSPERSON	MSANKAR

visionstream

ULTRA FAST BROADBAND (UFB)

PGA-FFP28&39-64446-64428

LAY PLAN

DRAWING NUMBER PGA-FFP28-64446

SCALE 1:500 @ A2 SHEET 16 / 19

A2