


Analytical description of the scattering functions

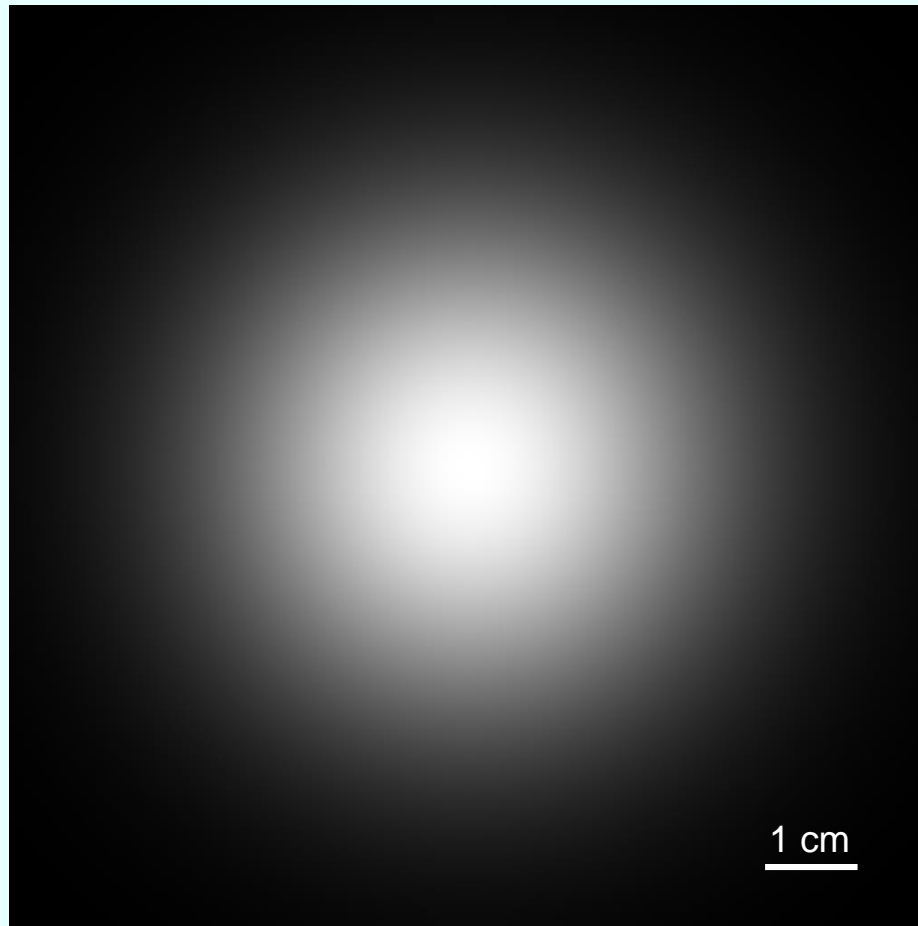

Calculated 2D analytical PScF using the parameters listed in the figures above for a water layer with a thickness of 20 mm at a distance of 20 mm from the detector.