



PTT PHENOL COMPANY
LIMITED

PROCESS SPECIFICATION

CHP SUMP (D-2206)

Docu. No. : 14780-8120-PS-D2206
Project No. : 120117
Rev. No. : Z1
Date : MAY 10, 2016
Page : 1 / 4

TITLE :

CHP SUMP

(D-2206)

DISCIPLINE : **PROCESS**
DOCUMENT NO. : **14780-8120-PS-D2206**
PROJECT NAME : **PTT Phenol Train II Project**
PROJECT NO. : **120117**
OWNER : **PTT Phenol Company Limited (PPCL)**

Z1	MAY 10, 2016	AS BUILT	S.W.Park	J.S.Chung	-	S.W.Lee
F1	MAY 22, 2014	FINAL ISSUE	S.W.Park	J.S.Chung	-	S.W.Lee
A3	APR 18, 2013	APPROVED FOR DESIGN	S.W.Park	J.S.Chung	-	S.W.Lee
A2	DEC 11, 2013	APPROVED FOR DESIGN	S.W.Park	J.S.Chung	-	S.W.Lee
A1	OCT 2, 2013	APPROVED FOR DESIGN	S.W.Park	J.S.Chung	-	S.W.Lee
O2	AUG 23, 2013	COMMENT ISSUE	S.W.Park	J.S.Chung	-	S.W.Lee
O1	JUN 27, 2013	COMMENT ISSUE	S.W.Park	J.S.Chung	-	S.W.Lee
REV. NO.	DATE	DESCRIPTION	PREP'N	REVIEW	QA REVIEW	APPROVAL
REV. NO.	PREPARATION DEPT.	PREPARATION	REVIEW	QA REVIEW	APPROVAL	
Z1	PROCESS	S.W.Park	J.S.Chung	-	S.W.Lee	
		MAY 10, 2016	MAY 10, 2016	-	MAY 10, 2016	

This Document is the property of POSCO Engineering Co., Ltd. Therefore, it shall not be released to Any third party without permission of an authorized personnel of the POSCO Engineering Co., Ltd.

[illegible]



Note: The information in this document is confidential and the property of UOP LLC and must not be disclosed to others or reproduced in any manner or used for any purpose whatsoever without its written permission.



VESSELS

PROJECT SPECIFICATION

963765 — 301

SHEET 3 / 4

REV	DATE	BY	APVD	REV	DATE	BY	APVD
0	27APR12	TS	HDT				

General Notes

- A. Vessels shall be constructed in accordance with the following unless otherwise specified on the individual vessel specification sheet.

Standards:

UOP Standard Specification 3-11

- B. Although the resulting inside diameter may be slightly different than specified, vessels without trays or packing, may be fabricated from pipe.
- C. The dimensioned location of some of the vessel level nozzles may be noted as min (minimum) or max (maximum). It is the responsibility of the contractor to adjust these dimensions to suit the specific level requirements specified on the UOP Piping and Instrument Diagram(s) and on UOP Standard Drawing 8-121. When additional nozzles are required for level instrumentation, the contractor shall specify them consistent with the size, class and facing requirements specified in the UOP Project Specification 301-Vessels and on the UOP Piping and Instrument Diagram(s).
- D. When system of measurement is metric, all dimensions are in millimeters unless noted otherwise.
- E. Contractor shall not locate TI thermowells in a downcomer. Contractor shall also ensure that TI thermowells are located to avoid interference with downcomers, weirs, distributors, collectors, baffles, chimneys, traps and all other vessel internals.
- F. Suppliers (or equal):

Spray Nozzle:

BETE Fog Nozzle Inc.
www.bete.com

Profile Wire Screens:

Johnson Screens
www.johnsonscreens.com

Nagaoka International Corporation
www.nagaokajapan.co.jp

Other specifications
referenced in this
specification:

UOP Standard Specification: 3-11, 3-15, 3-35, 9-11

UOP Standard Drawing: 3-115, 3-116, 3-122, 3-123, 3-144, 3-183, 3-190, 3-264, 3-266, 3-313, 3-322, 8-121

UOP Project Specification: 963765-106, 963765-307



PROJECT SPECIFICATION

963765 - 301

SHEET 4 / 4

REV	DATE	BY	APP'D	REV	DATE	BY	APP'D
0	27APR12	TS	HDT				
1	07SEP12	JG	HDT				

REV

VESSELS

SERVICE CHP SUMP

ITEM NO D-2206

Design	INT 3.5 kg/cm2(g) @ 120°C
Conditions at Top	EXT FULL VACUUM @ 175°C
	Metal Temperature(Min) 15°C
Operating Conditions	0.07 kg/cm2(g) @ 38°C

Radiograph	MR
Postweld Heat Treat	MR

Material	Corrosion Allowance mm (Min)
SA 240 TYPE 304L	1.5

This Vessel is in the Following Service(s):	
Hydrogen	NO
Hydrofluoric (HF) Acid	NO
Hydrofluoric (HF) Acid (with Resid. Elem. Control)	NO
Wet Hydrogen Sulfide (H2S)	NO
Severe Cyclic	NO
Caustic	NO
Carbonate	NO
Note:	


Vessel Heads	
Riser	FLANGED
Vessel	2:1 ELLIPTICAL
Accessories Applied by Fabricator	
Ladder & Platform Clips	AS REQUIRED
Insulation Clips & Rings	NO
Vessel Support	(NOTE 2)

Nozzles and Manways			
Mark	No	Size Inches	Service
AF	1	RISER ID	MANWAY
AL	1	3	LEVEL (2)
AT	1	2	TE (2)
AX	1	MR	PUMP MOUNT & DISCHARGE
BB	1	6	VENTILATION
BI	1	6	INLET
BV	1	6	VENT/RELIEF
BT	1	2	TI (2)

Class	- ASME CL150
(2)	- ASME CL300
Facing	- RAISED FACE

Normal Liquid Level = MINIMUM LIQUID LEVEL

Specific Gravity = 0.85

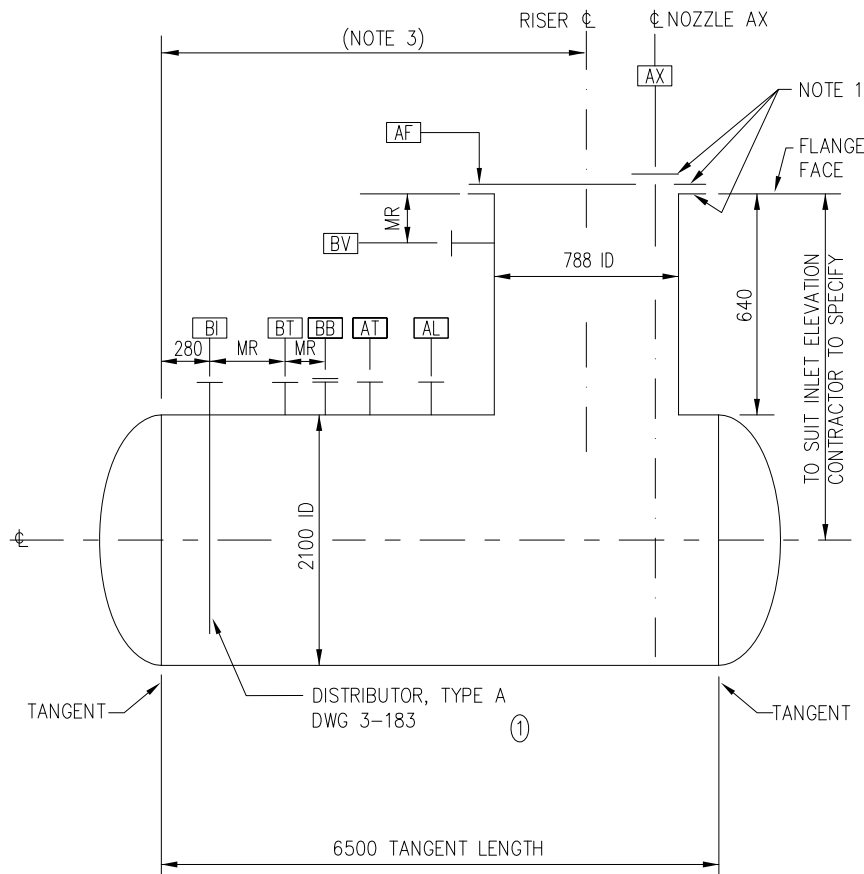

NOTES:

1. MR FLANGE AND COVER. DRILL FOR MOUNTING SUMP PUMP FLANGE. PROVIDE BOLTS AND SUITABLE GASKET FOR VAPOR TIGHT SEAL AT DESIGN PRESSURE.
2. PROVIDE SECONDARY CONTAINMENT (LINED VAULT OR DOUBLE-WALL VESSEL) FOR ENVIRONMENTAL PROTECTION CONSISTENT WITH U.S. EPA REGULATIONS; PART 280 OF TITLE 40 OF THE CODE OF FEDERAL REGULATIONS; UNDERGROUND STORAGE TANKS TECHNICAL REQUIREMENTS.
3. DELETED.
4. DELETED.
5. DELETED.
6. DELETED.
7. DELETED.

Drawings Referred to in this Specification

3-183