

THESE P AND I DIAGRAM IS DIAGRAMATIC ONLY. DESIGN OF PIPE LINES MUST BE INVESTIGATED FOR VENTING OF GAS AND VAPOR POCKETS IN PIPING AND EQUIPMENT. LOW POINTS IN PIPING, PUMPS AND EQUIPMENT FOR FREEZING AND DRAINING, AND ACCESSIBILITY OF ALL VALVES, FLANGES, INSTRUMENTS INCLUDING THERMOCOUPLES, ETC.

NOTE: THE INFORMATION IN THIS DOCUMENT IS CONFIDENTIAL AND THE PROPERTY OF UOP LLC AND MUST NOT BE DISCLOSED TO OTHERS OR REPRODUCED IN ANY MANNER OR USED FOR ANY PURPOSE WHATSOEVER WITHOUT ITS WRITTEN PERMISSION.

14780-8120-25-23-0001

B

C

D








E

F

G

H

J

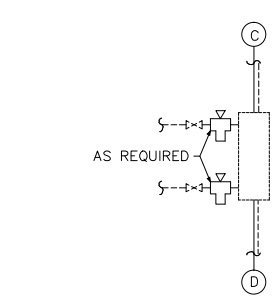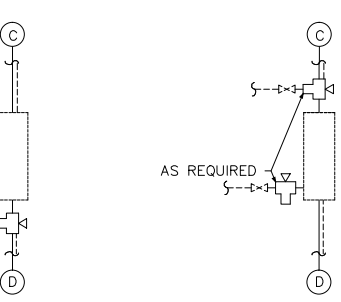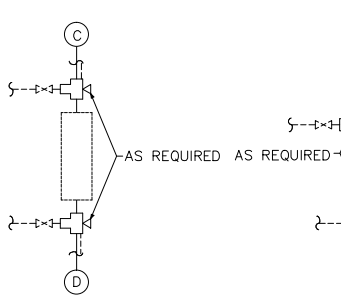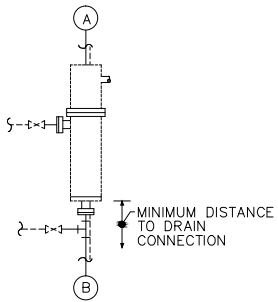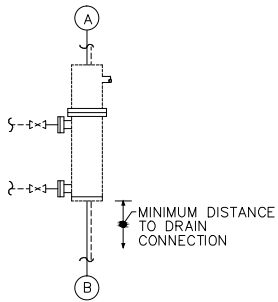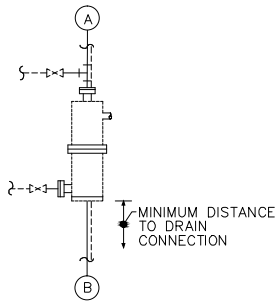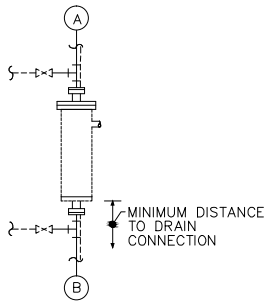




EXTERNAL DISPLACEMENT LEVEL INSTRUMENT CONNECTIONS

GAUGE GLASS AND MAGNETIC INDICATOR CONNECTIONS

DETAIL OF STP DWG 8-139-8

DETAIL OF STP DWG 8-140-7

DETAIL OF STP DWG 8-141-8

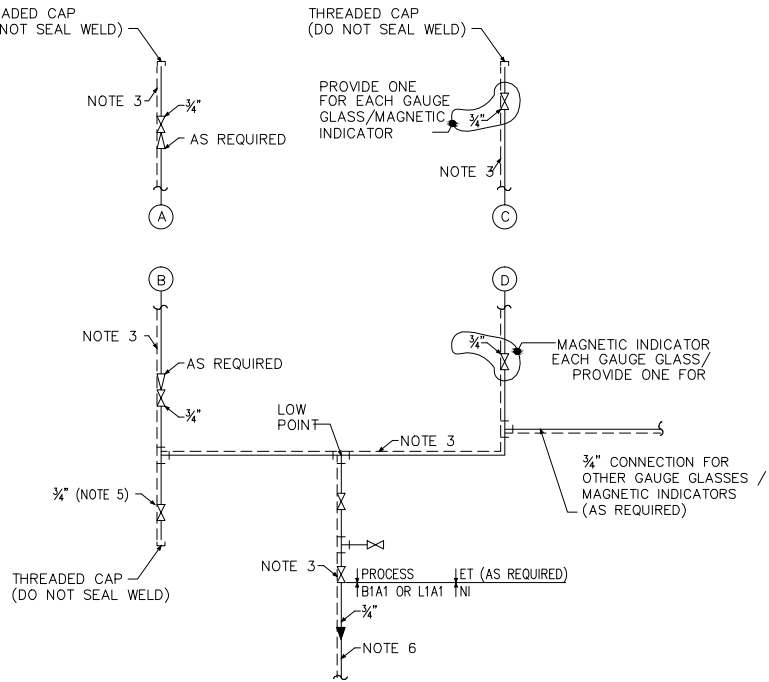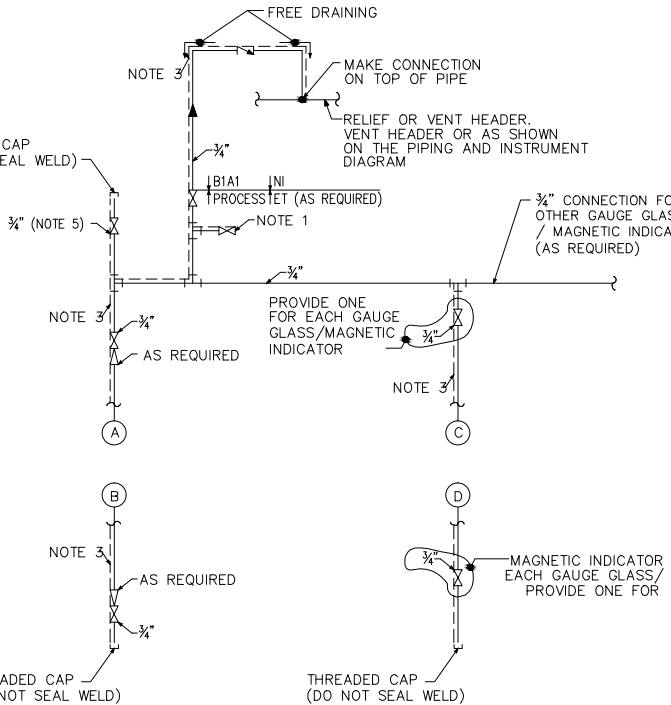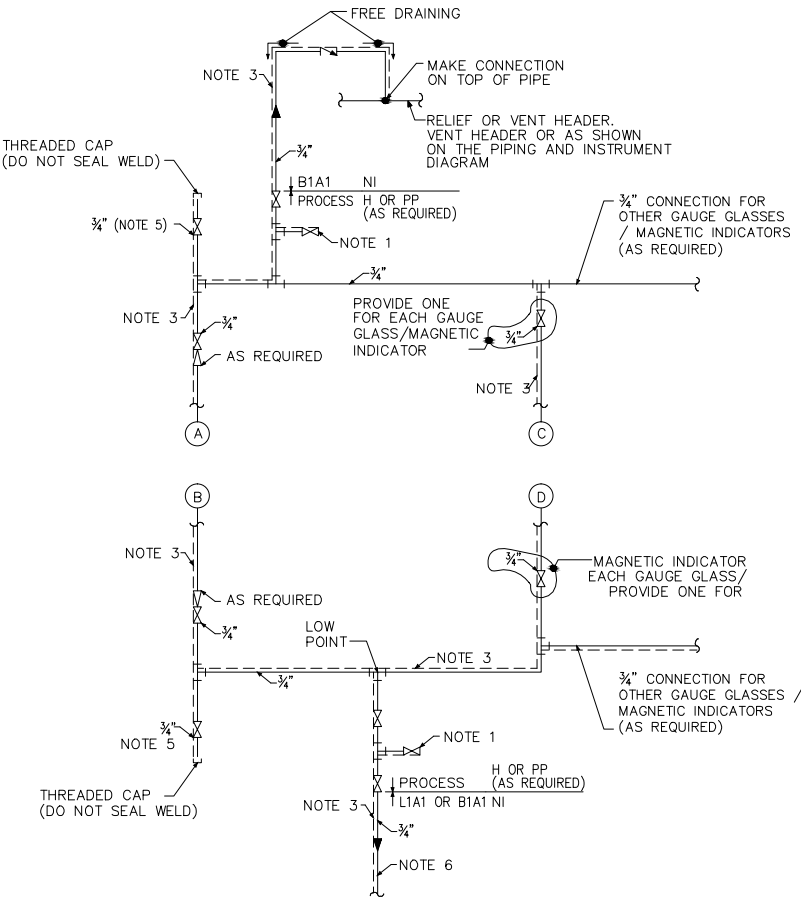

EQUIPMENT NO.	P&ID NO.	ITEM NO.	VENT LINE NO.	DRAIN LINE NO.	SUMP NO.
D-2306	14780-8120-25-23-0020	LGR-2003	3/4"-F-92-056138-L1A1/B1A1-NI	3/4"-AD-23-020012-L1A1-NI	D-2307

EQUIPMENT NO.	P&ID NO.	ITEM NO.	VENT LINE NO.

EQUIPMENT NO.	P&ID NO.	ITEM NO.	DRAIN LINE NO.	SUMP NO.
D-2301	14780-8120-25-23-0006	LGR-0602	3/4"-CHD-23-006015-B1A1-NI/C	D-2206
SAMPLE RECEIVER	14780-8120-25-23-0007	LGR-0703	3/4"-CHD-23-007015-L1A1-NI/H(*)	D-2206
E-2301	14780-8120-25-23-0008A	LGR-0804	3/4"-CHD-23-008041-L1A1-NI	D-2206
D-2302	14780-8120-25-23-0011	LGR-1102	3/4"-CHD-23-011005-B1A1-NI	D-2206
D-2303	14780-8120-25-23-0012A	LGR-1202	3/4"-AD-23-012006-B1A1-NI	D-2307
D-2304	14780-8120-25-23-0013	LGR-1304	3/4"-AD-23-013010-L2A1/L1A1-NI	D-2307

GENERAL NOTES

- SHOWN ON PIPING AND INSTRUMENT DIAGRAM
- === HEAT TRACE AND INSULATE

NOTES

- 3/4" PLUGGED UTILITY CONNECTION.
- VALVES AND PIPING SHALL BE OF THE SAME METALLURGY TYPE AND CLASS AS SHOWN ON THE PIPING AND INSTRUMENT DIAGRAM. SPECIAL VALVE TRIM REQUIREMENTS INDICATED AT LEVEL ASSEMBLIES ON THE PIPING AND INSTRUMENT DIAGRAM SHALL ALSO APPLY TO THE VENT AND DRAIN ASSEMBLY VALVES.
- THE REQUIREMENT FOR HEAT TRACING AND INSTALLATION AND THE OBJECTIVE TEMPERATURE SHALL BE AS SHOWN AT THE LEVEL INSTRUMENT SERVICE ON THE PIPING AND INSTRUMENT DIAGRAM.
- DO NOT SEAL WELD TREADED PIPING WHERE IT IS ATTACHED TO THE LEVEL INSTRUMENT.
- VALVE IS REQUIRED FOR ASME FLANGE CLASS 900, 1500 AND 2500 AND OPTIONAL FOR ASME FLANGE CLASS 150, 300 AND 600.
- TO CLOSE DRAIN HEADER OR AS SHOWN ON PIPING AND INSTRUMENT DIAGRAM.
- (*) : INSULATION FOR PIPING CONTAINING MORE THAN 5WT% CHP MUST MEET SPECIAL REQUIREMENTS. SEE PROJECT SPECIFICATION 907 FOR DETAILS.



THIS DRAWING IS CONFIDENTIAL PROPERTY OF PTT PHENOL COMPANY LIMITED

AND IS LENT WITHOUT CONSIDERATION OTHER THAN THE BORROWER'S AGREEMENT THAT IT SHALL NOT BE RE-PRODUCED, COPIED, LENT, OR DISPOSED OF DIRECTLY OR INDIRECTLY NOR USED FOR ANY PURPOSE OTHER THAN THAT FOR WHICH IT IS SPECIFICALLY FURNISHED. THE APPARATUS SHOWN IN THE DRAWING MAY BE COVERED BY PATENTS AND/OR MAY BE PROPRIETARY

uop BASED ON

PIPING AND INSTRUMENT DIAGRAM
DETAIL OF LEVEL INSTRUMENT VENT / DRAIN
CONCENTRATION, DECOMPOSITION AND NEUTRALIZATION
SECTION UOP PHENOL PROCESS UNIT

REV.	DESCRIPTION	BY	CHK.	APPR.	DATE
Z1	AS BUILT	HSO	SWP	JSC	SWL 4/25/16
FS4-1	ISSUED FOR CONSTRUCTION NO HOLDS	HSO	SWP	JSC	SWL 12/28/14
S4	ISSUED FOR CONSTRUCTION NO HOLDS	HSO	SWP	JSC	SWL 10/15/14
S3	ISSUED FOR CONSTRUCTION NO HOLDS	HSO	SWP	JSC	SWL 10/8/14
S2	ISSUED FOR CONSTRUCTION NO HOLDS	HSO	SWP	JSC	SWL 9/16/14
S1	ISSUED FOR CONSTRUCTION NO HOLDS	HSO	SWP	JSC	SWL 8/20/14
R2	ISSUED FOR CONSTRUCTION WITH HOLDS	HSO	SWP	JSC	SWL 4/4/14
R1	ISSUED FOR CONSTRUCTION WITH HOLDS	HSO	SWP	JSC	SWL 2/28/14

BY	DATE	DWG.	DSGN.	CHK.	APPR.

SCALE