




Stabilized amplitude spectrum for ds3564 ch 490 (calibration_TGS)

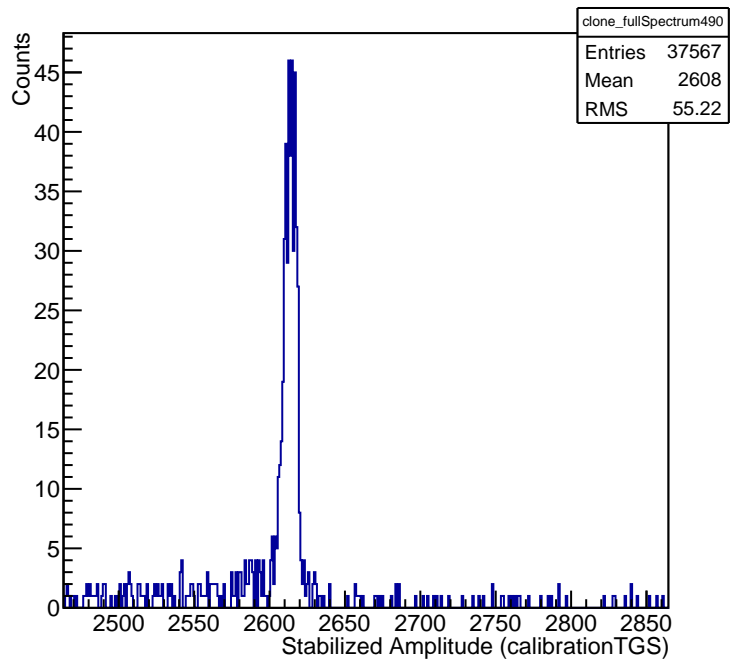

Fit of peak for energy 2615 keV

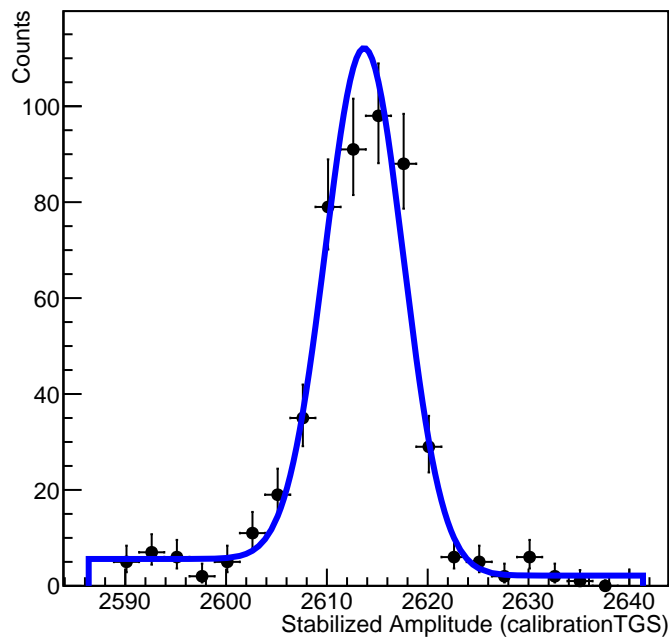

Residuals for ch490

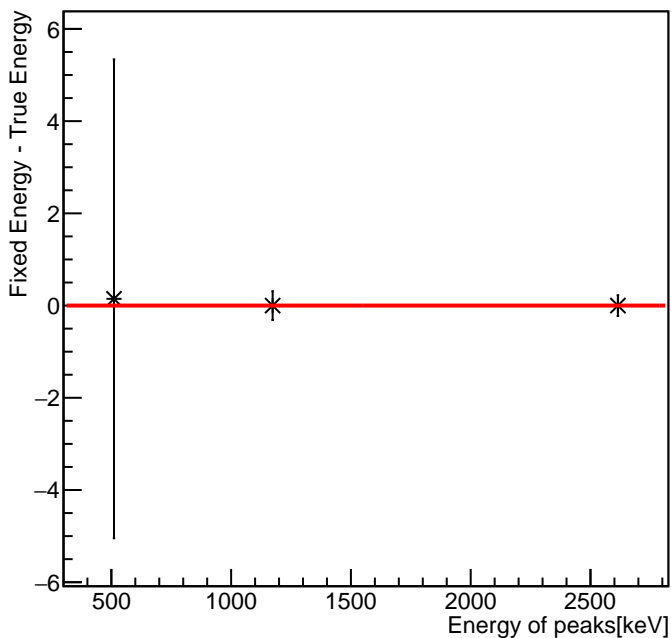

Calibration fit function for ch 490

