Stabilized amplitude spectrum for ds3522 ch 123 (calibration_TGS)

clone_fullSpectrum123	
Entries	21404
Mean	876.5
RMS	102.6
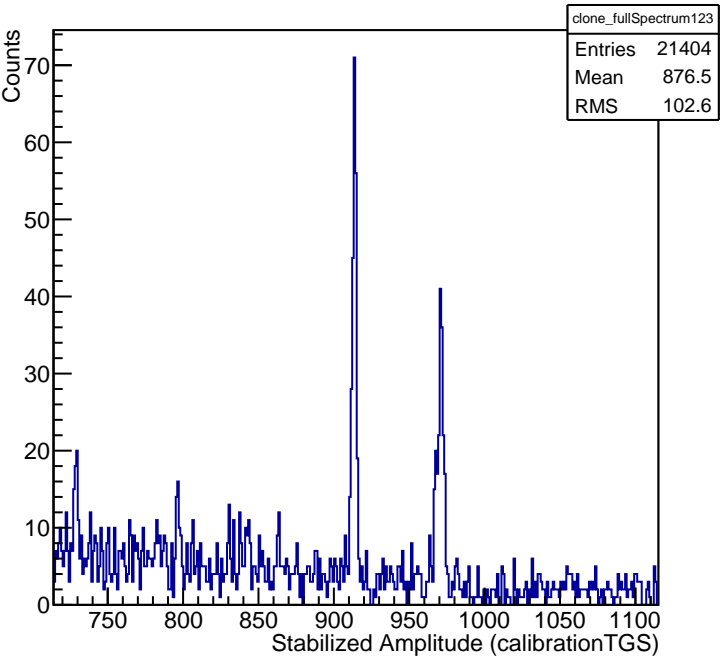
Fit of peak for energy 911 keV
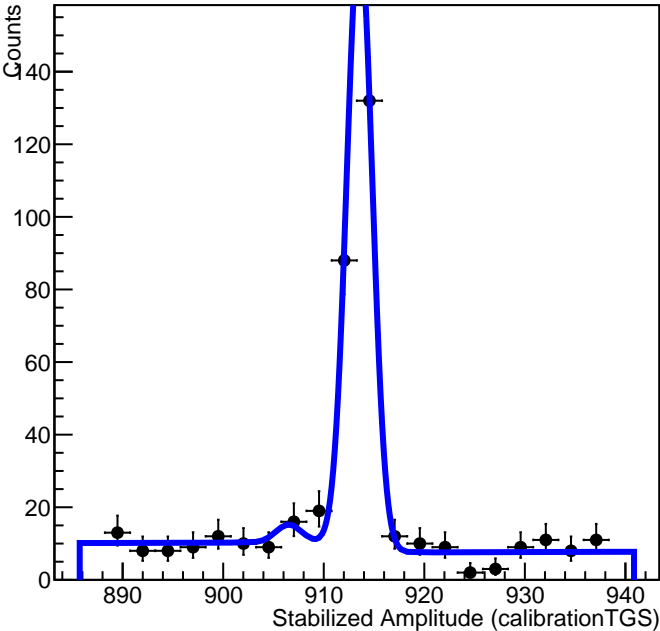
Residuals for ch123
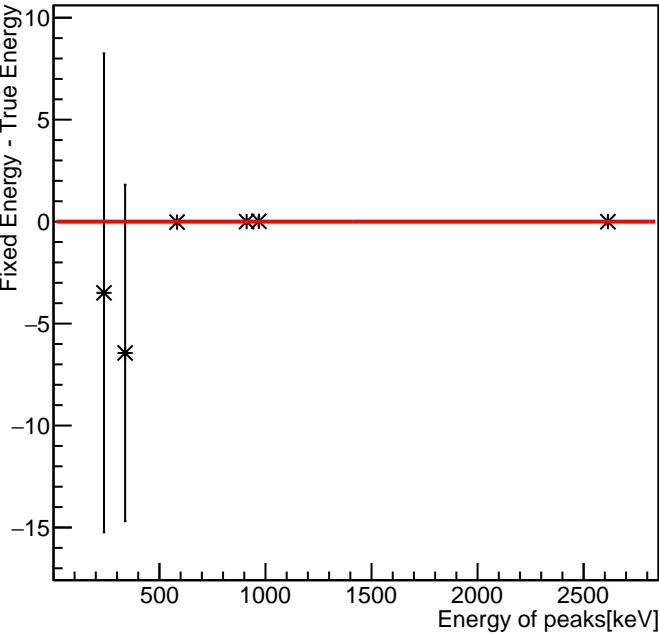
Calibration fit function for ch 123