




Stabilized amplitude spectrum for ds3519 ch 445 (calibration\_TGS)

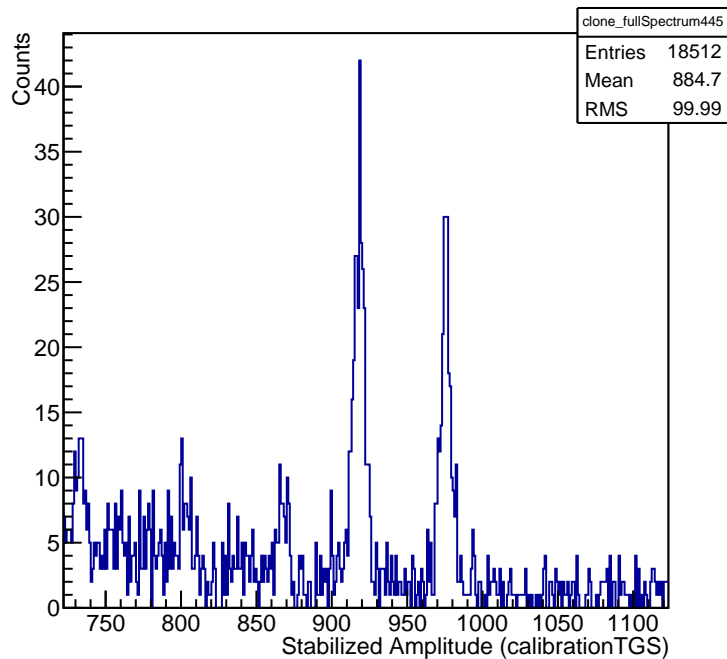

Fit of peak for energy 911 keV

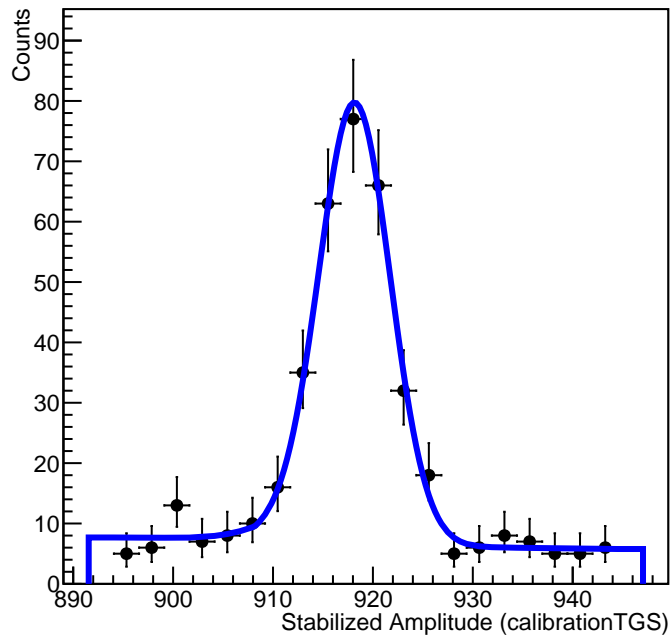

Residuals for ch445

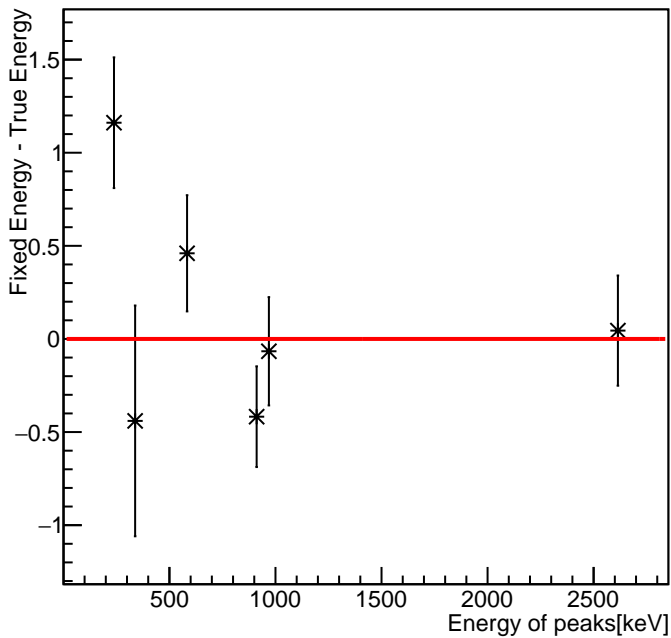

Calibration fit function for ch 445

