Stabilized amplitude spectrum for ds3522 ch 152 (calibration_TGS)

clone_fullSpectrum152	
Entries	34201
Mean	886
RMS	98.74
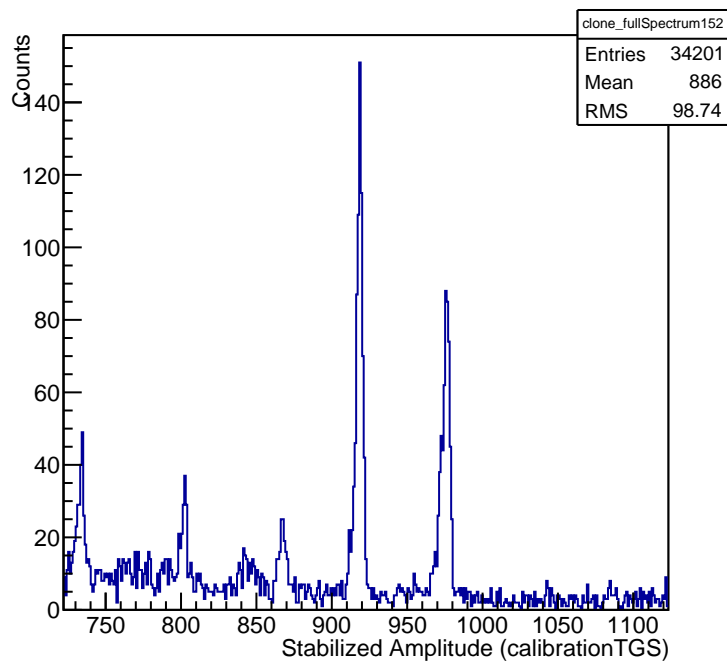
Fit of peak for energy 911 keV
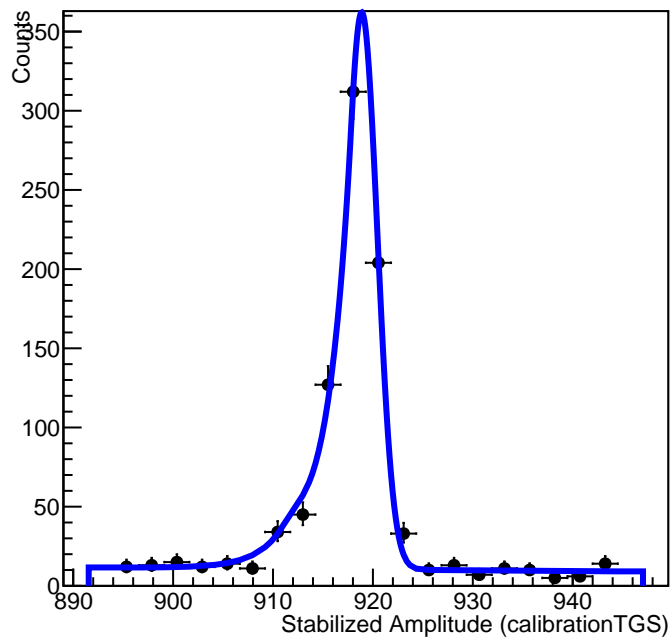
Residuals for ch152
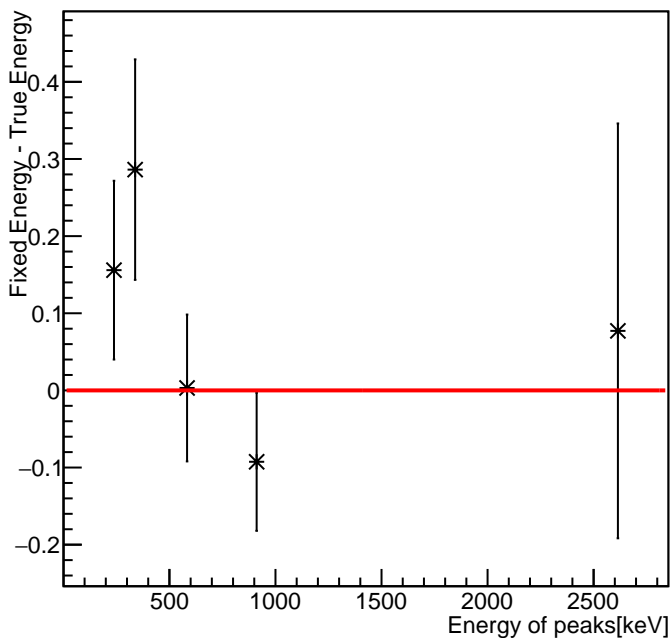
Calibration fit function for ch 152