Stabilized amplitude spectrum for ds3564 ch 192 (calibration_TGS)

clone_fullSpectrum192	
Entries	39386
Mean	2603
RMS	65.22

Counts

Stabilized Amplitude (calibrationTGS)
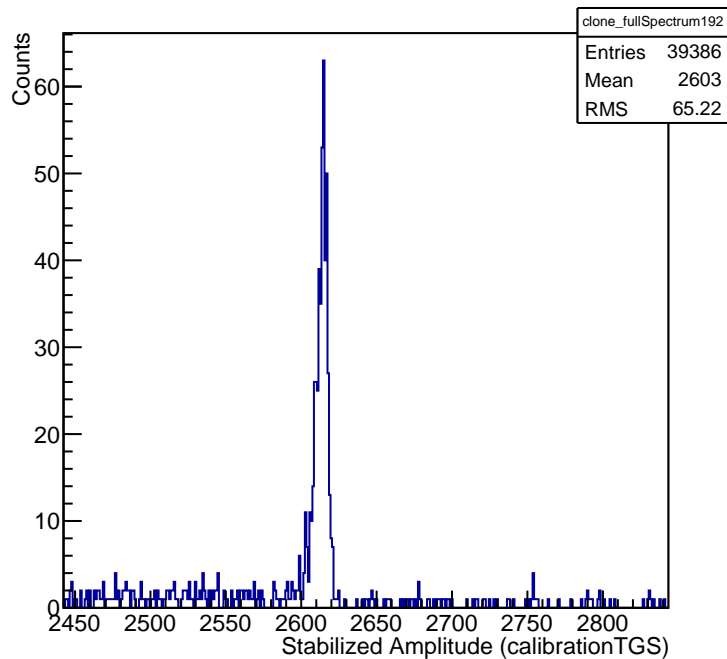
Fit of peak for energy 2615 keV

Counts

Stabilized Amplitude (calibrationTGS)

Residuals for ch192

Fixed Energy - True Energy

Energy of peaks[keV]
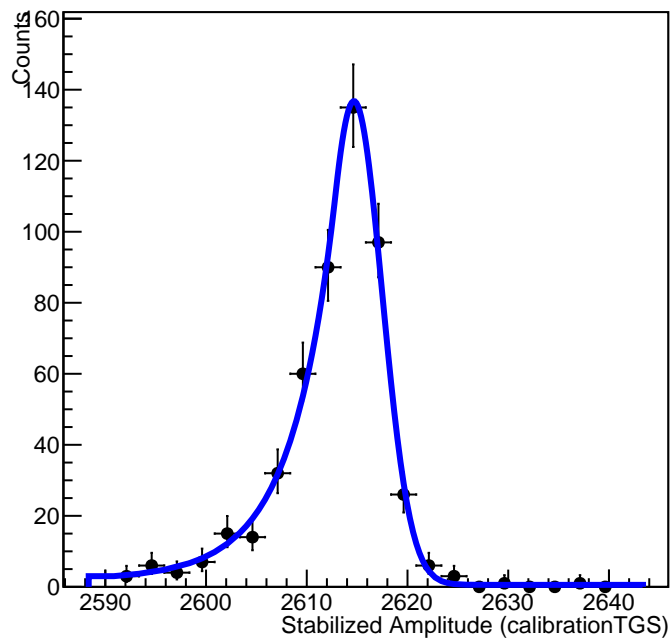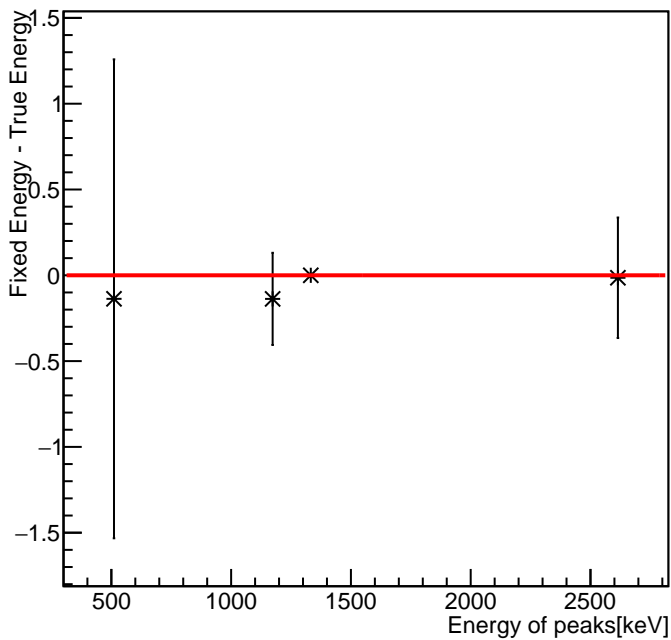
Calibration fit function for ch 192

Energy[keV]

Stabilized Amplitude (calibration_TGS)