




Stabilized amplitude spectrum for ds3519 ch 360 (calibration\_TGS)

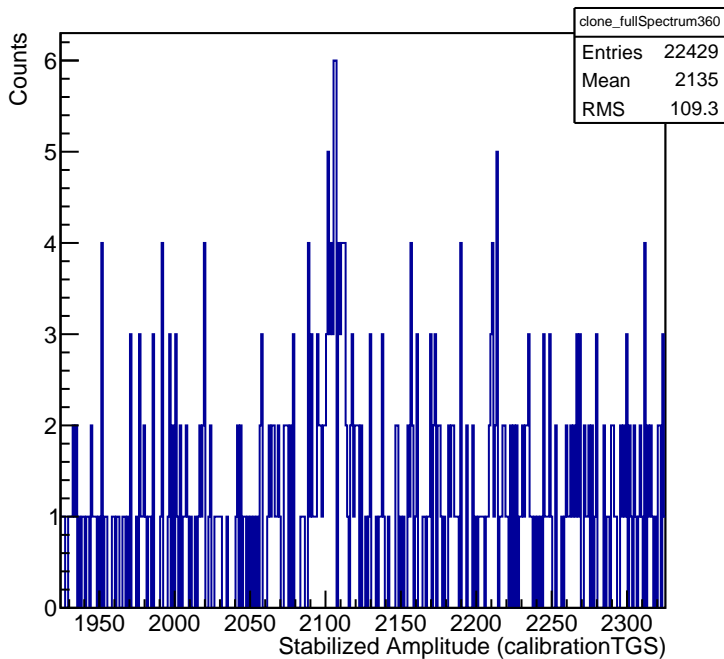

Fit of peak for energy 969 keV

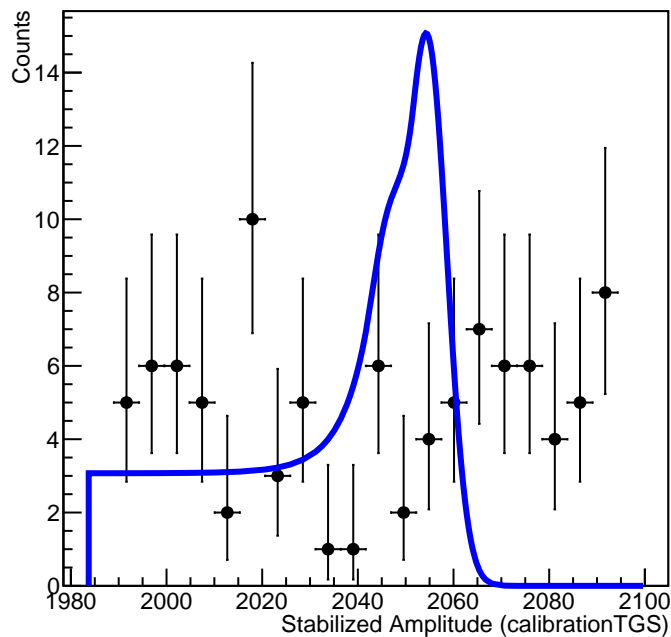

Residuals for ch360

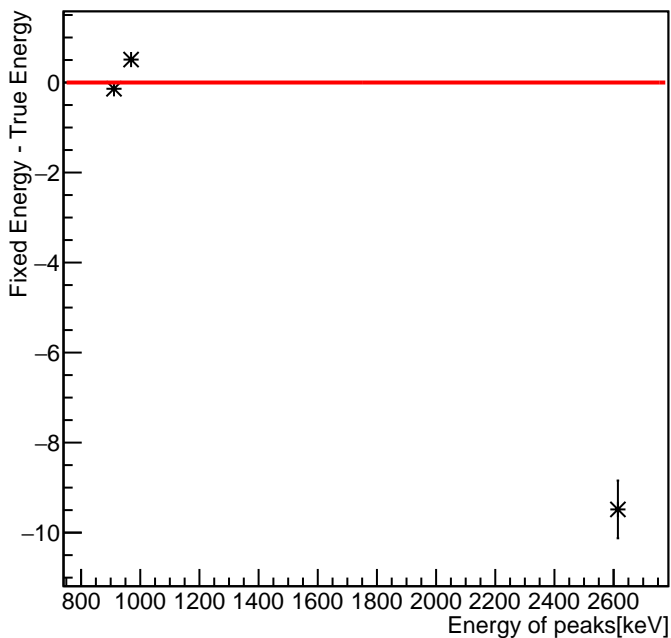

Calibration fit function for ch 360

