




Stabilized amplitude spectrum for ds3519 ch 445 (calibration_TGS)

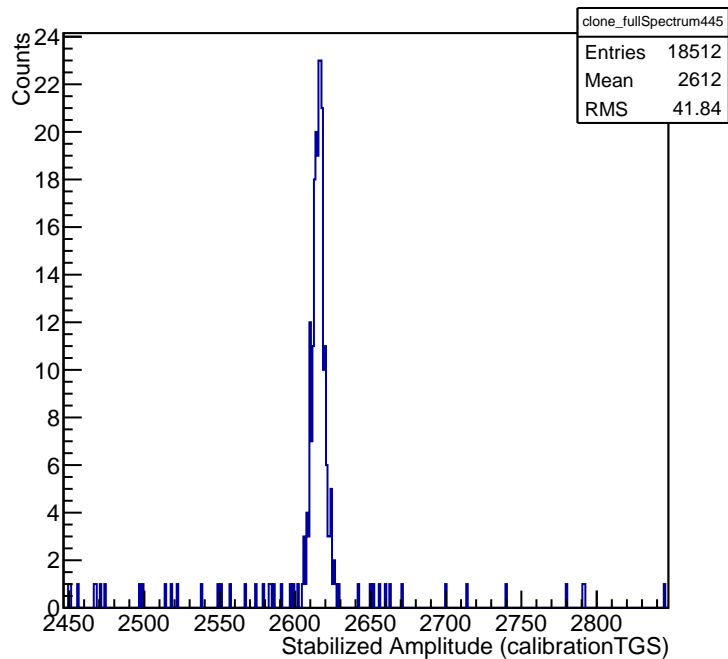

Fit of peak for energy 2615 keV

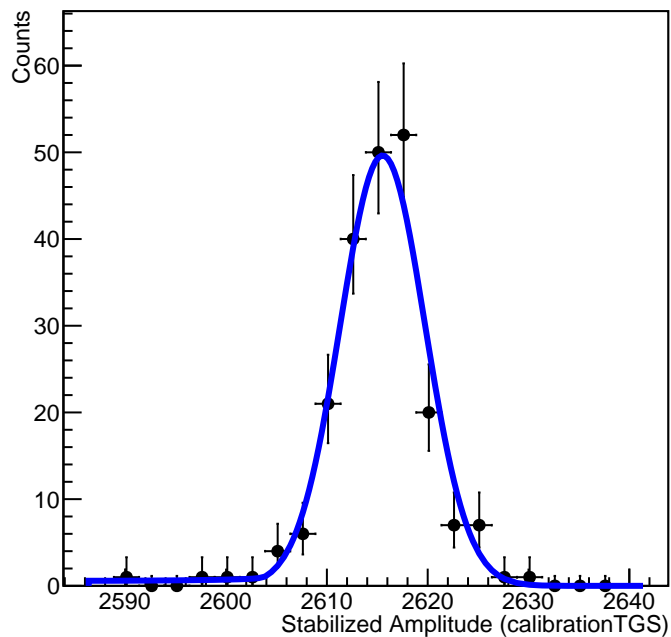

Residuals for ch445

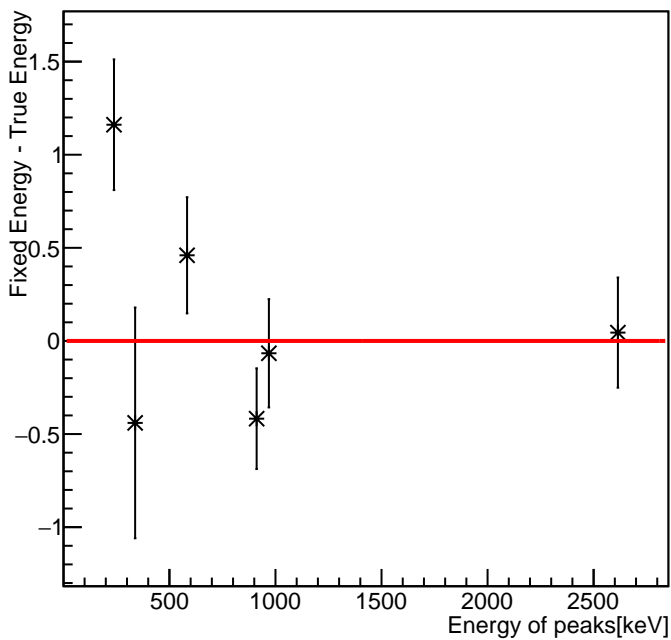

Calibration fit function for ch 445

