




Stabilized amplitude spectrum for ds3564 ch 90 (calibration_TGS)

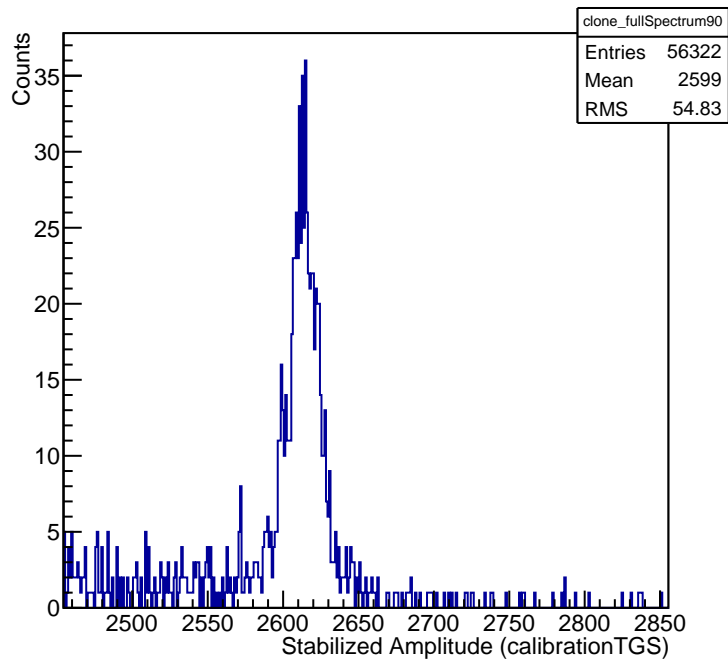

Fit of peak for energy 2615 keV

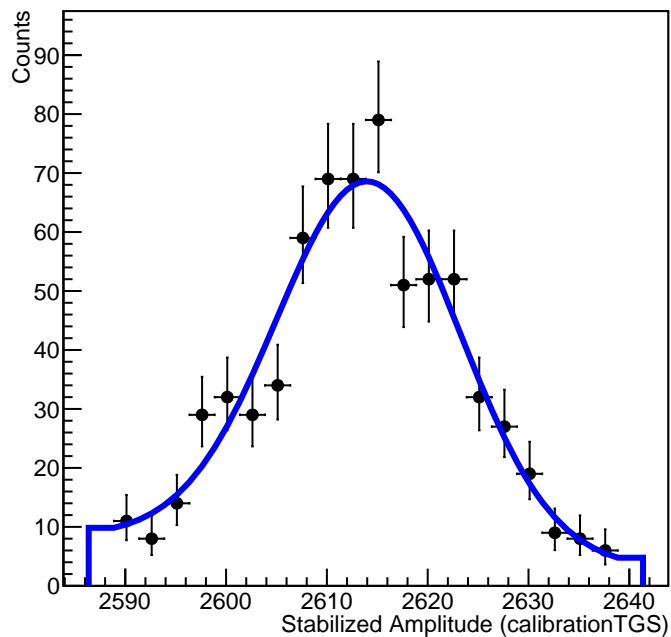

Residuals for ch90

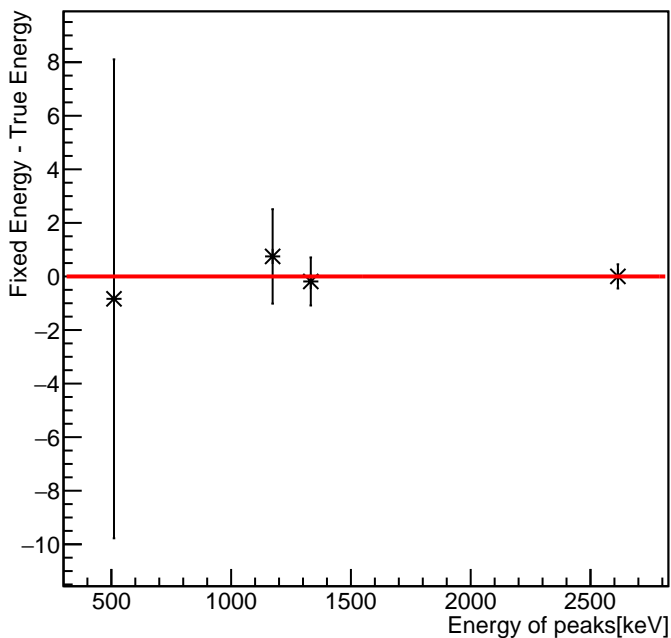

Calibration fit function for ch 90

