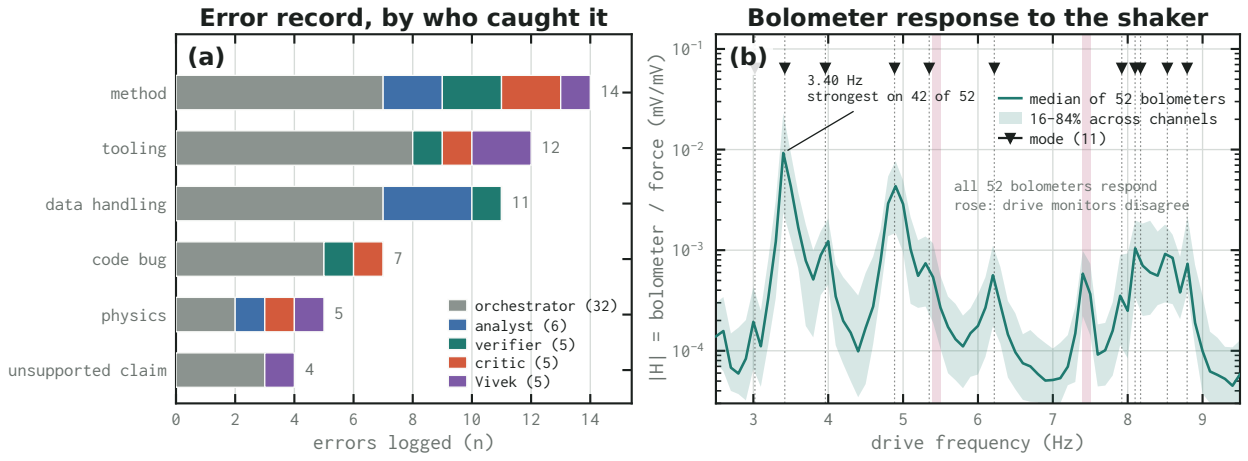
Error record, by who caught it
(a)
method
tooling
data handling
code bug
physics
unsupported claim
14
12
11
7
5
4
orchestrator (32)
analyst (6)
verifier (5)
critic (5)
Vivek (5)
0
2
4
6
8
10
12
14
errors logged (n)
Bolometer response to the shaker
(b)
3.40 Hz
strongest on 42 of 52
median of 52 bolometers
16–84% across channels
mode (11)
all 52 bolometers respond
rose: drive monitors disagree
|H| = bolometer / force (mV/mV)
10^{-1}
10^{-2}
10^{-3}
10^{-4}
3
4
5
6
7
8
9
drive frequency (Hz)