


# 2WFB-6

WALL TO WALL FIRE BARRIER  
2 HOUR RATED - 100% MOVEMENT  
MAXIMUM OPENING 12" (305mm)

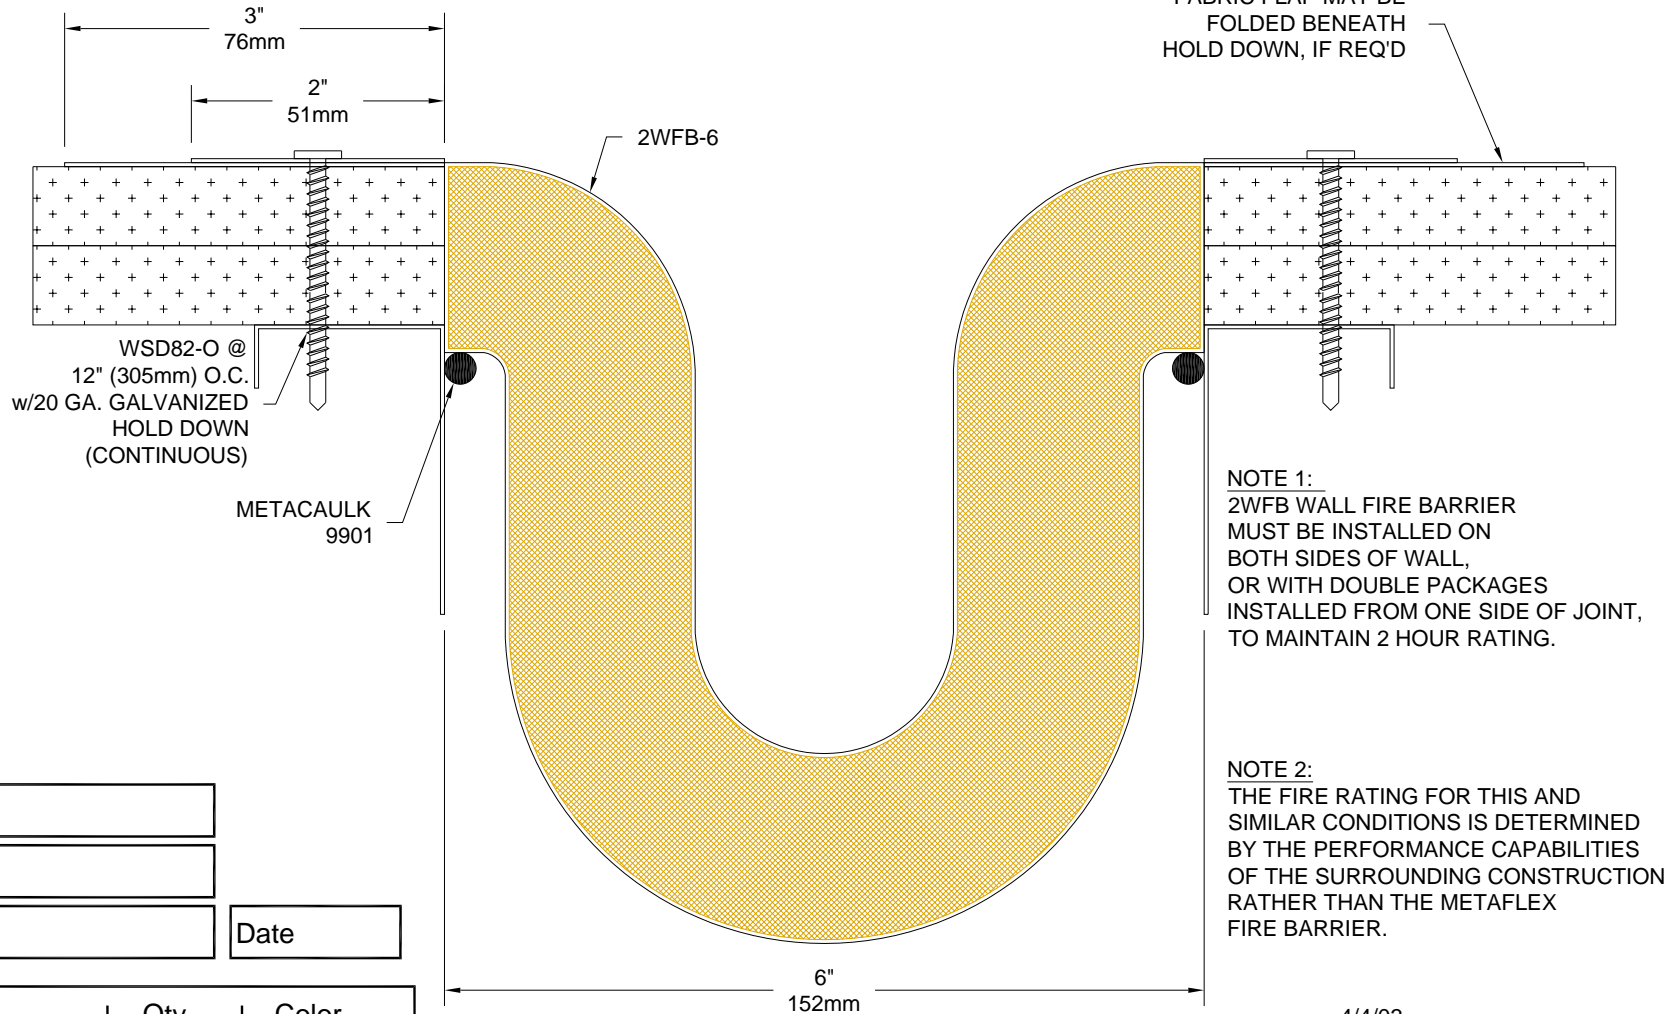

**NOTE 1:**  
2WFB WALL FIRE BARRIER  
MUST BE INSTALLED ON  
BOTH SIDES OF WALL,  
OR WITH DOUBLE PACKAGES  
INSTALLED FROM ONE SIDE OF JOINT,  
TO MAINTAIN 2 HOUR RATING.

**NOTE 2:**  
THE FIRE RATING FOR THIS AND  
SIMILAR CONDITIONS IS DETERMINED  
BY THE PERFORMANCE CAPABILITIES  
OF THE SURROUNDING CONSTRUCTION  
RATHER THAN THE METAFLEX  
FIRE BARRIER.

4/4/03

Project

Customer

SO#

Date

| Length | Qty. | Color |
|--------|------|-------|
|        |      |       |
|        |      |       |
|        |      |       |
|        |      |       |
|        |      |       |

Scale: NTS



2626 S. Sheridan PO Box 17249  
Wichita, Kansas 67217-0249 USA  
P: +1-316-945-9328 F: +1-316-945-0789