


2WFB-16.5

WALL TO WALL FIRE BARRIER
2 HOUR RATED - 100% MOVEMENT
MAXIMUM OPENING 33" (838mm)

- A MINIMUM WALL THICKNESS OF 12" (305mm) IS REQ'D FOR THIS SYSTEM

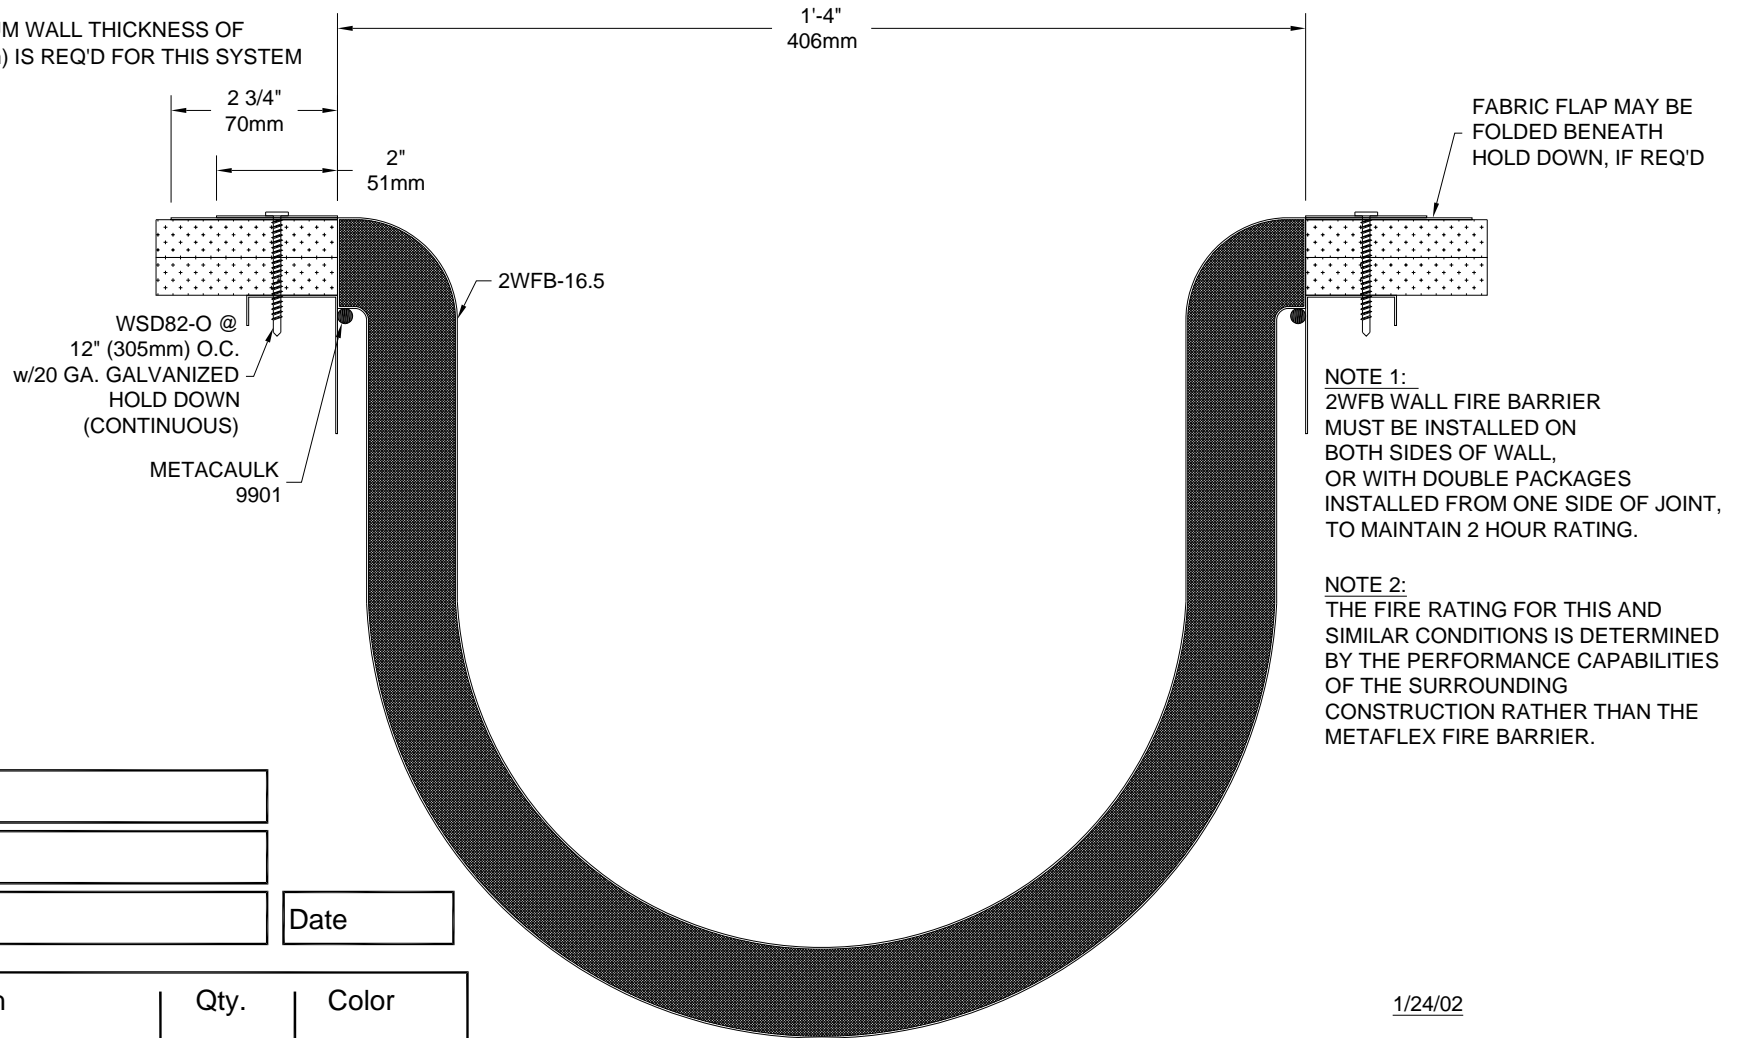

Project

Customer

SO#

Date


Length

Qty.

Color

Page ____ of ____

Scale: NTS



BALCO INC

2626 S. Sheridan PO Box 17249
Wichita, Kansas 67217-0249 USA
P: +1-316-945-9328 F: +1-316-945-0789