


2WFB-2

WALL TO WALL FIRE BARRIER
2 HOUR RATED - 100% MOVEMENT
MAXIMUM OPENING 4" (102mm)

NOTE 1:

2WFB WALL FIRE BARRIER
MUST BE INSTALLED ON
BOTH SIDES OF WALL,
OR WITH DOUBLE PACKAGES
INSTALLED FROM ONE SIDE OF JOINT,
TO MAINTAIN 2 HOUR RATING.

FOR OFFICE USE ONLY

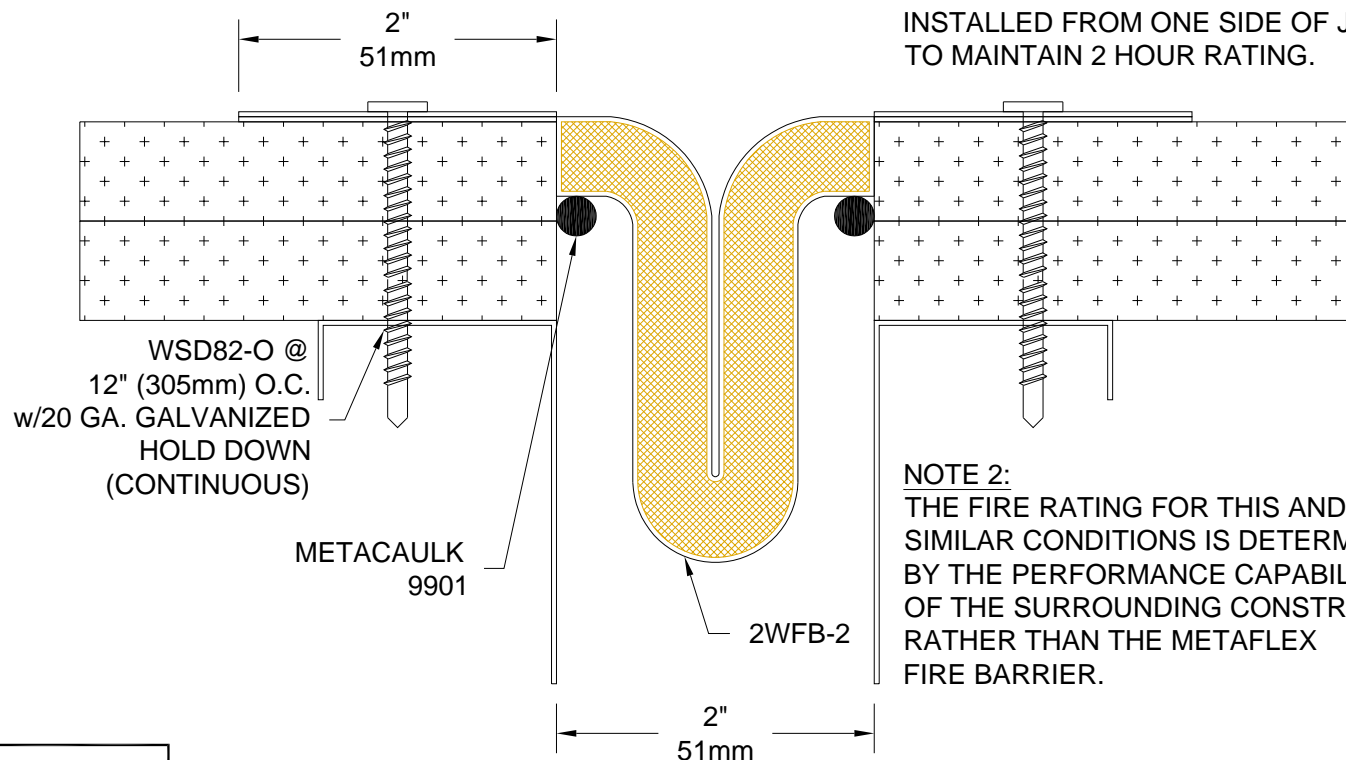

NOTE 2:

THE FIRE RATING FOR THIS AND
SIMILAR CONDITIONS IS DETERMINED
BY THE PERFORMANCE CAPABILITIES
OF THE SURROUNDING CONSTRUCTION
RATHER THAN THE METAFLEX
FIRE BARRIER.

Project

Customer

SO#


Date

Page ____ of ____

Length	Qty.	Color

Scale: NTS

4/4/03



BALCO INC

2626 S. Sheridan PO Box 17249
Wichita, Kansas 67217-0249 USA
P: +1-316-945-9328 F: +1-316-945-0789