


## 2WFB-18

WALL TO WALL FIRE BARRIER  
2 HOUR RATED - 100% MOVEMENT  
MAXIMUM OPENING 36" (914mm)

- A MINIMUM WALL THICKNESS OF 12" (305mm) IS REQ'D FOR THIS SYSTEM

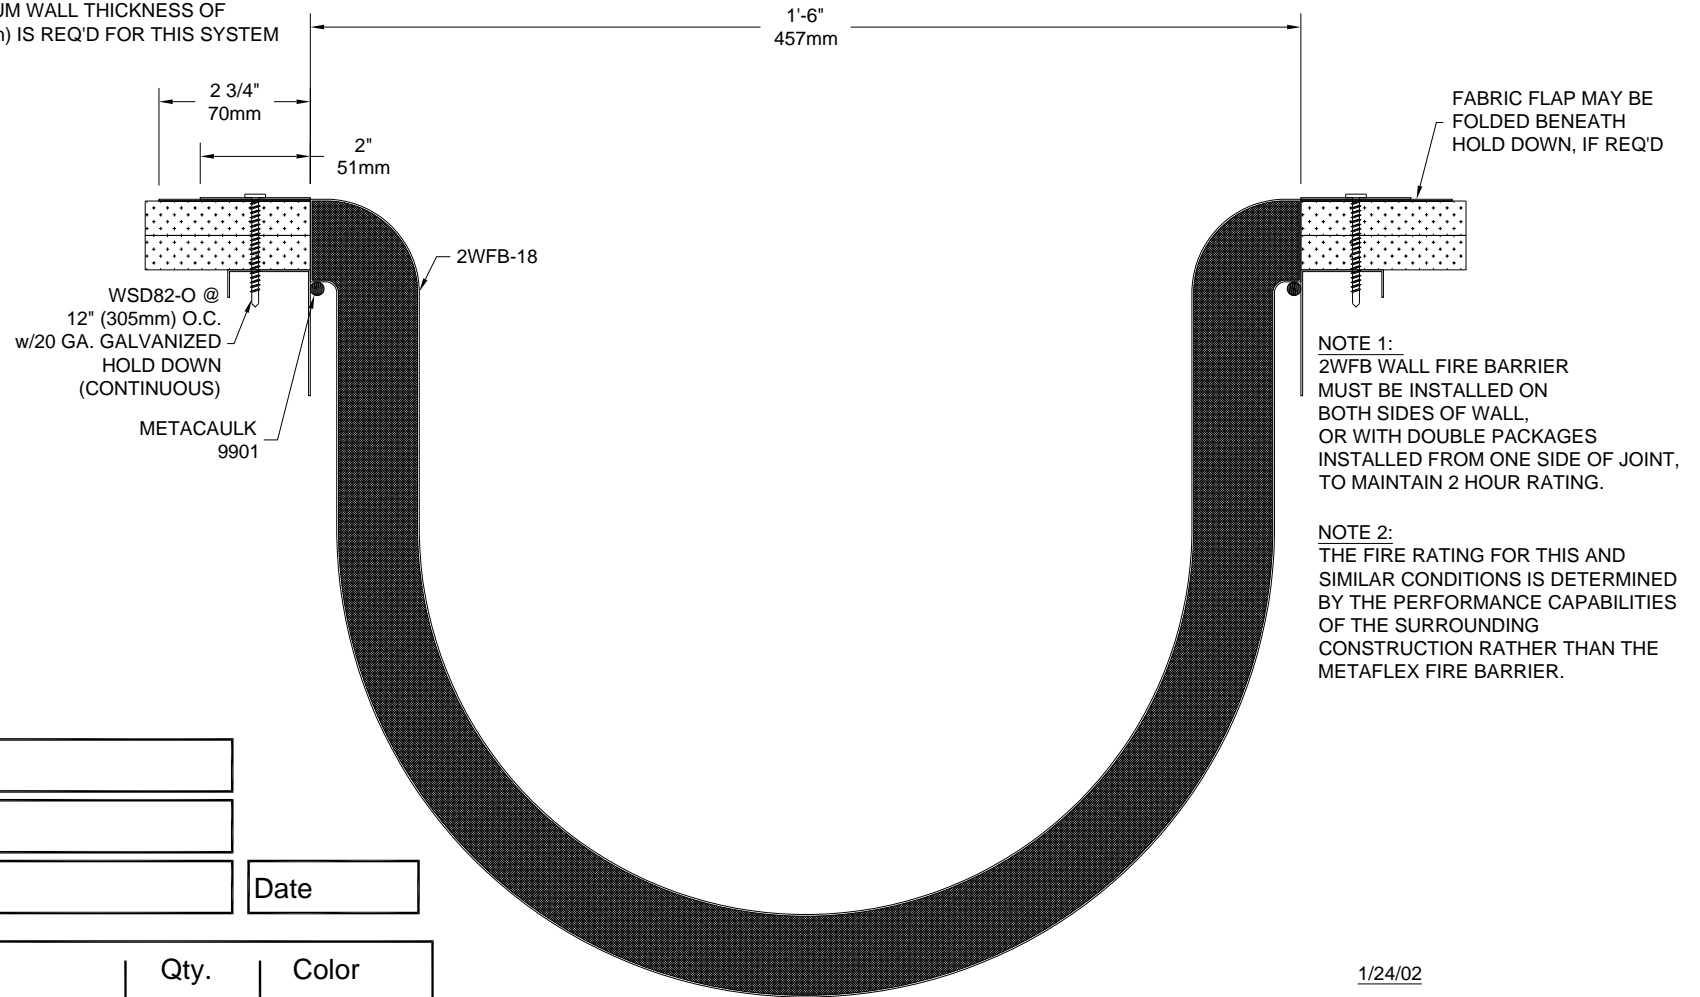

Project

Customer

SO#

Date

Length	Qty.	Color

Page \_\_\_\_ of \_\_\_\_

Scale: NTS



2626 S. Sheridan PO Box 17249  
Wichita, Kansas 67217-0249 USA  
P: +1-316-945-9328 F: +1-316-945-0789