


2WFB-3

WALL TO WALL FIRE BARRIER
2 HOUR RATED - 100% MOVEMENT
MAXIMUM OPENING 6" (152mm)

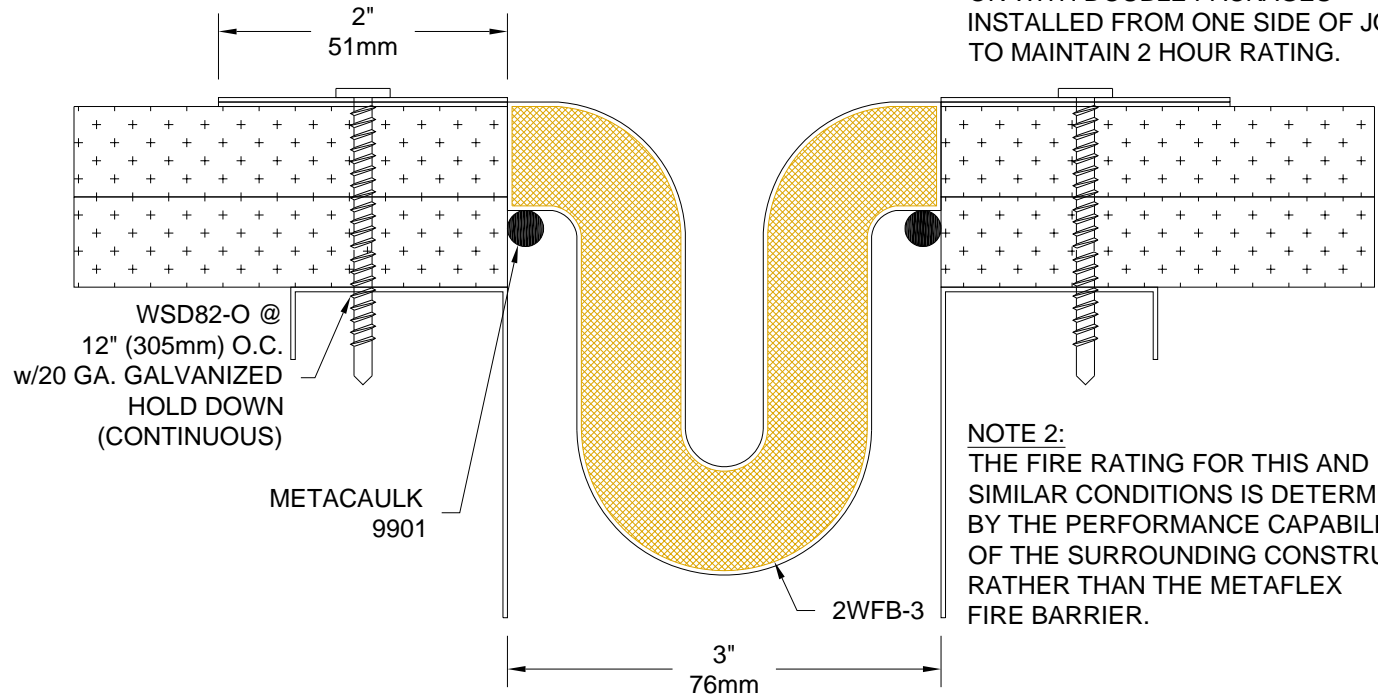

NOTE 1:

2WFB WALL FIRE BARRIER
MUST BE INSTALLED ON
BOTH SIDES OF WALL,
OR WITH DOUBLE PACKAGES
INSTALLED FROM ONE SIDE OF JOINT,
TO MAINTAIN 2 HOUR RATING.

NOTE 2:

THE FIRE RATING FOR THIS AND
SIMILAR CONDITIONS IS DETERMINED
BY THE PERFORMANCE CAPABILITIES
OF THE SURROUNDING CONSTRUCTION
RATHER THAN THE METAFLEX
FIRE BARRIER.

FOR OFFICE USE ONLY

Project

Customer

SO#

Date

Page ____ of ____

Length	Qty.	Color

Scale: NTS

4/4/03



2626 S. Sheridan PO Box 17249
Wichita, Kansas 67217-0249 USA
P: +1-316-945-9328 F: +1-316-945-0789