

MW2H04

METAMAT WALL TO WALL
2 HOUR RATED FIRE BARRIER SYSTEM
UL LISTINGS: WW-D-0069, WW-D-0073
MAX OPEN = 4" (102mm)

PATENTS PENDING

APPLICATION:

FOR USE WITH ALL WALL EXPANSION JOINT
COVERS WITH ANCHORS AT 10" (254mm) O.C.

NOTES:


FIRE BARRIER MUST BE INSTALLED ON
BOTH SIDES OF WALL OR WITH DOUBLE
PACKAGES INSTALLED FROM ONE SIDE OF
JOINT TO MAINTAIN FIRE
RATING.

FIRE RATING IS DETERMINED NOT ONLY BY
THE METAMAT FIRE BARRIER, BUT ALSO THE
PERFORMANCE CAPABILITIES OF THE
SURROUNDING CONSTRUCTION

LENGTHS:

AVAILABLE IN 20FT, 40FT AND 80FT ROLLS

PLEASE SPECIFY: _____

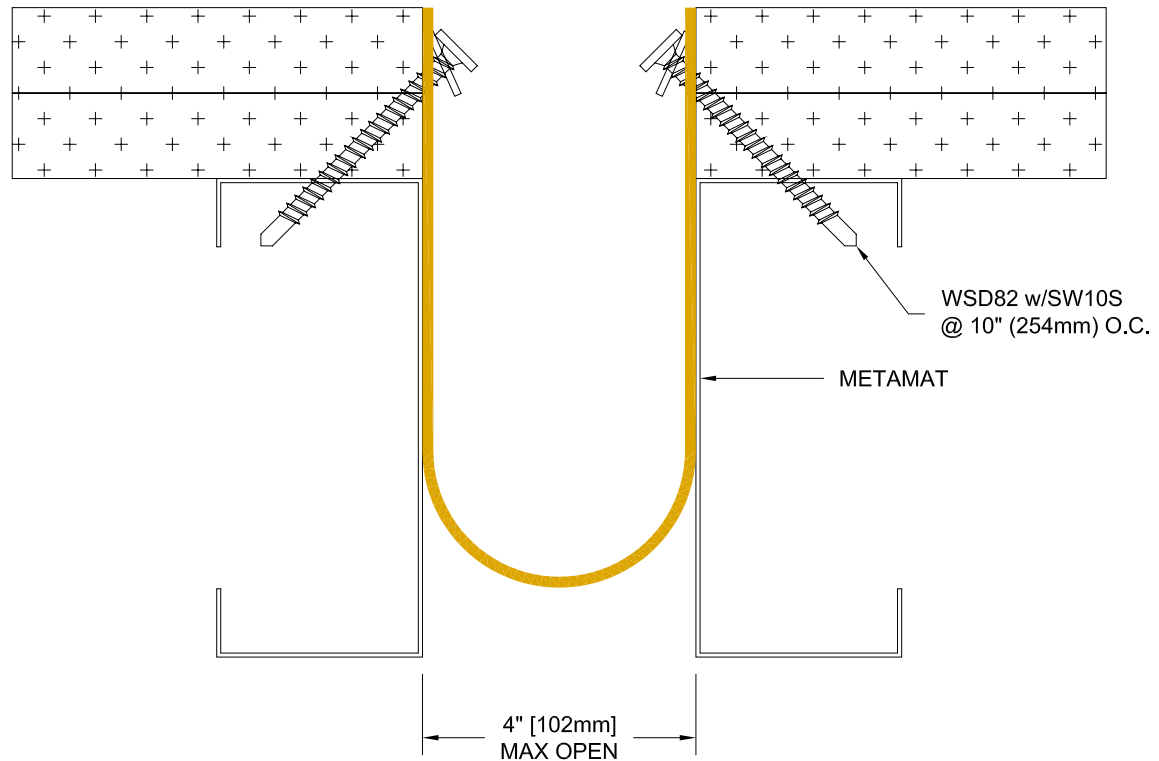

Project:

Customer:

SO#

Date:

Page ____ of ____

Scale: NTS


Length

Qty.

Color

Drawn By: JMH

The information contained herein is the proprietary property of **BALCO, INC.** No portion of it may be reproduced by any means or used in any form except for the purpose for which it was furnished. All rights of design and invention are hereby reserved.



BALCO INC

2626 S. Sheridan PO Box 17249
Wichita, Kansas 67217-0249 USA
P: +1-316-945-9328 F: +1-316-945-0789