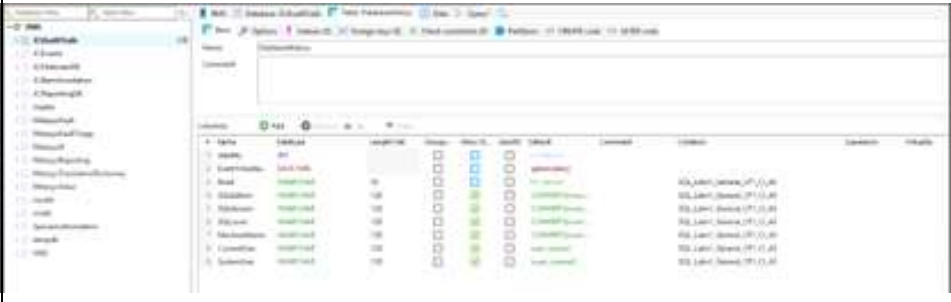


No	Questions for RMIT	Answer from RMIT
1	In your responses to questions 7 and 10, there is a discrepancy regarding latency (1 minute vs. 5 minutes). Could you clarify which is the correct target?	Final answer: 5 minutes
2	Regarding the table in Answer 3: does this represent the actual system latencies or is it an illustrative example? If these reflect the current system, the 1-to-5-minute latency requirements for Power BI dashboards may be difficult to guarantee.	Please recommend the fastest latency
3	Regarding Hosting: Since the BMS and PME servers are on-premises, where should the new core application components (databases, workflow engine, and APIs) reside? Should we plan for on-premises deployment or utilize your Azure cloud environment?	Azure cloud is not preferable
4	Teams Integration: You mentioned using Power Automate to record findings and send notifications via Microsoft Teams. Would you like our custom Notification Service to integrate with Microsoft Teams to replicate this functionality, or should we stick strictly to automated email notifications as requested in the original Statement of Requirements?	Via email notifications
5	What protocols are available for data extraction (BACnet/IP, Modbus TCP, OPC-UA, REST API)?	BACnet/IP and Modbus
6	What BMS platform(s) are in use (brand, version)? Is an API or database export available?	Johnson control
7	What CMMS is currently deployed? Is an API or database export available?	Archibus
8	Which version of Schneider PME (or equivalent) is installed? Is an API or database export available? How many meters/feeders are monitored	Schneider 20 meters on-site
9	Are there existing IoT sensors deployed beyond BMS and PME? If so, what platforms/protocols do they use?	No
10	What is unacceptable threshold for possible data loss when ingest data from BMS, PME, CMMS?	The acceptable threshold is typically less than 1–2%. Any data loss beyond these limits should trigger immediate investigation and corrective actions.
11	Data volume - what is an approximate size of the data in GB for CMMS?	
12	And what is a rough number of records/readings/data points for CMMS PME BMS	
13	Which meters and other offline equipment identification method is required for technicians: QR code/NFC scanning or manual selection from an on-screen list?	QR code, but need a backup way (ID number...) in case the QR code is damaged or can not be scanned
14	Do you need to be able to fill data to the platform when internet is unstable?	No, we do not
15	How many of current Power BI dashboards should be reviewed and centralized?	The current dashboard has one main page and 8 sub.
16	For historical trends: does migration of legacy data is needed?	Yes, it is needed
17	What is the current state of API documentation for the existing BMS, PME, and CMMS systems?	No connect among them. So, we propose
18	Does RMIT prefer the solution to be hosted on-premises or within your existing Azure cloud environment?	Currently, RMIT SERVERS (1 FOR BMS, 1 FOR PME) are on-premises
19	What is the required data polling frequency or maximum allowable latency for the real-time Power BI dashboards?	Please refer to the example below. Alternatively, feel free to suggest similar buildings that are operating smoothly without any interruptions.
20	Is there a definitive list of all offline equipment locations and the total number of manual data entry points currently identified (the current manual process)?	We currently utilize 2 water meters and 14 checklists. However, please ensure the system can accommodate up to 5 pieces of equipment and 20 checklists for future expansion.
21	Tech stack - whether it's possible to use Java instead of .NET (C#) for the backend of the application	We prefer using .NET; however, we are also open to Java-based solutions

22	Data volume - what is an approxiamte size of the data in GB? And what is a rough number of records/readings/data points?	please view the attached folder " BMS DATA VOLUME" AND "PME DATA VOLUME"
23	"real-time dashboards" - is there a case for presenting streaming data from some sources (like updated in real time indications of an IoT sensor)? Or real-time means whenever a dashboard is updated it reflects the latest data (say the latest data is not older then a minute)?	That is correct. When the dashboard refresh button is clicked, it should display the most current data, with a maximum latency of one minute.
24	What is an estimated number of users for the system?	About 30 users
25	Kindly share us more info about the current process by Power Automate that are used further.	Power automate is using to record findings, then send out via teams. Below is one example. No automate for dashboard
26	The refresh time you are expecting "<5 mins" is the time when user presh the refresh button or refreshing time of power BI under sematic model? Are all users equiped with M365 E3 and above?	The expected < 5-minute refresh window applies to both manual user-initiated refreshes and scheduled updates within the semantic model. Furthermore, all relevant users are already onboarded to the Microsoft 365 ecosystem, ensuring full compatibility
27	About the item #3. Workflow Automation for FM Processes in tatement of Requirements, kindly provide us the flow-chart in the email that help us understand more. That is created by your organization or vendor?	Our existing process relies on manual email-based workflows. This 'back-and-forth' approach to approvals and modifications creates a bottleneck that could be resolved through centralized automation.