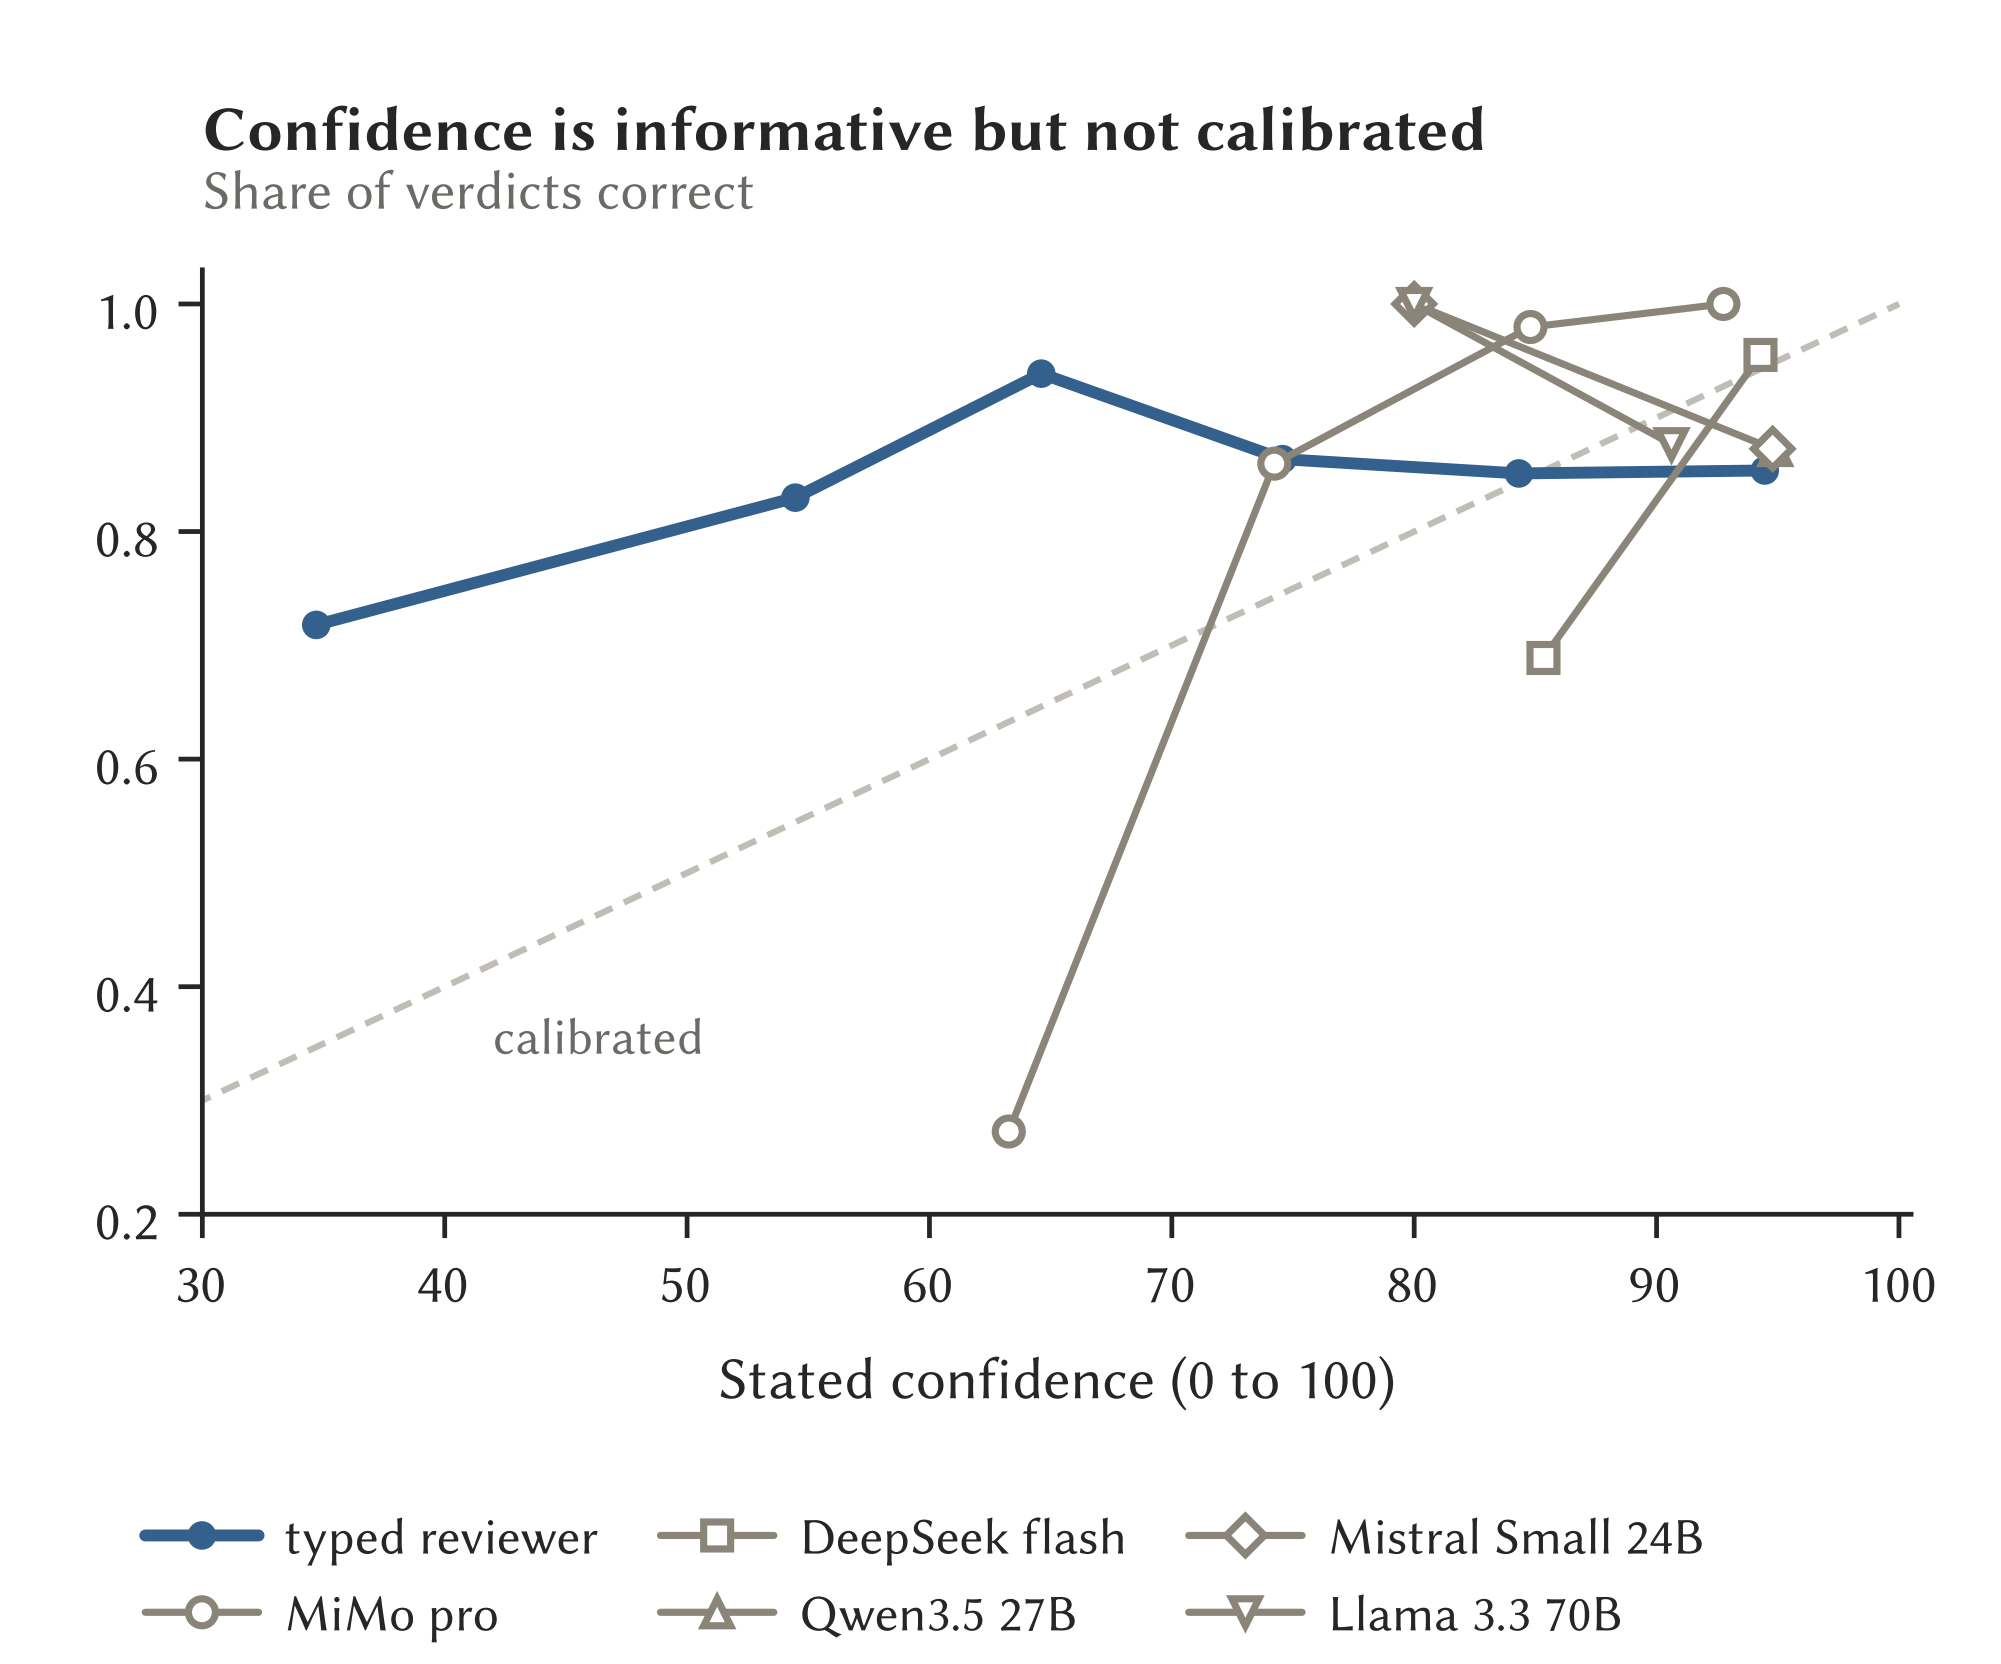
Confidence is informative but not calibrated
Share of verdicts correct
1.0
0.8
0.6
0.4
0.2
calibrated
30
40
50
60
70
80
90
100
Stated confidence (0 to 100)
typed reviewer
DeepSeek flash
Mistral Small 24B
MiMo pro
Qwen3.5 27B
Llama 3.3 70B