

Overview

Infrastructure

Energy

Reliability

Predictive

Cost & Carbon

Impact

facility_name

Ashburn East

Year

2015

430

Server Count

99.9970

Operational Availability

1,158

Incident Count

1.476

Average PUE


\$392M

Modeled Energy Cost


95.4

Live Facility Health Score

PUE trend | monthly, 2015–2025

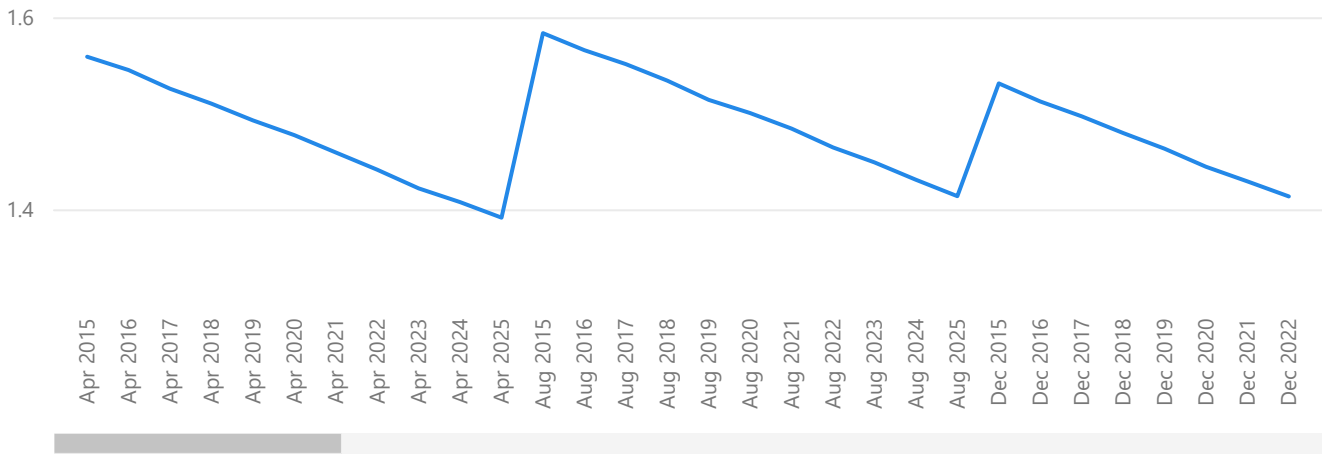


Downtime by facility | minutes

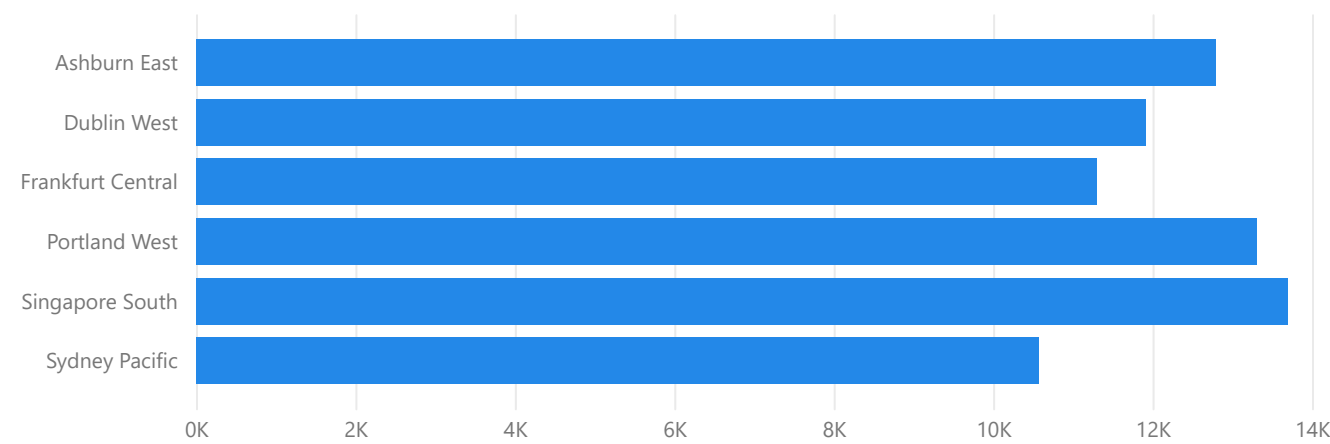

Facility operations scorecard

facility_name	Average PUE	Operational Availability	Incident Count	Modeled Energy Cost	Live Facility Health Score
Ashburn East	1.479	99.9972	212	\$70,051,972	95.7
Dublin West	1.419	99.9970	174	\$52,241,795	97.0
Frankfurt Central	1.531	99.9973	199	\$77,063,911	94.6
Portland West	1.379	99.9967	180	\$43,555,856	97.4
Singapore South	1.610	99.9969	228	\$87,332,007	92.1
Sydney Pacific	1.439	99.9971	165	\$61,987,843	95.6
Total	1.476	99.9970	1,158	\$392,233,383	95.4

Latest simulated facility health score

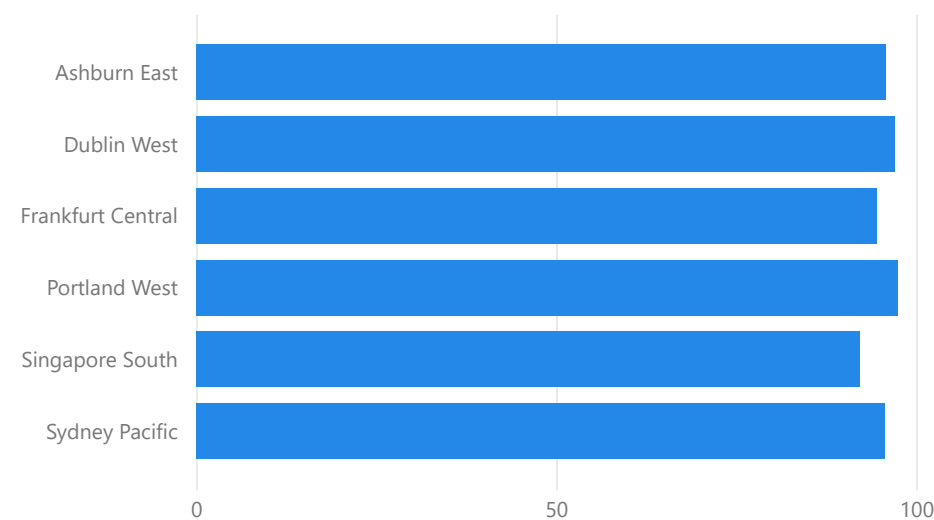

Overview

Infrastructure

Energy

Reliability

Predictive

Cost & Carbon

Impact

facility_name

Ashburn East

server_type

compute

430

Server Count

48.74

Average CPU Utilization

48.12



Average Memory Utilization

10.90

Average Network Latency

4.10K

Average Throughput

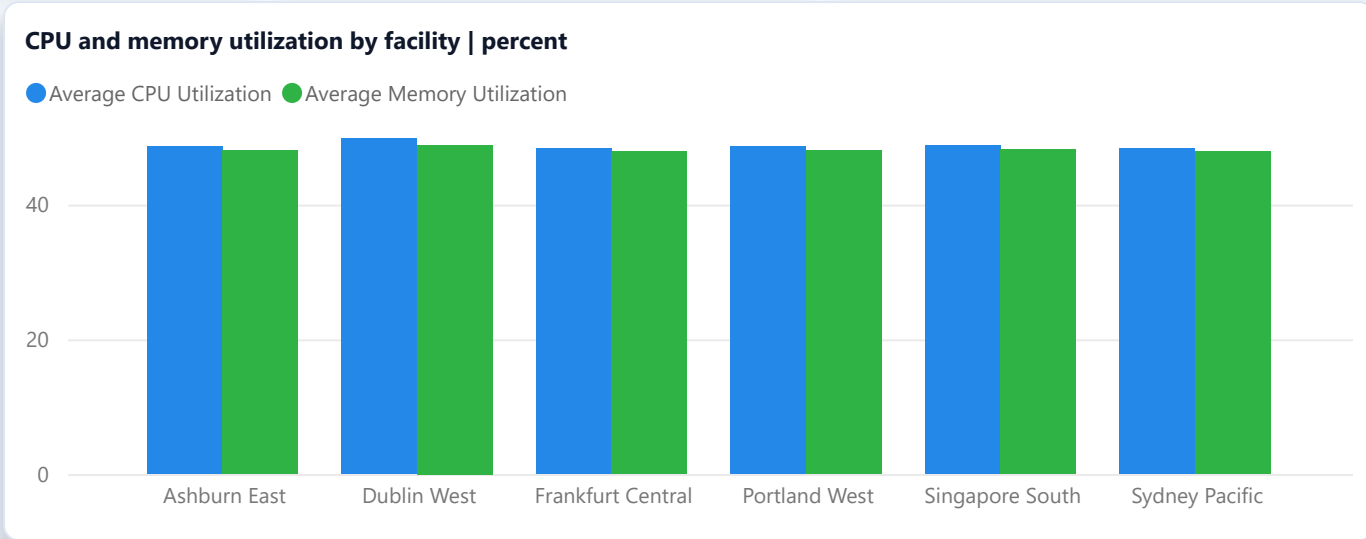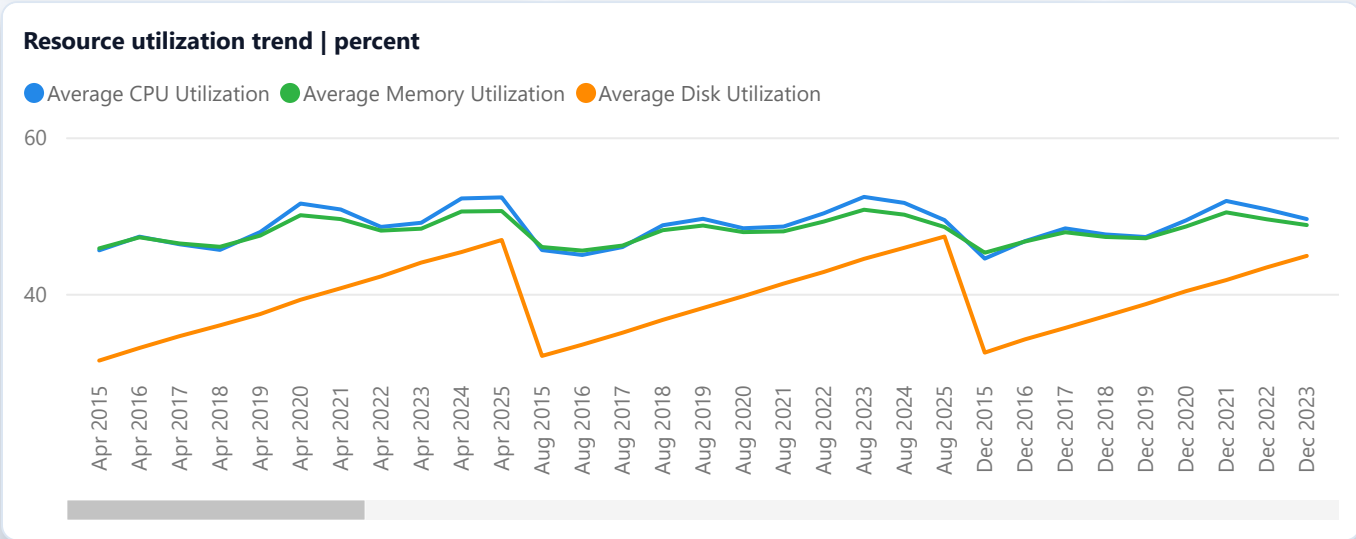

Server performance detail					
server_id	server_type	status	Average CPU Utilization	Average Memory Utilization	Average Disk Utilization
SRV-00001	virtualization	maintenance	54.20	52.00	39.76
SRV-00002	virtualization	active	55.69	52.83	39.47
SRV-00003	virtualization	active	55.94	53.09	39.54
SRV-00004	compute	active	49.84	48.76	39.51
SRV-00005	gpu	active	61.91	57.31	39.62
SRV-00006	compute	active	50.00	48.92	39.43
SRV-00007	compute	active	49.97	48.88	39.53
SRV-00008	database	active	45.00	45.61	39.60
SRV-00009	virtualization	active	55.87	53.17	39.49
SRV-00010	compute	active	50.00	48.12	39.53
Total			48.74	48.12	39.53



Overview

Infrastructure

Energy

Reliability








Predictive

Cost & Carbon

Impact

facility_name
☐ Ashburn East

Year
☐ 2015

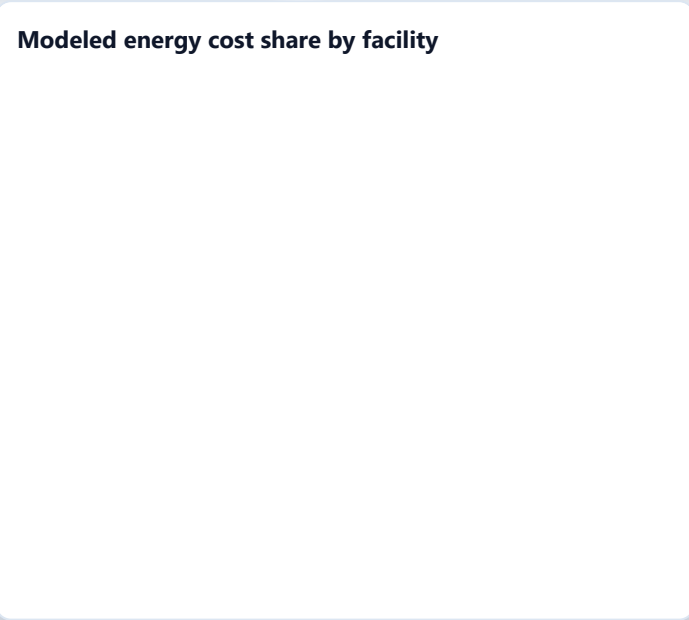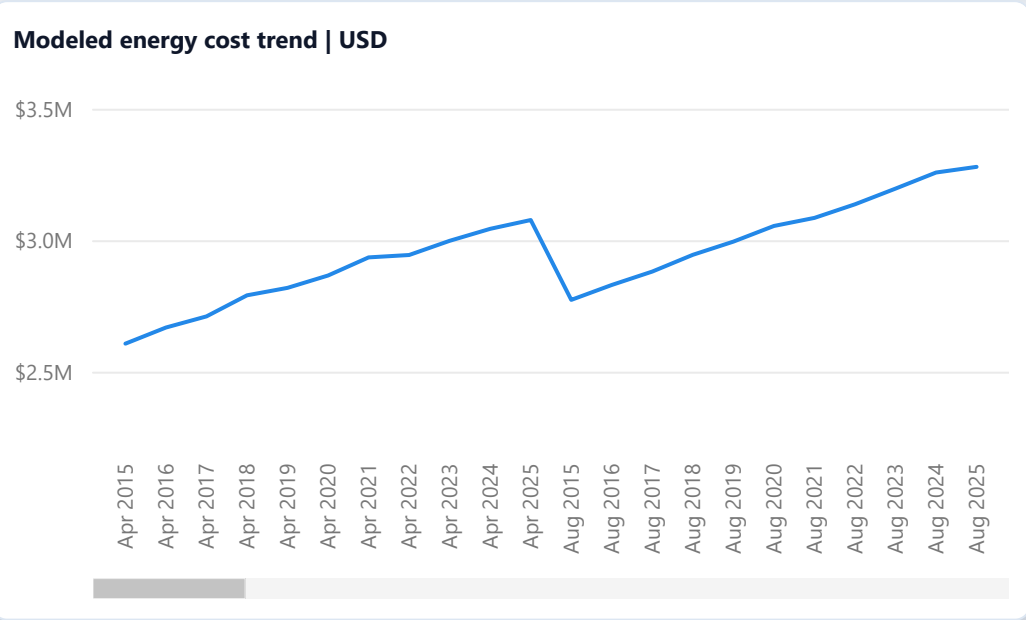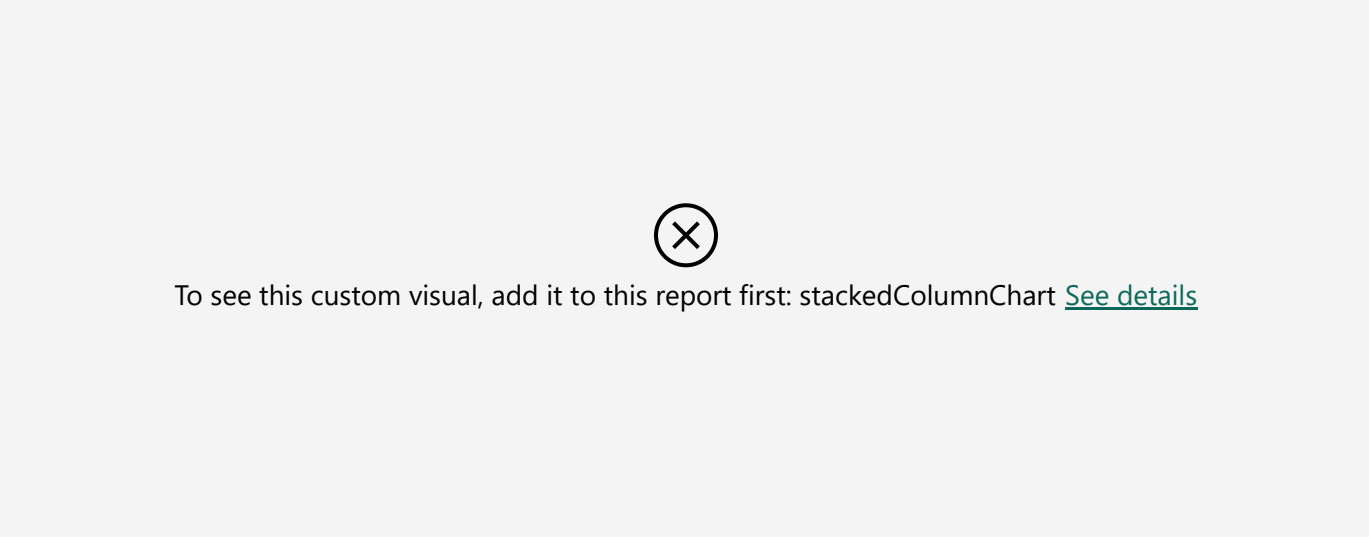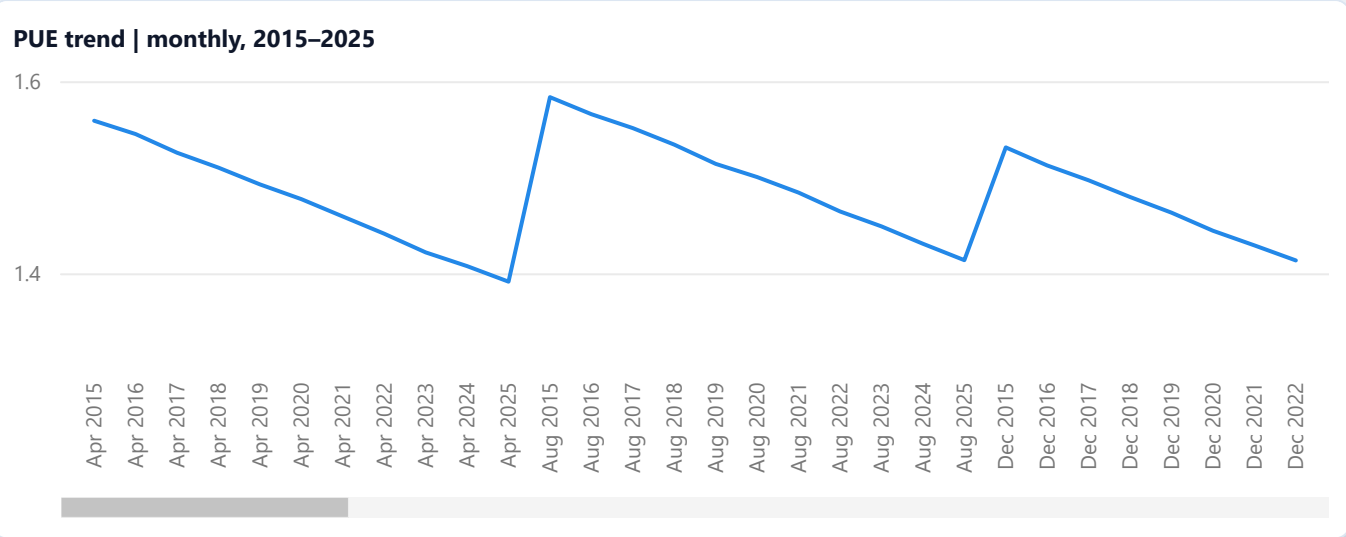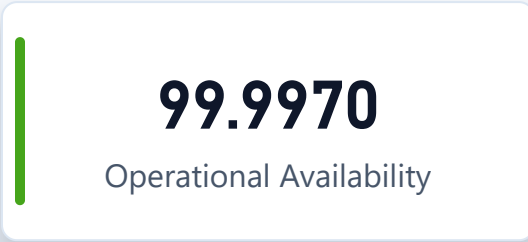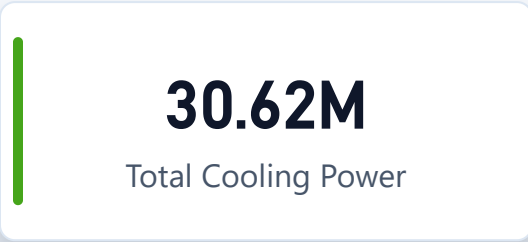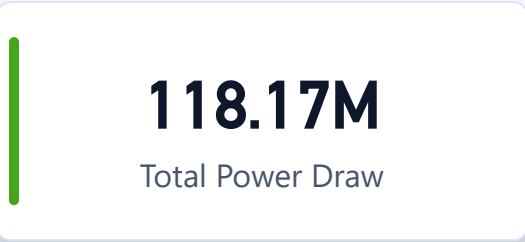

Facility energy and reliability				
facility_name	Average PUE	Total Power Draw	Total Cooling Power	Operational Ava
Ashburn East	1.479	24,528,001.25	6,311,894.26	
Dublin West	1.419	16,490,465.59	3,868,210.68	
Frankfurt Central	1.531	20,322,761.43	5,604,118.67	
Portland West	1.379	16,803,956.62	3,662,573.79	
Singapore South	1.610	24,923,517.89	7,510,182.49	
Sydney Pacific	1.439	15,104,250.26	3,659,440.06	
Total	1.476	118,172,953.04	30,616,419.95	

Overview

Infrastructure

Energy

Reliability

Predictive

Cost & Carbon

Impact

1,158

Incident Count

63.52

MTTR Minutes

99.9970

Operational Availability

544

Alert Count


893

Anomaly Count

46

Critical Alert Count

Incident trend | monthly count

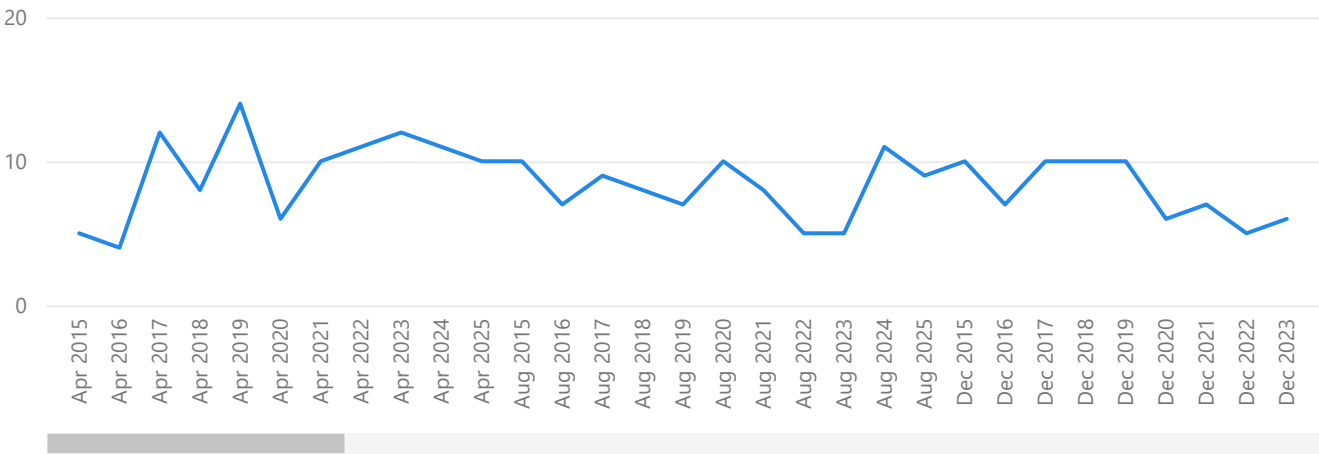


Incidents by recorded root cause

Recent incident evidence

incident_date	facility_name	server_id	severity	root_cause	downtime_minutes
Monday, January 05, 2015	Sydney Pacific	SRV-00417	low	hardware failure	11
Wednesday, January 07, 2015	Portland West	SRV-00243	medium	software failure	15
Friday, January 09, 2015	Frankfurt Central	SRV-00065	low	hardware failure	8
Sunday, January 11, 2015	Singapore South	SRV-00301	high	scheduled maintenance	92
Sunday, January 18, 2015	Sydney Pacific	SRV-00374	low	hardware failure	31
Friday, January 23, 2015	Sydney Pacific	SRV-00384	low	software failure	7
Wednesday, January 28, 2015	Singapore South	SRV-00317	low	network outage	18
Sunday, February 01, 2015	Dublin West	SRV-00130	low	hardware failure	9
Monday, February 02, 2015	Singapore South	SRV-00303	medium	scheduled maintenance	56
Tuesday, February 03, 2015	Sydney Pacific	SRV-00395	medium	hardware failure	69
Friday, February 06, 2015	Frankfurt Central	SRV-00060	high	network outage	50

Incident resolution time | average minutes

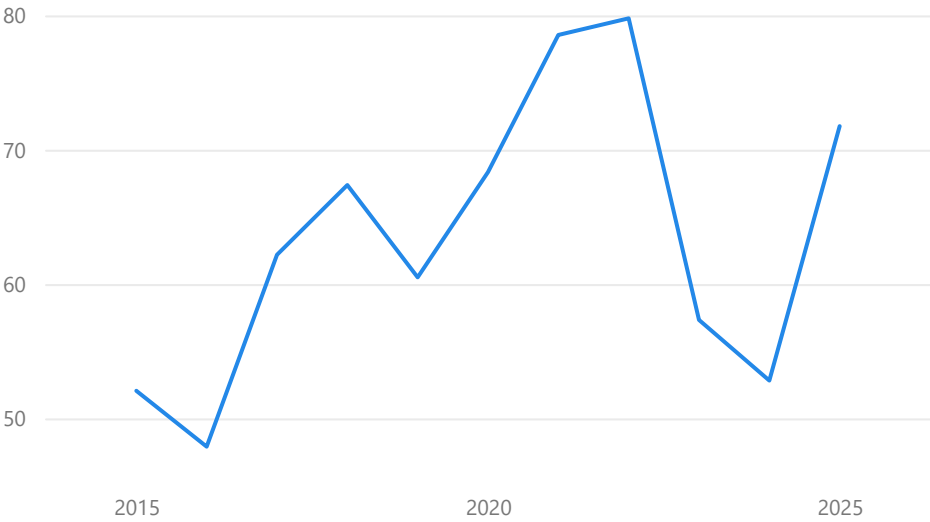

Overview

Infrastructure

Energy

Reliability

Predictive

Cost & Carbon

Impact

facility_name
Ashburn East

risk_level
low

12.58

Average Server Risk Score

(Blank)

High Risk Server Count

53.76



Average Facility Health Score

95.4


Live Facility Health Score

100.0

Live Data Completeness

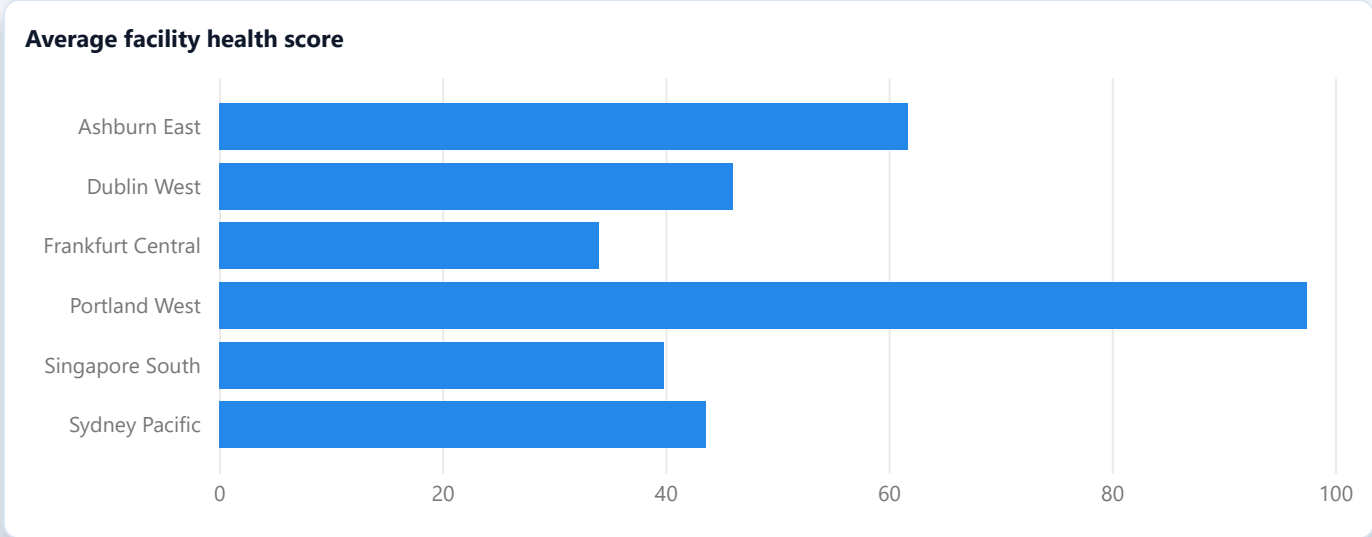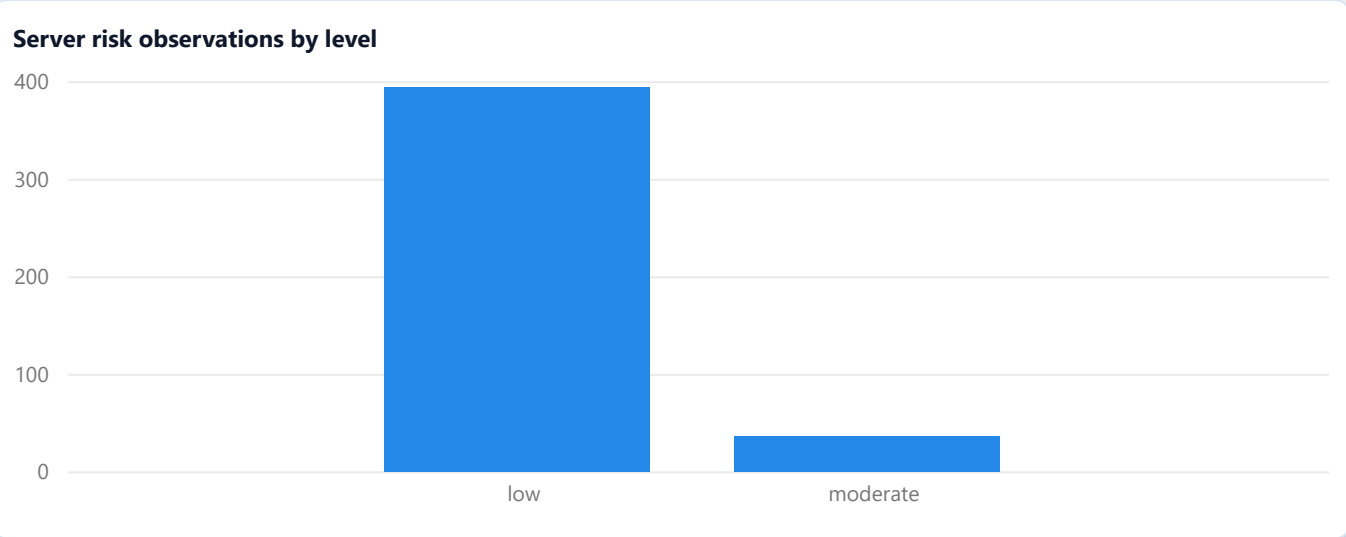

Highest-risk server evidence					
server_id	score_date	risk_score	risk_level	primary_signal	recommendation
SRV-00001	Wednesday, December 31, 2025	10.00	low	age_points	Review lifecycle status and age-related maintenance needs.
SRV-00002	Wednesday, December 31, 2025	10.00	low	age_points	Review lifecycle status and age-related maintenance needs.
SRV-00003	Wednesday, December 31, 2025	30.50	moderate	hardware_points	Inspect hardware health and storage/controller evidence.
SRV-00004	Wednesday, December 31, 2025	10.00	low	age_points	Review lifecycle status and age-related maintenance needs.
SRV-00005	Wednesday, December 31, 2025	28.50	moderate	hardware_points	Inspect hardware health and storage/controller evidence.
SRV-00006	Wednesday, December 31, 2025	10.00	low	age_points	Review lifecycle status and age-related maintenance needs.
SRV-00007	Wednesday, December 31, 2025	28.50	moderate	age_points	Review lifecycle status and age-related maintenance needs.
SRV-00008	Wednesday, December 31, 2025	13.50	low	age_points	Review lifecycle status and age-related maintenance needs.
SRV-00009	Wednesday, December 31, 2025	9.67	low	age_points	Review lifecycle status and age-related maintenance needs.
SRV-00010	Wednesday, December 31, 2025	10.00	low	age_points	Review lifecycle status and age-related maintenance needs.
SRV-00011	Wednesday, December 31, 2025	10.00	low	age_points	Review lifecycle status and age-related maintenance needs.

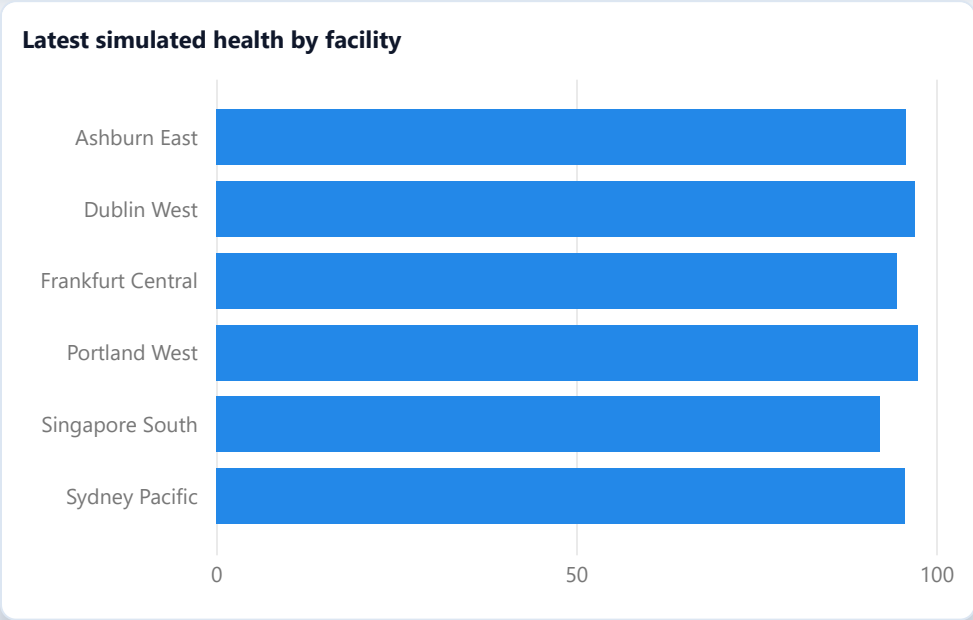

Overview

Infrastructure

Energy

Reliability

Predictive

Cost & Carbon

Impact

facility_name

☐ Ashburn East

Year

☐ 2015

\$392M

Modeled Energy Cost

\$102M

Modeled Cooling Cost

980.06K





Modeled Carbon

\$0.139

Average Energy Price

49.3

Average Efficiency Opportunity S...

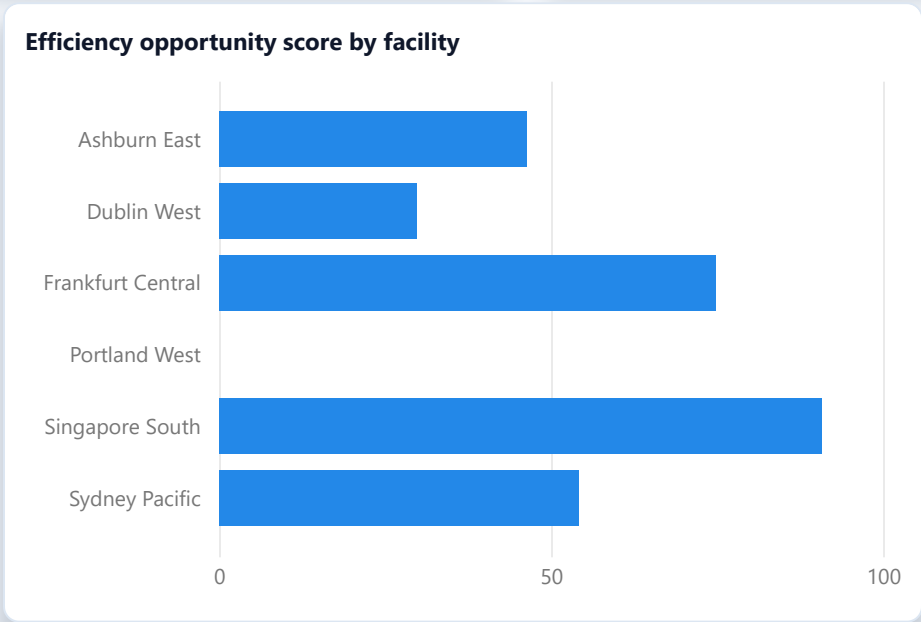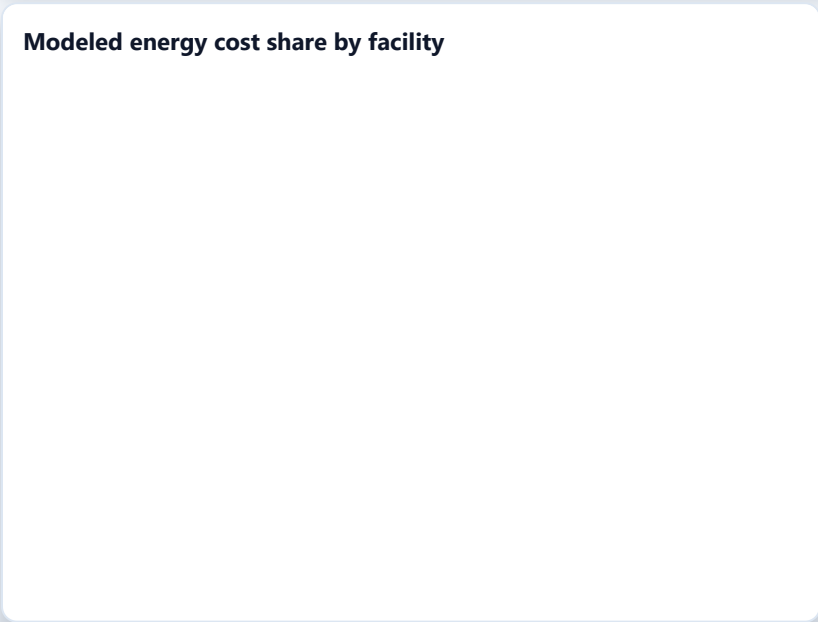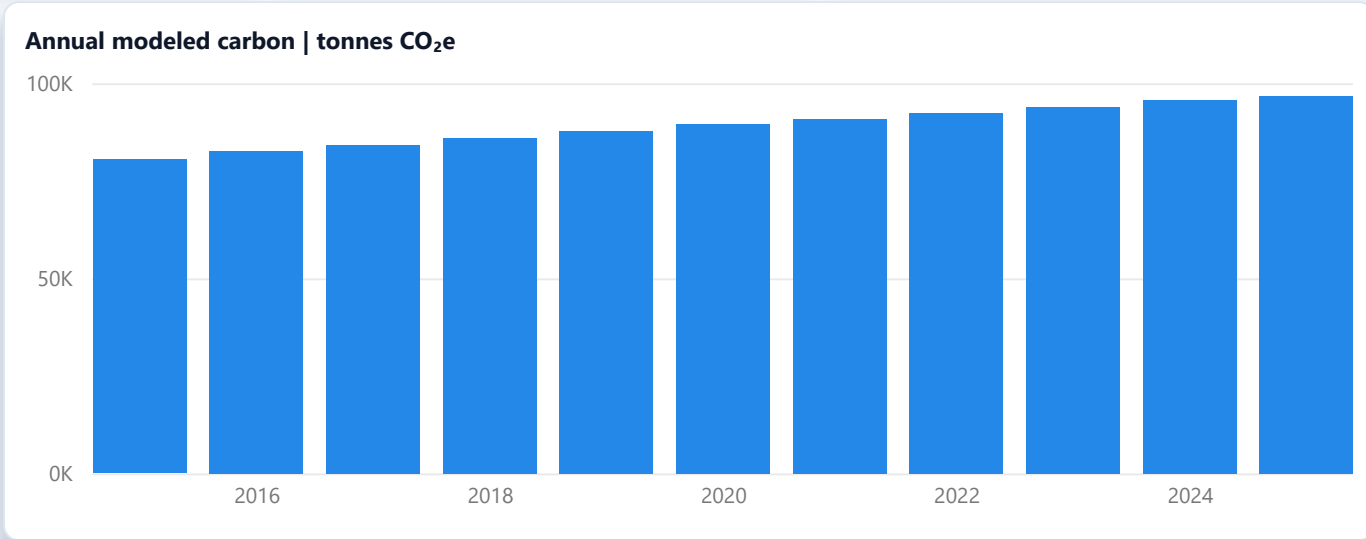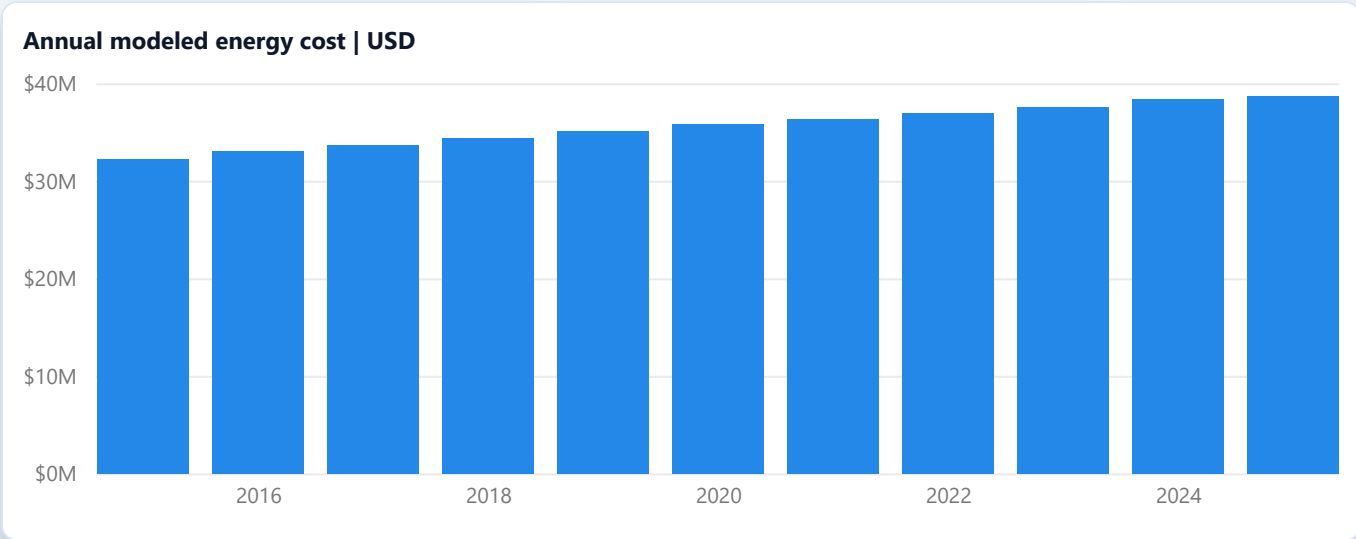

Governed sustainability snapshot

snapshot_date	facility_name	Modeled Energy Cost	Modeled Cooling
Thursday, January 01, 2015	Ashburn East	\$504,726	\$139,000
Thursday, January 01, 2015	Dublin West	\$386,068	\$98,000
Thursday, January 01, 2015	Frankfurt Central	\$463,557	\$137,000
Thursday, January 01, 2015	Portland West	\$287,529	\$69,000
Thursday, January 01, 2015	Singapore South	\$526,372	\$167,000
Thursday, January 01, 2015	Sydney Pacific	\$482,479	\$141,000
Sunday, February 01, 2015	Ashburn East	\$392,466	\$108,000
Sunday, February 01, 2015	Dublin West	\$285,877	\$72,000
Sunday, February 01, 2015	Frankfurt Central	\$510,595	\$150,000
Total		\$392,233,383	\$102,359,000

Overview

Infrastructure

Energy

Reliability

Predictive

Cost & Carbon

Impact

facility_name

Ashburn East

severity

critical

1,158

Incident Impact Count

\$836K

Modeled Downtime Cost Exposure

-0.01

Average Incident PUE Change


0.05

Average Incident Latency Change


74K

Total Downtime

Modeled downtime exposure trend | USD

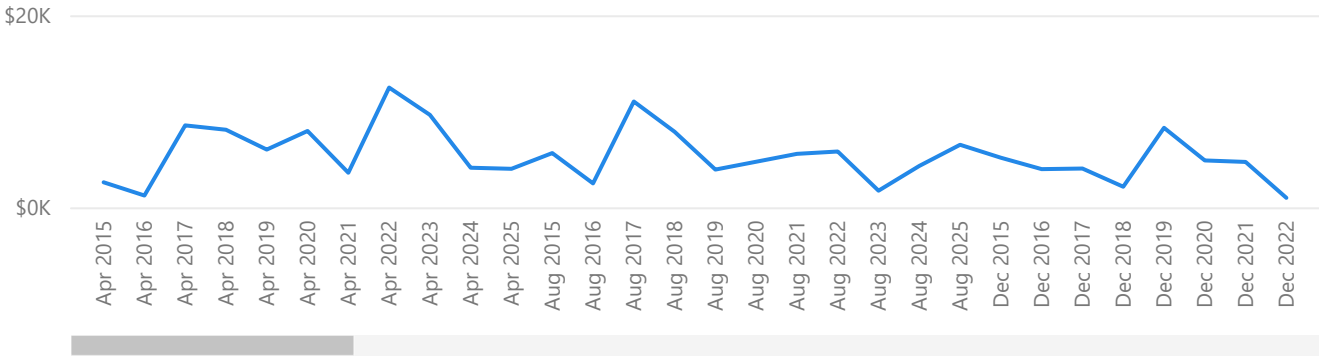

Modeled exposure by recorded root cause | USD

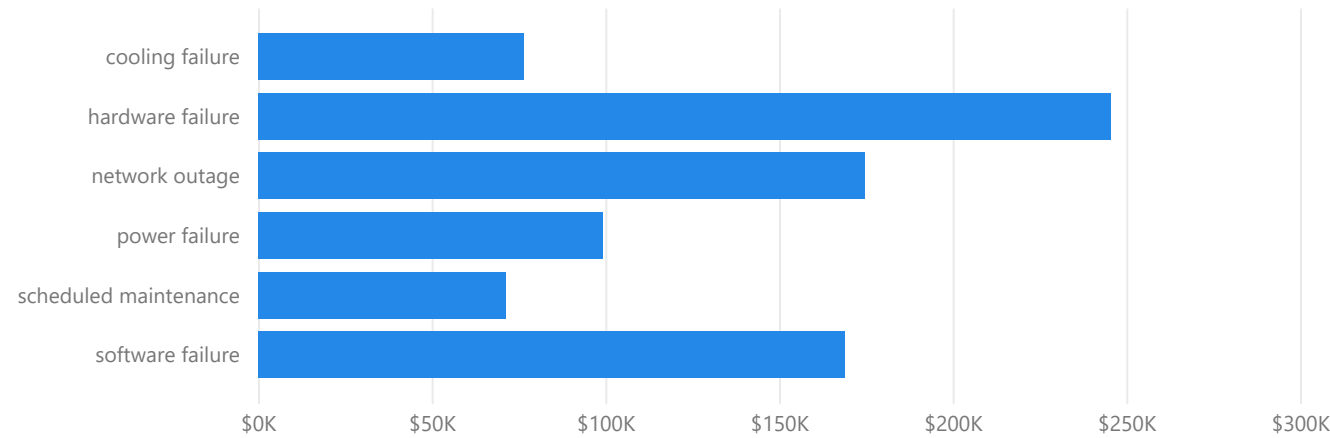

Highest-impact incident evidence

incident_date	facility_name	severity	root_cause	downtime_minutes	modeled_downtime_cost_exposure_usd
Monday, January 05, 2015	Sydney Pacific	low	hardware failure	11	118.89
Wednesday, January 07, 2015	Portland West	medium	software failure	15	96.62
Friday, January 09, 2015	Frankfurt Central	low	hardware failure	8	83.07
Sunday, January 11, 2015	Singapore South	high	scheduled maintenance	92	1,084.82
Sunday, January 18, 2015	Sydney Pacific	low	hardware failure	31	335.05
Friday, January 23, 2015	Sydney Pacific	low	software failure	7	75.66
Wednesday, January 28, 2015	Singapore South	low	network outage	18	212.25
Sunday, February 01, 2015	Dublin West	low	hardware failure	9	63.81
Monday, February 02, 2015	Singapore South	medium	scheduled maintenance	56	809.12
Tuesday, February 03, 2015	Sydney Pacific	medium	hardware failure	69	617.10
Friday, February 06, 2015	Frankfurt Central	low	network outage	50	700.10

Average incident change by root cause | percent

